

2016 Panhandle
Water Plan


Volume II Appendices

Freese and Nichols, Inc.

LBG - Guyton Associates, Inc.

Texas A&M AgriLife Research
and Extension Center at
Amarillo






APPENDICES


| | |
|------------|--|
| Appendix A | Bibliography |
| Appendix B | 2016 Panhandle Regional Water Plan Task 2 Report: Agricultural Water Demand Projections |
| Appendix C | Analyses for PWPA Surface Water Availability |
| Appendix D | 2016 Panhandle Regional Water Plan Task 5 Report: Agricultural Water Management Strategies |
| Appendix E | Cost Estimates |
| Appendix F | Consistency Matrix |
| Appendix G | Socio-economic Impacts |
| Appendix H | Infrastructure Financing Survey Results |
| Appendix I | Comments Received on the IPP and Responses |
| Appendix J | Implementation Survey |
| Appendix K | Data Tables |

2015 NOV 25 AM 10:33

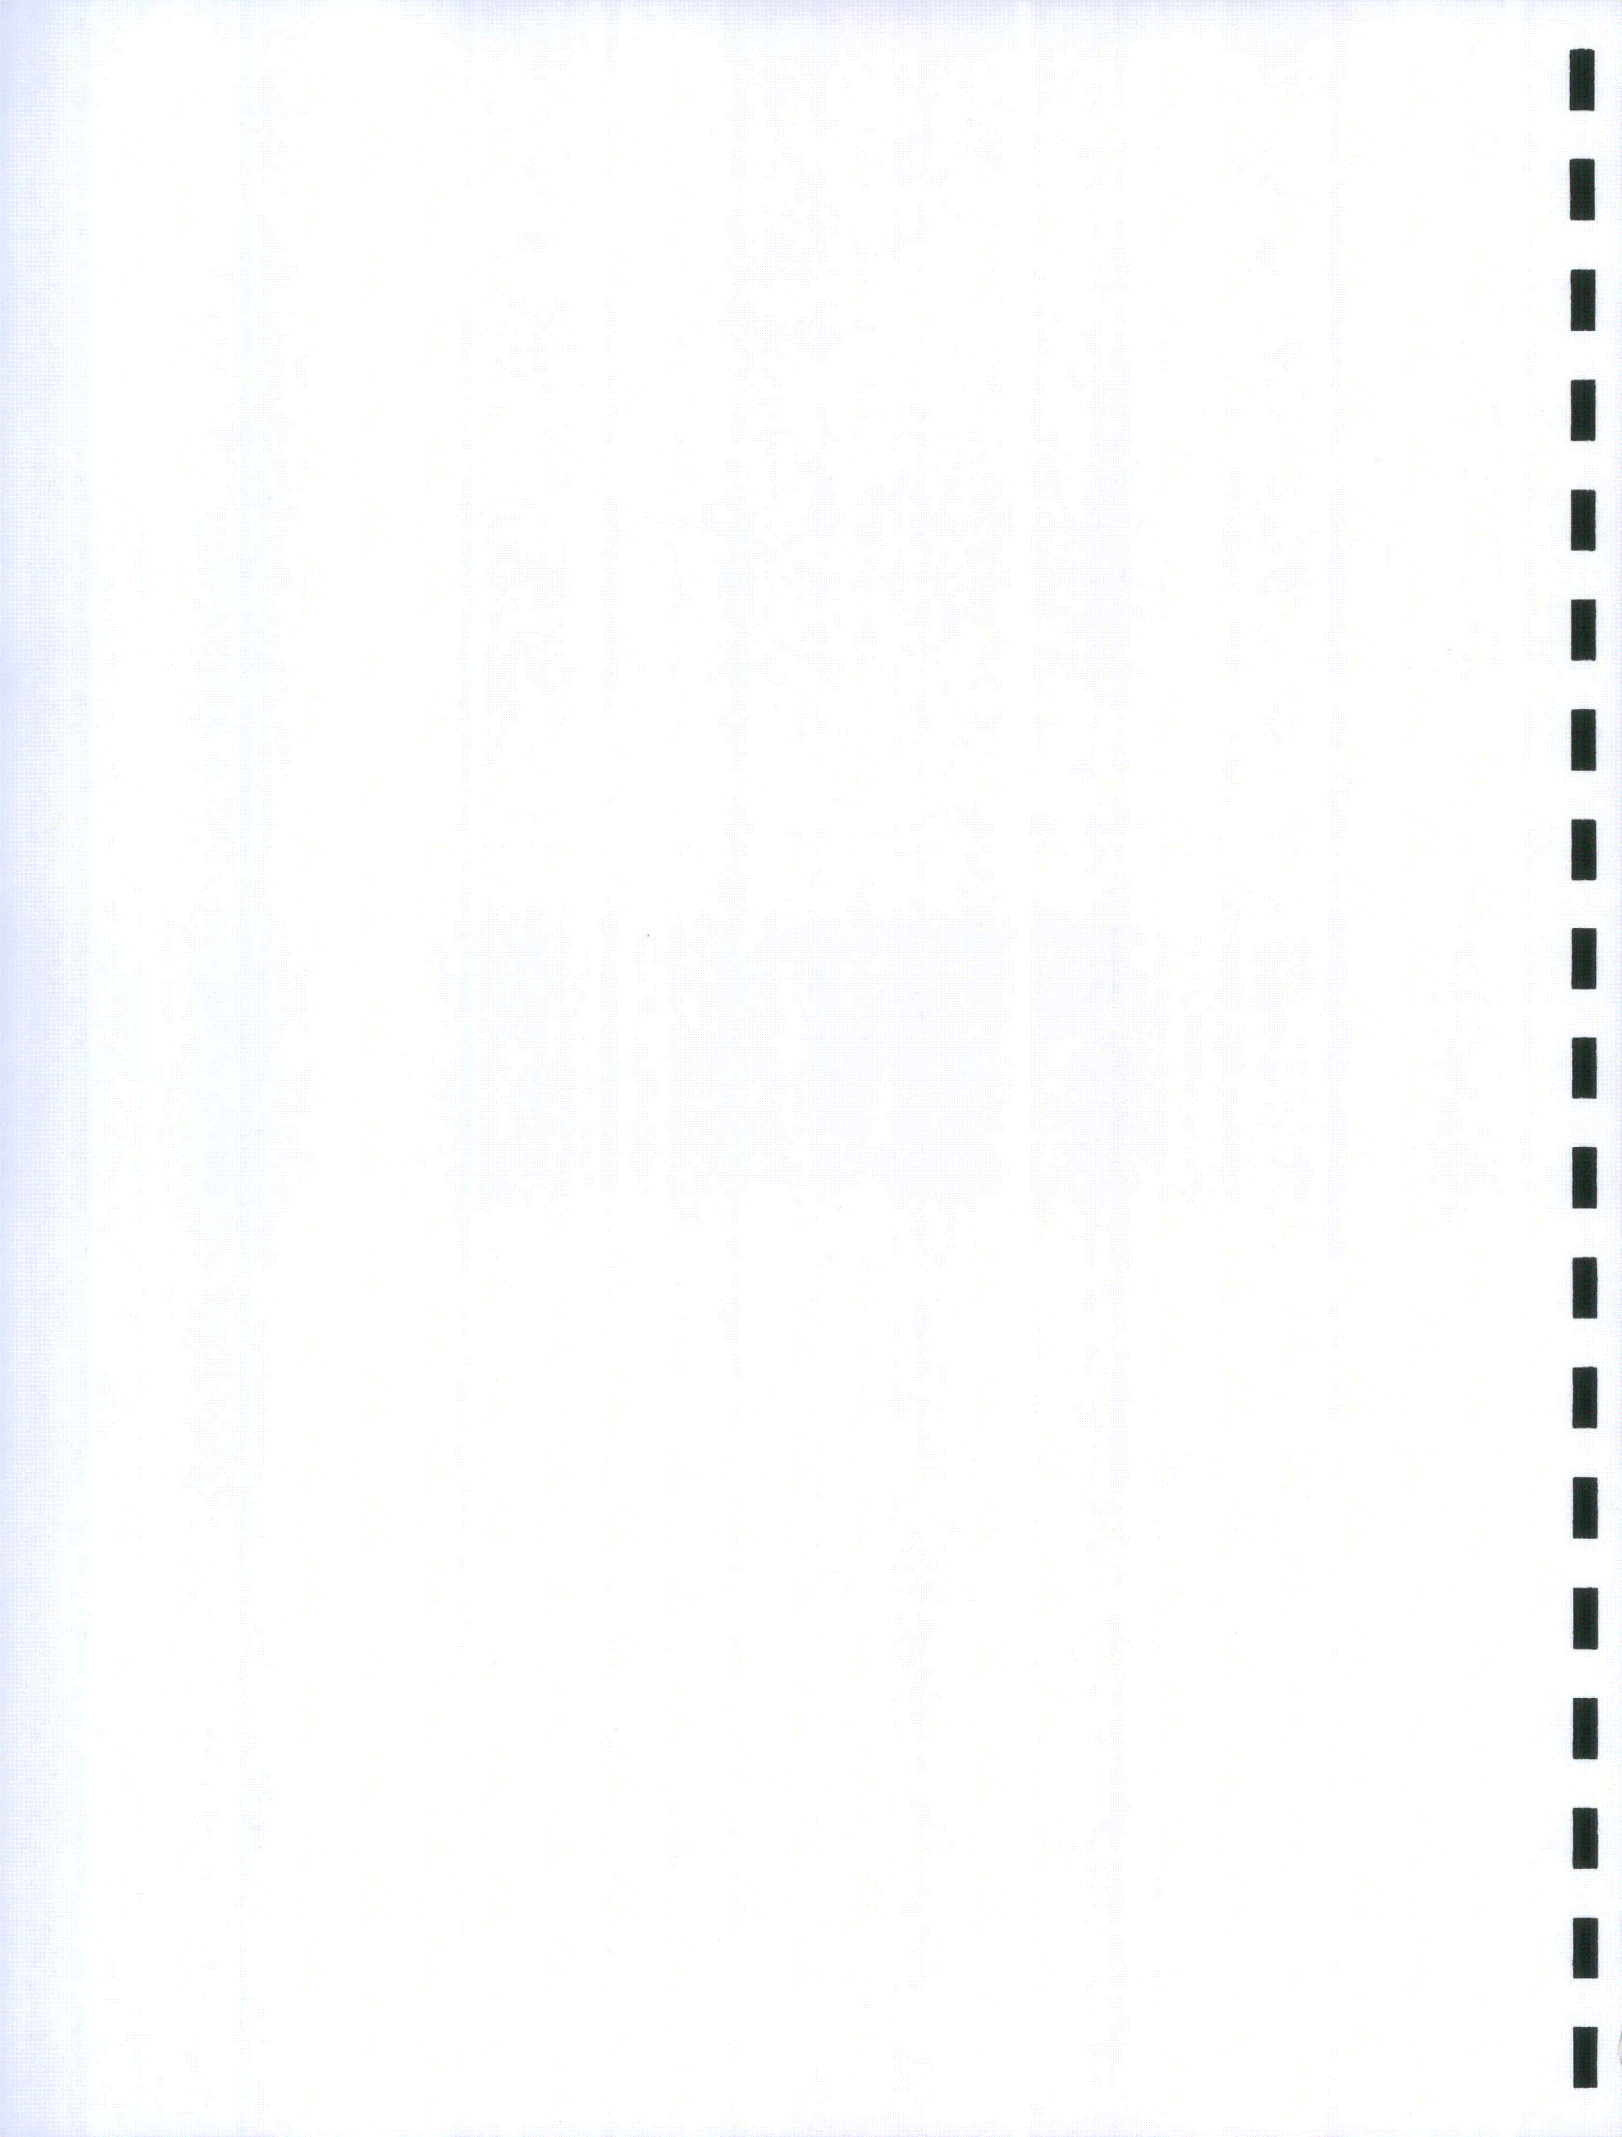



Appendix A
Bibliography

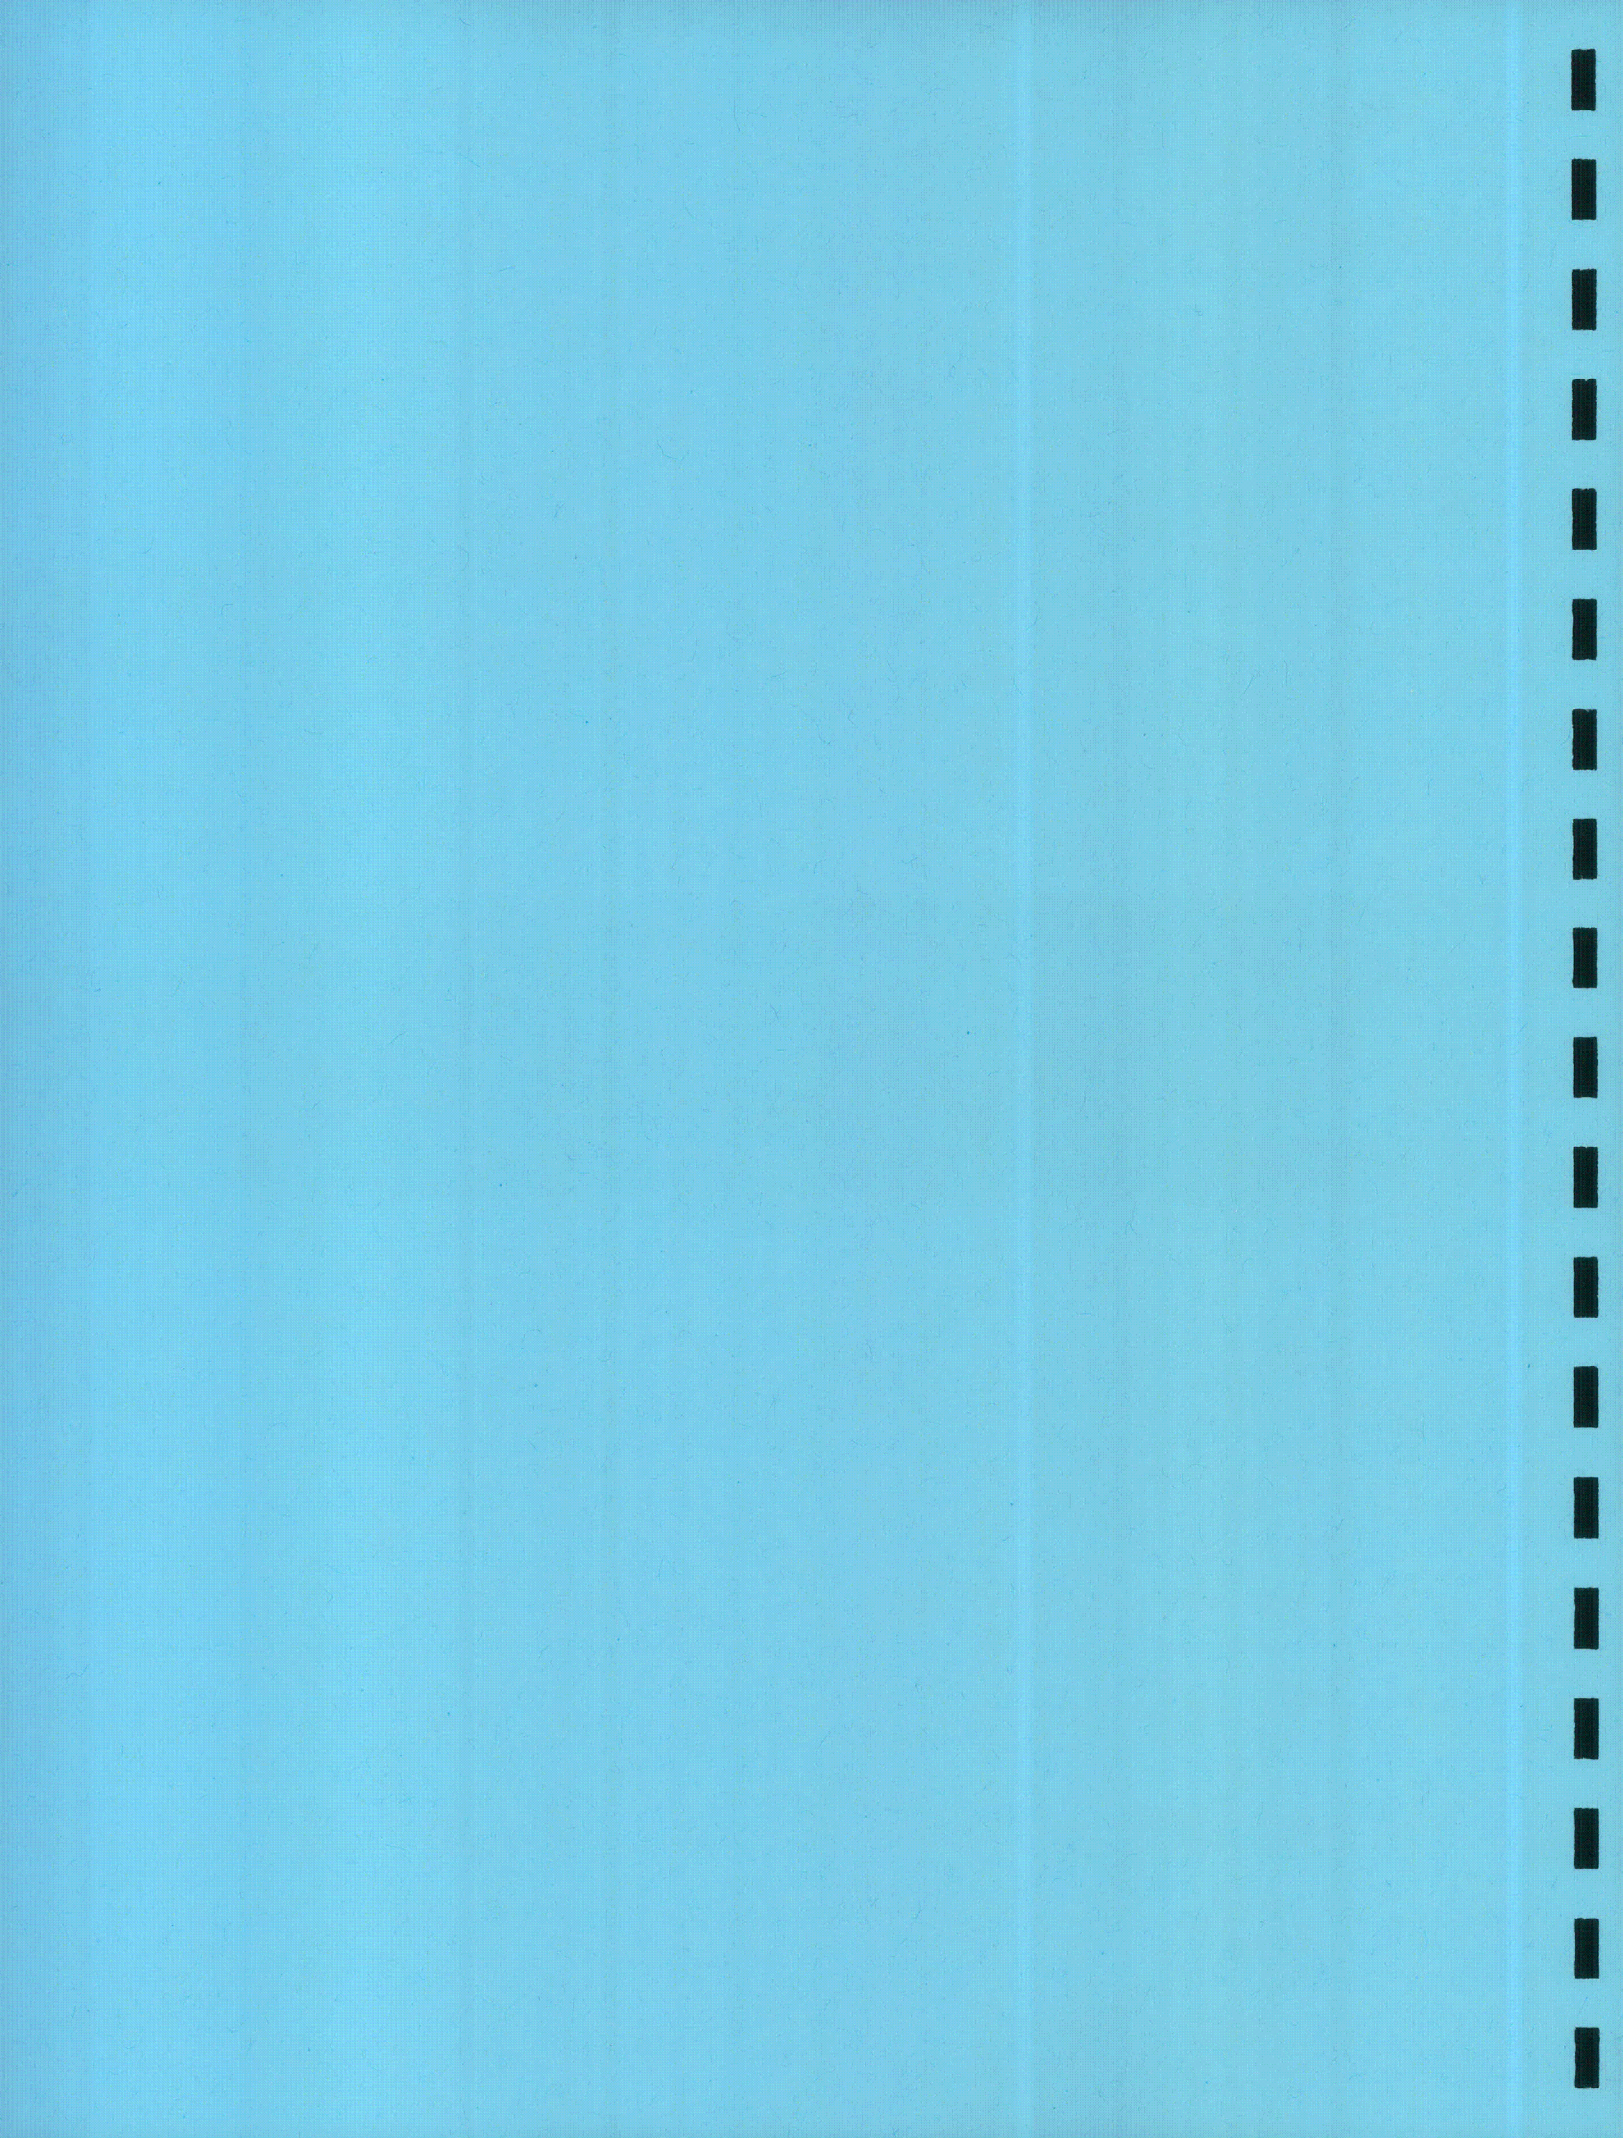

Bibliography

- Ashworth, J.B. and J. Hopkins, *Aquifers of Texas*. Texas Water Development Board Report 345. Texas Water Development Board. Austin, Texas. November 1995.
- Bradley, Robert and Sanjeeve Kalaswad: *The Groundwater Resources of the Dockum Aquifer in Texas, Report 359*. December 2003.
- Brauer, David et al. *Characteristics of Reservoir Storage and Streamflow in the Canadian River Watershed in New Mexico and Texas: Implication to the use of Lake Meredith as a Municipal Water Supply*. September 2011.
- Breeding, Seth: Handbook of Texas Online. The Texas State Historical Association. Available at: <http://www.tsha.utexas.edu/handbook/online>. 1999.
- Bureau of Economic Geology, Water Demand Projections for Power Generation in Texas, prepared for the Texas Water Development Board, August 2008.
- Bureau of Economic Geology, Current and Projected Water Use in the Texas Mining and Oil and Gas Industry, prepared for the Texas Water Development Board, June 2011.
- Bureau of Economic Geology, Oil and Gas Water Use in Texas: Update to the 2011 Mining Water Use Report, prepared from the Texas Oil and Gas Association, September 2012.
- Canadian River Municipal Water Authority, *Drought Contingency Plan for CRMWA*, January 2011.
- Canadian River Municipal Water Authority, *Water Conservation Plan for CRMWA*, Revised April 2014.
- Chirase, N.K., S.H. Amosson, D.B. Parker, and T.H. Montgomery. *Quantity of Consumption of Grain and Water by Feedlot Cattle in ANRCP Counties. Section C, Agricultural Production Issues. In: Expert Panel to Identify Agricultural Science and Engineering Technical Issues and Data Resources for Risk Characterization Studies of Mixed Oxide Fuel Conversion Process* (eds. J.M. Sweeten, R.N. Clark, and B.A. Stewart). Final Report submitted to the Amarillo National Resource Center for Plutonium (ANRCP), Amarillo, Texas. October 14, 1997.
- City of Amarillo, *Drought Contingency Plan for the City of Amarillo*, April 2014.
- City of Borger, *Drought Contingency Plan for the City of Borger*, March 2014.
- City of Borger, *Water Conservation Plan for the City of Borger*, March 2014.
- City of Canyon, *Drought Contingency Plan for the City of Canyon*, April 2014.
- City of Canyon, *Water Conservation Plan for the City of Canyon*, April 2014.
- City of Dalhart, *Drought Contingency Plan for the City of Dalhart*, September 2014.

Appendix A
Bibliography

- City of Dumas, *Drought Contingency Plan for the City of Dumas*, March 2013.
- City of Higgins, *Drought Contingency Plan for the City of Dumas*, September 2000.
- City of Perryton, *Drought Contingency Plan for the City of Perryton*.
- City of Shamrock, *Drought Contingency Plan for the City of Shamrock*, June 2002.
- City of Turkey, *Drought Contingency Plan for the City of Turkey*, February 2000.
- City of Wellington, *Drought Contingency Plan for the City of Wellington*, October 2000.
- City of White Deer, *Drought Contingency Plan for the City of White Deer*.
- Drought Preparedness Council: *State Drought Preparedness Plan*, January 2001.
- Dutton, Alan, Robert Reedy, and Robert Mace: *Saturated Thickness in the Ogallala Aquifer in the Panhandle Water Planning Area – Simulations of 2000 through 2050 Withdrawal Projections*, prepared for the Panhandle Water Planning Group and Panhandle Water Planning Commission. December 2001.
- Fish, Ernest B. and Erin L. Atkinson et al.: *Playa Lakes Digital Database for the Texas Portion of the Playa Lakes Joint Venture Region*. Texas Tech University. 1998.
- Freese and Nichols, Inc. et al. *Regional Water Plan for the Panhandle Water Planning Area*. Fort Worth. 2011.
- Freese and Nichols, Inc. et al. *Assessment of Potential Water Supplies*, prepared for Greenbelt Municipal and Industrial Water Authority, December 2011.
- Greenbelt Municipal and Industrial Water Authority, *Drought Contingency Plan for Greenbelt Municipal and Industrial Water Authority*, August 1999.
- Intera Inc. and Dutton, Alan. *Northern Ogallala Update to Support 2011 State Water Plan*, prepared for the Panhandle Water Planning Group, February 2010.
- Maderak, M.L., *Ground-Water Resources of Wheeler and Eastern Gray Counties, Texas*. Texas Water Development Board Report 170. Texas Water Development Board, Austin, Texas. May 1973.
- May, K. and E. Block. Personal Communication. Texas Natural Resource Conservation Commission, Austin, Texas, August 21 and August 28 1997.
- National Agricultural Statistics Service, Table 9, 2012, 2007, 2002 Census of Agriculture available online at <http://www.nass.usda.gov/census/>; 2007 Texas Census of Agriculture available online at <http://www.agcensus.usda.gov/Publications/2007/index.asp>.
- Playa Lakes Joint Venture, Playa Lakes GIS Data, Downloaded March 2015, available online at <http://www.pljv.org/partners/maps-data>.

Appendix A
Bibliography

Ramos, M. G.: Texas Almanac, 2002-2003. Texas A&M Press Consortium. College Station, Texas. 2001.

Red River Authority of Texas, Water Conservation and Drought Contingency Plan, April 2014.

Runkles, J.R. *Agricultural resources related to water development in Texas. Water Resources Institute*, Texas Agricultural Experiment Station, Texas A& University, College Station, Texas. pp. 4.50-4.54.

Texas A&M University (TAMU). Bioregions of Texas. [Online] August 12, 1999. Available URL: <http://texastreeid.tamu.edu/content/texasEcoRegions/>.

Texas A&M University (TAMU). Checklist of the Vascular Plants of Texas, Ecological Summary. [Online] August 12, 1999. Available URL: <http://www.csdl.tamu.edu/FLORA/tracy/>

Texas Commission on Environmental Quality, Water Rights Database, Downloaded September 2014, available online at http://www.tceq.state.tx.us/permitting/water_rights/wr_databases.html.

Texas Commission on Environmental Quality, 2012 Texas Integrated Report - Texas 303(d) List (Category 5), 2012, available online at <http://www.tceq.state.tx.us/waterquality/assessment>.

Texas Commission on Environmental Quality (TCEQ). *Joint Groundwater Monitoring and Contamination Report*, June 1996. Texas Groundwater Protection Committee, Report SFR-56, Texas Natural Resource Conservation Commission.

Texas Commission on Environmental Quality (TCEQ) Texas Clean Rivers Program, available online at <https://www.tceq.texas.gov/waterquality/clean-rivers>.

Texas Commission on Environmental Quality (TCEQ) 2014. TCEQ Organization Chart, available online at <http://www.tceq.state.tx.us/about/organization>.

Texas Parks and Wildlife Department (TPWD). The Texas Wetlands Plan. August 24, 1999.

Texas Parks and Wildlife Department. 2014. Annotated County Lists of Rare Species. <http://tpwd.texas.gov/gis/rtest/>.

Texas Water Development Board, 2010 Water Loss Audit Entity Dataset, provided by the Texas Water Development Board by e-mail, July 2014.

Texas Water Development Board, 2011 GAM Run 10-058 MAG Report developed by TWDB.

Texas Water Development Board, 2011 GAM Run 10-056 and GAM Run 10-020 MAG Reports developed by TWDB.

Texas Water Development Board, 2011 GAM Run 10-019 MAG Report developed by TWDB

Appendix A
Bibliography

Texas Water Development Board: Chapter 357, Regional Water Planning Guidelines, Rule 357.42
Drought Response Information, Activities, and Recommendations, Austin, August 12, 2012.

Texas Water Development Board: Chapter 357, Regional Water Planning Guidelines, Austin, August 12,
2012.

Texas Water Development Board, Final Report Groundwater Availability Model for the Dockum
GAM, October 2008

Texas Water Development Board, Modeled Available Groundwater in the Ogallala/Rita Blanca 2012
GAM Run 12-005 MAG Report developed by TWDB

Texas Water Development Board, Historic Water Use Estimates, available online at
<http://www.twdb.texas.gov/waterplanning/waterusesurvey/estimates/index.asp>.

Texas Water Development Board, Projected Population, available online at
<http://www.twdb.texas.gov/waterplanning/data/projections/2017/popproj.asp>.

Texas Water Development Board, Projected Demand, available online at
<http://www.twdb.texas.gov/waterplanning/data/projections/2017/demandproj.asp>.

United States Census Bureau, 2010 Census Population, available online at
<http://quickfacts.census.gov/>.

United States Census Bureau, 2012 Economic Census, available online at
<http://factfinder.census.gov/faces/nav/jsf/pages/index.xhtml###>.


United States Fish and Wildlife Service. 2014. Endangered Species List.
<http://www.fws.gov/endangered/>.

Wyatt, A. W. High Plains Ogallala Area Regional Water Management Plan: *County Summary of Historical
Use of Ground and Surface Water*. High Plains Undergroundwater Conservation District No. 1,
September 1996.



Appendix B

2016 Panhandle Regional Water Plan Task 2 Report: Agricultural Water Demand Projections

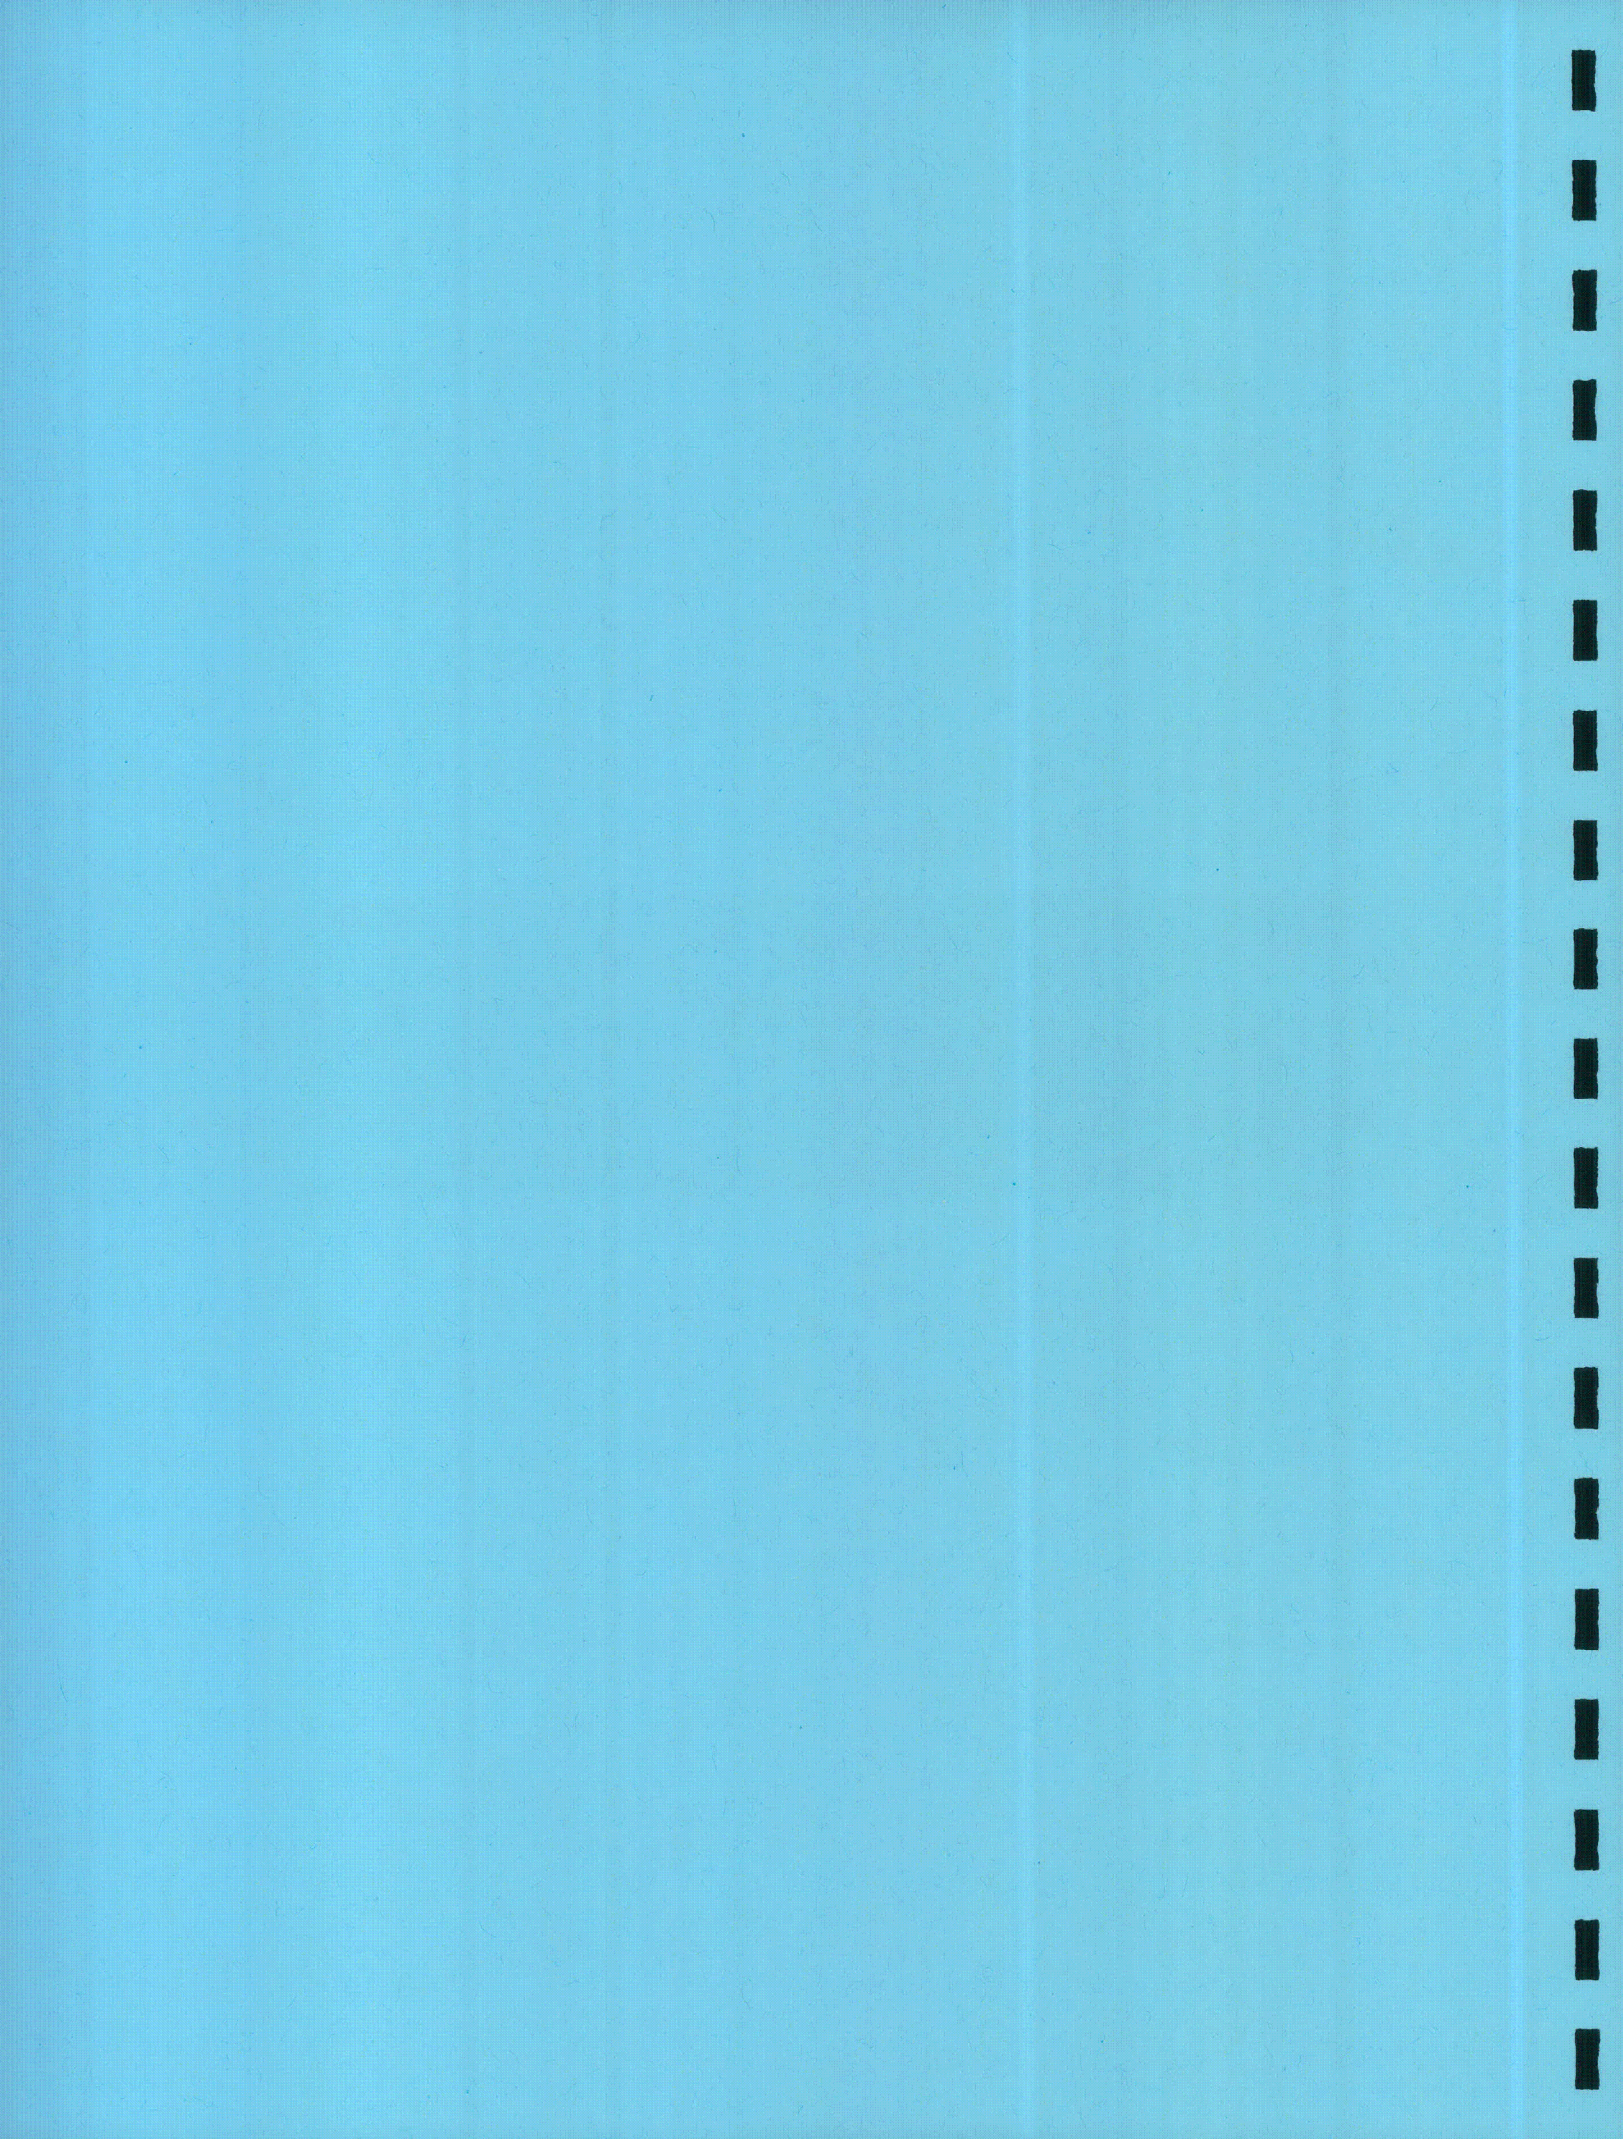

2016 Panhandle Regional Water Plan Task 2 Report: Agricultural Water Demand Projections

Thomas Marek, Steve Amosson, and Bridget Guerrero¹

Water use by the agricultural sector accounts for approximately 90% of total water use within Region A, making accurate projection of water demands essential to the water planning process. Review of the proposed agricultural water use estimates by the Texas Water Development Board (TWDB) for Region A resulted in a decision to revise the estimates due to the relatively large and increased difference with those of the 2011 regional water plan (RWP) values. The preliminary agricultural estimates by the TWDB for Region A suggest a 28.8% and 39.5% increase in water use by irrigated crops and livestock, respectively, in 2020. This result is an estimated annual difference in water demand of over 400,000 ac-ft. (377,915 and 22,800 ac-ft. for irrigation and livestock, respectively). Compounding that increased difference over a 50-year horizon posed serious concern as to remaining aquifer resource availability in future years and as to whether regional groundwater districts could meet their desired future conditions (DFC).

The systemic problem may lie in the TWDB's attempt to make one methodology fit all of the state which fails to account for the unique utilization characteristics within the region and local knowledge of the planning group. It is recognized that the TWDB does not currently have access to agriculturally based ET network(s) for the most representative reference and crop ET demand data. Furthermore, Farm Service Agency (FSA) is used as the primary source for irrigated acreage data. A vast majority of irrigated acreage in the region is reported to FSA; however, there are large farms which are increasingly not participating in government support programs. Thus, these crop acreages are not being reported to FSA. Therefore, these operations' existence is only known through local contacts which are generally not known by TWDB personnel.

Given the importance of the agricultural water use projections to the regional water planning process, it was concluded that the original plan of work be expanded to include the development of the 2016 agricultural demand projections using the methodology developed and refined in Region A during the previous planning efforts to ensure accuracy of the estimates. The objective of this project task is to update agricultural water use estimates for Region A. The specific objectives are:

1. Identify and estimate water use of changing conditions in the irrigated cropping and livestock sectors that have emerged within the region since the 2011 RWP,
2. Update irrigated acreages, irrigation application data by producers and compile the latest average ET demand data to update the irrigation water use estimates,
3. Collect recent data on livestock inventories, develop anticipated livestock trends and update livestock water use by industry type, and
4. Revise and supply new agricultural demands for Region A to the regional planning committee.

¹ Senior Research Engineer and Superintendent, North Plains Research Field, Texas AgriLife Research; Regents Fellow, Professor and Extension Economist, Texas AgriLife Extension Service; Program Specialist, Texas AgriLife Extension Service

Irrigation Water Demand Estimates

The 2016 RWP irrigation estimates were developed using the TAMA model. The model is effectively a water balance model using the parameters of irrigation water pumped, crop ET, effective rainfall and soil profile water used within the respective crop growing seasons. The TAMA model is computed on a per crop per county basis and then summed over the regional counties (26) for the irrigation demand total.

The 2016 model utilized updated irrigated acreages from the FSA plus known non-FSA irrigated acreages within the region. These non-FSA acreages have increased over the last decade as producers are opting out of government support programs and regulatory/reporting issues. Current non-FSA acreage is over 83,000 acres within the region with some acreage presently outside groundwater conservation boundaries. The crop acreage basis was changed from that in the 2011 RWP using the average of years 2006 through 2008 to a more normal and longer record basis of years 2006 through 2010. Crop categories were also increased and acreage reallocated in regards to some crops as acreage increases have occurred and also shifted within the region since the 2011 RWP. The 12 crop categories in the 2016 TAMA model run include alfalfa, corn, cotton, hay, miscellaneous, pasture and other, peanuts, sorghum, forage sorghum, soybeans, sunflowers and wheat.

In northwest Hartley and southwest Dallam Counties, new irrigated land (largely held and undeveloped by the City of Amarillo) has been sold and is anticipated to be in full production by 2015. In Dallam County, 8,000 new acres and in Hartley County, 28,700 new acres of potato production will be irrigated within the miscellaneous crop category. This high crop value category will reflect priority irrigation for meeting full crop ET requirements. As this new operation requires crop rotation for sustained production, not all the new acreage was attributed to the miscellaneous category but split in a three year rotation with wheat for the other two years. This crop rotation lessens the potential irrigation demand impact of the new acreage since wheat requires less irrigation demand than vegetables (and has differing seasonal requirements). All new irrigated vegetable acreage was assumed to be operated under center pivot systems.

The applied crop ET percentage was increased by 2% for two crops due to the loss of the Texas High Plains ET network in 2010 resulting in producers periodically overwatering crops. The crop categories increased were corn (the largest regional crop category) and wheat (the second largest regional crop category). The 2011 RWP irrigation demand estimates contained a declining aquifer availability function (which relates to decreased irrigation system capacity per land area), the adoption of new technologies and the implementation of conservation pumping regulations over time. This function was also used in the 2016 TAMA demand model projections. The 2016 RWP irrigation demand estimates do not include or reflect the near record drought conditions and subsequently pumping demands of 2011.

Irrigated Acreage

Total regional irrigated acreage of 1,218,664 for 2020 in the 2011 RWP increased to 1,350,944 acres in the 2016 RWP (a 10.9% increase), Table 1. An analysis of FSA data indicated an increase in irrigated acreage of approximately 50,000 acres since the 2011 RWP. In addition, over 83,000 irrigated acres were identified as not being reported to FSA. Dallam and Hartley Counties have the largest irrigated acreage at 294,502 acres and 255,623 acres, respectively estimated in 2020. The updated acreage values account for the new vegetable production and rotational acreage in Dallam and Hartley Counties anticipated by 2015.

Table 1. Region A 2016 RWP irrigated crop acreage by county in 2020.

| County | Total crop acreage (acres) |
|---------------|----------------------------|
| Armstrong | 4,828 |
| Carson | 58,204 |
| Childress | 10,560 |
| Collingsworth | 36,854 |
| Dallam | 294,502 |
| Donley | 22,390 |
| Gray | 22,298 |
| Hall | 23,236 |
| Hansford | 132,913 |
| Hartley | 255,623 |
| Hemphill | 3,032 |
| Hutchinson | 35,520 |
| Lipscomb | 20,015 |
| Moore | 142,470 |
| Ochiltree | 59,634 |
| Oldham | 3,986 |
| Potter | 2,587 |
| Randall | 20,489 |
| Roberts | 5,633 |
| Sherman | 184,844 |
| Wheeler | 11,326 |
| Total | 1,350,944 |

Irrigated acreage by crop for the region is shown in Figure 1. Corn accounts for almost 40% of irrigated acreage at 533,158 acres. Wheat accounts for 35% of irrigated acreage at 473,104 acres. Cotton (121,158 acres), sorghum (88,505 acres), alfalfa (27,449 acres), pasture and other (27,267 acres), miscellaneous (24,774 acres), sorghum forage (19,225 acres), peanuts (14,634 acres), soybeans (10,499 acres), sunflowers (9,969 acres), and hay (1,200 acres) account for the remaining 25% of irrigated acreage.

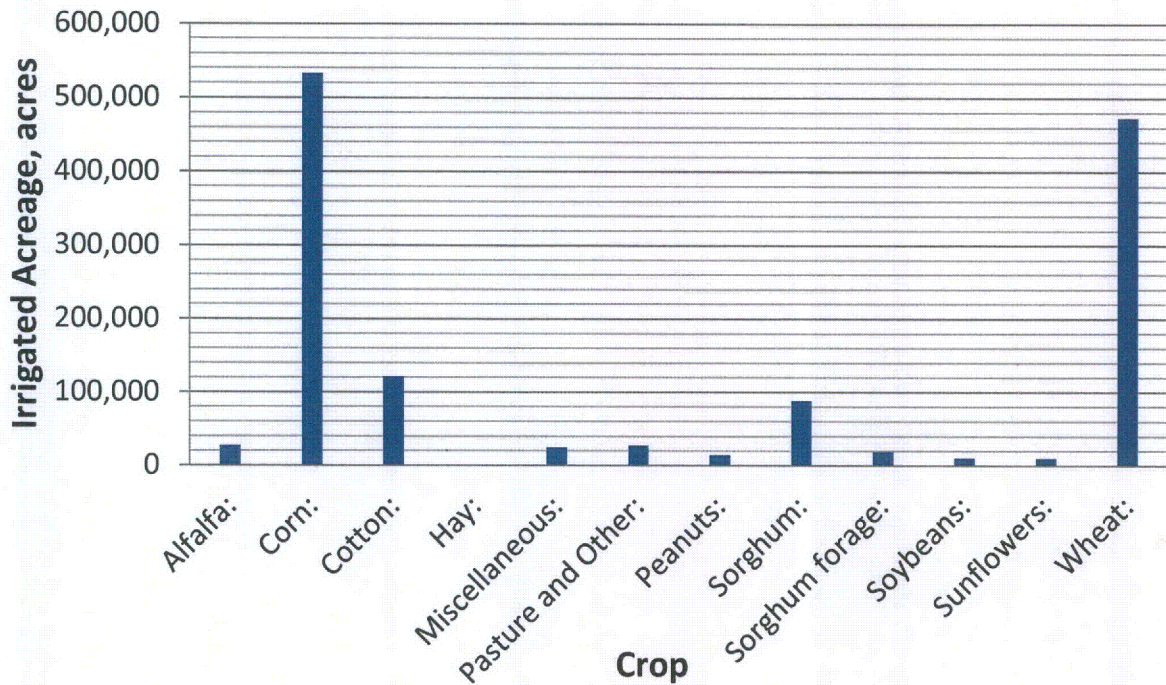


Figure 1. Region A 2016 RWP irrigated acreage by crop in 2020.

2016 RWP Irrigation Demand Estimates

The irrigation water demand of 1,311,372 ac-ft annually in the 2011 RWP for 2020 increased in the 2016 RWP to 1,513,469 ac-ft. annually for 2020. This value represents a 13.4% demand increase and accounts for the new and non-FSA county acreages. The projected 2020 to 2070 irrigation water demand estimates are shown in Table 2 and Figure 2. The counties with the largest irrigation demand are Dallam, Hartley, and Sherman Counties. These counties also exhibit a significant change in estimated irrigation demand from the 2011 RWP.

Table 2. Region A 2016 RWP estimated irrigation water demand by county for selected years (ac-ft).

| County | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
|-----------------------|------------------|------------------|------------------|------------------|------------------|----------------|
| Armstrong | 4,194 | 3,999 | 3,789 | 3,368 | 2,947 | 2,526 |
| Carson | 55,702 | 50,339 | 47,689 | 40,337 | 37,092 | 31,793 |
| Childress | 7,308 | 6,511 | 6,169 | 5,483 | 4,798 | 4,112 |
| Collingsworth | 17,943 | 17,086 | 16,187 | 14,388 | 12,590 | 10,791 |
| Dallam | 369,864 | 344,388 | 326,263 | 290,011 | 253,760 | 217,509 |
| Donley | 24,080 | 22,496 | 21,312 | 18,944 | 16,576 | 14,208 |
| Gray | 21,291 | 20,330 | 19,260 | 17,120 | 14,980 | 12,840 |
| Hall | 10,134 | 8,450 | 8,005 | 7,116 | 6,226 | 5,337 |
| Hansford | 134,902 | 130,548 | 123,677 | 109,935 | 96,193 | 82,451 |
| Hartley | 345,365 | 294,013 | 278,538 | 247,590 | 216,641 | 185,692 |
| Hemphill | 1,907 | 1,589 | 1,506 | 1,339 | 1,171 | 1,004 |
| Hutchinson | 40,008 | 38,669 | 36,634 | 32,564 | 28,493 | 24,423 |
| Lipscomb | 20,009 | 19,225 | 18,213 | 16,189 | 14,166 | 12,142 |
| Moore | 143,028 | 137,390 | 130,159 | 115,697 | 101,234 | 86,772 |
| Ochiltree | 57,243 | 54,456 | 51,589 | 45,857 | 40,125 | 34,393 |
| Oldham | 3,937 | 3,557 | 3,370 | 2,995 | 2,621 | 2,246 |
| Potter | 3,427 | 2,633 | 2,495 | 2,217 | 1,940 | 1,663 |
| Randall | 18,000 | 17,370 | 16,456 | 14,627 | 12,799 | 10,971 |
| Roberts | 5,958 | 5,669 | 5,371 | 4,774 | 4,177 | 3,581 |
| Sherman | 220,966 | 212,269 | 200,042 | 178,753 | 156,409 | 134,064 |
| Wheeler | 8,203 | 8,113 | 7,686 | 6,832 | 5,978 | 5,124 |
| Total (ac-ft.) | 1,513,469 | 1,399,100 | 1,324,410 | 1,176,136 | 1,030,916 | 883,642 |

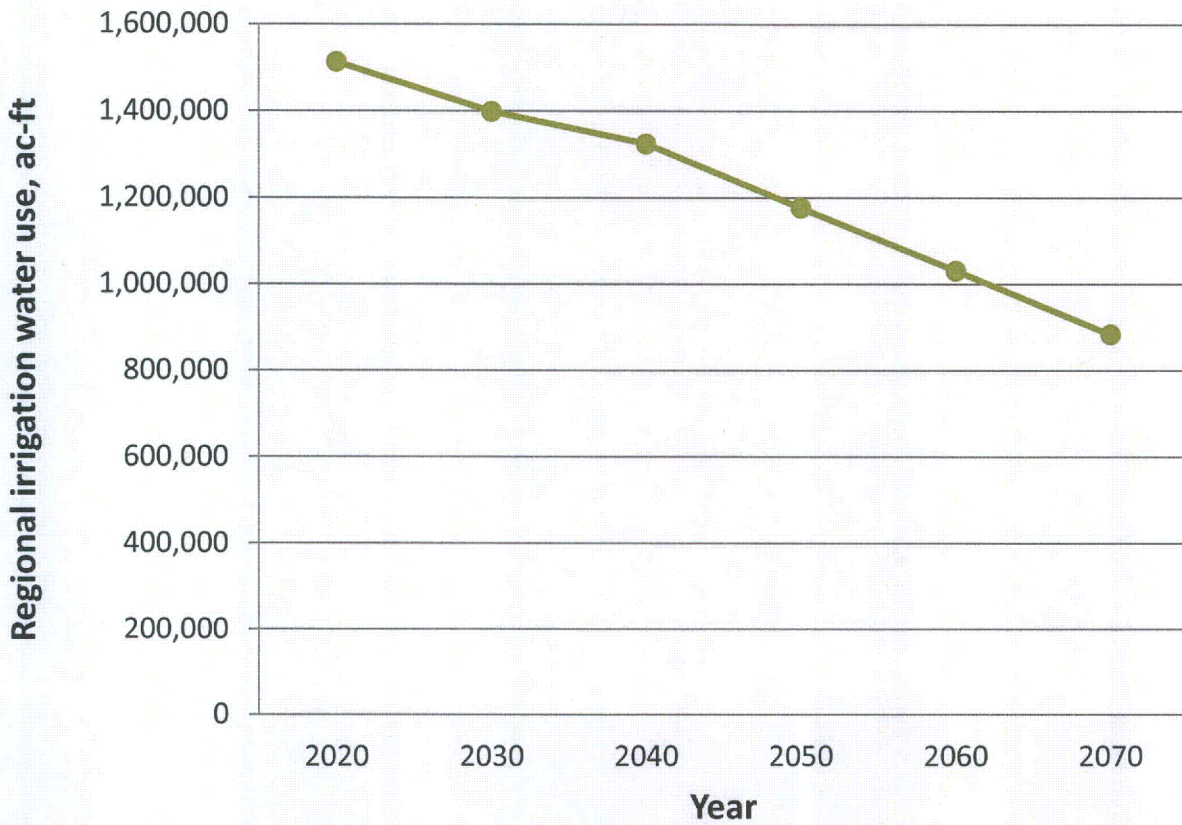


Figure 2. Region A 2016 RWP estimated regional irrigation water demand for selected years, ac-ft.

The regional water use per crop is illustrated in Figure 3. Corn has the highest demand for irrigation water estimated at over 912,202 ac-ft in 2020. Wheat is the second largest user due to the large amount of acreage grown in the region with 241,874 ac-ft. Combined, the remainder of the crops account for 359,393 ac-ft (or less than 24%) of the estimated irrigation water demand in 2020.

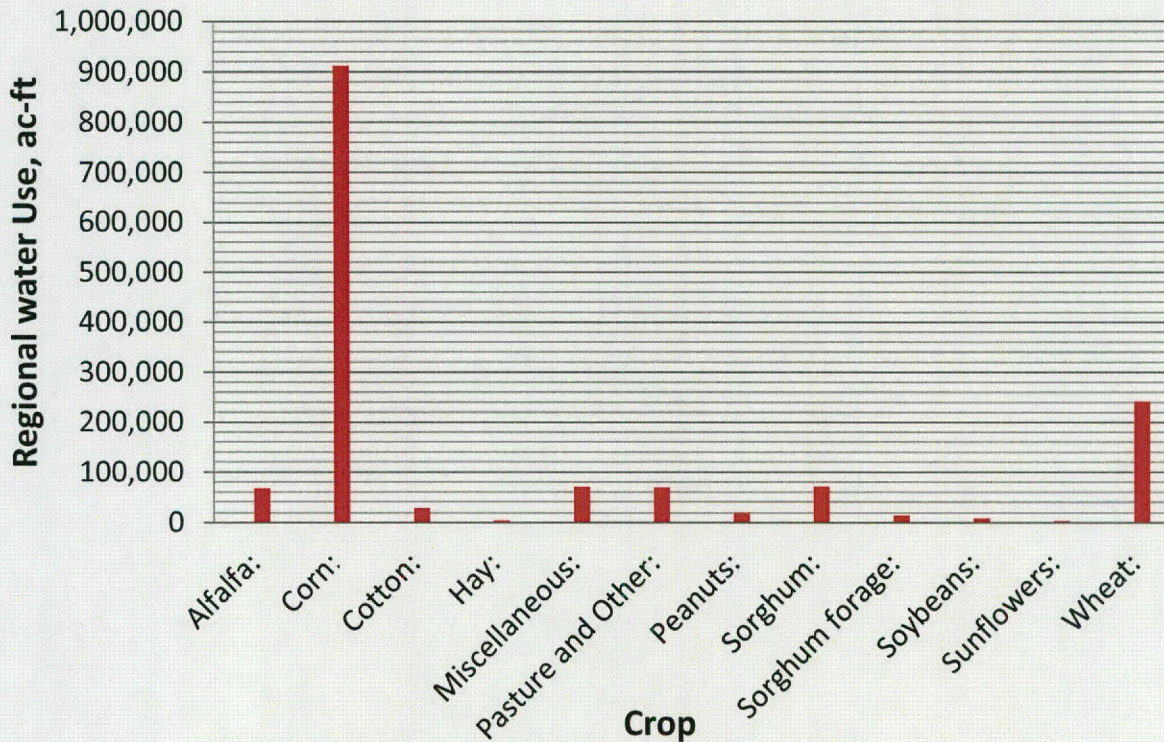


Figure 3. Region A 2016 RWP regional water use by crop in 2020.

The regional weighted water use per acre is shown in Figure 4. On average, water use per acre by crops trends downward over the 50-year time horizon. This is due in part to more efficiency in irrigation application, increasing limitations to irrigation system capacities and advances in technology. In addition, the reduction of water availability implies that some shifting in the crop composition will happen in the future within the region to more crops with lower water requirements.

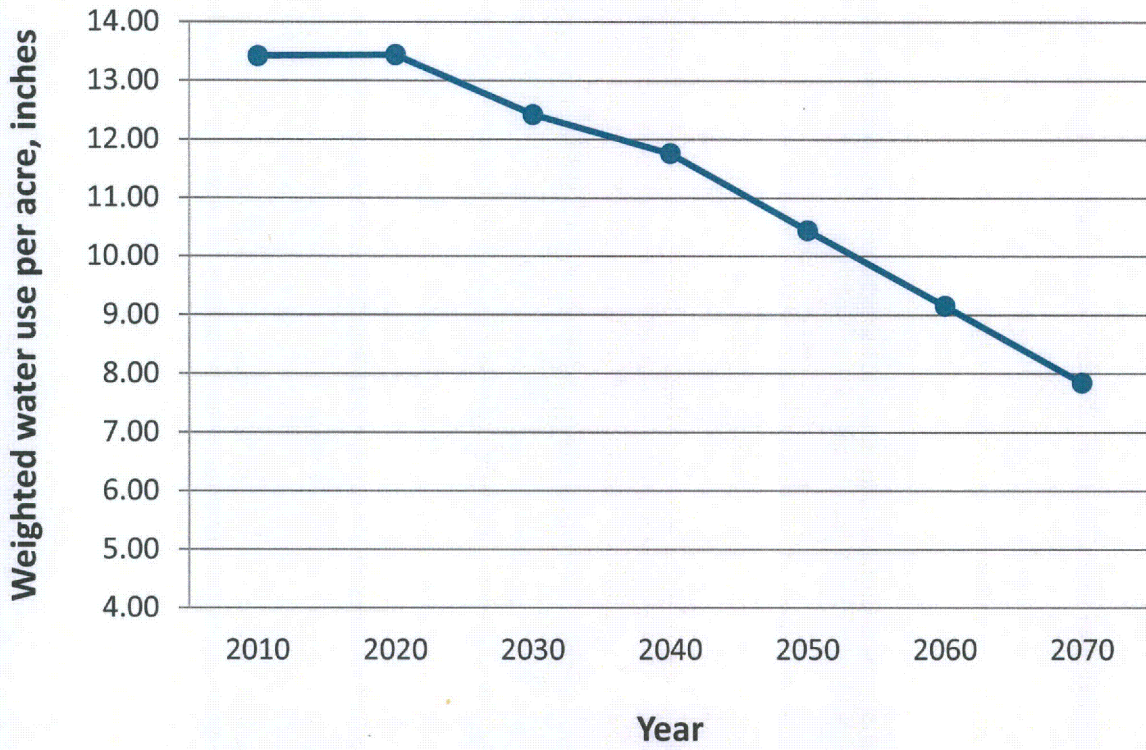


Figure 4. Region A 2016 RWP weighted (by crop) irrigation water use per acre.

Region A 2011 RWP and 2016 RWP Irrigation Water Use Comparison

A comparison of projected total irrigation water use in the 2011 RWP and the 2016 RWP are presented graphically in Figure 5. The 2016 RWP annual water use estimates by 2060 are estimated to be over 9% more than those made during the 2011 RWP process. This increase in anticipated water use can be primarily attributed the increase in irrigated acreage within the region.

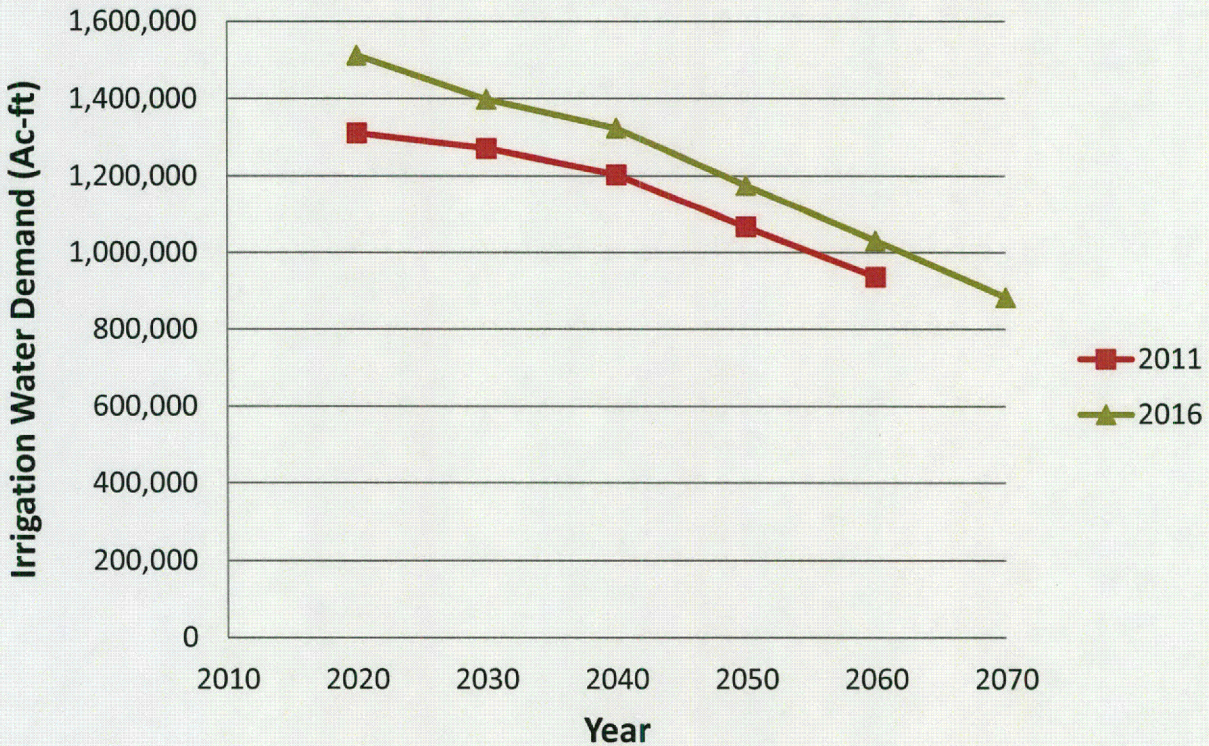


Figure 5. Region A comparison of estimated irrigation demand between 2011 RWP and 2016 RWP for selected years.

The estimated irrigation demand for Region A projected for 2020 by county coming from the 2011 RWP, proposed 2016 RWP and 2016 TWDB efforts are presented in Table 3. The initial TWDB estimates indicate that in 2020 a 28.82% increase in irrigation demand will occur compared to the 2011 RWP projection for the region whereas, the updated 2016 projections suggest the increase will occur but will be less (15.41%). The difference between the 2016 TWDB and the updated 2016 RWP projections in 2020 amounted to 175,818 ac-ft. An examination of the detailed irrigation demand data used in formulating the Region A 2016 TWDB agricultural water use estimates indicates that potential errors were made in the current methodology and data used. Several problems in the detailed TWDB 2016 Region A projections were found with unexplainable variations in water use: from county to adjacent county; year to year; between crops; and sometimes crop use estimates appear unrealistic. If the 83,000 irrigated acres which were identified outside of the FSA records and incorporated into the 2016 RWP projections had also been utilized in the TWDB estimates, the difference in the projected 2020 irrigation demand would have increased approximately 100,000 ac-ft.

Table 3. Comparison of 2011 RWP, 2016 RWP and 2016 TWDB estimates of irrigation demand by county for 2020.

| | 2020 Estimate (ac-ft.) | | | % Difference | | |
|---------------|------------------------|-----------|-----------|-----------------------|-------------------|-------------------|
| | 2011 RWP | 2016 RWP | 2016 TWDB | 2011 RWP vs. 2016 RWP | TWDB vs. 2011 RWP | TWDB vs. 2016 RWP |
| Armstrong | 4,688 | 4,194 | 6,059 | -10.54% | 29.24% | 44.47% |
| Carson | 49,230 | 55,702 | 63,657 | 13.15% | 29.31% | 14.28% |
| Childress | 5,519 | 7,308 | 9,542 | 32.42% | 72.89% | 30.57% |
| Collingsworth | 21,907 | 17,943 | 38,669 | -18.09% | 76.51% | 115.51% |
| Dallam | 283,315 | 369,864 | 377,737 | 30.55% | 33.33% | 2.13% |
| Donley | 29,676 | 24,080 | 29,226 | -18.86% | -1.52% | 21.37% |
| Gray | 20,410 | 21,291 | 28,259 | 4.32% | 38.46% | 32.73% |
| Hall | 10,731 | 10,134 | 17,185 | -5.56% | 60.14% | 69.58% |
| Hansford | 115,027 | 134,902 | 132,095 | 17.28% | 14.84% | -2.08% |
| Hartley | 281,648 | 345,365 | 336,179 | 22.62% | 19.36% | -2.66% |
| Hemphill | 1,705 | 1,907 | 6,117 | 11.85% | 258.77% | 220.77% |
| Hutchinson | 39,971 | 40,008 | 41,545 | 0.09% | 3.94% | 3.84% |
| Lipscomb | 15,546 | 20,009 | 27,232 | 28.71% | 75.17% | 36.10% |
| Moore | 135,001 | 143,028 | 204,936 | 5.95% | 51.80% | 43.28% |
| Ochiltree | 51,839 | 57,243 | 59,331 | 10.42% | 14.45% | 3.65% |
| Oldham | 3,914 | 3,937 | 6,484 | 0.59% | 65.66% | 64.69% |
| Potter | 5,697 | 3,427 | 5,132 | -39.85% | -9.92% | 49.75% |
| Randall | 19,900 | 18,000 | 22,648 | -9.55% | 13.81% | 25.82% |
| Roberts | 5,639 | 5,958 | 11,068 | 5.66% | 96.28% | 85.77% |
| Sherman | 200,521 | 220,966 | 254,134 | 10.20% | 26.74% | 15.01% |
| Wheeler | 9,488 | 8,203 | 12,052 | -13.54% | 27.02% | 46.92% |
| Total | 1,311,372 | 1,513,469 | 1,689,287 | 15.41% | 28.82% | 11.62% |

Livestock Water Demand Estimates

It was estimated in the 2011 RWP that livestock operations accounted for 2% to 3% of the water use in Region A. The anticipated rapid growth of the livestock industry makes on-going monitoring of this sector relevant. Given the importance of livestock to the region's economy, an objective of the 2016 RWP is to review/revise/modify, where necessary, regional livestock water use projections. Specific objectives were to:

1. Revise livestock inventory estimates for 2010 used in the 2011 RWP given current inventories,
2. Review/revise, where necessary, future livestock growth projections through 2070, and
3. Review/revise, where necessary, water use estimates per species.

Livestock Inventory Estimates

Livestock inventories by species were estimated for each county of Region A for 2000 in the 2006 RWP effort. County determination of livestock numbers is vital to the accurate estimation of water use. As in previous efforts, eight livestock water use groups were evaluated. They include beef cows, fed beef, summer stockers, winter stockers, dairy cattle, equine, swine and poultry. The procedure developed in previous planning efforts was utilized to develop the estimates of 2010 county level inventories by species.

In the 2016 RWP, updated inventory projections were estimated and utilized to replace 2010 inventory projections made in the 2011 RWP to improve the accuracy of the base for making future projections. Texas Agricultural Statistics Service was used as the primary source of livestock inventory estimates. However, TASS does not provide county level livestock inventory estimates for all species. In some species, only crop reporting district or state level estimates are made. In these instances, other sources of information including the 2007 Census of Agriculture, Extension or industry specialists, and advisory groups were used to refine/improve county level estimates.

Beef Cows

TASS inventory estimates of 2010 beef cow numbers by county were assumed to be equal to the 2010 inventories.

Fed Beef

TASS only estimates fed beef by inventories on a crop reporting district basis. In the 2011 RWP Texas Cattle Feeders Association (TCFA) personnel made the county level fed cattle estimates in consultation with the regional livestock advisory committee. In the 2016 RWP, TCFA personnel updated county level feedlot inventories via secondary data and personal communications with feedlot managers.

Summer Stockers

The procedure for estimating the number of summer stockers was revisited and refined. In the 2011 RWP, the number of summer stockers in a county was adjusted depending on the change in beef cow inventory. The cropland used for the grazing purposes in this category was identified via the 2007 Census of Agriculture and stocking rate on that acreage was doubled to reflect its improved grazing capacity relative to typical pastureland. The same procedure was followed in the 2016 RWP estimates with the summer stocker calculations being updated based on the 2010 beef cow inventories. Stocker estimates were reduced 10% to allow for frictional losses in inventories associated with under stocking.

Winter Stockers

A decrease in the number of stocker cattle grazing wheat has been observed over the last five years. A survey of Texas AgriLife County Extension Agents in the major wheat producing counties was

conducted to ascertain changes in wheat pasture grazing. Based on the survey, the percentage of irrigated and dryland wheat assumed to be grazed, on average, was reduced to 60% and 20%, respectively. In the 2016 RWP, winter stocker numbers were adjusted to reflect the new wheat crop acreage base (2006 – 2010 average). These changes in winter stockers were reflected in the 2010 estimated inventory.

Dairy Cattle

County level dairy inventories were identified through TASS for 2010. In counties with less than three dairies which are not reported in TASS data, Industry sources were utilized to identify herd sizes where possible. Residual dairy cows not accounted for were divided evenly between counties where dairies exist but herd sizes were unknown.

Equine

The 2007 Census of Agriculture was used as the source for county level equine estimates. Currently, it is the only source of this data by county.

Swine

In the 2011 Water Plan, these companies were surveyed directly in the winter of 2009 with the assistance of the Texas Pork Producers Association to determine the actual inventories to use in the 2011 RWP effort. The 2007 Census of Agriculture was utilized to estimate inventories in counties without commercial scale operations. Inventory estimates were adjusted in the 2016 RWP based on the reductions in the 1-N inventories compared to the 2011 RWP estimates. In estimating the current inventories, it was assumed all hog numbers had remained unchanged from the previous plan with the exception of Dallam County where Premium Standard Farms (PSF) was in the process of closing their operation. Therefore, all reductions in inventory were assumed to occur in Dallam County. In addition, 2020 inventories in Dallam County were modified to reflect the final closure of PSF and the plans of the new operation that is replacing PSF.

Poultry

Virtually no poultry currently exists within Region A. In the 2011 RWP, 2010 inventory numbers were arbitrarily set at 1,000 birds per county. In the 2016 RWP, these 2010 county level inventories were replaced with 2007 Census of Agriculture county level estimates.

Livestock Growth Projections

Revising the projected growth rate from the 2011 RWP was beyond the scope of this Task. Projected growth rates developed in consultation with industry groups during the 2011 RWP were assumed to apply to the 2016 RWP projections (Table 4). However, one modification was made. At the request of TCFA personnel, the start of projected growth (Dallam, Hansford, Hartley, Moore, Ochiltree, and Sherman Counties) was delayed from 2020 to 2030 and the rate of growth for the remainder of the time horizon in those counties was reduced from 10% per decade to 5% per decade.

Table 4. Region A 2011 RWP and 2016 RWP projected livestock inventory growth by species, 2010 – 2070.

| Species | 2011 RWP | 2016 RWP |
|-----------------------------------|--|--|
| (----- Annual Growth Rates -----) | | |
| Beef Cows: | | |
| 2010 – 2070 | 0.00% | 0.00% |
| Fed Beef: | | |
| 2010 – 2070 | 10% growth per decade in Dallam, Hansford, Hartley, Moore, Ochiltree, and Sherman Counties. No growth in other counties. | 5% growth per decade starting in 2030 in Dallam, Hansford, Hartley, Moore, Ochiltree, and Sherman Counties. No growth in other counties. |
| Summer Stockers: | | |
| 2010 - 2070 | 0.00% | 0.00% |
| Winter Stockers: | | |
| 2010 - 2070 | 0.25% | 0.25% |
| Dairy Cattle: | | |
| 2010 - 2020 | In 2020, 60,000 cows allocated to Dallam, Hartley, Moore and Sherman Counties based on percentage of TCEQ permits | In 2020, 60,000 cows allocated to Dallam, Hartley, Moore and Sherman Counties based on percentage of TCEQ permits |
| 2030 - 2070 | 1.00% annual growth rate in all dairy counties. | 1.00% annual growth rate in all dairy counties. |
| Equine | | |
| 2010 - 2070 | 1.00% | 1.00% |
| Poultry: | | |
| 2010 - 2070 | In 2020, add 1,000,000 capacity operations in Armstrong, Carson, Childress, Collingsworth, Gray, Oldham, and Wheeler Counties. No other growth is assumed. | In 2020, add 1,000,000 capacity operations in Armstrong, Carson, Childress, Collingsworth, Gray, Oldham, and Wheeler Counties. No other growth is assumed. |
| Swine: | | |
| 2010 - 2020 | 0.00% | Dallam County inventory scaled up to reflect new operation. 0.00% growth in other counties |
| 2030 - 2070 | 0.00% | 0.00% |

Inventory Projection Summary

A summary of the impacts of changes in livestock inventories and future projections utilized in the 2016 RWP compared to the 2011 RWP is given in Table 5. In this table, a comparison of inventories is made during 2010 and 2060. In addition, the final 2070 inventory projection in the 2016 RWP is presented. The 2010 inventories were changed in 2016 RWP to reflect current inventories that were estimated based on 2009 data. Projected growth rates were altered to account for changing industry conditions. The 2016 RWP inventories (2060) of fed beef are expected to be more than 300,000 lower than the 2011 RWP due to delayed and reduced growth rates while dairy cow numbers are projected to be 15,000 cows higher than the 2011 RWP estimates. The most significant change in inventory projections was in the swine industry where ending inventory was dropped more than 660,000 head. This decrease can be traced to the demise of Premium Standard Farms (PSF) and a planned reduction in an existing operation. The replacement of PSF with a planned smaller operation is reflected in the projections.

Table 5. Region A 2010, 2060, and 2070 inventories by species for 2011 and 2016 RWPs.

| Species | 2011 RWP | 2016 RWP | 2011 RWP | 2016 RWP | 2016 RWP |
|------------------------------|-----------|-----------|-----------|-----------|-----------|
| | 2010 | 2010 | 2060 | 2060 | 2070 |
| (----- Number of Head -----) | | | | | |
| Beef Cows | 251,000 | 250,900 | 251,000 | 250,900 | 250,900 |
| Fed Beef | 1,312,739 | 1,341,809 | 1,854,972 | 1,536,932 | 1,591,960 |
| Summer Stockers | 368,921 | 338,985 | 368,921 | 338,985 | 338,985 |
| Winter Stockers | 467,971 | 430,927 | 530,198 | 488,228 | 500,572 |
| Dairy Cattle | 49,137 | 57,000 | 162,490 | 177,328 | 195,881 |
| Equine | 16,882 | 16,035 | 26,372 | 26,372 | 29,131 |
| Poultry | 21,000 | 6,805 | 7,014,000 | 7,005,739 | 7,005,739 |
| Swine | 1,182,371 | 710,000 | 1,093,971 | 431,557 | 431,557 |

Livestock Water Use by Species

Significant time and effort was made in the 2011 RWP to form advisory committees consisting of industry experts to review water use estimates by species. The estimates developed by the committees were implemented in the 2016 RWP, Table 6. These estimates were assumed to still hold and were used in developing livestock water use projections in the 2016 RWP. However, water use in Dallam County swine operations was modified to reflect a different herd composition resulting from a change in ownership and focus of its primary hog operation.

Table 6. Region A 2016 RWP livestock water use estimates per animal.

| Species | 2016 RWP (gal/day) |
|-----------------|--------------------|
| Beef Cows | 20 |
| Fed Beef | 12.5 |
| Summer Stockers | 10 |
| Winter Stockers | 8 |
| Dairy Cattle | 55 |
| Equine | 12 |
| Poultry | 0.09 |
| Swine | 2.5 – 8.2 |

Livestock Projected Water Use

Region A annual livestock water use projections by county for selected years during the 2016 RWP over a 60-year horizon are presented in Table 7 and is illustrated by county for 2070 in Figure 6. Overall, water use in the Region A livestock sector is predicted to increase 28.5% from 37,799 ac-ft. usage in 2010 to 48,564 ac-ft. in 2070. While this increase is significant, it still will only represent approximately five percent of the total agricultural water use within the region during 2070. Six counties (Hartley, Dallam, Moore, Sherman, Hansford, and Ochiltree) account for nearly 68% of the livestock water use during 2070. These six counties are characterized by extensive fed beef operations in conjunction with significant sized dairy and/or swine operations.

Table 7. Region A 2016 RWP estimated livestock water use by county for selected years.

| County | 2010 | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
|---------------|---------------|---------------|---------------|---------------|---------------|---------------|---------------|
| Armstrong | 541 | 645 | 649 | 652 | 656 | 659 | 663 |
| Carson | 588 | 692 | 696 | 700 | 704 | 709 | 713 |
| Childress | 388 | 490 | 493 | 495 | 497 | 500 | 503 |
| Collingsworth | 497 | 600 | 603 | 605 | 608 | 611 | 614 |
| Dallam | 4,739 | 4,437 | 4,669 | 4,920 | 5,191 | 5,485 | 5,803 |
| Donley | 1,329 | 1,330 | 1,332 | 1,333 | 1,335 | 1,337 | 1,339 |
| Gray | 1,249 | 1,352 | 1,378 | 1,407 | 1,438 | 1,473 | 1,511 |
| Hall | 335 | 336 | 337 | 339 | 340 | 341 | 343 |
| Hansford | 3,425 | 3,432 | 3,574 | 3,724 | 3,881 | 4,046 | 4,219 |
| Hartley | 4,676 | 6,498 | 6,977 | 7,498 | 8,066 | 8,684 | 9,359 |
| Hemphill | 1,270 | 1,275 | 1,279 | 1,284 | 1,289 | 1,295 | 1,302 |
| Hutchinson | 843 | 847 | 873 | 903 | 935 | 971 | 1,010 |
| Lipscomb | 945 | 947 | 969 | 993 | 1,020 | 1,050 | 1,083 |
| Moore | 3,021 | 3,676 | 3,906 | 4,155 | 4,424 | 4,716 | 5,032 |
| Ochiltree | 4,769 | 4,216 | 3,632 | 3,729 | 3,832 | 3,942 | 4,058 |
| Oldham | 1,126 | 1,229 | 1,231 | 1,234 | 1,237 | 1,240 | 1,243 |
| Potter | 479 | 481 | 482 | 484 | 486 | 488 | 491 |
| Randall | 2,646 | 2,654 | 2,665 | 2,677 | 2,690 | 2,704 | 2,719 |
| Roberts | 368 | 369 | 369 | 370 | 371 | 372 | 373 |
| Sherman | 2,990 | 3,449 | 3,631 | 3,825 | 4,034 | 4,257 | 4,497 |
| Wheeler | 1,575 | 1,577 | 1,680 | 1,682 | 1,684 | 1,687 | 1,689 |
| Total | 37,799 | 40,532 | 41,425 | 43,009 | 44,718 | 46,567 | 48,564 |

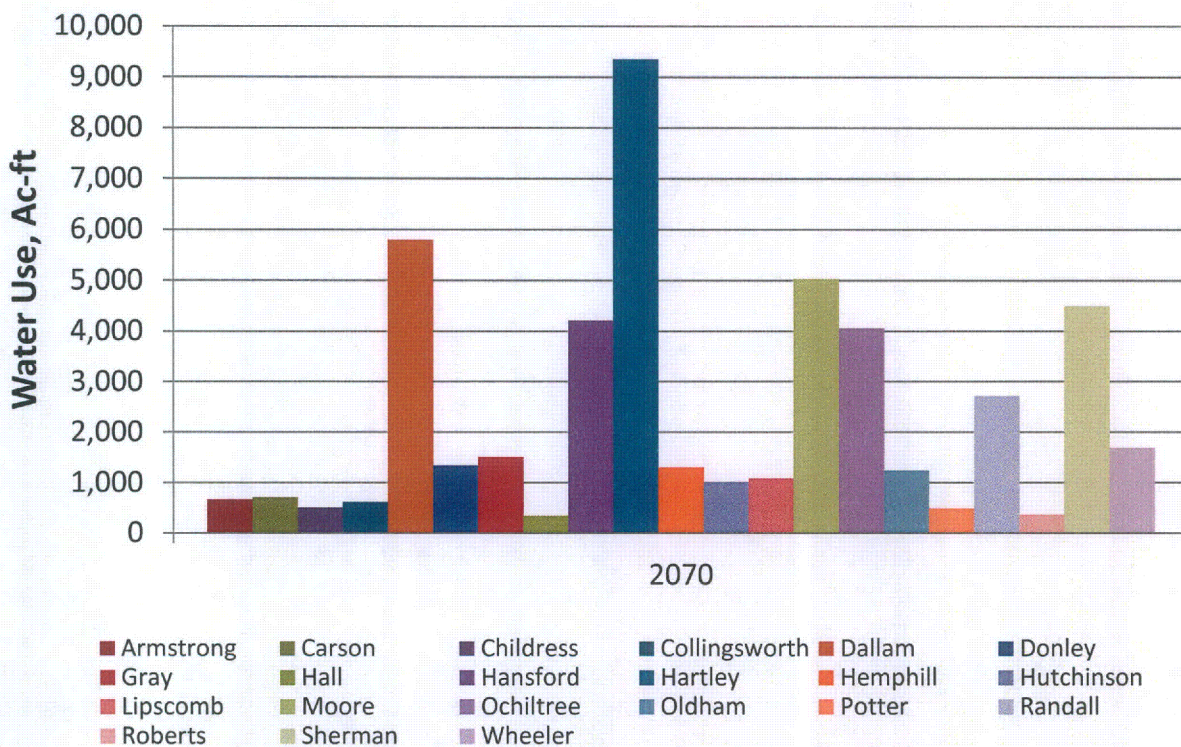


Figure 6. Region A 2016 RWP estimated livestock water use by county, 2070.

The largest livestock water use group is projected to be the fed cattle industry with an annual usage of 22,290 ac-ft. per year by 2070, Table 8. The anticipated expansion of the dairy industry will make it the second largest user group by 2070 (12,067 ac-ft. per year). These two user groups account for 71% of projected livestock water use in 2070. Beef cows, winter & summer stockers and swine are all projected to use more than 3,000 ac-ft. per year with estimated demand of 5,620, 4,400 and 3,086 ac-ft., respectively. Poultry and equine accounted for slightly more than two percent of the projected livestock water consumption in 2070.

Table 8. Region A 2016 RWP livestock water use by species for selected years.

| Species | 2010 | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
|------------|--------|--------|--------|--------|--------|--------|--------|
| Fed Cattle | 18,787 | 18,787 | 19,421 | 20,087 | 20,786 | 21,520 | 22,290 |
| Beef Cows | 5,620 | 5,620 | 5,620 | 5,620 | 5,620 | 5,620 | 5,620 |
| Stockers | 4,140 | 4,181 | 4,222 | 4,265 | 4,309 | 4,354 | 4,400 |
| Dairy Cows | 3,641 | 7,337 | 8,105 | 8,953 | 9,890 | 10,924 | 12,067 |
| Swine | 5,393 | 3,761 | 3,086 | 3,086 | 3,086 | 3,086 | 3,086 |
| Horses | 215 | 238 | 263 | 290 | 320 | 354 | 391 |
| Poultry | 1 | 605 | 706 | 706 | 706 | 706 | 706 |
| Total | 37,797 | 40,529 | 41,423 | 43,007 | 44,717 | 46,564 | 48,560 |

Region A 2011 RWP, 2016 RWP and 2016 TWDB Livestock Water Use Comparison

Projected total livestock water use in the 2011 RWP and the 2016 RWP are presented graphically in Figure 7. The 2016 RWP annual water use estimates by 2060 are estimated to be approximately 12.6% less than those made during the 2011 RWP process. This drop in anticipated water use can be attributed basically to two factors. First and foremost, the revision downward in swine inventory projections due to the closure of Premium Standard Farms. Second, the delay in implementing growth rates (2020 to 2030) and the reduction in anticipated decadal growth rate (10% to 5%) resulted in a relative decrease in fed beef inventory of 300,000+ by 2060. This modification was made at the request of TCFA personnel to reflect changing conditions within the industry.

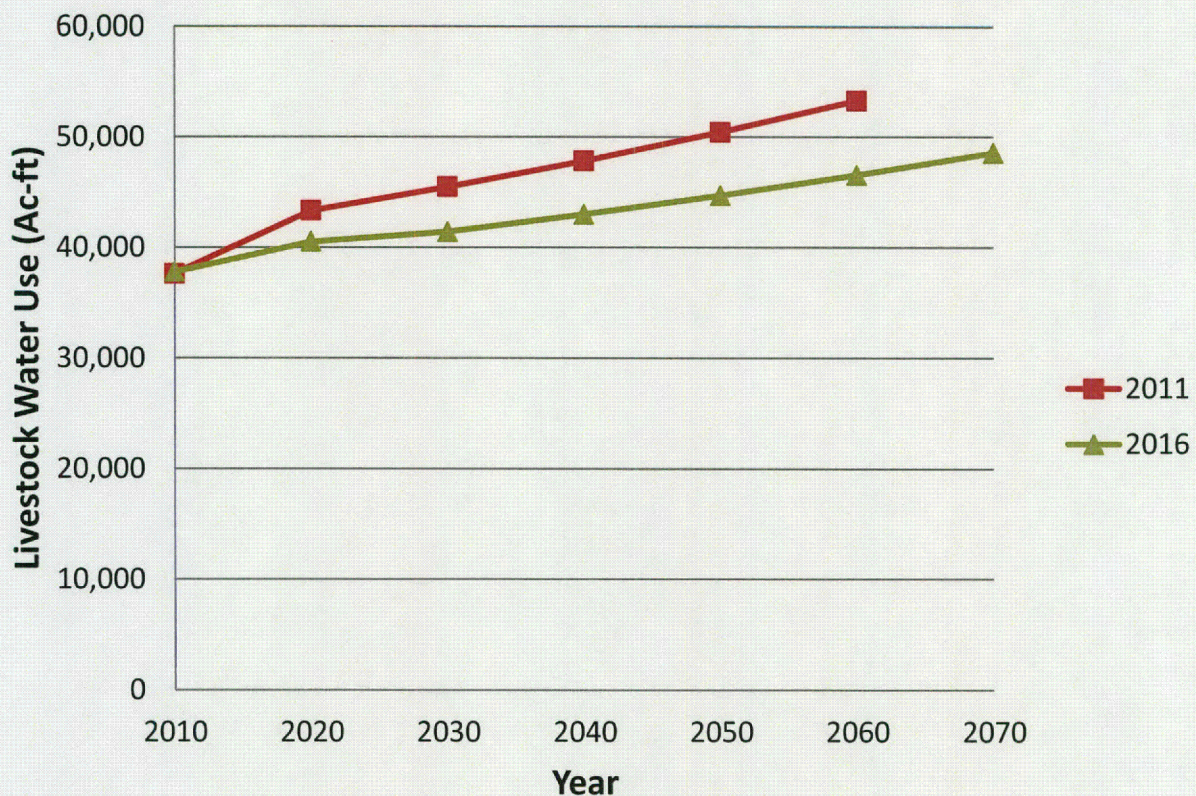


Figure 7. Region A comparison of estimated livestock water use between 2011 RWP and 2016 RWP for selected years.

The estimated livestock water use projected for 2020 by county emanating from the 2011 RWP, proposed 2016 RWP and 2016 TWDB efforts are presented in Table 9. The initial TWDB estimates suggest a 39.50% increase in livestock water use consumption compared to the 2011 RWP projection for the region and an even greater increase (49.19%) relative to the updated projections made as a part of the 2016 RWP. Differences between the 2016 TWDB and the updated 2016 RWP estimates can be traced to several factors and the TWDB estimates are believed to be excessive. These factors include: a double accounting error in some cases that resulted in an overestimation of water use in the fed beef sector; increased water use by species (fed cattle, dairy

cows and hogs) over the numbers developed and documented in the 2011RWP effort which accounted for the unique characteristics of regional operations; and unawareness of changing conditions that have occurred which include the closure of the swine operation (PSF) and the revision of future growth rates in the fed beef industry.

Table 9. Comparison of 2011 RWP, 2016 RWP and 2016 TWDB estimates of livestock water demands by county for 2020.

| | 2020 Estimate (ac-ft.) | | | % Difference | | |
|---------------|------------------------|----------|-----------|-----------------------|-------------------|-------------------|
| | 2011 RWP | 2016 RWP | 2016 TWDB | 2011 RWP vs. 2016 RWP | TWDB vs. 2011 RWP | TWDB vs. 2016 RWP |
| Armstrong | 670 | 645 | 871 | -3.73% | 30.00% | 35.04% |
| Carson | 711 | 692 | 832 | -2.67% | 17.02% | 20.23% |
| Childress | 470 | 490 | 444 | 4.26% | -5.53% | -9.39% |
| Collingsworth | 564 | 600 | 653 | 6.38% | 15.78% | 8.83% |
| Dallam | 4,654 | 4,437 | 11,605 | -4.66% | 149.36% | 161.55% |
| Donley | 1,268 | 1,330 | 1,078 | 4.89% | -14.98% | -18.95% |
| Gray | 1,451 | 1,352 | 2,385 | -6.82% | 64.37% | 76.41% |
| Hall | 330 | 336 | 333 | 1.82% | 0.91% | -0.89% |
| Hansford | 3,956 | 3,432 | 5,632 | -13.25% | 42.37% | 64.10% |
| Hartley | 7,103 | 6,498 | 9,341 | -8.52% | 31.51% | 43.75% |
| Hemphill | 1,281 | 1,275 | 1,557 | -0.47% | 21.55% | 22.12% |
| Hutchinson | 689 | 847 | 648 | 22.93% | -5.95% | -23.49% |
| Lipscomb | 1,007 | 947 | 825 | -5.96% | -18.07% | -12.88% |
| Moore | 3,605 | 3,676 | 4,764 | 1.97% | 32.15% | 29.60% |
| Ochiltree | 3,463 | 4,216 | 2,862 | 21.74% | -17.35% | -32.12% |
| Oldham | 1,257 | 1,229 | 1,440 | -2.23% | 14.56% | 17.17% |
| Potter | 504 | 481 | 699 | -4.56% | 38.69% | 45.32% |
| Randall | 2,741 | 2,654 | 3,790 | -3.17% | 38.27% | 42.80% |
| Roberts | 385 | 369 | 419 | -4.16% | 8.83% | 13.55% |
| Sherman | 5,579 | 3,449 | 8,284 | -38.18% | 48.49% | 140.19% |
| Wheeler | 1,657 | 1,577 | 2,006 | -4.83% | 21.06% | 27.20% |
| Total | 43,345 | 40,532 | 60,468 | -6.49% | 39.50% | 49.19% |


Summary and Conclusions


The preliminary agricultural water use estimate by the Texas Water Development Board (TWDB) for Region A suggests a 28.8% and 39.5% increase in water use by irrigated crops and livestock, respectively, in 2020. This result is an estimated annual difference in water demand of over 400,000 ac-ft., (377,915 and 22,800 ac-ft. for irrigation and livestock, respectively), compared to the previous 2011 regional water plan (RWP) projections. A review of the TWDB estimates found several inconsistencies and a failure to take into account unique characteristics of the region. Therefore, the Region A Ag Demands subcommittee requested TAMU personnel to estimate the

agricultural demands using the same methodology developed in previous planning efforts with adjustments being made to reflect changing conditions that have occurred in the region since the last planning cycle.

Review and revision of the Region A 2011 RWP irrigation demand estimates for the 2016 RWP indicate that new, additional irrigated acreage has increased the irrigation demand. The irrigation water demand of 1,311,372 ac-ft. annually in the 2011 RWP for 2020 increased in the 2016 RWP to 1,513,469 ac-ft. annually for 2020. This value represents a 13.4% demand increase and accounts for the new and non-FSA county acreages. The majority of the new acreage changes occurred in Hartley and Dallam Counties and is attributed to potato production. Other acreage related TAMA model impacts are non-FSA irrigated data operations known to exist within the region. The acreage basis also changed in the TAMA (Texas A&M-Amarillo) irrigation demand model to reflect the average of the years of 2006 through 2010, which is representative of a more normal distribution of years in regards to crop evapotranspiration (ET) demand and rainfall patterns, as compared to the 2006 to 2008 averages. These changed and new crop acreages and accompanying irrigation requirements have increased the total regional irrigation demand over the 2011 RWP estimates but represent the best available data to date. The new regional irrigation demand values are below the suggested TWDB estimates provided for consideration in Region A.

The 2016 RWP estimates indicate that livestock water demand will increase 28.5% from 2010 (37,800 ac-ft.) to 2070 (48,564 ac-ft.) primarily due to anticipated expansions in the fed beef and dairy industries. However, this is a decrease of 12.6% relative to the 2011 RWP projections when comparing 2060 estimates. Changing conditions in the swine and fed beef industries accounted for most of the relative decline. In Dallam County, Premium Standard Farms ceased operations and is being replaced by what is/will be replaced by a smaller operation. At the request of TCFA personnel, the start of projected growth (Dallam, Hansford, Hartley, Moore, Ochiltree, and Sherman Counties) was delayed from 2020 to 2030 and the rate of growth for the remainder of the time horizon in those counties was reduced from 10% per decade to 5% per decade.

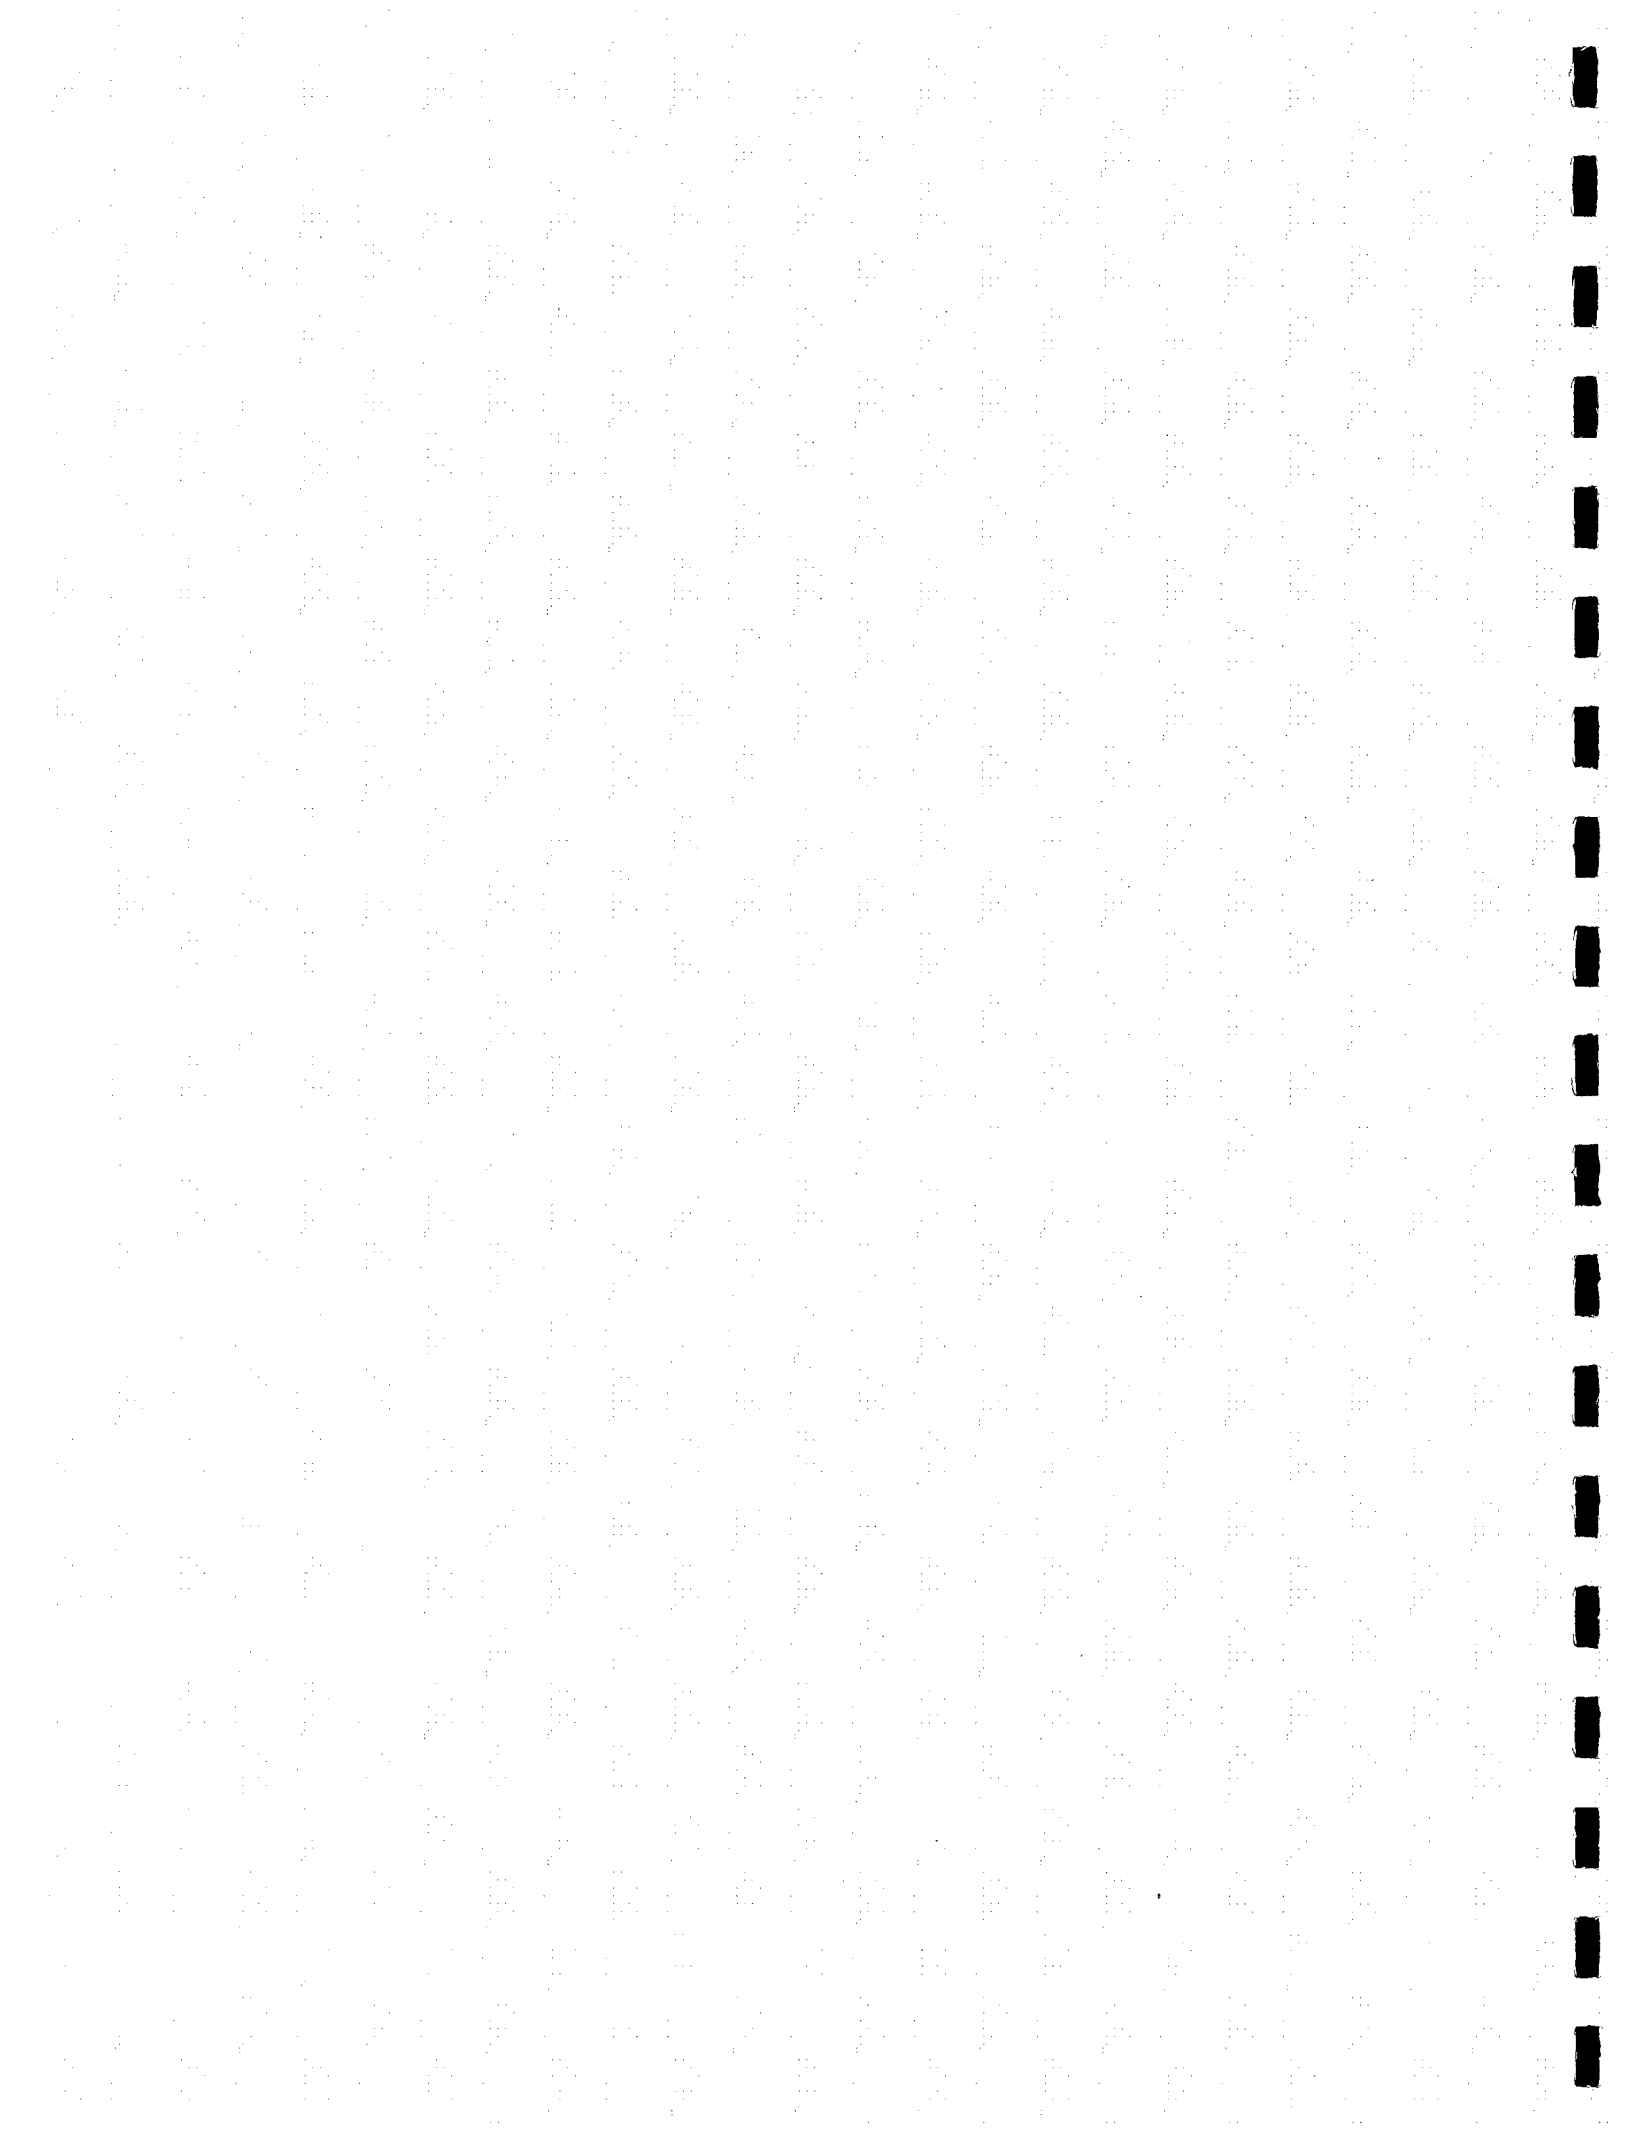



Appendix C

Analyses for PWPA Surface Water Availability



SUBJECT: Documentation of Canadian River and Red River WAM Analyses for PWPA Water Availability

DATE: April 6, 2015, Updated October 26, 2015

PROJECT: PPC11456

This memorandum documents the datasets and processes used in the Water Availability Model (WAM) analyses for the Panhandle Water Planning Area (PWPA). The memorandum is organized into four sections, discussion of the modeling for Lake Meredith, Greenbelt Reservoir, Palo Duro Reservoir, and run-of-river supplies in the Canadian River and Red River Basin. The Texas Water Development Board in a letter to the Panhandle Water Planning Group (PWPG) dated October 29, 2012 approved the PWPG request to use extended hydrology datasets in calculating the yield of Lake Meredith in the Canadian River Basin. The letter approved the request that the 2070 yield for Palo Duro Reservoir be estimated by linear interpolation based on the yield analysis from the 2011 Panhandle Regional Water Plan for the decades 2020-2060. The letter also authorized the use of the findings from the Greenbelt Municipal and Industrial Authority's water study estimate for Greenbelt Reservoir in the Red River Basin.

The following table lists each major reservoir in Panhandle Water Planning Area (PWPA), including pertinent data relative to the water availability modeling.

Table C-1 Summary of Reservoir Water Right Information

| Reservoir | Water Right | Priority Date | Diversion (Ac-ft/yr) | Authorized Impoundment (Ac-ft) |
|-----------|-------------|---------------|----------------------|--------------------------------|
| Meredith | CA 01-3782 | Jan 30, 1956 | 151,200 | 904,000 ¹ |
| Palo Duro | CA 01-3803 | Apr 23, 1974 | 10,460 | 60,900 |
| Greenbelt | CA 02-5233 | Aug 11, 1958 | 16,030 ² | 59,100 |

¹ of which 9,111 ac-ft is reserved for compliance with the Red River Compact

² of which 4,030 ac-ft/yr is authorized diversion from Lelia Lake Creek run-of-river and 250 ac-ft/yr diverted directly from Salt Fork of the Red River.

1.1 Lake Meredith

Lake Meredith is a key component of water supply in the Texas Panhandle region. As such, estimation of the yield and reliability of Lake Meredith has been a significant component of prior planning cycles for the Panhandle Water Planning Area. Prior Regional Plans have relied upon the Full Authorization Run (Run 3) of the TCEQ-approved Canadian Water Availability Models (WAMs) to assess water availability for the lake in accordance with TWDB requirements. The 2006 Regional Plan included substantial revisions to model parameters and extension of historical hydrology datasets to capture more current portions of the hydrologic record than the original WAM. However, even this updated WAM does not fully capture recent portions of the ongoing critical drought. As such, an alternate methodology is required in order to estimate Lake Meredith yield for the 2016 Regional Plan.

Due to the constraints of the current planning cycle, a major update of the WAM is not feasible. As such, Lake Meredith yield analysis for the 2016 plan utilizes a Microsoft Excel-based Operate reservoir model. The Operate model incorporates hydrologic data such as inflow, net evaporation, water demands and priority releases, reservoir configuration, and other parameters to perform a monthly water balance on a single reservoir over a certain historical period. As with the TCEQ WAM, the Operate model is not a direct predictive model but rather a statistical tool analyzing reservoir behavior under a period of historical hydrology. While only examining one particular reservoir rather than the entire basin, the Operate model uses a similar conceptual approach to the WAM. Further, the lake's water right seniority and extremely minimal history of water rights releases supports the use of a focused, simplified model. This enables estimation of firm and safe yields for the reservoir for Regional Planning purposes.

Input parameters for the model were compiled from several sources. The Canadian River Basin WAM updated for the 2006 Regional Plan (Canadian2000 WAM) served as the primary reference, with substantial additional data from Canadian River Municipal Water Authority (CRMWA) records, TWDB records, and prior Regional Plans. The combination of sources used for the study allowed for simulation of historical hydrology for the reservoir site from 1940 through March 2012.

Development of input parameters for the model is discussed in Section 1.2 below, with model results following in Section 1.3.

1.2 Lake Meredith Model Input Development

Inputs for the monthly time step modeling of Lake Meredith were compiled from multiple sources due to the length of the historical period of the simulation and the availability of individual references. Where possible, information from the Canadian2000 WAM was utilized as the preferred dataset; this version of the Canadian River Basin WAM was updated during a prior round of Regional Water Planning and includes improved and extended hydrology datasets relative to the TCEQ WAM Run 3. However, the effective Canadian2000 simulation period is limited to January 1940 through September 2004. Thus, alternate data sources were evaluated for later time periods.

- a) **Inflows** – Inflows (runoff) into Lake Meredith were determined by multiple methods for different date ranges of the historical simulation period. For January 1940 through September 2004, modeled inflows into the lake were extracted from the Canadian2000 WAM and applied directly. Prior to inflow extraction, the WAM was modified to include full permitted diversion targets for Lake Meredith and the Palo Duro reservoir.

For October 2004 through March 2012, a water balance approach was required to estimate Lake Meredith inflows. Lake levels for this time period were available on a monthly basis from CRMWA records. The beginning and ending elevation for each month was used in conjunction with lake survey data to determine the estimated total volume change of the reservoir over the course of the month. CRMWA records of reservoir releases, lakeside diversions, and seepage, as well as estimates of monthly evaporation, were then summed with the volume change to determine estimated inflows to the reservoir. In cases where an individual monthly time step was not of sufficient resolution to estimate inflow accurately, generating a negative inflow estimate, inflow was estimated to be zero for that month with the cancelled negative volume distributed to adjacent months to preserve the overall mass balance. A

comparison of this estimated inflow to CRMWA inflow estimates showed a good relationship ($r^2 = 0.98$) between estimated and observed data.

Reservoir inflows for the last ten to fifteen years of the hydrologic record show substantial decline relative to earlier years, corresponding with declining reservoir storage and the ongoing critical drought. A number of potential complicating factors to the drought have been proposed for the lake, including rainfall intensity patterns, declining groundwater levels, land use change, and climatic shifts. Regardless of the cause or causes of declining inflows, continuation or worsening of drought conditions would be expected to substantially impact reservoir yield. The extended inflows used in the model are shown in Table C-2.

- b) **Net reservoir evaporation** – As with inflow data, monthly net evaporation was compiled from multiple sources. For the time period from January 1940 through September 2004, net evaporation depths were extracted from the Canadian2000 WAM. Since the Canadian2000 WAM does not include historical data subsequent to September 2004, values for the remainder of the desired simulation period were calculated from CRMWA evaporation and precipitation records; some CRMWA data was also used in development of the Canadian2000 WAM itself. The extended net evaporation is shown in Table C-3.
- c) **Area-Capacity-Elevation data** – Data for the area-capacity-elevation properties of the reservoir were taken primarily from the volumetric survey of Lake Meredith performed by the Texas Water Development Board in June 1995 and published in March 2003. In addition to construction and survey history of the lake, the report includes tables of area and volume of the lake as a function of elevation. Based on a sedimentation rate of 0.088 ac-ft/mi²/yr from this report and an incremental drainage area of 4,908 square miles below Ute Reservoir, estimated area-capacity-elevation properties were projected for future decades. Reservoir curves were generated for years 2010, 2020, 2040, and 2070. The area capacity curves for 2010 and 2070 are shown in Table C-4.
- d) **Releases** – Reservoir releases from CRMWA records total 465 ac-ft since reservoir construction, with the last release occurring in 1999. Results of the Canadian2000 WAM do not show any modeled releases for senior rights. Due to the small volume and intermittent nature of past releases, they were not included in the modeling of the reservoir. No environmental flow releases were assumed.
- e) **Demand Pattern** – Because the reliability models operate on a monthly time step, the annual water demand estimated for the reservoir must be distributed in twelve monthly increments. The monthly water demand distribution (percent of annual demand each month) was estimated as the average monthly distribution of lakeside diversions from CRMWA records for 2001 through 2010. Year 2011 and 2012 demands were not included due to the extreme situation impacting the reservoir at that time. Please note that the demand pattern generated from this ten-year period of CRMWA records is similar to the diversion distribution already included in the Canadian River WAM.
- f) **Seepage** – Studies performed as part of the prior planning cycle note the potential for seepage losses for Lake Meredith, with such losses seeming to diminish with time; this corresponds with declining seepage estimates in CRMWA records. The development of the Canadian2000 WAM in the prior planning cycle included adjustment of naturalized flows due to seepage at the lake. As the inflows extracted from the model should already exclude any direct seepage or channel loss volumes, no seepage loss term was applied in the Excel-based model for January 1940 through September 2004. A seepage loss is included for October 2004 through March 2012 to account for losses in data extracted from the most recent water balance methodology. Seepage values were extracted from CRMWA records.

- g) **Operating Range** – While Lake Meredith has a substantial potential storage capacity, several factors constrain the usable portion of the reservoir for Texas to a smaller volume. The lake’s inactive pool elevation is 2,860 ft above mean sea level (MSL). Therefore, the model was constrained not to fall below this level during firm and safe yield estimation. In addition, the interstate Canadian River Compact limits the right of Texas to retain water in conservation storage in Lake Meredith to 500,000 ac-ft. While the initial permitted conservation pool elevation of the reservoir (2,936.5 ft MSL) corresponds to a volume in excess of 800,000 ac-ft, all but 500,000 ac-ft is for sedimentation and inactive storage. Because sedimentation in the reservoir has been limited and the reservoir has not exceeded a water surface elevation of 2,915 ft MSL, the model reflects the usable portion of the reservoir as the first 500,000 ac-ft above the inactive pool.
- h) **Upstream Reservoir Impacts** – Ute reservoir in New Mexico is located on the Canadian River upstream of Lake Meredith and could conceivably impact inflows to Lake Meredith. Because model inflow data through September 2004 was extracted from the Canadian2000 WAM, which already includes full allowed Ute Reservoir diversions, no further adjustment to inflow was needed for that time period. An examination of flows at the USGS station downstream of Ute Reservoir indicated typically very low flows. There are occasional pulses, but fewer than for Lake Meredith inflows; additionally, there has only been one significant spill at Ute Reservoir since year 2000, which does not appear to have had substantial impact on Lake Meredith. For this reason, it appears that Ute Reservoir would have little impact on Lake Meredith yield. This is consistent with the approach taken in the Canadian2000 WAM.
- i) **Starting Volume** – The Excel-based reservoir model used for this study was set to a starting volume equal to the maximum allowable storage of 500,000 ac-ft above the inactive pool. This was done to maintain consistency with the approach taken with the TCEQ WAM, which assumes that reservoirs are full at the beginning of the simulation.

Table C-2: Extended Inflow to Lake Meredith

-Values in Acre-Feet-

| Year | Jan | Feb | Mar | Apr | May | Jun | Jul | Aug | Sep | Oct | Nov | Dec |
|------|--------|--------|--------|---------|---------|---------|---------|---------|---------|---------|--------|--------|
| 1940 | 779 | 3,991 | 86 | 129 | 26,769 | 5,525 | 2,243 | 13,958 | 10,771 | 55 | 12,986 | 2,917 |
| 1941 | 2,396 | 3,370 | 2,878 | 2,336 | 419,139 | 371,586 | 321,780 | 174,760 | 480,405 | 424,777 | 54,545 | 28,618 |
| 1942 | 14,736 | 9,761 | 10,081 | 364,077 | 189,747 | 51,470 | 34,214 | 36,265 | 276,247 | 71,128 | 16,765 | 5,677 |
| 1943 | 30,109 | 1,687 | 743 | 1,642 | 2,076 | 177 | 26,671 | 0 | 0 | 153 | 324 | 4,754 |
| 1944 | 11,525 | 5,430 | 1,986 | 2,368 | 23,469 | 34,542 | 26,423 | 25,216 | 44,693 | 2,129 | 221 | 13,251 |
| 1945 | 9,567 | 1,822 | 1,103 | 319 | 36 | 2,495 | 0 | 23,206 | 4,341 | 10,100 | 54 | 58 |
| 1946 | 673 | 456 | 69 | 249 | 1,923 | 7,884 | 0 | 8,992 | 55,312 | 152,418 | 4,490 | 3,877 |
| 1947 | 5,112 | 388 | 4,714 | 4,890 | 34,846 | 3,385 | 12,067 | 0 | 96 | 324 | 247 | 353 |
| 1948 | 495 | 3,258 | 5,770 | 57 | 4,235 | 91,912 | 3,175 | 45,552 | 790 | 1,302 | 5,684 | 441 |
| 1949 | 569 | 2,152 | 1,620 | 2,651 | 119,681 | 97,403 | 70,930 | 32,177 | 16,895 | 2,541 | 2,302 | 655 |
| 1950 | 1,679 | 922 | 557 | 1,260 | 2,082 | 31,270 | 177,593 | 50,207 | 83,891 | 7,046 | 900 | 2,449 |
| 1951 | 3,554 | 5,503 | 2,245 | 1,115 | 75,406 | 19,480 | 27,017 | 2,794 | 2,313 | 718 | 3,648 | 1,102 |
| 1952 | 1,366 | 809 | 329 | 2,821 | 1,278 | 768 | 5,918 | 10,321 | 2,534 | 404 | 386 | 947 |
| 1953 | 2,874 | 977 | 793 | 481 | 277 | 2,117 | 28,598 | 22,447 | 119 | 13,261 | 956 | 1,137 |
| 1954 | 3,186 | 2,126 | 1,643 | 4,246 | 51,596 | 0 | 34,852 | 9,791 | 0 | 20,591 | 689 | 433 |
| 1955 | 1,071 | 922 | 441 | 27,530 | 72,103 | 28,994 | 11,829 | 11,563 | 6,382 | 3,111 | 542 | 527 |
| 1956 | 765 | 1,487 | 746 | 501 | 36,215 | 4,941 | 3,776 | 0 | 346 | 353 | 428 | 542 |
| 1957 | 403 | 734 | 2,726 | 9,688 | 62,084 | 37,691 | 394 | 73,042 | 8,033 | 13,252 | 2,694 | 1,235 |
| 1958 | 3,440 | 3,464 | 8,955 | 6,933 | 13,739 | 18,761 | 192,442 | 61,003 | 65,991 | 1,269 | 1,059 | 1,698 |
| 1959 | 1,486 | 1,511 | 278 | 569 | 8,630 | 14,684 | 23,163 | 36,874 | 3,271 | 2,758 | 417 | 25,107 |
| 1960 | 11,975 | 10,496 | 4,921 | 659 | 259 | 67,299 | 209,013 | 60,383 | 22,805 | 53,450 | 2,134 | 6,042 |
| 1961 | 2,195 | 7,256 | 24,753 | 7,495 | 2,583 | 9,082 | 19,625 | 12,069 | 24,017 | 1,343 | 11,787 | 6,539 |
| 1962 | 4,527 | 922 | 347 | 1,862 | 0 | 9,252 | 9,924 | 32,697 | 3,692 | 1,250 | 964 | 2,274 |
| 1963 | 1,149 | 2,236 | 1,176 | 516 | 4,852 | 28,776 | 11,138 | 16,598 | 12,989 | 390 | 338 | 544 |
| 1964 | 892 | 4,699 | 817 | 173 | 1,302 | 3,016 | 267 | 2,317 | 22,305 | 438 | 1,770 | 1,629 |
| 1965 | 1,867 | 972 | 1,658 | 256 | 23,774 | 214,674 | 14,922 | 25,867 | 2,111 | 24,402 | 9,511 | 2,743 |
| 1966 | 995 | 3,761 | 2,305 | 523 | 612 | 11,133 | 9,290 | 22,054 | 7,365 | 586 | 367 | 627 |
| 1967 | 1,819 | 1,498 | 743 | 15,529 | 5,733 | 29,190 | 74,493 | 15,574 | 9,965 | 13,078 | 3,521 | 5,534 |
| 1968 | 6,001 | 3,433 | 1,730 | 423 | 13,889 | 13,058 | 15,190 | 16,694 | 1,088 | 10,682 | 671 | 722 |
| 1969 | 1,790 | 4,339 | 5,103 | 547 | 41,932 | 48,425 | 28,316 | 23,966 | 70,578 | 16,953 | 5,075 | 3,854 |
| 1970 | 3,927 | 1,648 | 2,735 | 31,264 | 2,250 | 1,053 | 3,849 | 14,773 | 12,194 | 3,963 | 1,907 | 1,262 |
| 1971 | 1,854 | 2,599 | 1,256 | 1,671 | 9,758 | 22,066 | 32,380 | 30,998 | 19,515 | 8,212 | 34,425 | 11,031 |
| 1972 | 7,970 | 3,630 | 1,156 | 582 | 6,235 | 9,152 | 68,159 | 45,470 | 34,116 | 15,921 | 3,096 | 2,037 |
| 1973 | 2,785 | 2,922 | 15,432 | 18,573 | 2,173 | 94 | 14,217 | 9,889 | 567 | 369 | 0 | 787 |
| 1974 | 1,989 | 1,375 | 10,499 | 530 | 7,602 | 4,441 | 2,321 | 51,453 | 19,241 | 37,486 | 3,619 | 2,232 |
| 1975 | 4,727 | 4,970 | 2,590 | 3,566 | 3,737 | 32,958 | 19,807 | 10,854 | 875 | 537 | 496 | 590 |
| 1976 | 1,074 | 1,016 | 1,606 | 3,117 | 7,779 | 3,304 | 3,606 | 13,599 | 54,603 | 3,228 | 1,123 | 1,106 |

Documentation of Canadian River and Red River WAM Analyses for PWPA Water Availability
 April 6, 2015, Updated October 26, 2015
 Page 6 of 20

| Year | Jan | Feb | Mar | Apr | May | Jun | Jul | Aug | Sep | Oct | Nov | Dec |
|------|-------|-------|--------|--------|--------|--------|--------|---------|--------|--------|--------|-------|
| 1977 | 0 | 2,145 | 456 | 10,830 | 22,908 | 9,082 | 4,466 | 42,230 | 23,410 | 22 | 263 | 319 |
| 1978 | 386 | 1,567 | 1,116 | 499 | 28,944 | 52,901 | 1,401 | 2,697 | 18,805 | 7,702 | 1,546 | 778 |
| 1979 | 2,071 | 1,322 | 3,095 | 759 | 6,908 | 22,282 | 590 | 11,988 | 101 | 0 | 1,251 | 1,224 |
| 1980 | 3,417 | 7,020 | 3,414 | 2,678 | 20,986 | 7,149 | 0 | 5,834 | 2,128 | 0 | 0 | 1,062 |
| 1981 | 641 | 382 | 1,525 | 11 | 1,008 | 21,510 | 14,233 | 145,891 | 39,960 | 8,409 | 3,538 | 2,485 |
| 1982 | 2,068 | 2,244 | 2,219 | 1,366 | 6,804 | 37,543 | 44,454 | 9,224 | 6,229 | 6,999 | 2,354 | 6,332 |
| 1983 | 4,483 | 8,026 | 7,968 | 3,193 | 3,087 | 11,261 | 0 | 0 | 0 | 97 | 0 | 15 |
| 1984 | 1,191 | 1,164 | 1,459 | 4,139 | 1,765 | 4,343 | 1,125 | 14,184 | 100 | 6,858 | 2,925 | 4,637 |
| 1985 | 2,989 | 3,321 | 7,246 | 3,784 | 9,094 | 4,163 | 0 | 1,559 | 22,538 | 18,506 | 2,973 | 2,298 |
| 1986 | 2,161 | 4,820 | 2,056 | 258 | 1,228 | 11,776 | 956 | 15,909 | 26,643 | 7,081 | 12,313 | 2,836 |
| 1987 | 3,305 | 3,617 | 6,150 | 878 | 66,907 | 21,626 | 1,065 | 21,380 | 13,084 | 2,244 | 1,343 | 2,890 |
| 1988 | 6,041 | 2,467 | 12,192 | 11,672 | 31,290 | 35,556 | 38,250 | 5,437 | 40,068 | 3,181 | 531 | 3,495 |
| 1989 | 2,649 | 2,822 | 1,978 | 1,098 | 20,012 | 28,573 | 8,232 | 21,591 | 12,705 | 1,730 | 6,862 | 2,215 |
| 1990 | 4,162 | 6,821 | 5,400 | 4,147 | 2,713 | 302 | 1,185 | 1,955 | 22,991 | 4,653 | 4,668 | 1,686 |
| 1991 | 4,973 | 1,754 | 854 | 1,192 | 14,214 | 14,911 | 24,555 | 37,393 | 159 | 1,869 | 2,794 | 7,026 |
| 1992 | 9,862 | 3,305 | 1,982 | 2,922 | 5,497 | 51,380 | 13,082 | 16,156 | 4,138 | 286 | 890 | 3,844 |
| 1993 | 3,113 | 3,972 | 3,621 | 2,339 | 3,526 | 20,261 | 11,290 | 9,297 | 15,468 | 2,679 | 1,384 | 1,297 |
| 1994 | 1,136 | 1,114 | 2,731 | 1,149 | 15,775 | 11,253 | 17,884 | 1,300 | 3,640 | 37,023 | 1,325 | 2,025 |
| 1995 | 2,394 | 1,003 | 2,011 | 2,077 | 9,138 | 15,836 | 13,860 | 23,042 | 19,561 | 9,040 | 3,372 | 2,002 |
| 1996 | 1,943 | 1,281 | 777 | 427 | 3,418 | 19,771 | 50,038 | 36,855 | 18,353 | 5,508 | 3,880 | 4,309 |
| 1997 | 2,983 | 3,066 | 2,065 | 23,147 | 10,534 | 23,073 | 4,912 | 20,814 | 1,432 | 4,487 | 2,564 | 4,146 |
| 1998 | 6,395 | 4,592 | 11,062 | 3,319 | 2,407 | 76 | 0 | 6,092 | 320 | 17,649 | 14,311 | 2,714 |
| 1999 | 2,708 | 5,949 | 5,499 | 12,618 | 90,013 | 35,063 | 8,067 | 49,066 | 13,182 | 753 | 333 | 2,242 |
| 2000 | 1,661 | 2,642 | 19,474 | 11,470 | 2,804 | 6,982 | 3,214 | 0 | 0 | 13,994 | 4,557 | 1,641 |
| 2001 | 5,228 | 6,632 | 10,983 | 4,130 | 5,217 | 1,730 | 496 | 0 | 0 | 0 | 592 | 0 |
| 2002 | 1,476 | 1,948 | 596 | 4,054 | 2,816 | 4,145 | 1,155 | 6,053 | 9,771 | 0 | 2,051 | 3,020 |
| 2003 | 2,545 | 2,525 | 2,130 | 1,472 | 947 | 15,899 | 1,573 | 81 | 10,010 | 1,056 | 214 | 547 |
| 2004 | 1,024 | 1,752 | 4,328 | 6,370 | 1,741 | 9,548 | 9,783 | 11,633 | 2,592 | 8,898 | 10,778 | 6,528 |
| 2005 | 7,636 | 6,556 | 5,603 | 4,623 | 4,346 | 19,661 | 1,404 | 2,828 | 3,543 | 0 | 293 | 0 |
| 2006 | 1,491 | 1,463 | 4,528 | 0 | 365 | 351 | 3,299 | 6,228 | 6,567 | 2,088 | 929 | 2,613 |
| 2007 | 3,590 | 4,122 | 7,448 | 8,044 | 4,392 | 4,391 | 2,617 | 1,527 | 0 | 0 | 1,144 | 442 |
| 2008 | 715 | 1,123 | 1,033 | 1,163 | 1,323 | 1,116 | 8,758 | 23,767 | 2,391 | 15,683 | 3,384 | 1,660 |
| 2009 | 1,622 | 1,787 | 2,264 | 2,810 | 1,788 | 1,296 | 1,163 | 6,215 | 1,104 | 173 | 1,458 | 341 |
| 2010 | 752 | 5,241 | 4,258 | 4,933 | 2,605 | 1,592 | 909 | 192 | 0 | 826 | 708 | 1,302 |
| 2011 | 447 | 937 | 900 | 555 | 565 | 756 | 1,207 | 242 | 124 | 5 | 122 | 440 |
| 2012 | 78 | 240 | 526 | | | | | | | | | |

Table C-3: Extended Net Evaporation at Lake Meredith

-Values in Feet-

| Year | Jan | Feb | Mar | Apr | May | Jun | Jul | Aug | Sep | Oct | Nov | Dec |
|------|--------|--------|--------|-------|--------|-------|--------|-------|--------|--------|--------|--------|
| 1940 | 0.009 | 0.185 | 0.426 | 0.398 | 0.394 | 0.580 | 0.902 | 0.588 | 0.610 | 0.550 | 0.053 | 0.181 |
| 1941 | 0.109 | 0.107 | 0.128 | 0.317 | -0.077 | 0.153 | 0.231 | 0.395 | 0.270 | -0.206 | 0.231 | 0.175 |
| 1942 | 0.147 | 0.181 | 0.299 | 0.096 | 0.501 | 0.258 | 0.651 | 0.382 | 0.345 | -0.076 | 0.397 | 0.129 |
| 1943 | 0.180 | 0.256 | 0.336 | 0.382 | 0.475 | 0.595 | 0.428 | 0.700 | 0.561 | 0.489 | 0.257 | 0.004 |
| 1944 | 0.017 | 0.107 | 0.352 | 0.233 | 0.314 | 0.547 | 0.393 | 0.545 | 0.439 | 0.291 | 0.194 | -0.009 |
| 1945 | 0.046 | 0.168 | 0.334 | 0.270 | 0.642 | 0.627 | 0.516 | 0.416 | 0.402 | 0.287 | 0.350 | 0.196 |
| 1946 | 0.191 | 0.204 | 0.353 | 0.446 | 0.483 | 0.619 | 0.740 | 0.396 | 0.236 | -0.011 | 0.064 | 0.172 |
| 1947 | 0.207 | 0.251 | 0.264 | 0.276 | 0.133 | 0.529 | 0.640 | 0.605 | 0.724 | 0.425 | 0.200 | 0.064 |
| 1948 | 0.091 | -0.033 | 0.215 | 0.505 | 0.337 | 0.433 | 0.532 | 0.313 | 0.621 | 0.367 | 0.140 | 0.349 |
| 1949 | 0.076 | 0.134 | 0.311 | 0.251 | 0.106 | 0.292 | 0.315 | 0.443 | 0.379 | 0.324 | 0.332 | 0.144 |
| 1950 | 0.257 | 0.190 | 0.399 | 0.384 | 0.493 | 0.344 | -0.089 | 0.303 | 0.113 | 0.445 | 0.316 | 0.257 |
| 1951 | 0.100 | 0.158 | 0.325 | 0.438 | -0.108 | 0.352 | 0.779 | 0.887 | 0.837 | 0.614 | 0.310 | 0.226 |
| 1952 | 0.238 | 0.287 | 0.333 | 0.270 | 0.468 | 0.800 | 0.786 | 0.856 | 0.875 | 0.808 | 0.364 | 0.211 |
| 1953 | 0.267 | 0.253 | 0.507 | 0.598 | 0.728 | 0.903 | 0.748 | 0.594 | 0.954 | 0.346 | 0.287 | 0.062 |
| 1954 | 0.123 | 0.344 | 0.398 | 0.381 | 0.064 | 0.637 | 0.680 | 0.517 | 0.712 | 0.330 | 0.339 | 0.261 |
| 1955 | 0.135 | 0.216 | 0.415 | 0.532 | 0.061 | 0.457 | 0.642 | 0.513 | 0.333 | 0.450 | 0.345 | 0.236 |
| 1956 | 0.161 | 0.059 | 0.487 | 0.566 | 0.534 | 0.648 | 0.524 | 0.635 | 0.727 | 0.484 | 0.311 | 0.244 |
| 1957 | 0.145 | 0.146 | -0.012 | 0.089 | -0.021 | 0.476 | 0.763 | 0.281 | 0.423 | 0.085 | 0.080 | 0.251 |
| 1958 | 0.026 | 0.074 | -0.087 | 0.169 | 0.130 | 0.491 | 0.113 | 0.502 | 0.334 | 0.363 | 0.183 | 0.120 |
| 1959 | 0.140 | 0.184 | 0.361 | 0.369 | 0.088 | 0.466 | 0.327 | 0.335 | 0.519 | 0.137 | 0.202 | -0.172 |
| 1960 | -0.009 | 0.034 | 0.185 | 0.426 | 0.390 | 0.126 | 0.091 | 0.363 | 0.048 | -0.064 | 0.253 | 0.109 |
| 1961 | 0.072 | 0.056 | 0.038 | 0.404 | 0.391 | 0.252 | 0.276 | 0.347 | 0.378 | 0.355 | -0.025 | 0.150 |
| 1962 | 0.018 | 0.197 | 0.328 | 0.329 | 0.547 | 0.086 | 0.185 | 0.433 | 0.224 | 0.366 | 0.214 | 0.109 |
| 1963 | 0.058 | 0.150 | 0.469 | 0.643 | 0.358 | 0.407 | 0.636 | 0.376 | 0.363 | 0.464 | 0.300 | 0.060 |
| 1964 | 0.060 | -0.007 | 0.304 | 0.574 | 0.475 | 0.582 | 0.794 | 0.596 | 0.312 | 0.451 | 0.095 | 0.089 |
| 1965 | 0.090 | 0.129 | 0.067 | 0.398 | 0.319 | 0.033 | 0.560 | 0.563 | 0.582 | 0.448 | 0.336 | 0.101 |
| 1966 | 0.040 | 0.067 | 0.461 | 0.581 | 0.817 | 0.449 | 0.836 | 0.275 | 0.352 | 0.415 | 0.346 | 0.163 |
| 1967 | 0.293 | 0.273 | 0.541 | 0.419 | 0.685 | 0.420 | 0.304 | 0.459 | 0.475 | 0.576 | 0.202 | 0.134 |
| 1968 | 0.069 | 0.123 | 0.274 | 0.559 | 0.427 | 0.317 | 0.462 | 0.425 | 0.609 | 0.382 | 0.176 | 0.114 |
| 1969 | 0.237 | 0.101 | 0.138 | 0.507 | 0.284 | 0.357 | 0.583 | 0.531 | 0.202 | 0.182 | 0.184 | 0.145 |
| 1970 | 0.131 | 0.283 | 0.217 | 0.482 | 0.898 | 0.871 | 0.875 | 0.644 | 0.616 | 0.340 | 0.315 | 0.227 |
| 1971 | 0.176 | 0.191 | 0.514 | 0.613 | 0.778 | 0.775 | 0.682 | 0.468 | 0.251 | 0.271 | 0.110 | 0.127 |
| 1972 | 0.249 | 0.271 | 0.584 | 0.752 | 0.463 | 0.461 | 0.399 | 0.569 | 0.532 | 0.290 | -0.019 | 0.039 |
| 1973 | 0.086 | 0.149 | -0.036 | 0.253 | 0.569 | 0.817 | 0.556 | 0.764 | 0.292 | 0.405 | 0.274 | 0.147 |
| 1974 | 0.089 | 0.314 | 0.298 | 0.697 | 0.632 | 0.731 | 0.893 | 0.057 | 0.343 | -0.004 | 0.227 | 0.075 |
| 1975 | 0.131 | 0.004 | 0.345 | 0.448 | 0.523 | 0.428 | 0.245 | 0.676 | 0.379 | 0.530 | 0.155 | 0.165 |
| 1976 | 0.241 | 0.390 | 0.391 | 0.403 | 0.529 | 0.775 | 0.634 | 0.488 | -0.183 | 0.311 | 0.153 | 0.169 |

Documentation of Canadian River and Red River WAM Analyses for PWPA Water Availability

April 6, 2015, Updated October 26, 2015

Page 8 of 20

| Year | Jan | Feb | Mar | Apr | May | Jun | Jul | Aug | Sep | Oct | Nov | Dec |
|------|--------|--------|--------|--------|-------|-------|-------|-------|-------|--------|--------|--------|
| 1977 | 0.197 | 0.270 | 0.553 | 0.335 | 0.088 | 0.732 | 0.832 | 0.106 | 0.491 | 0.422 | 0.295 | 0.255 |
| 1978 | 0.127 | 0.147 | 0.388 | 0.636 | 0.223 | 0.540 | 0.921 | 0.633 | 0.352 | 0.411 | 0.112 | 0.162 |
| 1979 | 0.178 | 0.218 | 0.297 | 0.414 | 0.180 | 0.320 | 0.700 | 0.419 | 0.448 | 0.388 | 0.217 | 0.268 |
| 1980 | 0.041 | 0.156 | 0.202 | 0.442 | 0.207 | 0.608 | 0.975 | 0.812 | 0.532 | 0.494 | 0.177 | 0.116 |
| 1981 | 0.131 | 0.305 | 0.227 | 0.520 | 0.357 | 0.552 | 0.684 | 0.252 | 0.218 | 0.155 | 0.093 | 0.164 |
| 1982 | 0.297 | 0.247 | 0.414 | 0.572 | 0.281 | 0.093 | 0.101 | 0.619 | 0.425 | 0.413 | 0.242 | 0.061 |
| 1983 | 0.040 | -0.039 | 0.170 | 0.406 | 0.398 | 0.497 | 0.834 | 0.743 | 0.688 | 0.204 | 0.204 | 0.072 |
| 1984 | 0.092 | 0.251 | 0.241 | 0.459 | 0.741 | 0.611 | 0.825 | 0.248 | 0.536 | 0.098 | 0.166 | 0.037 |
| 1985 | 0.057 | 0.130 | 0.185 | 0.269 | 0.565 | 0.504 | 0.774 | 0.540 | 0.282 | 0.109 | 0.099 | 0.091 |
| 1986 | 0.228 | 0.165 | 0.443 | 0.589 | 0.473 | 0.158 | 0.710 | 0.504 | 0.272 | 0.116 | 0.042 | 0.051 |
| 1987 | 0.104 | 0.165 | 0.156 | 0.496 | 0.194 | 0.328 | 0.626 | 0.473 | 0.179 | 0.310 | 0.179 | 0.090 |
| 1988 | 0.140 | 0.233 | 0.336 | 0.296 | 0.383 | 0.480 | 0.386 | 0.430 | 0.083 | 0.408 | 0.316 | 0.206 |
| 1989 | 0.197 | 0.265 | 0.468 | 0.583 | 0.336 | 0.240 | 0.692 | 0.483 | 0.415 | 0.445 | 0.341 | 0.022 |
| 1990 | 0.076 | 0.174 | 0.272 | 0.477 | 0.626 | 1.016 | 0.627 | 0.517 | 0.220 | 0.388 | 0.239 | 0.119 |
| 1991 | 0.046 | 0.325 | 0.490 | 0.597 | 0.424 | 0.385 | 0.235 | 0.419 | 0.354 | 0.430 | 0.066 | -0.100 |
| 1992 | 0.088 | 0.218 | 0.417 | 0.258 | 0.361 | 0.108 | 0.606 | 0.073 | 0.542 | 0.474 | 0.134 | 0.040 |
| 1993 | -0.016 | 0.106 | 0.311 | 0.421 | 0.487 | 0.460 | 0.478 | 0.628 | 0.568 | 0.405 | 0.220 | 0.207 |
| 1994 | 0.303 | 0.160 | 0.366 | 0.455 | 0.367 | 0.655 | 0.593 | 0.511 | 0.524 | 0.206 | -0.208 | 0.156 |
| 1995 | 0.108 | 0.259 | 0.410 | 0.400 | 0.097 | 0.340 | 0.572 | 0.716 | 0.256 | 0.425 | 0.308 | 0.101 |
| 1996 | 0.118 | 0.349 | 0.416 | 0.720 | 0.810 | 0.580 | 0.107 | 0.222 | 0.102 | 0.360 | 0.140 | 0.199 |
| 1997 | 0.140 | 0.085 | 0.468 | -0.170 | 0.327 | 0.428 | 0.623 | 0.219 | 0.385 | 0.362 | 0.114 | 0.011 |
| 1998 | 0.124 | 0.069 | 0.220 | 0.484 | 0.589 | 0.967 | 0.586 | 0.469 | 0.561 | 0.039 | 0.173 | 0.157 |
| 1999 | 0.077 | 0.360 | 0.178 | 0.221 | 0.111 | 0.544 | 0.567 | 0.528 | 0.447 | 0.363 | 0.301 | 0.160 |
| 2000 | 0.230 | 0.332 | 0.076 | 0.442 | 0.665 | 0.258 | 0.734 | 0.940 | 0.799 | -0.051 | 0.120 | 0.067 |
| 2001 | 0.059 | 0.048 | 0.081 | 0.626 | 0.336 | 0.693 | 0.929 | 0.558 | 0.492 | 0.461 | 0.167 | 0.200 |
| 2002 | 0.130 | 0.218 | 0.472 | 0.467 | 0.681 | 0.599 | 0.480 | 0.454 | 0.481 | -0.135 | 0.241 | 0.134 |
| 2003 | 0.201 | 0.171 | 0.317 | 0.761 | 0.718 | 0.014 | 0.958 | 0.744 | 0.447 | 0.405 | 0.284 | 0.263 |
| 2004 | 0.208 | 0.144 | 0.334 | 0.407 | 0.865 | 0.108 | 0.583 | 0.507 | 0.190 | 0.303 | -0.094 | 0.172 |
| 2005 | -0.076 | 0.181 | 0.335 | 0.546 | 0.420 | 0.183 | 0.789 | 0.380 | 0.714 | 0.259 | 0.388 | 0.191 |
| 2006 | 0.308 | 0.317 | 0.288 | 0.688 | 0.603 | 0.845 | 0.719 | 0.102 | 0.345 | 0.164 | 0.270 | -0.022 |
| 2007 | 0.054 | 0.395 | -0.142 | 0.270 | 0.357 | 0.492 | 0.573 | 0.593 | 0.186 | 0.494 | 0.288 | 0.039 |
| 2008 | 0.270 | 0.234 | 0.415 | 0.590 | 0.628 | 0.835 | 0.289 | 0.347 | 0.416 | -0.078 | 0.265 | 0.213 |
| 2009 | 0.234 | 0.286 | 0.414 | 0.313 | 0.485 | 0.666 | 0.565 | 0.465 | 0.366 | 0.175 | 0.292 | 0.110 |
| 2010 | 0.062 | -0.056 | 0.211 | 0.369 | 0.495 | 0.642 | 0.411 | 0.334 | 0.525 | 0.382 | 0.114 | 0.121 |
| 2011 | 0.105 | 0.178 | 0.426 | 0.721 | 0.912 | 1.118 | 1.118 | 0.665 | 0.595 | 0.404 | 0.265 | -0.003 |
| 2012 | 0.250 | 0.121 | 0.416 | | | | | | | | | |

Table C-4: 2010 and 2070 Elevation Area Capacity Relationship for Lake Meredith

| 2010 Conditions | | | 2070 Conditions | | |
|-----------------|-----------|------------------|-----------------|-----------|------------------|
| Elevation (ft) | Area (Ac) | Capacity (Ac-Ft) | Elevation (ft) | Area (Ac) | Capacity (Ac-Ft) |
| 2820 | 0 | 0 | 2820 | 0 | 0 |
| 2825 | 398 | 787 | 2825 | 171 | 144 |
| 2830 | 833 | 3,861 | 2830 | 606 | 2,083 |
| 2835 | 1,265 | 9,163 | 2835 | 1,038 | 6,251 |
| 2840 | 1,570 | 16,239 | 2840 | 1,343 | 12,194 |
| 2845 | 1,954 | 25,023 | 2845 | 1,727 | 19,845 |
| 2850 | 2,657 | 36,433 | 2850 | 2,430 | 30,122 |
| 2855 | 3,449 | 51,663 | 2855 | 3,222 | 44,218 |
| 2860 | 4,181 | 70,796 | 2860 | 3,954 | 62,219 |
| 2865 | 4,809 | 93,279 | 2865 | 4,582 | 83,568 |
| 2870 | 5,364 | 118,762 | 2870 | 5,137 | 107,918 |
| 2875 | 5,815 | 146,721 | 2875 | 5,588 | 134,743 |
| 2880 | 6,281 | 176,894 | 2880 | 6,054 | 163,783 |
| 2885 | 6,801 | 209,619 | 2885 | 6,574 | 195,376 |
| 2890 | 8,241 | 245,468 | 2890 | 8,014 | 230,092 |
| 2895 | 8,939 | 288,846 | 2895 | 8,712 | 272,336 |
| 2900 | 10,420 | 335,304 | 2900 | 10,193 | 317,661 |
| 2905 | 11,045 | 388,780 | 2905 | 10,818 | 370,004 |
| 2910 | 11,730 | 445,578 | 2910 | 11,503 | 425,668 |
| 2915 | 12,359 | 505,474 | 2915 | 12,132 | 484,432 |
| 2920 | 13,510 | 568,927 | 2920 | 13,283 | 546,751 |
| 2925 | 14,220 | 637,881 | 2925 | 13,993 | 614,572 |
| 2926 | 14,352 | 652,167 | 2926 | 14,125 | 628,632 |
| 2927 | 14,495 | 666,591 | 2927 | 14,268 | 642,829 |
| 2928 | 14,650 | 681,163 | 2928 | 14,423 | 657,174 |
| 2929 | 14,815 | 695,896 | 2929 | 14,588 | 671,680 |
| 2930 | 15,024 | 710,815 | 2930 | 14,797 | 686,373 |
| 2931 | 15,153 | 725,904 | 2931 | 14,926 | 701,235 |
| 2932 | 15,288 | 741,124 | 2932 | 15,061 | 716,229 |
| 2933 | 15,430 | 756,483 | 2933 | 15,203 | 731,362 |
| 2934 | 15,579 | 771,988 | 2934 | 15,352 | 746,639 |
| 2935 | 15,793 | 787,674 | 2935 | 15,566 | 762,099 |
| 2936 | 16,018 | 803,579 | 2936 | 15,791 | 777,778 |
| 2936.5 | 16,345 | 811,670 | 2936.5 | 16,118 | 785,755 |

1.3 Lake Meredith Yield Results

Model analyses were executed for a repeat of the historical hydrology from January 1940 through March 2012. The model assumes that the reservoir starts full to the top of the usable volume, with a certain diversion target repeated for each year of simulation. This target is then adjusted until the model converges on the reservoir yield. This iteration process was used to determine both the firm yield (volume that can be diverted every year without shortage) and the safe yield (volume that can be diverted every year with one year reserve capacity) for Lake Meredith. Because supplies must be assessed through year 2070, several model runs were performed for estimated sedimentation conditions for years 2010, 2020, 2040, and 2070 to account for any loss of storage capacity over time. Yields for intermediate decades were interpolated from the adjacent models. Results of the Operate model runs for firm and safe yield are shown in Figure C-1 and Table C-5 below.

Figure C-1: Model Reservoir Storage Trace

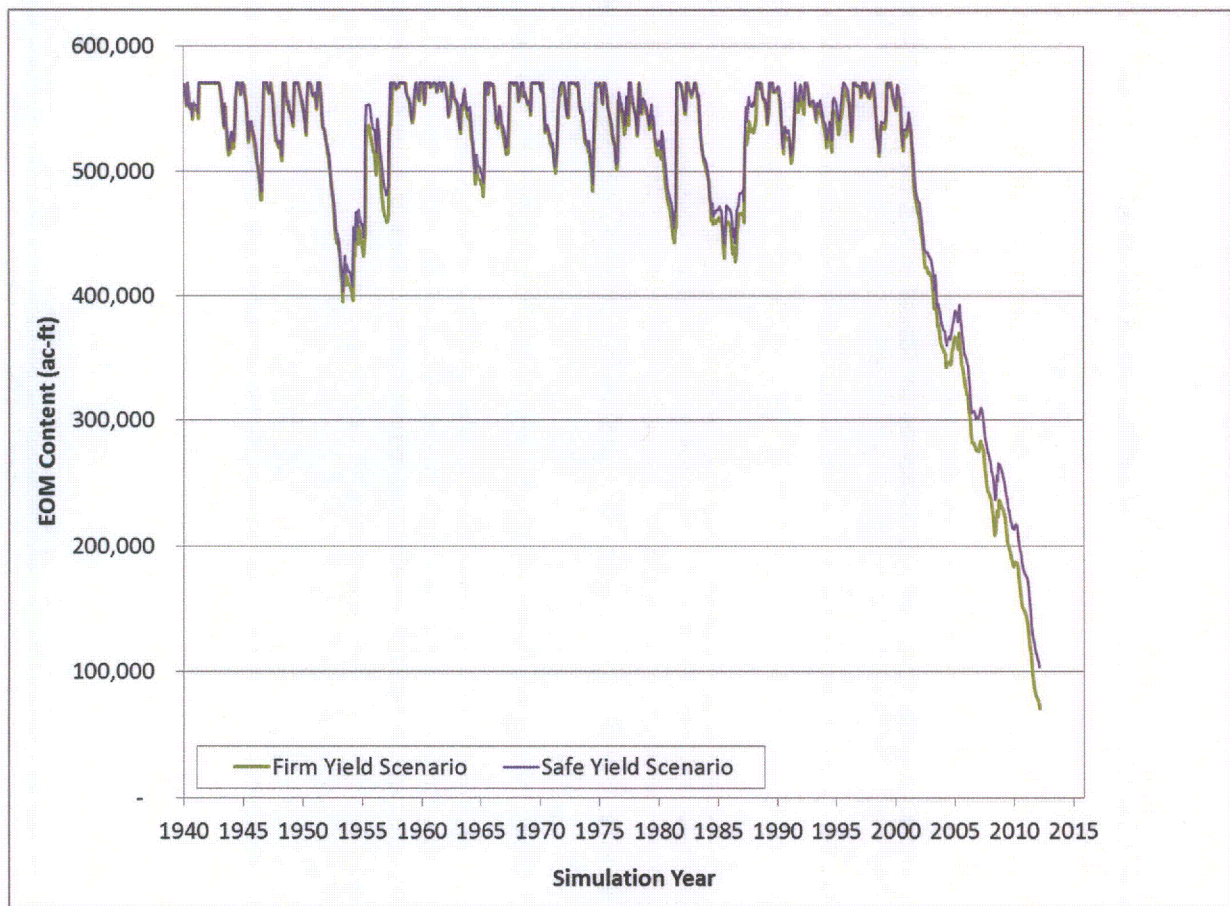


Table C-5: Modeled Lake Meredith Yield

| Scenario | Yield (acre-feet per year) | | | | | | |
|------------|----------------------------|--------|--------|--------|--------|--------|--------|
| | 2010 | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| Firm Yield | 37,505 | 37,584 | 37,662 | 37,739 | 37,811 | 37,835 | 37,956 |
| Safe Yield | 32,928 | 32,974 | 33,024 | 33,073 | 33,128 | 33,146 | 33,238 |

The modeled reservoir storage illustrated in Figure C-1 shows several periods of prolonged decreased reservoir capacity. The first of these corresponds with the drought of the 1950s which is the drought of record for much of the state, with subsequent level drops in the early to mid-1980s. The trend of declining inflows and severity of the ongoing drought are clearly shown as storage declines drastically after the late 1990s, with the minimum reservoir content reached at the end of the simulation.

As shown in Table C-5, the model showed a slight increase in yield over time. This minor variation is due to several factors, including the low yield of the reservoir, minor rounding impacts from area-capacity-elevation curves, and the ability of the 500,000 acre-feet usable capacity to adjust in elevation over time due to sedimentation. As these gains are minor and driven partially by the limitations of the available data, it is recommended that the year 2010 values of firm and safe yield as reflected in Table C-6 be applied for all decades of the planning cycle. The reliable supply shown in Table C-6 was determined in conjunction with CRMWA, and reflects diversions in recent years from Lake Meredith.

Table C-6. Recommended Lake Meredith Yield

| Lake Meredith | Supply (acre-feet per year) | |
|---------------------|-----------------------------|-----------------|
| | 2011 Water Plan | 2016 Water Plan |
| Permitted Diversion | 151,200 | 151,200 |
| Firm Yield | 69,750 | 37,505 |
| Safe Yield | 63,750 | 32,928 |
| Reliable Supply | 50,000 | 0 ¹ |

1. Determined in conjunction with CRMWA, dependent on the CRMWA supply allocation process.

Table C-6 shows a significant decrease in reservoir yield and reliable supply from previous estimates. This is consistent with current observations and operations.


2.1 Greenbelt Reservoir

In the Red River Basin, the Greenbelt Municipal and Industrial Water Authority completed a water supply study for Greenbelt Reservoir¹. This study used reservoir-specific data through June 2011 to calculate inflows and reservoir yield. By extending the hydrology it was possible to develop a more accurate supply availability due to the impacts of the ongoing drought. The findings of this study were the basis for the yield of Greenbelt Reservoir in the 2016 Panhandle Water Plan.

2.2 Hydrology for Greenbelt Reservoir

New hydrology was developed for the historical period of the reservoir (9/1967 to 6/2011). This hydrology is based on a mass-balance analysis of the reservoir, using the most recent evaporation and precipitation from the Texas Water Development Board and updated area-capacity data. Hydrology prior to the historical period is from previous studies. The pre-reservoir hydrology is based on data from two gages. The June 1960 to September 1964 flows are from the Salt Fork Red River near Clarendon gage (USGS 07299850), which was located at the current dam site. Flows prior to June 1960 and from October 1964 to August 1967 are based on the Wellington gage. As shown in Figure C-2, the flows based on the Wellington gage have much more year-to-year variation than the mass balance and Clarendon gage flows. The extended inflows are shown in Table C-7 and the extended net evaporation is shown in Table C-8.

Figure C-2 Historical Inflows to Greenbelt Reservoir

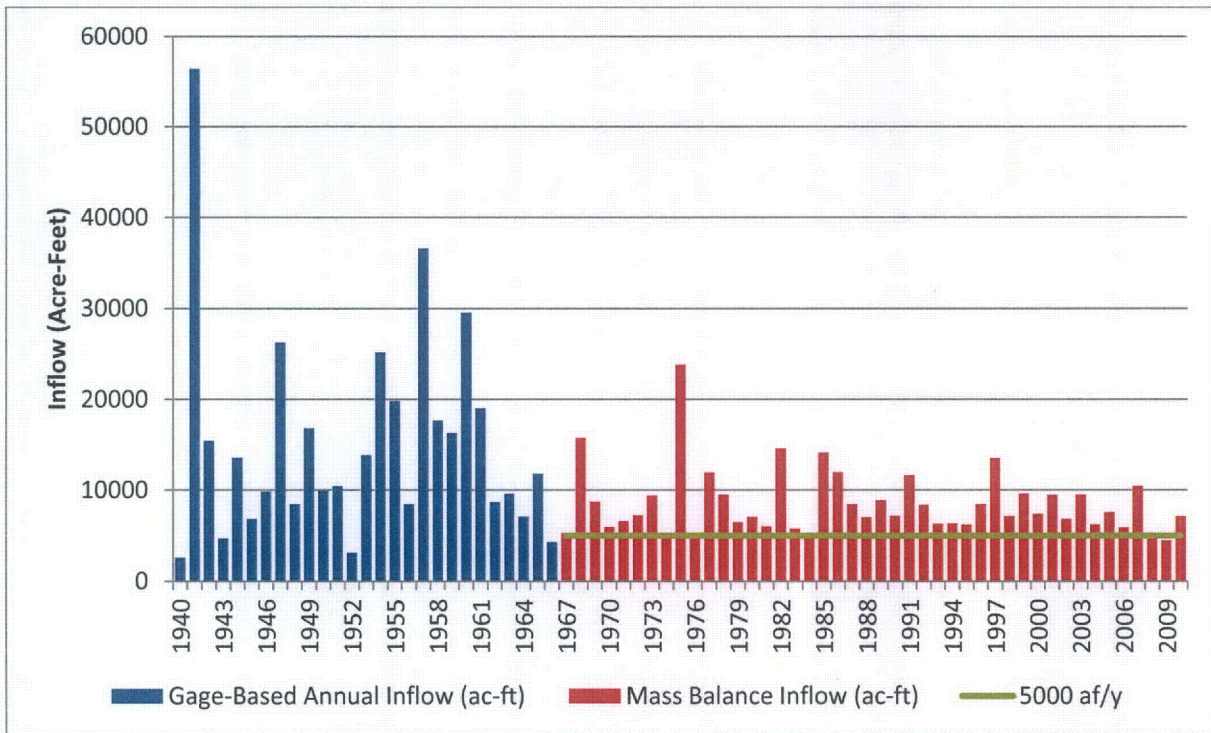

¹ Freese and Nichols Inc. *Assessment of Potential Water Supplies*, prepared for the Greenbelt Municipal and Industrial Water Authority. December 2011.

Table C-7: Extended Inflow to Greenbelt Reservoir

-Values in Acre-Feet-

| Year | Jan | Feb | Mar | Apr | May | Jun | Jul | Aug | Sep | Oct | Nov | Dec |
|------|-------|-------|-------|-------|--------|--------|-------|-------|-------|-------|-------|-------|
| 1940 | 0 | 400 | 0 | 420 | 200 | 20 | 420 | 360 | 260 | 0 | 390 | 100 |
| 1941 | 170 | 580 | 510 | 4,650 | 13,480 | 22,880 | 2,290 | 1,910 | 1,160 | 6,700 | 1,000 | 1,090 |
| 1942 | 910 | 530 | 940 | 3,880 | 660 | 750 | 140 | 130 | 310 | 5,170 | 510 | 1,470 |
| 1943 | 970 | 350 | 270 | 660 | 1,560 | 460 | 30 | 0 | 0 | 0 | 0 | 400 |
| 1944 | 1,510 | 570 | 1,400 | 280 | 240 | 5,410 | 1,800 | 220 | 230 | 330 | 350 | 1,230 |
| 1945 | 1,030 | 580 | 1,310 | 1,010 | 140 | 1,480 | 1,230 | 80 | 0 | 0 | 0 | 0 |
| 1946 | 660 | 550 | 290 | 920 | 480 | 160 | 90 | 200 | 790 | 4,640 | 550 | 530 |
| 1947 | 720 | 180 | 620 | 1,530 | 17,060 | 5,060 | 850 | 10 | 0 | 140 | 40 | 80 |
| 1948 | 100 | 1,070 | 1,670 | 50 | 1,300 | 4,050 | 70 | 20 | 0 | 0 | 40 | 80 |
| 1949 | 580 | 2,620 | 700 | 490 | 8,870 | 1,890 | 110 | 130 | 540 | 290 | 170 | 440 |
| 1950 | 620 | 640 | 210 | 240 | 270 | 900 | 2,610 | 1,200 | 2,320 | 220 | 170 | 530 |
| 1951 | 590 | 400 | 350 | 330 | 5,050 | 1,330 | 1,770 | 0 | 20 | 260 | 160 | 210 |
| 1952 | 480 | 330 | 340 | 1,020 | 230 | 0 | 40 | 20 | 40 | 80 | 350 | 210 |
| 1953 | 170 | 270 | 370 | 510 | 160 | 30 | 9,190 | 940 | 110 | 1,380 | 320 | 400 |
| 1954 | 470 | 240 | 150 | 720 | 10,340 | 11,840 | 130 | 870 | 80 | 100 | 110 | 120 |
| 1955 | 270 | 300 | 100 | 80 | 6,050 | 9,730 | 620 | 160 | 70 | 1,950 | 130 | 360 |
| 1956 | 370 | 350 | 110 | 80 | 6,610 | 90 | 220 | 20 | 30 | 480 | 40 | 60 |
| 1957 | 100 | 220 | 780 | 7,610 | 22,510 | 1,260 | 80 | 2,390 | 270 | 520 | 690 | 210 |
| 1958 | 690 | 450 | 970 | 660 | 6,800 | 1,720 | 4,970 | 70 | 610 | 110 | 180 | 450 |
| 1959 | 570 | 340 | 110 | 310 | 5,220 | 910 | 4,330 | 50 | 840 | 1,630 | 380 | 1,580 |
| 1960 | 1,870 | 1,350 | 1,800 | 140 | 1,450 | 10,290 | 1,210 | 1,450 | 740 | 7,310 | 660 | 1,270 |
| 1961 | 730 | 1,140 | 1,280 | 830 | 540 | 6,290 | 2,860 | 670 | 390 | 1,960 | 1,640 | 670 |
| 1962 | 540 | 740 | 690 | 790 | 750 | 1,930 | 450 | 940 | 290 | 350 | 640 | 610 |
| 1963 | 300 | 1,300 | 700 | 300 | 200 | 500 | 0 | 3,200 | 1,300 | 500 | 600 | 700 |
| 1964 | 1,000 | 1,100 | 700 | 300 | 400 | 1,300 | 100 | 0 | 700 | 200 | 700 | 600 |
| 1965 | 500 | 400 | 300 | 300 | 200 | 7,800 | 200 | 100 | 300 | 800 | 300 | 600 |
| 1966 | 600 | 700 | 200 | 300 | 200 | 200 | 200 | 800 | 400 | 200 | 200 | 300 |
| 1967 | 200 | 200 | 200 | 700 | 200 | 200 | 300 | 100 | 1,000 | 1,414 | 361 | 407 |
| 1968 | 707 | 388 | 855 | 712 | 1,155 | 4,139 | 165 | 6,540 | 365 | 229 | 235 | 264 |
| 1969 | 635 | 518 | 690 | 525 | 2,469 | 1,304 | 124 | 782 | 560 | 504 | 113 | 533 |
| 1970 | 539 | 393 | 402 | 3,155 | 343 | 203 | 97 | 188 | 58 | 29 | 227 | 325 |
| 1971 | 516 | 484 | 535 | 357 | 205 | 245 | 0 | 754 | 647 | 1,069 | 1,302 | 474 |
| 1972 | 316 | 515 | 493 | 321 | 1,482 | 1,542 | 1,331 | 167 | 21 | 41 | 455 | 570 |
| 1973 | 568 | 574 | 1,265 | 2,384 | 499 | 1,127 | 335 | 0 | 1,802 | 317 | 229 | 279 |
| 1974 | 807 | 653 | 568 | 482 | 269 | 383 | 120 | 589 | 117 | 478 | 286 | 432 |
| 1975 | 362 | 486 | 409 | 491 | 12,415 | 9,284 | 0 | 0 | 0 | 0 | 0 | 356 |
| 1976 | 296 | 644 | 378 | 699 | 591 | 0 | 35 | 340 | 1,303 | 38 | 246 | 476 |

Documentation of Canadian River and Red River WAM Analyses for PWPA Water Availability

April 6, 2015, Updated October 26, 2015

Page 14 of 20 ✓

| Year | Jan | Feb | Mar | Apr | May | Jun | Jul | Aug | Sep | Oct | Nov | Dec |
|------|-----|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-----|
| 1977 | 460 | 817 | 350 | 1,317 | 6,489 | 452 | 471 | 476 | 176 | 159 | 262 | 495 |
| 1978 | 423 | 796 | 532 | 504 | 4,309 | 1,271 | 170 | 0 | 387 | 252 | 431 | 418 |
| 1979 | 637 | 345 | 971 | 563 | 608 | 901 | 366 | 272 | 615 | 470 | 293 | 444 |
| 1980 | 398 | 638 | 678 | 1,044 | 723 | 610 | 256 | 2,712 | 0 | 0 | 0 | 0 |
| 1981 | 0 | 0 | 352 | 627 | 537 | 1,381 | 139 | 780 | 562 | 594 | 566 | 472 |
| 1982 | 383 | 497 | 716 | 593 | 2,267 | 4,502 | 3,997 | 370 | 105 | 213 | 435 | 472 |
| 1983 | 740 | 821 | 816 | 620 | 331 | 1,201 | 193 | 0 | 287 | 291 | 225 | 264 |
| 1984 | 769 | 655 | 700 | 694 | 233 | 1,180 | 164 | 0 | 0 | 0 | 262 | 699 |
| 1985 | 388 | 1,223 | 1,134 | 1,252 | 538 | 1,282 | 485 | 627 | 821 | 5,555 | 368 | 422 |
| 1986 | 679 | 788 | 909 | 476 | 891 | 748 | 244 | 745 | 1,176 | 2,781 | 1,762 | 789 |
| 1987 | 840 | 883 | 993 | 889 | 1,648 | 441 | 270 | 520 | 548 | 344 | 345 | 750 |
| 1988 | 792 | 642 | 903 | 810 | 733 | 907 | 250 | 117 | 545 | 350 | 392 | 573 |
| 1989 | 609 | 535 | 944 | 578 | 659 | 3,006 | 5 | 763 | 506 | 355 | 505 | 418 |
| 1990 | 629 | 680 | 616 | 2,061 | 1,349 | 384 | 0 | 269 | 359 | 264 | 305 | 276 |
| 1991 | 650 | 592 | 615 | 723 | 1,366 | 1,210 | 2,127 | 969 | 1,177 | 492 | 834 | 904 |
| 1992 | 663 | 778 | 1,080 | 816 | 557 | 2,042 | 543 | 122 | 192 | 378 | 464 | 748 |
| 1993 | 803 | 680 | 825 | 799 | 773 | 386 | 84 | 423 | 193 | 270 | 568 | 495 |
| 1994 | 669 | 606 | 859 | 947 | 908 | 353 | 363 | 783 | 0 | 0 | 427 | 440 |
| 1995 | 333 | 340 | 645 | 582 | 552 | 1,673 | 311 | 271 | 88 | 317 | 588 | 549 |
| 1996 | 563 | 664 | 491 | 1,047 | 0 | 583 | 992 | 1,449 | 851 | 503 | 622 | 692 |
| 1997 | 685 | 801 | 799 | 6,931 | 1,221 | 729 | 267 | 220 | 213 | 445 | 540 | 649 |
| 1998 | 810 | 777 | 1,560 | 757 | 704 | 276 | 225 | 101 | 110 | 650 | 712 | 450 |
| 1999 | 0 | 1,161 | 1,192 | 1,209 | 2,642 | 1,288 | 1,042 | 0 | 0 | 0 | 407 | 664 |
| 2000 | 571 | 612 | 0 | 1,639 | 392 | 2,313 | 259 | 106 | 53 | 475 | 414 | 556 |
| 2001 | 794 | 857 | 735 | 438 | 2,841 | 315 | 160 | 694 | 415 | 55 | 1,841 | 330 |
| 2002 | 538 | 420 | 303 | 968 | 442 | 506 | 407 | 334 | 501 | 1,383 | 434 | 619 |
| 2003 | 625 | 427 | 703 | 629 | 338 | 1,759 | 540 | 354 | 2,750 | 354 | 474 | 555 |
| 2004 | 680 | 753 | 1,126 | 963 | 289 | 373 | 293 | 20 | 111 | 447 | 562 | 632 |
| 2005 | 731 | 614 | 884 | 894 | 567 | 2,778 | 0 | 0 | 0 | 140 | 412 | 559 |
| 2006 | 619 | 480 | 661 | 355 | 412 | 487 | 266 | 782 | 379 | 224 | 393 | 832 |
| 2007 | 824 | 567 | 2,660 | 1,002 | 2,604 | 672 | 275 | 141 | 59 | 322 | 664 | 694 |
| 2008 | 521 | 558 | 677 | 679 | 128 | 285 | 68 | 754 | 0 | 491 | 407 | 505 |
| 2009 | 471 | 494 | 679 | 560 | 398 | 339 | 42 | 181 | 182 | 384 | 411 | 352 |
| 2010 | 448 | 632 | 609 | 1,335 | 909 | 359 | 1,365 | 0 | 237 | 351 | 436 | 448 |
| 2011 | 386 | 439 | 299 | 0 | 0 | 0 | | | | | | |

Table C-8: Extended Net Evaporation at Greenbelt Reservoir

-Values in Feet-

| Year | Jan | Feb | Mar | Apr | May | Jun | Jul | Aug | Sep | Oct | Nov | Dec |
|------|-------|-------|-------|-------|-------|-------|-------|------|------|-------|-------|-------|
| 1940 | 0.07 | 0.14 | 0.47 | 0.31 | 0.42 | 0.60 | 0.96 | 0.57 | 0.63 | 0.51 | 0.05 | 0.18 |
| 1941 | 0.10 | 0.05 | 0.11 | 0.19 | -0.12 | 0.02 | 0.42 | 0.40 | 0.35 | -0.26 | 0.23 | 0.14 |
| 1942 | 0.17 | 0.21 | 0.31 | 0.02 | 0.48 | 0.35 | 0.67 | 0.39 | 0.32 | -0.04 | 0.37 | 0.04 |
| 1943 | 0.21 | 0.30 | 0.33 | 0.35 | 0.23 | 0.58 | 0.53 | 0.94 | 0.59 | 0.48 | 0.28 | -0.03 |
| 1944 | -0.02 | 0.10 | 0.33 | 0.36 | 0.34 | 0.50 | 0.47 | 0.60 | 0.36 | 0.29 | 0.22 | -0.03 |
| 1945 | 0.06 | 0.14 | 0.28 | 0.19 | 0.62 | 0.61 | 0.52 | 0.52 | 0.44 | 0.27 | 0.34 | 0.20 |
| 1946 | -0.12 | 0.18 | 0.32 | 0.46 | 0.46 | 0.52 | 0.80 | 0.56 | 0.18 | 0.04 | 0.14 | 0.15 |
| 1947 | 0.18 | 0.27 | 0.25 | 0.18 | -0.04 | 0.57 | 0.76 | 0.79 | 0.81 | 0.48 | 0.17 | 0.12 |
| 1948 | 0.12 | -0.02 | 0.21 | 0.50 | 0.37 | 0.45 | 0.56 | 0.42 | 0.65 | 0.40 | 0.29 | 0.36 |
| 1949 | -0.09 | 0.12 | 0.26 | 0.20 | 0.03 | 0.32 | 0.52 | 0.49 | 0.37 | 0.28 | 0.36 | 0.17 |
| 1950 | 0.24 | 0.20 | 0.42 | 0.38 | 0.35 | 0.35 | -0.05 | 0.34 | 0.05 | 0.50 | 0.38 | 0.24 |
| 1951 | 0.18 | 0.13 | 0.34 | 0.39 | 0.01 | 0.38 | 0.79 | 0.86 | 0.66 | 0.50 | 0.26 | 0.28 |
| 1952 | 0.23 | 0.28 | 0.35 | 0.20 | 0.49 | 0.87 | 0.79 | 0.99 | 0.83 | 0.78 | 0.33 | 0.17 |
| 1953 | 0.28 | 0.28 | 0.41 | 0.48 | 0.64 | 0.91 | 0.71 | 0.63 | 0.94 | 0.15 | 0.25 | 0.14 |
| 1954 | 0.14 | 0.34 | 0.38 | 0.29 | -0.13 | 0.56 | 0.69 | 0.48 | 0.65 | 0.40 | 0.34 | 0.25 |
| 1955 | 0.11 | 0.19 | 0.41 | 0.58 | -0.06 | 0.22 | 0.57 | 0.55 | 0.35 | 0.29 | 0.35 | 0.22 |
| 1956 | 0.17 | 0.08 | 0.50 | 0.57 | 0.30 | 0.64 | 0.60 | 0.73 | 0.71 | 0.45 | 0.31 | 0.22 |
| 1957 | 0.15 | 0.11 | 0.07 | -0.02 | -0.16 | 0.30 | 0.79 | 0.41 | 0.43 | 0.01 | 0.05 | 0.25 |
| 1958 | 0.03 | 0.09 | -0.08 | 0.13 | 0.08 | 0.43 | 0.22 | 0.51 | 0.22 | 0.34 | 0.20 | 0.14 |
| 1959 | 0.16 | 0.19 | 0.40 | 0.33 | 0.03 | 0.27 | 0.28 | 0.48 | 0.48 | 0.08 | 0.23 | -0.22 |
| 1960 | -0.01 | 0.01 | 0.18 | 0.36 | 0.29 | 0.09 | 0.03 | 0.32 | 0.14 | -0.21 | 0.27 | 0.05 |
| 1961 | 0.07 | 0.04 | 0.06 | 0.42 | 0.33 | 0.09 | 0.17 | 0.39 | 0.34 | 0.33 | -0.01 | 0.13 |
| 1962 | 0.04 | 0.25 | 0.38 | 0.27 | 0.52 | 0.04 | 0.26 | 0.53 | 0.09 | 0.28 | 0.17 | 0.12 |
| 1963 | 0.06 | 0.18 | 0.46 | 0.55 | 0.32 | 0.28 | 0.66 | 0.36 | 0.32 | 0.46 | 0.25 | 0.06 |
| 1964 | 0.11 | 0.00 | 0.36 | 0.60 | 0.44 | 0.48 | 0.83 | 0.60 | 0.22 | 0.38 | 0.06 | 0.07 |
| 1965 | 0.10 | 0.13 | 0.13 | 0.39 | 0.32 | -0.09 | 0.69 | 0.46 | 0.23 | 0.23 | 0.30 | 0.17 |
| 1966 | 0.03 | -0.01 | 0.45 | 0.29 | 0.48 | 0.42 | 0.70 | 0.14 | 0.21 | 0.46 | 0.42 | 0.13 |
| 1967 | 0.09 | 0.14 | 0.44 | 0.37 | 0.34 | 0.29 | 0.34 | 0.50 | 0.32 | 0.51 | 0.22 | 0.09 |
| 1968 | -0.10 | -0.02 | 0.20 | 0.35 | 0.05 | 0.38 | 0.38 | 0.28 | 0.49 | 0.38 | 0.12 | 0.04 |
| 1969 | 0.06 | 0.04 | 0.05 | 0.42 | 0.10 | 0.40 | 0.62 | 0.42 | 0.12 | 0.09 | 0.19 | 0.02 |
| 1970 | 0.09 | 0.16 | 0.06 | 0.28 | 0.52 | 0.60 | 0.60 | 0.54 | 0.43 | 0.25 | 0.18 | 0.17 |
| 1971 | 0.24 | 0.14 | 0.34 | 0.45 | 0.43 | 0.46 | 0.55 | 0.30 | 0.06 | 0.17 | 0.11 | 0.04 |
| 1972 | 0.16 | 0.26 | 0.50 | 0.50 | 0.08 | 0.35 | 0.40 | 0.41 | 0.31 | 0.15 | -0.01 | 0.19 |
| 1973 | 0.06 | 0.09 | -0.17 | -0.03 | 0.30 | 0.47 | 0.38 | 0.57 | 0.11 | 0.32 | 0.26 | 0.26 |
| 1974 | 0.19 | 0.36 | 0.26 | 0.54 | 0.34 | 0.58 | 0.87 | 0.19 | 0.03 | 0.04 | 0.17 | 0.10 |
| 1975 | 0.05 | -0.01 | 0.18 | 0.34 | 0.11 | 0.35 | 0.17 | 0.46 | 0.27 | 0.51 | 0.06 | 0.16 |
| 1976 | 0.25 | 0.37 | 0.38 | 0.20 | 0.30 | 0.51 | 0.46 | 0.61 | 0.17 | 0.26 | 0.22 | 0.24 |

Documentation of Canadian River and Red River WAM Analyses for PWPA Water Availability

April 6, 2015, Updated October 26, 2015

Page 16 of 20

| Year | Jan | Feb | Mar | Apr | May | Jun | Jul | Aug | Sep | Oct | Nov | Dec |
|------|------|------|-------|-------|-------|-------|------|------|------|-------|-------|-------|
| 1977 | 0.10 | 0.20 | 0.46 | 0.14 | -0.07 | 0.52 | 0.76 | 0.25 | 0.57 | 0.39 | 0.30 | 0.29 |
| 1978 | 0.06 | 0.05 | 0.38 | 0.59 | -0.05 | 0.36 | 0.77 | 0.61 | 0.23 | 0.40 | 0.08 | 0.21 |
| 1979 | 0.04 | 0.08 | 0.10 | 0.29 | 0.16 | 0.20 | 0.39 | 0.34 | 0.47 | 0.46 | 0.19 | 0.20 |
| 1980 | 0.09 | 0.18 | 0.34 | 0.40 | 0.07 | 0.65 | 0.99 | 0.73 | 0.38 | 0.47 | 0.19 | 0.15 |
| 1981 | 0.19 | 0.24 | 0.22 | 0.41 | 0.29 | 0.56 | 0.52 | 0.32 | 0.35 | 0.07 | 0.22 | 0.22 |
| 1982 | 0.19 | 0.16 | 0.40 | 0.48 | 0.04 | 0.09 | 0.36 | 0.60 | 0.53 | 0.45 | 0.22 | 0.05 |
| 1983 | 0.05 | 0.01 | 0.21 | 0.34 | 0.28 | 0.36 | 0.88 | 0.75 | 0.60 | 0.05 | 0.24 | 0.07 |
| 1984 | 0.15 | 0.33 | 0.22 | 0.48 | 0.56 | 0.40 | 0.64 | 0.39 | 0.58 | 0.25 | 0.19 | -0.01 |
| 1985 | 0.07 | 0.09 | 0.15 | 0.36 | 0.40 | 0.17 | 0.60 | 0.52 | 0.22 | 0.00 | 0.15 | 0.00 |
| 1986 | 0.31 | 0.22 | 0.51 | 0.44 | 0.26 | 0.25 | 0.82 | 0.21 | 0.17 | -0.10 | 0.04 | 0.08 |
| 1987 | 0.10 | 0.04 | 0.22 | 0.51 | 0.00 | 0.31 | 0.63 | 0.39 | 0.19 | 0.37 | 0.23 | 0.00 |
| 1988 | 0.09 | 0.21 | 0.19 | 0.27 | 0.37 | 0.43 | 0.40 | 0.52 | 0.13 | 0.37 | 0.31 | 0.26 |
| 1989 | 0.20 | 0.08 | 0.37 | 0.47 | 0.09 | -0.03 | 0.58 | 0.27 | 0.27 | 0.49 | 0.48 | 0.17 |
| 1990 | 0.11 | 0.05 | 0.11 | 0.15 | 0.24 | 0.71 | 0.55 | 0.51 | 0.33 | 0.33 | 0.12 | 0.13 |
| 1991 | 0.09 | 0.28 | 0.47 | 0.60 | 0.34 | 0.45 | 0.61 | 0.60 | 0.25 | 0.57 | 0.17 | 0.06 |
| 1992 | 0.08 | 0.24 | 0.34 | 0.27 | 0.14 | 0.03 | 0.58 | 0.40 | 0.57 | 0.49 | 0.12 | 0.14 |
| 1993 | 0.07 | 0.15 | 0.29 | 0.47 | 0.40 | 0.56 | 0.69 | 0.65 | 0.65 | 0.48 | 0.32 | 0.25 |
| 1994 | 0.25 | 0.21 | 0.34 | 0.38 | 0.37 | 0.84 | 0.68 | 0.76 | 0.57 | 0.43 | 0.32 | 0.20 |
| 1995 | 0.00 | 0.00 | 0.37 | 0.36 | 0.02 | 0.25 | 0.49 | 0.34 | 0.05 | 0.50 | 0.40 | 0.30 |
| 1996 | 0.27 | 0.40 | 0.48 | 0.68 | 0.44 | 0.40 | 0.24 | 0.25 | 0.09 | 0.39 | 0.26 | 0.37 |
| 1997 | 0.22 | 0.09 | 0.56 | -0.25 | 0.15 | 0.31 | 0.60 | 0.29 | 0.33 | 0.29 | 0.24 | -0.03 |
| 1998 | 0.22 | 0.04 | 0.22 | 0.48 | 0.48 | 0.91 | 0.77 | 0.48 | 0.61 | 0.11 | 0.10 | 0.14 |
| 1999 | 0.17 | 0.29 | 0.15 | 0.29 | 0.15 | 0.38 | 0.64 | 0.52 | 0.32 | 0.46 | 0.44 | 0.33 |
| 2000 | 0.26 | 0.33 | 0.12 | 0.37 | 0.54 | 0.02 | 0.67 | 0.81 | 0.78 | 0.06 | 0.26 | 0.15 |
| 2001 | 0.05 | 0.09 | 0.05 | 0.35 | 0.09 | 0.76 | 0.93 | 0.48 | 0.45 | 0.53 | 0.04 | 0.00 |
| 2002 | 0.15 | 0.02 | 0.11 | 0.37 | 0.51 | 0.58 | 0.48 | 0.58 | 0.43 | -0.17 | 0.17 | -0.07 |
| 2003 | 0.19 | 0.13 | 0.37 | 0.52 | 0.50 | 0.06 | 0.90 | 0.65 | 0.37 | 0.40 | 0.35 | 0.34 |
| 2004 | 0.17 | 0.21 | 0.25 | 0.16 | 0.62 | 0.13 | 0.49 | 0.39 | 0.38 | 0.06 | -0.17 | 0.28 |
| 2005 | 0.08 | 0.12 | 0.29 | 0.38 | 0.20 | 0.48 | 0.59 | 0.26 | 0.55 | 0.30 | 0.47 | 0.39 |
| 2006 | 0.48 | 0.38 | 0.36 | 0.51 | 0.41 | 0.72 | 0.68 | 0.28 | 0.27 | 0.26 | 0.36 | -0.02 |
| 2007 | 0.17 | 0.33 | -0.05 | 0.26 | 0.04 | 0.21 | 0.49 | 0.49 | 0.27 | 0.60 | 0.69 | 0.20 |
| 2008 | 0.21 | 0.29 | 0.49 | 0.56 | 0.31 | 0.50 | 0.54 | 0.30 | 0.18 | 0.07 | 0.42 | 0.37 |
| 2009 | 0.31 | 0.34 | 0.45 | 0.31 | 0.39 | 0.44 | 0.52 | 0.44 | 0.32 | 0.23 | 0.41 | 0.11 |
| 2010 | 0.06 | 0.08 | 0.27 | 0.13 | 0.28 | 0.55 | 0.22 | 0.54 | 0.47 | 0.39 | 0.41 | 0.33 |
| 2011 | 0.13 | 0.16 | 0.28 | 0.35 | 0.26 | 0.40 | | | | | | |

Area-capacity information is based on the original curve for the reservoir, adjusted for sedimentation over time. (Since there has not been a volumetric survey conducted of the reservoir, the accuracy of the original area-capacity curve is uncertain.) The reservoir has never filled and storage has varied somewhat over time. As a result, instead of the common assumption of uniform distribution of sediment, it was assumed that the sediment distribution was based on the amount of time a particular elevation slice was inundated. New area-capacity curves were developed for 1976, 1986, 1996 and 2011. These curves were used in the mass balance analysis. The 2011 and 2070 curves were used in the yield modeling and are shown in Table C-9.

Table C-9: 2011 and 2070 Elevation Area Capacity Relationship for Greenbelt Reservoir

| 2011 Condition | | | 2070 Condition | | |
|----------------|-----------|------------------|----------------|-----------|------------------|
| Elevation (ft) | Area (Ac) | Capacity (Ac-Ft) | Elevation (ft) | Area (Ac) | Capacity (Ac-Ft) |
| 2600 | 0 | 0 | 2600 | 0 | 0 |
| 2605 | 59 | 108 | 2605 | 0 | 0 |
| 2610 | 159 | 656 | 2610 | 0 | 0 |
| 2615 | 246 | 1,663 | 2615 | 0 | 0 |
| 2620 | 332 | 3,093 | 2620 | 0 | 0 |
| 2625 | 452 | 5,044 | 2625 | 89 | 160 |
| 2630 | 598 | 7,661 | 2630 | 235 | 957 |
| 2635 | 738 | 11,013 | 2635 | 390 | 2,522 |
| 2640 | 938 | 15,151 | 2640 | 671 | 5,072 |
| 2645 | 1,176 | 20,447 | 2645 | 1,018 | 9,331 |
| 2650 | 1,417 | 26,899 | 2650 | 1,369 | 15,224 |
| 2651 | 1,467 | 28,341 | 2651 | 1,432 | 16,625 |
| 2652 | 1,513 | 29,832 | 2652 | 1,496 | 18,088 |
| 2653 | 1,556 | 31,366 | 2653 | 1,543 | 19,608 |
| 2654 | 1,599 | 32,943 | 2654 | 1,594 | 21,177 |
| 2655 | 1,640 | 34,562 | 2655 | 1,638 | 22,793 |
| 2656 | 1,675 | 36,219 | 2656 | 1,675 | 24,449 |
| 2657 | 1,715 | 37,914 | 2657 | 1,715 | 26,144 |
| 2658 | 1,760 | 39,652 | 2658 | 1,760 | 27,882 |
| 2659 | 1,800 | 41,432 | 2659 | 1,800 | 29,662 |
| 2660 | 1,835 | 43,249 | 2660 | 1,835 | 31,479 |
| 2661 | 1,870 | 45,102 | 2661 | 1,870 | 33,332 |
| 2662 | 1,910 | 46,992 | 2662 | 1,910 | 35,222 |
| 2663 | 1,950 | 48,922 | 2663 | 1,950 | 37,152 |
| 2664 | 1,990 | 50,892 | 2664 | 1,990 | 39,122 |

2.3 Greenbelt Reservoir Yield Analyses

Computer simulations were performed to determine the reliable supply, or yield, of Greenbelt Reservoir. These computer runs used an Excel-based reservoir operation model. The model used historical hydrologic data (inflows, evaporation and precipitation) and relevant reservoir data (area-capacity relationships, storage, and diversions) to simulate the behavior of the reservoir during a repeat of historical hydrologic conditions. The hydrology used in the studies covers the period from January 1940 to June 2011. The currently available conservation storage volume in the reservoir was estimated to be 50,892 acre-feet (this volume is less than the permitted volume due to sediment accumulation over time).

These runs determined both the firm yield and safe yield of the reservoir. Firm yield is defined as the largest diversion from the reservoir that does not result in a shortage during the simulation period. The minimum storage in the reservoir for a firm yield run is close to zero. Safe yield is a more conservative estimate of the reliable supply from the reservoir. Safe yield assumes that a minimum volume equal to one year's diversion from the reservoir is maintained throughout the simulation period.

Because Greenbelt Reservoir is at historical lows, GMIWA was concerned about the reliability of supplies. Yield runs show what would happen in a repeat of historical hydrologic conditions. However, since these yield runs also reach their minimum storage in 2011 they are not necessarily a good predictor of what the future conditions might be in the reservoir.

In order to evaluate the potential near-term reliability of supplies, the reservoir operation model developed for the yield studies was modified to begin with current conditions and step through the historical hydrology in five year increments. This type of modeling is referred to as Conditional Reliability Modeling. The model began with the storage at the end of June 2011 (7,316 acre-feet) and first runs the hydrology from July 1940 to June 1945. The next step again starts with storage of 7,316 acre-feet and runs the hydrology from July 1941 to June 1946. These steps were repeated until the last five-year period of the available hydrology, July 2006 to June 2011, a total of 67 iterations. The model was run with the average recent demand of 3,850 acre-feet per year with and without downstream releases, as well as at the safe yield of the reservoir.

The CRM yield was used as the baseline 2020 condition with the safe yield representing the 2070 condition. The firm yields were determined as described in the paragraph above. Table C-10 below shows the results of the various analyses.

Table C-10: Greenbelt Reservoir Availability and Yield

| Year | CRM and Safe Yield (Acre-Foot/ Year) | Firm Yield (Acre- Feet/ Year) |
|------|---|----------------------------------|
| 2020 | 3,850 | 5,362 |
| 2030 | 3,782 | 5,237 |
| 2040 | 3,714 | 5,112 |
| 2050 | 3,646 | 4,987 |
| 2060 | 3,578 | 4,862 |
| 2070 | 3,440 | 4,738 |

3.1 Palo Duro Reservoir

The Palo Duro Reservoir located in Hansford County is owned by the Palo Duro River Authority. Palo Duro Reservoir is not currently used as a water supply, but is included in the 2016 Panhandle Water Plan as an alternative strategy. For water supplies from the Palo Duro Reservoir, the yields from the 2011 Panhandle Water Plan were used since the hydrology from the Canadian WAM has not been extended and no new water rights have been granted in the Canadian Basin. The yield for 2070 was extrapolated from 2060 using a straight line interpolation of reservoir yields. The availability in 2020 is 3,917 acre-feet per year decreasing to 3,708 acre-feet per year in 2070.

4.1 Canadian River and Red River Run-of-River Diversions

The annual supply for the run-of-river water rights were determined using the TCEQ WAMs, Run 3. Run-of-river supplies are reported individually for municipal water rights and irrigation and/or industrial rights greater than 10,000 acre-feet /year. Smaller non-municipal water rights are aggregated by county. In the PWPA there are no individually reported run-of-river water rights. All run-of-river water rights are aggregated irrigation water rights. The reliable supply from these rights are estimated using the minimum annual diversion reported by the WAM analysis. This is considered a reasonable approach to reliable supplies for these water rights given the monthly time-step of the WAM and the uncertainty of the diversions. Some of these rights include storage and may also be supplemented with other sources of water, such as groundwater. There is no direct connection between the aggregated irrigation water demand by county and an individual irrigation water right. Therefore, evaluating water reliability as if such direct relationship existed is not practical. The following subsections discuss the run-of-river rights in the PWPA by river basin.

Canadian River Basin

The run-of-river flows for the Canadian River Basin were determined by using the TCEQ WAM Run 3 downloaded October 21, 2014. The flows were determined as the minimum annual diversion from the river. Table C-11 below shows the availability by county.

Table C-11: Canadian River Basin Run-of-River Availability

| County | Use | Water Rights | Permitted Diversion (Acre-Feet/ Year) | Total Run-of-River (Acre-Feet/ Year) |
|------------|------------|------------------------------------|---------------------------------------|--------------------------------------|
| Dallam | Irrigation | 3791 | 190 | 0 |
| Gray | Irrigation | 3788 | 4 | 1 |
| Hansford | Irrigation | 3792, 3800, 3801, 3802, 3804, 4297 | 530 | 22 |
| Hartley | Irrigation | 3776 | 0 | 0 |
| Hemphill | Irrigation | 3789, 3790 | 0 | 0 |
| Hutchinson | Irrigation | 3783, 3786, 3799 | 356 | 98 |
| Hutchinson | Industrial | 3784, 3785 | 290 ¹ | 0 |
| Lipscomb | Irrigation | 3805, 3807 | 122 | 66 |
| Moore | Irrigation | 3780, 3781, 3793, 3796, 3797, 3798 | 345 | 7 |
| Ochiltree | Irrigation | 3806 | 0 | 0 |
| Oldham | Mining | 3777 | 30 | 0 |

| County | Use | Water Rights | Permitted Diversion (Acre-Feet/ Year) | Total Run-of-River (Acre-Feet/ Year) |
|---------|------------|--|---------------------------------------|--------------------------------------|
| Potter | Irrigation | 3778, 3779, 4427, 4489, 5049, 5057, 5627, 5638 | 349 | 0 |
| Roberts | Irrigation | 3787 | 640 | 72 |
| Sherman | Irrigation | 3794, 3795 | 275 | 32 |

¹ for non-consumptive uses

Red River Basin

The run-of-river flows for the Red River Basin were determined by using the TCEQ WAM Run 3 downloaded October 21, 2014. The flows were determined as the minimum annual diversion from the river. Table C-12 below shows the availability by county.

Table C-12: Red River Basin Run-of-River Availability


| County | Use | Water Rights | Permitted Diversion (Acre-Feet/ Year) | Total Run-of-River (Acre-Feet/ Year) |
|---------------|------------|--|---------------------------------------|--------------------------------------|
| Carson | Irrigation | 5239, 5240, 5241, 5242, 5243 | 335 ¹ | 277 |
| Childress | Irrigation | 5223 | 38.5 | 19 |
| Collingsworth | Irrigation | 4184, 4198, 4207, 5235, 5236, 5237, 5256, 5257, 5258, 5259, 5260, 5261 | 1,194 | 851 |
| Donley | Irrigation | 4576, 5232, 5234 | 464 | 166 |
| Gray | Irrigation | 5246, 5251 | 130 | 55 |
| Hall | Irrigation | 5107 | 101 | 52 |
| Randall | Irrigation | 5181, 5189, 5190, 5191, 5192, 5194, 5195 | 1,072 | 217 |
| Randall | Municipal | 5022 | 2 | 0 |
| Wheeler | Irrigation | 4130, 4193, 4194, 5247, 5248, 5249, 5250, 5252, 5253, 5254, 5262, 5264 | 1,048 | 603 |

¹ plus 110 Ac-ft/yr authorized recapture of produced groundwater



Appendix D

2016 Panhandle Regional Water Plan Task 5 Report: Agricultural Water Management Strategies

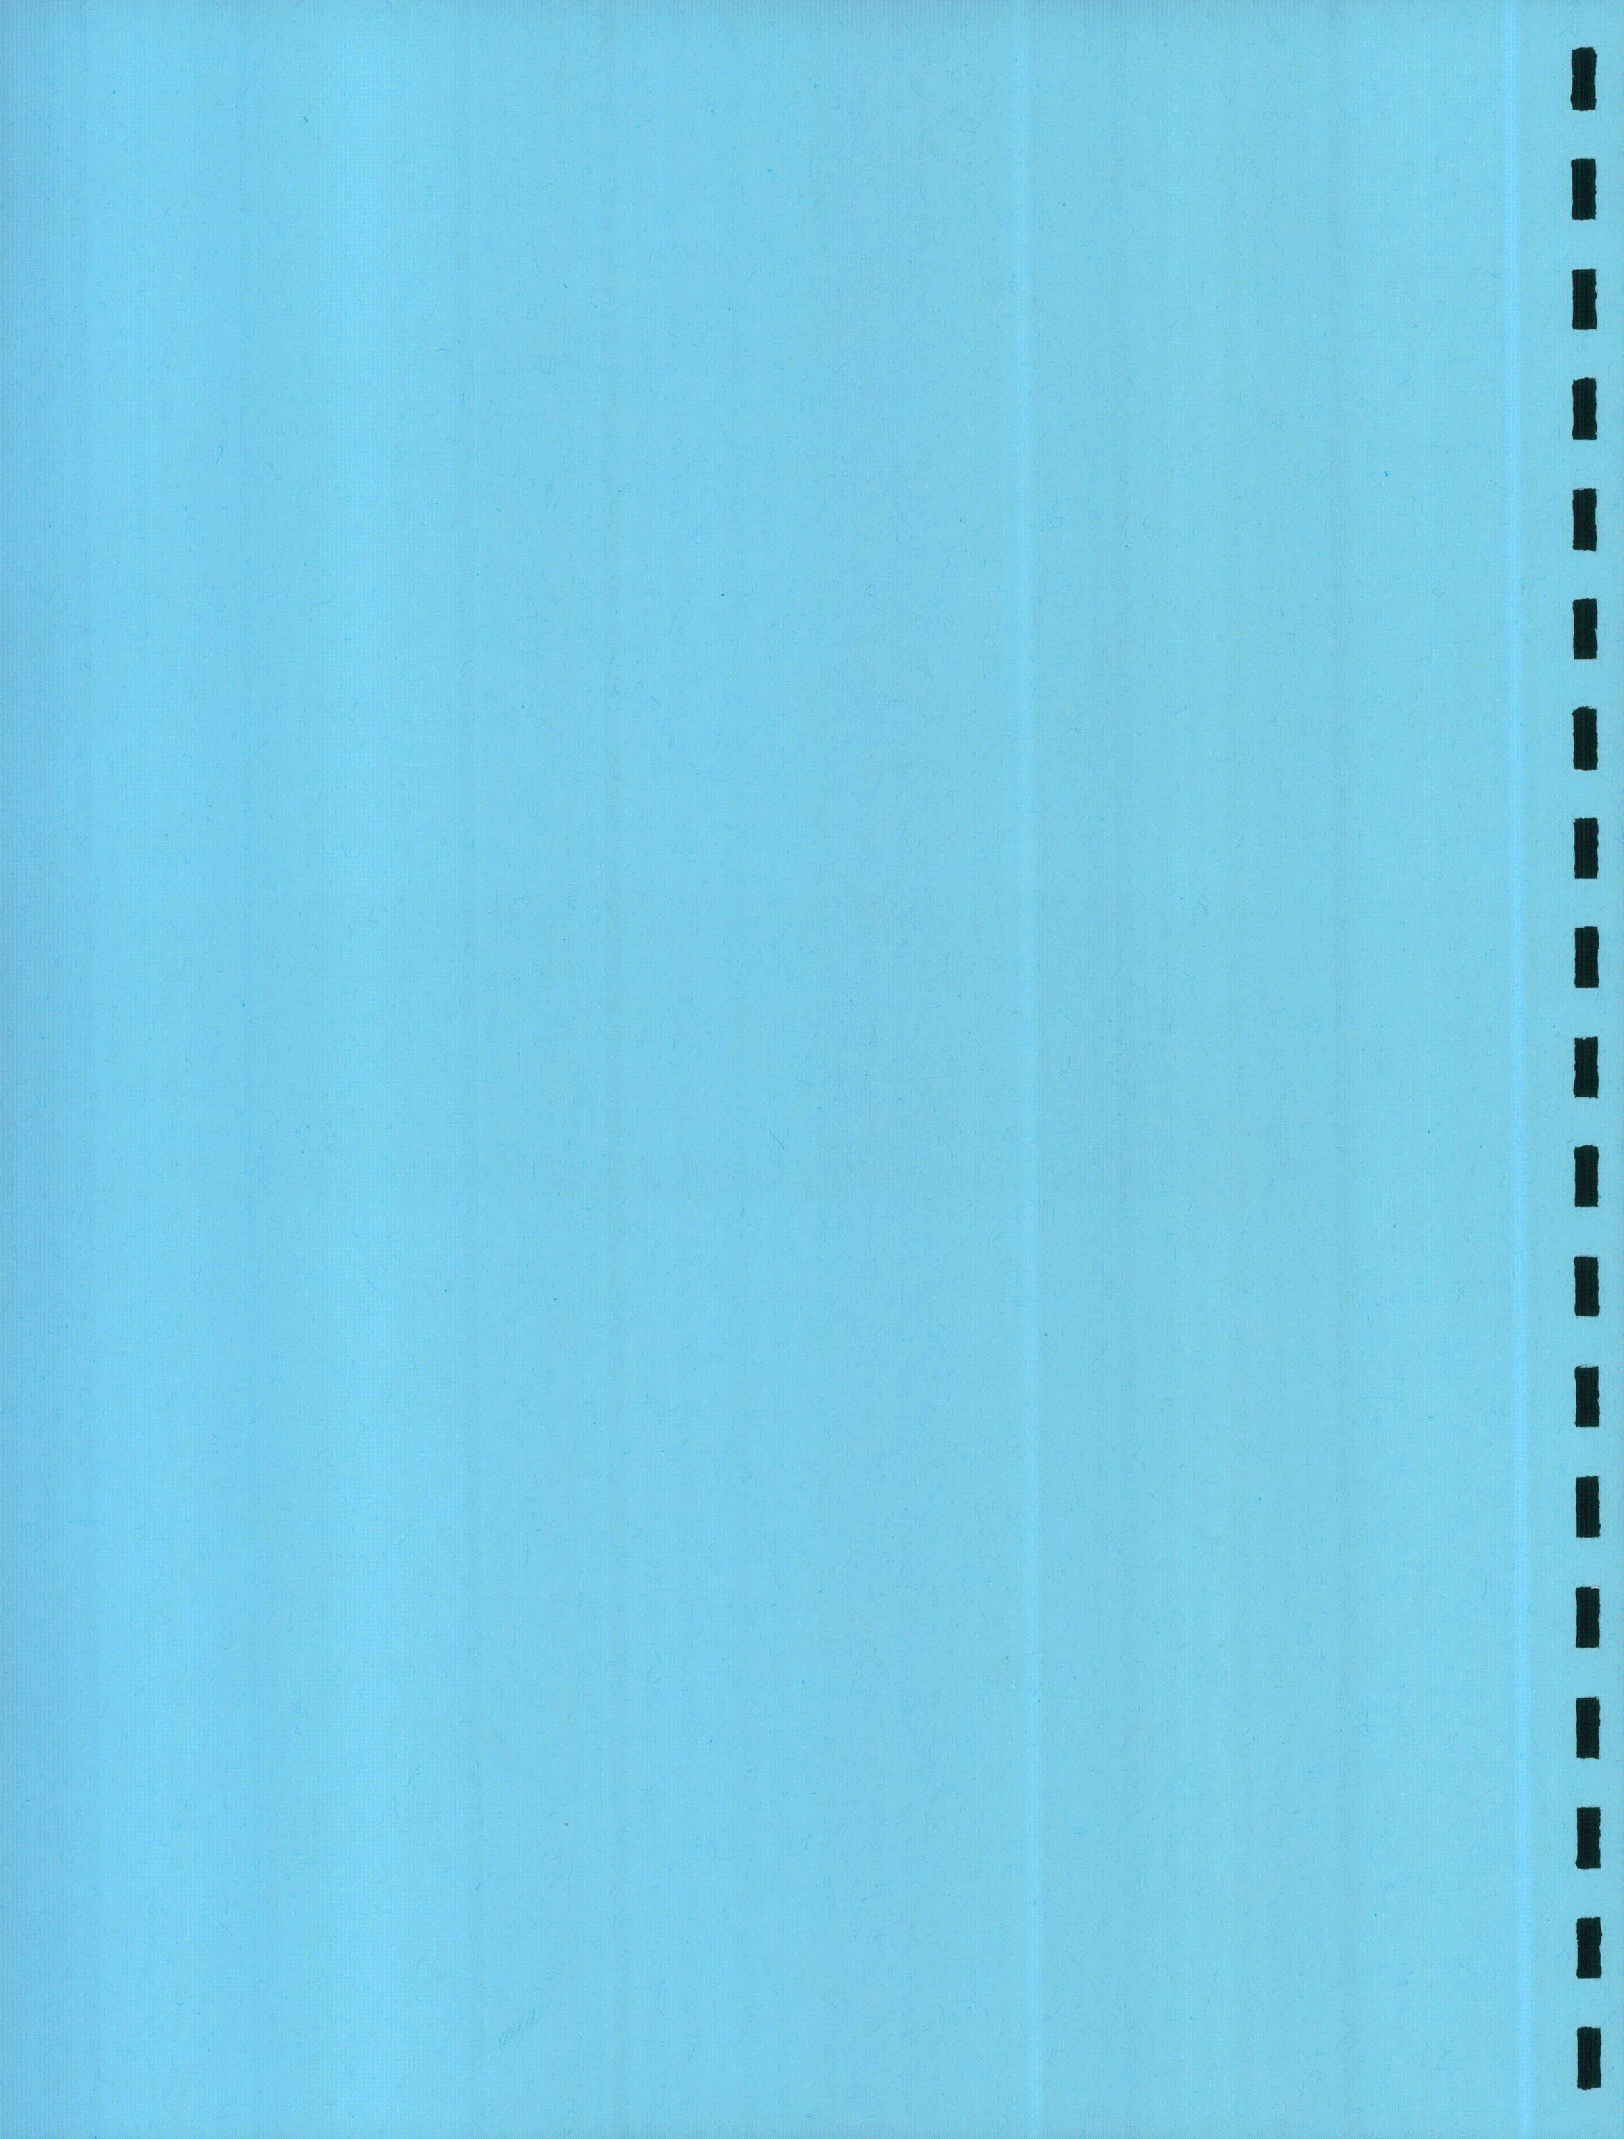

2016 Panhandle Regional Water Plan Task 5 Report: Agricultural Water Management Strategies

Steve Amosson, Shyam Nair, Bridget Guerrero and Thomas Marek¹

Agriculture is the primary user of water in the Panhandle Water Planning Area (PWPA). Agriculture is projected to account for 92% of the total water use in the PWPA in 2020. Counties with irrigation shortages in the region are projected to reach 156,704 acre-feet per year in 2020 and be 148,520 acre-feet per year deficit by 2070. Given the limited renewability of aquifers in the area, there is no readily available water supply in or near the high demand irrigation counties that could be developed to fully meet these shortages. Therefore, water management strategies for reducing irrigation demands in the Ogallala Aquifer for all 21 counties in the PWPA were examined. These strategies focus on Dallam, Hartley, and Moore Counties, which are the only counties in the region showing water demands that cannot be met with existing supplies, along with Sherman County, which is another major irrigation demand county that was projected to have a minimal surplus, Table 1. Hopefully, the use of irrigation management strategies and local groundwater rules will prolong the life of irrigated agriculture within these counties.

Table 1: Irrigation Shortages by County Identified in the PWPA, 2020-2070.

| County | Projected Need (acre-feet per year) | | | | | |
|----------|-------------------------------------|--------|--------|--------|--------|--------|
| | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| Dallam | 79,399 | 91,675 | 94,226 | 87,452 | 77,836 | 68,218 |
| Hartley | 77,305 | 93,368 | 98,650 | 92,699 | 83,415 | 74,130 |
| Moore | 0 | 0 | 0 | 0 | 3,882 | 6,171 |
| Sherman* | 0 | 0 | 0 | 0 | 0 | 0 |

*Sherman has a small surplus of 32 acre-feet in each decade.

Methodology

Water savings, implementation cost, savings from reduced pumping and the impact in gross crop receipts were estimated for each proposed water management strategy evaluated in the planning effort and described in the forthcoming sections. The year 2013 was selected as the baseline for evaluating strategies. Baseline adoption rates for strategies were estimated using secondary data sources and future adoption rates (2020 – 2070) were identified under the guidance of the Panhandle Water Planning Group (PWPG) Agriculture committee, Table 2. Since final implementation rates of conservation strategies do not occur until 2070, the water savings, direct cost and net cost of all strategies were evaluated over a 60-year planning horizon (2020 – 2079). A five-year average (2006 – 2010) of Farm Service Agency (FSA) irrigated acreage for the region was used to establish a baseline from which effectiveness of alternative conservation strategies were measured. FSA irrigated acreage estimates were increased in some counties based on local knowledge to account for farms known not to be registered with FSA. The five-

¹ Regents Fellow, Professor and Extension Economist, Texas A&M AgriLife Extension Service; Assistant Professor, Sam Houston State University; Assistant Professor, West Texas A&M University; and Senior Research Engineer, Texas A&M AgriLife Research.

year average of irrigated acreage was used to dampen distortions resulting from acreage shifts between crops caused by volatile crop prices. Water availability was assumed to remain constant in measuring the impacts of the various water conservation strategies.

In addition, the Agricultural subcommittee of the PWPG identified three combinations of the previously mentioned strategies that may likely be employed in irrigation deficit counties. The combinations of strategies were: 1) change in crop type, irrigation scheduling, and changes in irrigation equipment; 2) changes in crop variety, irrigation scheduling, and changes in irrigation equipment; and 3) change in crop type, advances in plant breeding, irrigation scheduling, and changes in irrigation equipment. When implementing multiple strategies the impact on potential water savings are not additive in most instances. The cumulative water savings from use of multiple strategies was estimated using a stepwise procedure; first revising water use after implementing one strategy and then using the revised water use as the base before introducing the second strategy and repeating the process for the third and fourth strategy. For example, the impact of changing crop type on water use was estimated, then based on the revised water use, the impact of scheduling was identified and water use revised again, and based on this estimate, the effectiveness of changes in irrigation equipment was made. The water savings of the three combinations of strategies considered was done for the four identified counties and the region as a whole. In examining the cost effectiveness of the strategy combinations (done on a regional basis), it was assumed the cost was additive.

Implementation costs were defined as the costs that could be borne by producers and/or the government associated with implementing a strategy. The savings in pumping cost takes into the account the variable cost savings from the reduced irrigation. The variable cost of irrigation is assumed be \$9.10 per acre-inch (Texas A&M AgriLife Crop and Livestock Budgets, 2014). All costs were evaluated in 2014 dollars. The loss in gross receipts was estimated by strategy, where warranted. The impact on the regional economy resulting from a change in gross receipts was not estimated but is discussed.

Table 2: Estimated Potential Water Savings and Future Adoption Percentage of Water Conservation Strategies, 2013-2070

| Water Management Strategy | Annual Regional Water Savings (% of irrigation or ac-inch/ac/yr.) | Assumed Baseline Use 2013 | Goal for Adoption 2020 | Goal for Adoption 2030 | Goal for Adoption 2040 | Goal for Adoption 2050 | Goal for Adoption 2060 | Goal for Adoption 2070 |
|------------------------------|---|---------------------------|------------------------|------------------------|------------------------|------------------------|------------------------|------------------------|
| Irrigation Scheduling | 10% | 20% | 35% | 50% | 75% | 85% | 90% | 95% |
| Irrigation Equipment Changes | Furrow to MESA or LESA 3.5 | 87% | 90% | 91.5% | 93% | 94.5% | 96% | 98% |
| | MESA or LESA to LEPA or SDI 1.3 | 75% | 80% | 85% | 90% | 95% | 100% | 100% |
| Change in crop type | 7.8-8.6 | 10% | 15% | 20% | 25% | 30% | 35% | 40% |
| Change in crop variety | 4.10 (corn) 3.0 (sorghum) | 40% | 50% | 60% | 70% | 70% | 70% | 70% |
| Conversion to Dryland | 13.9 | 0% | 2.5% | 5% | 5% | 5% | 5% | 5% |
| Soil Management | 1.75 | 70% | 75% | 80% | 85% | 90% | 95% | 95% |
| Advances in Plant Breeding | Corn, cotton, and soybean 15% (2020-2030) 30% starting in 2040 | 0% | 50% | 75% | 85% | 95% | 95% | 95% |
| | Wheat and sorghum 12% starting in 2030 | 0% | 0% | 50% | 75% | 85% | 95% | 95% |
| Precipitation Enhancement | 1.0 | 38% | 38% | 38% | 38% | 38% | 38% | 38% |

Description of Agricultural Conservation Strategies

In this plan, the Agriculture subcommittee of the PWPG identified eight potential agricultural water conservation strategies to be evaluated. These strategies include: irrigation scheduling; irrigation equipment changes; change in crop type; change in crop variety; conversion to dryland; soil management; advances in plant breeding for drought tolerance; and precipitation enhancement. Precipitation enhancement is considered a limited use strategy since it cannot be implemented by an individual producer and little interest has been shown in implementing this strategy by ground water districts in the region with the exception of the Panhandle Groundwater Conservation District. A description of each of these strategies is presented in the following sections.

Irrigation Scheduling

Irrigation scheduling refers to the process of allocating irrigation water according to crop requirements based on meteorological demands and field conditions with the intent to manage and conserve water, control disease infestations, and maximize farm profit. In a region like the Panhandle, where irrigation water availability is increasingly becoming limited, proper and accurate irrigation scheduling is critical to ensure profitable agricultural production and conservation of the existing water resources. Soil water measurement-based methods, plant stress sensing-based methods, and weather-based methods are the common irrigation scheduling tools. The prevalent soil-based irrigation scheduling method utilized in the region today employs soil moisture probes that estimate soil moisture at different depths to schedule irrigation. Irrigation scheduling based on crop evapotranspiration reported by ET networks in the region is also an important weather-based irrigation scheduling method since this data references the climatic demand, which varies annually and can vary substantially within the season. Plant stress-based irrigation scheduling techniques using thermal sensors are also a developing irrigation scheduling strategy but are not yet widespread in use. The soil moisture probe and thermal sensor methods can allow for automation of irrigation scheduling by wireless connection of the sensors to respective irrigation systems. Proper and accurate irrigation scheduling can save up to 2 to 3 acre-inches of irrigation per year for corn. In this analysis, the water savings from this strategy is assumed to be 10% of the water applied for each crop.

The cost of irrigation scheduling can vary significantly depending on several factors including the level of service, equipment costs, and area served. More money tends to be invested in irrigation scheduling of higher value crops. A range of \$3.00 to \$12.00 per acre for irrigation scheduling was identified based on discussions with industry representatives, depending on the level of service. In this analysis, a \$5.00 per acre annual cost was assumed for irrigation scheduling. Irrigation scheduling costs can be reduced if the producer chooses to buy the soil moisture probe. Typically, the cost of a soil moisture probe ranges from \$1,300 to \$2,650, depending on the company and level of sophistication of the probe.

Irrigation Equipment Changes

Current irrigation methods practiced in the Texas Panhandle include conventional furrow irrigation (CF), center pivot irrigation (MESA: Mid Elevation Spray Application, LESA: Low Elevation Spray Application, and LEPA: Low Elevation Precision Application) and subsurface drip irrigation (SDI). The average application efficiency of CF, MESA, LESA, LEPA, and SDI is 60, 78, 88, 95, and 97%, respectively (Amosson et al., 2011). These application efficiencies are the percentage of irrigation water applied that is used by the crop with the remainder being lost to runoff, evaporation or deep percolation. Switching from low efficiency irrigation systems such as CF and MESA to more efficient irrigation systems such as LEPA and SDI improves the efficiency of irrigation system water use and can help conserve groundwater resources. Switching irrigation systems can be a costly strategy to conserve irrigation water, but that cost can be partially offset by the decrease in pumping cost. The water conservation strategy of changing irrigation equipment includes establishing new MESA and LESA systems in CF irrigated fields and converting MESA and LESA to LEPA to improve its application efficiency. Establishing MESA, LESA, LEPA, or SDI systems requires a major investment, while converting MESA and LESA to LEPA using conversion kits are comparatively less expensive.

The regional water savings estimate in 2020 from this strategy is 3.5 and 1.3 acre-inches per acre for conversion of furrow to MESA/LESA and MESA/LESA to LEPA, respectively. It should be noted that water savings from this strategy vary by county and over time as the amount of water pumped changes.

Initial investment in irrigation equipment varies depending on the dealer and spacing between sprinkler drops or tape in the case of SDI. In consultation with industry representatives and other secondary sources, the cost of adding a quarter-mile (125 acres) sprinkler system was estimated to be \$75,000-\$80,000. The estimates to convert a MESA or LESA quarter-mile sprinkler system to LEPA ranged from \$7,000-\$10,000, depending on the spacing of the drops. The estimates for installing a SDI system ranged from \$1,200-\$1,500 per acre, depending primarily on whether drip tapes were spaced 80 inches or 40 inches apart.

The implementation cost of this strategy is estimated using the costs associated with the irrigation equipment required for each of the systems and their respective adoption rate. The total cost (fixed cost + variable cost) of applying one acre-inch of water per acre for intermediate water use for furrow, MESA, LESA, LEPA, and SDI are \$12.26, \$13.98, \$13.60, \$13.76, and \$17.04, respectively (Amosson et al., 2011). These values were inflated to 2014 values using price index for farm machinery (USDA, 2014). The assumed adoption percentage of the irrigation systems during each decade was used along with the acreage and average water use to estimate the amount of irrigation applied using these systems during the baseline period and future periods. These irrigation amounts were multiplied with the cost per acre-inch to get the total cost of irrigation during the baseline and future time periods. The difference in cost between successive time periods is the cost of implementation for this strategy.

Change in crop type

There are considerable differences in water requirements among different crops. Selection of crops with lower water requirements can be an effective water conservation strategy. Corn, cotton, wheat, and grain sorghum are the four major crops in the Panhandle region accounting for about 90% of the irrigated acreage. Corn has one of the highest water requirements of any irrigated crop grown in the Texas High Plains because of a longer growing season than most other spring crops, which can adversely affect yield in limited moisture situations (Howell et al., 1996). The seasonal evaporative demand for corn is 28 to 32 inches, for wheat is 26 to 28 inches, for cotton is 13 to 27 inches, and for grain sorghum is 13 to 24 inches. To date, the majority of water used for irrigation has been applied to high water use crops such as corn. On the other hand, cotton, wheat, and grain sorghum can tolerate lower moisture availability and are more suited to deficit irrigation practices. Considerable amounts of irrigation water can be saved by shifting from high water use crops like corn to lower water use crops like cotton, wheat or grain sorghum. In this analysis, it is assumed that shifting from corn to low water use crops can save 7.8-8.6 acre-inches per acre depending on the crop choice.

The cost of implementing this water conservation strategy is evaluated in terms of an "opportunity cost" expressed by the reduced land values which reflect the water availability required to produce crops. Land that has "good" water availability to support corn production is worth more compared to the land with "fair" availability of water that can support cotton, wheat, or grain sorghum. Hence the cost of adoption of this strategy for one acre of land is estimated as

the difference between the average land value in the region for irrigated cropland with good water availability and that of irrigated cropland with fair water availability. This per acre cost of adoption is then multiplied by the assumed acreage of adoption to get the total cost. The total cost is divided by the estimated water savings to get the cost incurred by producers to generate an acre-foot of water savings. The land values reported by the Texas chapter of the American Society of Farm Managers and Rural Appraisers (ASFMRA, 2013) provided the average land value for these two classes of irrigated cropland in the region. ASFMRA (2013) reported that the value of irrigated cropland with good water availability in the region ranges from \$2,800 to \$4,000 per acre. The average of these two values (\$3,400) was used as the average land value for irrigated cropland with good water availability in the region. The value of irrigated cropland with fair water availability in the region ranges from \$1,800 to \$2,500 per acre. The average of these two prices (\$2,150) was used as the average land value for irrigated cropland with fair water availability in the region.

Change in crop variety

The evaporative demand for short season varieties can be significantly lower than that for long season varieties. Short season varieties of corn and grain sorghum use less water than the conventional longer season varieties. Thus, converting from long season varieties to short season varieties of corn and grain sorghum can be a useful water conservation strategy. In addition, short season hybrids may be seeded earlier to possibly avoid insect threat, and have the potential of planting a third crop in two years either by planting a short season variety prior to or following a wheat crop (Howell et al., 1996). Early planting of the short season hybrids can also help avoid high evaporative demand periods and save water. The seasonal evapotranspiration for short season corn hybrids was found to be generally 5 inches less than that of long season hybrids (Howell et al., 1998). The water use of short season grain sorghum is about 0.6 inches less than that of long season varieties. Therefore, considerable water savings can be realized by substituting long season varieties of corn and grain sorghum with the short season varieties. In this analysis, the water savings from adopting short season corn and short season grain sorghum are assumed to be 4.1 and 3.0 acre-inches per acre, respectively.

The implementation cost of this water conservation strategy was assumed to be the compensation needed to account for the loss in yield and profitability of employing the strategy. Howell et al. (1998) reported that the yield from short season hybrids was about 15% less than that from the full season hybrids. A partial budget analysis considering the loss in revenue versus the reduction in pumping cost, fertilizer, and harvest expense indicates that approximately half of the revenue reduction is profit loss (Texas A&M AgriLife Crop and Livestock Budgets, 2014). In this analysis, the loss of revenue from short season corn and grain sorghum is estimated as 15% of the average revenue for the last 5 years and the implementation cost is assumed to be half of that amount. The average revenue was calculated using the average corn and grain sorghum yield and the average price received in Northern High Plains for last 5 years (USDA, 2014). It should be noted that the reduction in gross receipts and associated expenditures is expected to have a negative impact on the regional economy.

Conversion to Dryland

The strategy of converting from irrigated crop production to dryland crop production would save all of the irrigation water normally used on irrigated acreage. Converting from an irrigated to dryland cropping system may be a viable economic alternative for some producers in the Panhandle on marginally irrigated lands or as a regional strategy to conserve water reserves. The primary dryland crops grown in the area are winter wheat, grain sorghum, and cotton. Conversion programs that provide incentives to conversion to dryland, identifying and adopting crops that perform well in the region under rainfed conditions, and developing higher yielding heat and drought-tolerant varieties will be critical in implementing this strategy. Other highly drought tolerant crops like canola, safflower, mustard, camelina, jatropha, castor, guar, and rapeseed are currently being evaluated for suitability and profitability, but sustained markets and returns on investments are still valid concerns. This analysis assumes 13.9 acre-inches per acre water savings by the adoption of this strategy over the entire region; however, the amount varies by county depending on crop composition.

The cost of implementing this water conservation strategy is evaluated in terms of reduced land values. Land that has sufficient water available for irrigation is worth much more compared to dry cropland. Therefore, the cost of adoption of this strategy for one acre of land is estimated as the difference between the average land value in the region for irrigated cropland and that of dryland. This per acre cost of adoption is then multiplied by the assumed acreage of adoption to get the total cost. The land values reported by the Texas chapter of the American Society of Farm Managers and Rural Appraisers (ASFMRA, 2013) provided the average land value for irrigated and dry cropland in the region. The value of irrigated cropland with fair water availability in the region ranges from \$1,800 to \$4,000 per acre. The average of these two values (\$2,900) was used as the average land value for irrigated cropland availability in the region. The average land value of dry cropland ranged from \$500 to \$700 per acre in the western parts of the region and from \$700 to \$1,100 in the Eastern parts of the region resulting in an overall average of \$750 per acre. Therefore, the cost assumed in the analysis to retire an acre of irrigated land was \$2,150 (\$2,900 - \$750). In addition to the implementation cost, the loss in gross receipts from the conversion of irrigated to dryland crop production was estimated.

Soil Management

Effective soil management practices can increase the efficiency of both irrigation and rainfall events, increase soil infiltration, reduce runoff, reduce evaporative loss, and conserve moisture available within the soil profile. Thus, these practices promote efficient use of the available water and enhance crop production and sustainability of the region's natural resources. Conservation tillage practices, furrow diking, and introduction of fallow and low water use crops in the crop rotation are the most important land management practices that can lead to water conservation within the region.

Conservation tillage is defined as tillage practices that minimize soil and water loss by maintaining a surface residue cover of more than 30% on the soil surface (CTIC, 2014). Conservation tillage can reduce evaporation, increase rainfall infiltration, water storage, soil moisture conservation, and water use efficiency. Conservation tillage systems are also reported to have economic advantages as it reduces machinery, fuel, and labor costs. Conservation tillage is a term covering a wide range of tillage practices with the common characteristic of reduced soil and water loss. Different tillage practices such as minimum tillage, reduced tillage, no-till;

ridge tillage, vertical tillage, and strip tillage are often interchangeably used with the term conservation tillage. In this analysis, the water savings from adopting effective soil management strategy is assumed to be 1.75 acre-inches per acre.

The initial capital investment in equipment may impede the adoption of soil management practices. The purchase price of conservation tillage equipment capable of doing strip till or vertical tillage varies considerably depending on the size and company that made it. For example, a six-row strip till implement costs approximately \$32,000, whereas a 24-row prices out at \$116,500 (Texas A&M AgriLife Crop and Livestock Budgets, 2014). A 14-foot vertical tillage implement costs \$39,000, where a 40-foot version priced out at \$116,500. The appropriate size of conservation implements depends upon the equipment compliment of the producer.

The implementation cost of soil management strategy is estimated as the difference between the cost of conventional tillage and conservation tillage. It is assumed that the average conventionally tilled field will be disked once, chiseled once, and cultivated three times during the year. This will be followed by two herbicide applications; one pre-plant and one post-plant. In the case of conservation tillage (strip tillage is assumed as it is most common in the region), it is assumed that the field is chiseled once and cultivated two times. There are three herbicide applications in conservation tillage; one burn down, one pre-plant, and one post-plant application. The cost of disc ploughing, chiseling, and cultivation are \$12.09, \$12.61, and \$10 per acre, respectively (Texas Agricultural Custom Rates, 2013). The cost of burn down, pre-plant, and post plant herbicide application are assumed to be \$19.50, \$17.36, and \$15.69 per acre, respectively (Texas A&M AgriLife Crop and Livestock Budgets, 2014). The cost of conventional and conservation tillage are calculated using this data as \$87.75 and \$85.16 per acre, respectively.

Advances in Plant Breeding

Plant breeding has played a major role in increasing crop productivity and enhancing the efficiency of inputs such as irrigation. Previously, plant breeding efforts were mainly concentrated on hybridization and selection to produce improved planting materials like composite seeds and F1 hybrid seeds. The success stories in this era were hybrid corn and semi dwarf varieties of wheat and rice that triggered the green revolution. The advances made in genetic engineering led to the plant biotechnology era, which began in the 1980s when transgenic plants were produced. Transgenic planting materials for several crops are commercially available now. The commercial varieties for several crops with genetically modified organisms (GMOs) are also widely in use. From a water conservation standpoint, varieties with higher water use efficiency and enhanced drought tolerance can lead to substantial water savings. The adoption of drought resistant varieties with high water use efficiency can be a potential water conservation strategy. The first wave of drought resistant varieties for corn, cotton, and soybeans are expected to be released by 2020 followed by a second wave in 2040 that will improve drought and heat tolerance even more. This analysis assumes that the first round of drought resistant varieties will reduce water use by 15% and the second round of varieties will reduce the water use an additional 15% compared to current varieties. It is also assumed that drought tolerant varieties of wheat and grain sorghum will be available by 2030 and will reduce the water use by 12%.

The implementation cost of this strategy assumed an additional cost of drought resistant seed estimated at a dollar for every one percent reduction in water use. Therefore it was assumed a 15 percent reduction in water use is will cost \$15 per acre and a 30 percent reduction will cost \$30 per acre. Cost estimates were made after consultation with industry personnel and researchers working in the area. These costs were then multiplied with the annual total acreage for corn, cotton and soybeans, affected by incorporation of this strategy. It is also assumed that drought tolerant varieties of wheat and grain sorghum will cost \$12/acre for a 12 percent reduction in water use.

Precipitation Enhancement

Precipitation enhancement, commonly known as cloud seeding or weather modification, is a process in which clouds are inoculated with condensation agents (such as silver iodide) to enhance rainfall formation. Cloud seeding is also used as a technique for hail suppression or reducing hailstone size (Encyclopedia Britannica, 2014). Currently, cloud seeding is conducted in almost one-fifth of the land area of Texas, covering about 31 million acres. In 2012, the weather modification programs in Texas conducted 162 missions, treating 353 thunderstorms. Analysis showed that the treated storms lived 40% longer, covered 47% more area, and produced 124% more rain than the untreated storms. The estimated increase in water availability was 1,517,266 acre-feet at a cost of \$11/acre-foot (TDLR, 2014). Precipitation enhancement can help conserve groundwater by reducing the irrigation requirement. It can also increase reservoir levels and could have positive impact on dryland farms and ranches. This analysis assumes a water savings of one acre-inch per acre for all irrigated acreage in the region by precipitation enhancement.

The strategy of precipitation enhancement is adopted only by the counties in the Panhandle Groundwater Conservation District (PGCD). In consultation with PGCD personnel, the cost of adoption of this strategy per acre feet of water saved is estimated as \$6.28 in the 2006 plan. Since this was a local estimate of the cost it was determined to be more accurate than the TDRL cost for the area. This 2006 PGCD value was adjusted to 2014 dollars (USDA, 2014). The cost of adoption of this strategy per acre-foot of water saved is estimated to be \$8.11

Results

Cumulative water savings, implementation cost, reduced cost and the change in gross receipts for each of the water conservation strategies and combinations of strategies are presented in Table 3. An excess of 61 million acre feet of water is projected to be utilized for irrigation within the region over the 50-year planning horizon (2020 – 2070) without adoption of any new conservation strategies or increases in the implementation level of current strategies. Since final implementation rates of conservation strategies do not occur until 2070, the water savings, direct cost and net cost of all strategies were evaluated over a 60-year planning horizon (2020 – 2079). Each of the conservation strategies is discussed in order of projected magnitude of water savings followed by the combinations of strategies that were considered.

Anticipated advances in plant breeding (drought resistant varieties) in corn, cotton, sorghum, soybeans and wheat were estimated to generate by far the largest amount of water savings, 13.8 million ac-ft., which was 22.6 percent of the total irrigation water pumped over the 60-year planning horizon. Implementing this strategy was expected to cost \$113.3 million resulting in an average cost of \$8.20 per ac-ft. of water saved. The reduction in pumping cost (\$1.5 billion) is expected to more than offset the implementation cost.

The change in crop type was estimated to generate 6.4 million ac-ft. of water savings, which was 10.5 percent of the total irrigation water pumped over the 60-year planning horizon. Implementing this strategy was expected to cost \$199.9 million resulting in an average cost of \$31.27 per ac-ft. of water saved. The difference in land values used to estimate implementation costs inherently takes into account reduced pumping costs, therefore, no additional benefit with respect to cost savings was identified. However, achieving these water savings came at an additional cost. The move to lower productive crops resulted in a loss in gross crop receipts of \$3.0 billion, resulting in a negative impact on the regional economy.

Proper and accurate irrigation scheduling can save up to 2 to 3 acre-inches of irrigation per year for corn. In this analysis, the water savings from this strategy is assumed to be 10% of the water applied for each crop. Increased use of irrigation scheduling to improve the water use efficiency was estimated to save 4.7 million ac-ft. or approximately 7.7 percent of total water pumped. Implementation costs were estimated at \$209.4 million resulting in a cost per ac-ft. of water saved of \$44.69. The resultant reduction in pumping cost was estimated at \$511.6 million, which is more than double the implementation cost.

Table 3: Estimated Water Savings and Costs Associated with Proposed Water Conservation Strategies in Region A

| Water Management Strategy | Cumulative Water Savings (WS) | Implementation Cost (IC) | IC/WS | Cost Savings | Net Cost/WS | Loss in Gross Receipts |
|------------------------------|-------------------------------|--------------------------|-----------|--------------|-------------|------------------------|
| | ac-ft. | \$1,000 | \$/ac-ft. | \$1,000 | \$/ac-ft. | \$1,000 |
| Irrigation Scheduling | 4,685,325 | 209,396 | \$44.69 | 511,637 | (\$64.51) | - |
| Change in Crop Variety | 3,064,326 | 602,294 | \$196.55 | - | \$196.55 | 1,204,587 |
| Irrigation Equipment Changes | 3,643,928 | 55,638 | \$15.27 | 397,917 | (\$93.93) | - |
| Change in Crop Type | 6,394,663 | 199,934 | \$31.27 | - | \$31.27 | 3,006,360 |
| Soil Management | 1,970,123 | (34,989) | (\$17.76) | 215,137 | (\$126.99) | - |
| Precipitation Enhancement | 813,923 | 6,601 | \$8.11 | 88,880 | (\$101.09) | - |
| Irrigated to Dryland Farming | 4,156,337 | 145,226 | \$34.94 | - | \$34.94 | 2,805,477 |

| | | | | | | |
|---|------------|---------|---------|-----------|------------|-----------|
| Advances in Plant Breeding | 13,821,966 | 113,322 | \$8.20 | 1,509,359 | (\$102.63) | - |
| Change in Crop Type, Irrigation Scheduling & Irrigation Equipment | 13,602,712 | 265,034 | \$19.48 | 1,485,416 | (\$89.72) | 3,006,360 |
| Change in Crop Variety, Irrigation Scheduling & Irrigation Equipment | 10,325,042 | 867,328 | \$84.00 | 1,127,495 | (\$25.20) | 1,204,587 |
| Change in Crop Type, Advances in Plant Breeding, Irrigation Scheduling & Irrigation Equipment | 22,928,545 | 378,356 | \$16.50 | 2,503,797 | (\$92.70) | 3,006,360 |

Converting irrigated land to dryland production yielded water savings of 4.2 million ac-ft. or 6.9 percent of the total pumped. The estimated change in land values resulted in an implementation cost of \$145.2 million and a resultant cost of \$34.94 per ac-ft. of water saved. Since the implementation cost was evaluated as a change in land values it can be deduced that any value attributed to reduced pumping is captured in the change in land prices, therefore, no additional savings for reduced pumping cost was calculated. The change in land use from irrigated to dryland resulted in a considerable loss in gross receipts that was estimated at \$2.8 billion dollars over the planning horizon which would be a significant negative impact on the regional economy.

Additional conversion of non-efficient irrigation delivery systems in the region, such as furrow to MESA and MESA to more efficient systems (LESA, LEPA, or subsurface drip irrigation) resulted in a savings of 3.6 million ac-ft. (7.7 percent of total irrigation water pumped). Investment in these more efficient systems results in an implementation cost of \$55.6 million which translates into a cost of \$15.27 per ac-ft. of water saved. The savings producers may capture from reduced pumping cost was estimated at \$ 397.9 million resulting in a net cost savings of \$342.3 million. This strategy was not expected to have any adverse effects on gross receipts while increasing investment and reducing pumping cost, thus, having a slightly positive impact on the regional economy.

The change to shorter season corn and sorghum varieties yielded the sixth largest water savings of 3.1 million ac-ft. or 5.1 percent of the total pumped. The implementation cost for this strategy which was assumed to be the loss in producer profitability was estimated at \$602.3 million. Change in producer returns was used in calculating the implementation cost which included the benefits of reduced pumping costs; therefore, no additional savings were credited to this strategy. In addition, changing crop variety leads to lower yields that reduce gross cash receipts (\$1.2

billion) which has a negative impact on the regional economy. The results of this strategy are very dependent on the yield reductions of short season varieties and crop prices. Lower prices and yield reductions increase the feasibility of this strategy.

The soil management conservation strategy encompasses a number of activities from including fallow in a rotation to the adoption of conservation tillage. Increasing the level of soil management yielded water savings of 2.0 million ac-ft. or 3.3 percent of total irrigation water pumped. The implementation cost of increased soil management was assessed by evaluating the cost differential between conventional and reduced till. The change in relative cost of fuel and chemicals and conservation tillage methods has made conservation tillage more cost effective than conventional tillage while achieving water savings. The implementation of increased conservation tillage was estimated to reduce costs \$35.0 million over the planning horizon, resulting in a negative cost per acre-foot of water saved (-\$17.76). The savings in pumping costs (\$215.1 million) added to the viability of this strategy reducing the cost per acre-foot of water saved (-\$126.99).

The precipitation enhancement strategy was projected to save 813,923 ac-ft. under the assumption that increased rainfall would result in a one acre-inch reduction in pumping. The estimated implementation cost associated with this strategy was \$6.6 million resulting in a cost of \$8.11 per ac-ft. of water saved. It should be noted that the total cost of this strategy is more than stated since it is used to benefit all land including dryland crops and pasture and only the proportional cost was attributed to the irrigated land. The savings in pumping cost was estimated at \$88.9 million. This strategy should yield a positive impact to gross receipts in the region, since additional rainfall will occur not only on irrigated land but on dryland and pasture operations increasing their productivity. It should be noted, that unlike the other strategies considered, this is not a strategy a producer can individually adopt. Currently, only the Panhandle Groundwater Conservation District practices precipitation enhancement in Region A, and there are no indications that other districts of the region plan to incorporate this strategy.

The Ag subcommittee of PWPG identified three combinations of strategies that may likely be used in deficit irrigated counties. These strategies were also evaluated for the region as a whole. The combination of change in crop type, irrigation scheduling, and irrigation equipment resulted in an estimated water savings of 13.6 million ac-ft. or 22.6 percent of the total pumped; the strategy of implementing changes in crop variety, irrigation scheduling, and irrigation equipment was projected to save 10.3 million ac-ft. or 16.9 percent of the total pumped; and the combination of change in crop type, advances in plant breeding, irrigation scheduling, and irrigation equipment had estimated water savings of 22.9 million ac-ft. or 37.5 percent of the total pumped. The interaction between some strategies results in lower water savings from implementing multiple strategies. It was estimated that the water savings from the combinations of strategies versus the additive water savings was reduced 7.5 percent, 10.4 percent and 19.5 percent, respectively, while the pumping cost savings ranged from 1.1 to 2.5 billion over the planning horizon for these combinations. It should be noted that all three combinations involved either change in crop type or a change in crop variety which results in a decrease in gross receipts having a negative impact on the regional economy.

Dallam County: Irrigation Shortages and Water Savings from Conservation Strategies

It is projected that Dallam County will have an irrigation shortage of 78,969 ac-ft. in 2020 (Table 4). This annual shortfall will increase to 93,817 ac-ft. in 2040 before falling to 67,839 ac-ft. by 2070. Advances in plant breeding was the most effective water saving strategy evaluated when fully implemented in Dallam County reducing annual use by 82,123 ac-ft. It was projected this strategy would meet the projected shortage by 2060. The effectiveness of the remaining strategies once fully implemented ranked as follows: change in crop type (50,048 ac-ft.), irrigation scheduling (27,734 ac-ft.), irrigation equipment (23,484 ac-ft.), conversion to dryland (18,489 ac-ft.), change in crop variety (16,142 ac-ft.) and soil management (10,737 ac-ft.). Precipitation enhancement was not considered a viable option for the county.

Three combinations of strategies identified by the Ag subcommittee of PWPG were evaluated. However, it is important to understand that implementation of certain strategies can diminish the effectiveness of others if they are also implemented. The combination of change in crop type, advances in plant breeding, irrigation scheduling, and irrigation equipment was estimated to be the most effective meeting the projected shortage by 2040 and generating a surplus of 72,773 ac-ft. (140,612 - 67,839) in 2070. While less effective, the combination of change in crop type, irrigation scheduling, and irrigation equipment was able to cover the projected shortage by 2060, however, the strategy of implementing changes in crop variety, irrigation scheduling, and irrigation equipment was unable to generate sufficient water savings to offset shortages in the time periods.

Table 4: Dallam County Projected Annual Irrigation Shortage and Water Savings by Strategy (acre-ft./year), 2020-2070.

| | | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
|------------------------------------|---|---------|---------|---------|---------|---------|---------|
| Projected Irrigation Demand | | 290,465 | 255,849 | 224,569 | 195,921 | 170,116 | 144,312 |
| Projected Shortage | | -79,399 | -91,675 | -94,226 | -87,452 | -77,836 | -68,218 |
| Projected Water Savings | | | | | | | |
| Water Saving Strategies | Change in Crop Type | 8,341 | 16,683 | 25,024 | 33,365 | 41,707 | 50,048 |
| | Change in Crop Variety | 5,381 | 10,761 | 16,142 | 16,142 | 16,142 | 16,142 |
| | Soil Management | 2,147 | 4,295 | 6,442 | 8,590 | 10,737 | 10,737 |
| | Conversion to Dryland | 9,245 | 18,489 | 18,489 | 18,489 | 18,489 | 18,489 |
| | Irrigation Equipment | 5,947 | 9,635 | 13,579 | 15,566 | 20,841 | 23,484 |
| | Irrigation Scheduling | 5,547 | 11,094 | 20,338 | 24,036 | 25,885 | 27,734 |
| | Precipitation Enhancement | 0 | 0 | 0 | 0 | 0 | 0 |
| | Advances in Plant Breeding | 19,445 | 33,500 | 72,708 | 81,256 | 82,123 | 82,123 |
| | Change in Crop Type, Irrigation Scheduling & Irrigation Equipment | 18,554 | 34,891 | 54,501 | 67,115 | 81,034 | 92,438 |
| | Change in Crop Variety, Irrigation Scheduling & Irrigation Equipment | 15,371 | 28,653 | 45,278 | 50,309 | 56,603 | 60,638 |
| | Change in Crop Type, Advances in Plant Breeding, Irrigation Scheduling & Irrigation Equipment | 34,218 | 61,174 | 106,343 | 121,011 | 132,167 | 140,612 |

Hartley County: Irrigation Shortages and Water Savings from Conservation Strategies

It is projected that Hartley County will have an irrigation shortage of 77,305 ac-ft. in 2020 (Table 5). This annual shortfall will increase to 98,650 ac-ft. in 2040 before falling to 74,130 ac-ft. by 2070. Advances in plant breeding was the most effective water saving strategy evaluated when fully implemented in Hartley County reducing annual use by 66,615 ac-ft. It was projected that this strategy by itself would not meet the projected shortage during the modeling time horizon thus, implementing a combination of strategies will be required to meet irrigation needs. The effectiveness of the remaining strategies once fully implemented ranked as follows: change in crop type (41,054 ac-ft.), irrigation scheduling (25,895 ac-ft.), irrigation equipment (21,928 ac-ft.), conversion to dryland (17,263 ac-ft.), change in crop variety (13,218 ac-ft.) and soil management (9,320 ac-ft.). Precipitation enhancement was not considered a viable option for the county.

Three combinations of strategies identified by the Ag subcommittee of PWPG were evaluated. However, it is important to understand that implementation of certain strategies can diminish the effectiveness of others if they are also implemented. The combination of change in crop type, advances in plant breeding, irrigation scheduling, and irrigation equipment was estimated to be the most effective meeting the projected shortage by 2050 and generating a surplus of 46,379 ac-ft. in 2070. While less effective, the combination of change in crop type, irrigation scheduling, and irrigation equipment was able to cover the projected shortage only in the last year modeled (2070), however, the strategy of implementing change in crop variety, irrigation scheduling, and irrigation equipment was unable to generate enough water savings to offset shortages in the time periods.

Table 5: Hartley County Projected Annual Irrigation Shortage and Water Savings by Strategy (acre-ft./year), 2020-2070.

| | | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
|--------------------------------|--|---------|---------|---------|---------|---------|---------|
| | Projected Irrigation Demand | 268,060 | 232,514 | 201,640 | 174,225 | 150,144 | 126,063 |
| | Projected Shortage | -77,305 | -93,368 | -98,650 | -92,699 | -83,415 | -74,130 |
| | Projected Water Savings | | | | | | |
| Water Saving Strategies | Change in Crop Type | 6,842 | 13,685 | 20,527 | 27,369 | 34,211 | 41,054 |
| | Change in Crop Variety | 4,406 | 8,812 | 13,218 | 13,218 | 13,218 | 13,218 |
| | Soil Management | 1,864 | 3,728 | 5,592 | 7,456 | 9,320 | 9,320 |
| | Conversion to Dryland | 8,632 | 17,263 | 17,263 | 17,263 | 17,263 | 17,263 |
| | Irrigation Equipment | 5,553 | 8,996 | 12,679 | 14,535 | 19,460 | 21,928 |
| | Irrigation Scheduling | 5,179 | 10,358 | 18,990 | 22,442 | 24,169 | 25,895 |
| | Precipitation Enhancement | 0 | 0 | 0 | 0 | 0 | 0 |
| | Advances in Plant Breeding | 15,812 | 27,154 | 59,014 | 65,927 | 66,615 | 66,615 |
| | Change in Crop Type, Irrigation Scheduling & Irrigation Equipment | 16,448 | 30,857 | 48,401 | 59,374 | 71,566 | 81,413 |
| | Change in Crop Variety, Irrigation Scheduling & Irrigation Equipment | 13,837 | 25,741 | 40,843 | 45,606 | 51,565 | 55,385 |
| | Change in Crop Type, Advances in Plant Breeding, Irrigation Scheduling & Irrigation Equipment | 29,197 | 52,161 | 90,476 | 103,095 | 113,047 | 120,509 |

Moore County: Irrigation Shortages and Water Savings from Conservation Strategies

It is projected that Moore County will have adequate water available for irrigation until 2040 when a deficit of 4,960 ac-ft. will occur (Table 6). This annual shortfall will increase to 12,764 ac-ft. in 2070. As standalone strategies, implementing advances in plant breeding or change in crop type were sufficient to meet projected deficits in all time periods considered with estimated annual savings 32,271 ac-ft. and 19,951 ac-ft., respectively, by 2070. The effectiveness of the remaining strategies once fully implemented ranked as follows: irrigation scheduling (10,716 ac-ft.), irrigation equipment (9,081 ac-ft.), change in crop variety (7,685 ac-ft.), conversion to dryland (7,144 ac-ft.) and soil management (5,194 ac-ft.). Precipitation enhancement was not considered a viable option for the county.

Three combinations of strategies identified by the Ag subcommittee of PWPG were evaluated. However, it is important to understand that implementation of certain strategies can diminish the effectiveness of others if they are also used. Implementing any of the three combinations of strategies was sufficient to meet projected shortages. The combination of change in crop type, advances in plant breeding, irrigation scheduling, and irrigation equipment was estimated to be the most effective generating a surplus of 42,642 ac-ft. in 2070. While less effective, the combination of change in crop type, irrigation scheduling, and irrigation equipment and the strategy of implementing changes in crop variety, irrigation scheduling, and irrigation equipment also were sufficient generating annual surpluses of 23,606 ac-ft. and 11,629 ac-ft., respectively, by 2070.

Table 6: Moore County Projected Annual Irrigation Shortage and Water Savings by Strategy (acre-ft./year), 2020-2070.

| | | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
|--------------------------------|---|---------|---------|---------|---------|--------|--------|
| | Projected Irrigation Demand | 143,035 | 134,402 | 123,297 | 109,598 | 92,010 | 76,022 |
| | Projected Shortage | 7 | 7 | 7 | 7 | -3,882 | -6,171 |
| | Projected Water Savings | | | | | | |
| Water Saving Strategies | Change in Crop Type | 3,325 | 6,650 | 9,976 | 13,301 | 16,626 | 19,951 |
| | Change in Crop Variety | 2,562 | 5,124 | 7,685 | 7,685 | 7,685 | 7,685 |
| | Soil Management | 1,039 | 2,078 | 3,117 | 4,155 | 5,194 | 5,194 |
| | Conversion to Dryland | 3,572 | 7,144 | 7,144 | 7,144 | 7,144 | 7,144 |
| | Irrigation Equipment | 2,300 | 3,726 | 5,251 | 6,020 | 8,059 | 9,081 |
| | Irrigation Scheduling | 2,143 | 4,286 | 7,858 | 9,287 | 10,001 | 10,716 |
| | Precipitation Enhancement | 0 | 0 | 0 | 0 | 0 | 0 |
| | Advances in Plant Breeding | 7,446 | 13,321 | 28,560 | 31,763 | 32,271 | 32,271 |
| | Change in Crop Type, Irrigation Scheduling & Irrigation Equipment | 7,276 | 13,693 | 21,372 | 26,349 | 31,849 | 36,370 |
| | Change in Crop Variety, Irrigation Scheduling & Irrigation Equipment | 6,341 | 11,862 | 18,614 | 20,507 | 22,875 | 24,393 |
| | Change in Crop Type, Advances in Plant Breeding, Irrigation Scheduling & Irrigation Equipment | 13,308 | 24,120 | 41,895 | 47,571 | 52,037 | 55,406 |

Sherman County: Irrigation Shortages and Water Savings from Conservation Strategies

It is projected that Sherman County will have adequate but marginal surplus of water available for irrigation throughout the planning horizon (Table 7). Therefore, implementing any of the conservation strategies will only add to the surplus. The effectiveness of the individual strategies once fully implemented ranked as follows: advances in plant breeding (49,844 ac-ft.), change in crop type (28,639 ac-ft.), irrigation scheduling (16,450 ac-ft.), irrigation equipment (14,030 ac-ft.), conversion to dryland (10,967 ac-ft.), change in crop variety (9,325 ac-ft.) and soil management (6,739 ac-ft.). Precipitation enhancement was not considered a viable option for the county.

Three combinations of strategies identified by the Ag subcommittee of PWPG were evaluated. However, it is important to understand that implementation of certain strategies can diminish the effectiveness of others if they are also used. The combination of change in crop type, advances in plant breeding, irrigation scheduling, and irrigation equipment was estimated to be the most effective, generating an estimated annual water savings relative to the baseline of 83,721 ac-ft. in 2070. While less effective, the combination of change in crop type, irrigation scheduling, and irrigation equipment and the strategy of implementing changes in crop variety, irrigation scheduling, and irrigation equipment also generated substantial annual savings of 54,121 ac-ft. and 35,802 ac-ft., respectively, by 2070.

Table 7: Sherman County Projected Annual Irrigation Shortage and Water Savings by Strategy (acre-ft./year), 2020-2070.

| | | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
|--------------------------------|---|---------|---------|---------|---------|---------|---------|
| | Projected Irrigation Demand | 220,998 | 207,789 | 190,719 | 169,531 | 148,344 | 127,157 |
| | Projected Shortage | 32 | 32 | 32 | 32 | 32 | 32 |
| | Projected Water Savings | | | | | | |
| Water Saving Strategies | Change in Crop Type | 4,773 | 9,546 | 14,320 | 19,093 | 23,866 | 28,639 |
| | Change in Crop Variety | 3,108 | 6,217 | 9,325 | 9,325 | 9,325 | 9,325 |
| | Soil Management | 1,348 | 2,696 | 4,043 | 5,391 | 6,739 | 6,739 |
| | Conversion to Dryland | 5,484 | 10,967 | 10,967 | 10,967 | 10,967 | 10,967 |
| | Irrigation Equipment | 3,553 | 5,756 | 8,112 | 9,300 | 12,451 | 14,030 |
| | Irrigation Scheduling | 3,290 | 6,580 | 12,064 | 14,257 | 15,354 | 16,450 |
| | Precipitation Enhancement | 0 | 0 | 0 | 0 | 0 | 0 |
| | Advances in Plant Breeding | 11,572 | 20,447 | 44,121 | 49,226 | 49,844 | 49,844 |
| | Change in Crop Type, Irrigation Scheduling & Irrigation Equipment | 10,876 | 20,435 | 31,957 | 39,312 | 47,470 | 54,121 |
| | Change in Crop Variety, Irrigation Scheduling & Irrigation Equipment | 9,048 | 16,859 | 26,664 | 29,657 | 33,401 | 35,802 |
| | Change in Crop Type, Advances in Plant Breeding, Irrigation Scheduling & Irrigation Equipment | 20,156 | 36,498 | 63,651 | 72,285 | 78,846 | 83,721 |

Additional Irrigation Supply from Groundwater Wells

While the PWPG does not recommend new groundwater wells as a strategy to meet future irrigation needs during the planning period, drilling of new wells is an option for irrigation water users who require additional supplies. Approximate cost estimates were developed to determine the expense associated with installing irrigation wells. Calculations assumed a well with a depth of 375 feet, pumping at less than 700 gpm costs \$95 per foot; and pumping equipment is estimated at \$75 per foot. At the 500 foot well depth level, drilling cost was estimated at \$110 per foot and pumping equipment cost estimates varied as to whether a submersible or electric turbine was employed (personal communication with Curry Drilling). Table 8 summarizes two scenarios: a pumping rate of less than and greater than 700 gallons per minute.

Table 8: Estimated Costs of Irrigation Wells in Region A

| Pumping Rate (gpm) | Approximate Well Depth (ft.) | Approximate Well Casing Diameter (in.) | Approximate Pumping Unit Diameter (in.) | Well Cost | Pumping Equipment Cost | Total Cost |
|--------------------|------------------------------|--|---|-----------|------------------------|------------|
| Less than 700 | 375 | 12¾ | 4 - 6 | \$33,750 | \$25,500 | \$59,250 |
| Greater than 700 | 500 | 16 | 8 | \$55,000 | \$54,500 ¹ | \$109,500 |
| | | | | \$55,000 | \$61,000 ² | \$116,000 |

¹ Assumes submersible pump and associated equipment

² Assumes electric turbine and associated equipment

Summary of Irrigation Conservation Strategies

Prioritizing and implementing the eight irrigation conservation strategies will depend on the individual irrigator and regional support for the strategy. The one strategy that yields the largest water savings is the adoption of drought resistant varieties of corn, cotton, sorghum, soybeans and wheat which are being developed with the aid of advances in plant breeding. It is estimated to have the potential to save 13.8 million ac-ft. (cumulative savings), which was 22.6 percent of the total irrigation water pumped over the 60-year planning horizon and is significantly more than the other strategies evaluated. The cumulative effectiveness of the remaining strategies in millions of ac-ft. ranked as follows: change in crop type (6.4), irrigation scheduling (4.7), conversion to dryland (4.2), irrigation equipment (3.6), change in crop variety (3.1), soil management (2.0) and precipitation enhancement (0.8).

Implementation cost can be a critical barrier to the adoption or rate of adoption of water conservation strategies. The estimated cost of implementing the various strategies expressed in \$/ac-ft. of water savings varied considerably. The cost of implementing soil management actually was negative suggesting producers would save money by utilizing soil conservation techniques (-\$17.76 per ac-ft.). Precipitation enhancement, advances in plant breeding, and irrigation equipment were the next three most cost effective strategies at \$8.11, \$8.20 and \$15.27 per ac-ft., respectively. The remaining strategies where implementation cost where identified included change in crop type, conversion to dryland and irrigation scheduling had implementation costs estimated at \$31.27, \$34.94 and \$44.69 per ac-ft., respectively.

Water savings generated by conservation strategies not only help meet regional goals for water conservation but have a direct benefit to producers through reduced pumping costs. Savings in pumping cost exceeded the estimated cost of implementation for five of the strategies leading to a negative net cost per acre foot of water saved. These strategies were; soil management (-\$126.99), advances in plant breeding (-\$102.63), precipitation enhancement (-\$101.09), irrigation equipment (-\$93.93) and irrigation scheduling (-\$64.51). This suggests these strategies may be readily adopted if the implementation cost can be overcome. The remaining three strategies, change in crop variety, conversion to dryland and change in crop type had a positive

net cost to implementation indicating more significant monetary enticements will be necessary to encourage adoption of these strategies.

Water conservation strategies can have significantly different impacts on the regional economy which is often measured by the change in gross receipts or costs. The impact on the regional economy should be a major consideration in prioritizing strategies to be implemented. In this planning effort, no attempt was made to quantify the impacts of individual strategies on the regional economy; however, the anticipated direction of effect(s) was included. Change in crop type, change in crop variety and conversion to dryland are all anticipated to have a negative impact due to the reduction in production. The remaining five conservation strategies are all expected to have a positive impact due to a reduction in costs without reducing yields leading to a "freeing up" of income to be spent in the economy.

The counties of Dallam, Hartley and Moore are projected to have irrigation shortfalls while Sherman is expected to have a marginal surplus. None of the individual or combinations of strategies evaluated was able to generate sufficient water savings to cover projected deficits in the near term (prior to 2050) in Dallam and Hartley Counties. Once fully in place, two of the combinations of strategies yielded sufficient water savings to overcome the projected deficits in later years. The two combinations were; change in crop type, advances in plant breeding, irrigation scheduling, and irrigation equipment and change in crop type, irrigation scheduling and irrigation equipment. In Moore County, implementing advances in plant breeding or change in crop type or any of the three combinations of strategies were sufficient to meet projected deficits in all time periods while employing one or any combination of identified water conservation strategies will add to the projected surplus in Sherman County.


Several caveats to this analysis need to be mentioned. First, the associated water savings with these strategies are "potential" water savings. In the absence of water use constraints, most of the strategies considered will simply increase gross receipts. In fact, the improved water use efficiencies generated from some of these strategies may actually increase the depletion rate of the Ogallala Aquifer. Second, potential water savings may be overestimated when combinations of strategies are implemented. For example, the savings associated with the implementation of irrigation equipment efficiency improvements cannot be applied to irrigated land that is converted to dryland farming. In this analysis, the decrease in water savings from using multiple conservation strategies is estimated for three combinations. Finally, precipitation enhancement is not a strategy that a producer can implement. It has to be funded and implemented by a group such as a water district. Currently, only the Panhandle Groundwater Conservation District practices precipitation enhancement. At this time, none of the other water districts have any plans to adopt precipitation enhancement; therefore, estimated water savings may be overestimated depending on location.

References

- Amosson, S. H., L. Almas, B. Guerrero, D. Jones, M. Jones and L. Guerrero. "Texas Crops and Livestock Budgets, Texas High Plains, Projected for 2014." December, 2013. B-1241, Texas A&M AgriLife Extension Service, College Station, Texas. 95pp
- Amosson, S., L. K. Almas, J.R. Girase, N. Kenny, B. Guerrero, K. Vimlesh, and T. Marek. Economics of irrigation systems. AgriLife Extension Publication no. B-6113. Texas A&M University. Available at <http://amarillo.tamu.edu/files/2011/10/Irrigation-Bulletin-FINAL-B6113.pdf>
- ASFMRA. 2013. Texas rural land value trends 2013. Texas Chapter of the American Society of Farm Managers and Rural Appraisers, Inc. Available at <http://www.txasfmra.com/rural-land-trends>
- CTIC. 2014. Tillage Type Definitions. Conservation Technology Information center. Available at <http://www.ctic.purdue.edu/resourcedisplay/322/>
- Encyclopedia Britannica. 2014. Weather Modification. Accessed April 2014, available at <http://www.britannica.com/EBchecked/topic/638346/weather-modification>
- Howell, T. A. 1996. Irrigation scheduling research and its impact on water use. In C.R. Camp, E.J. Sadler, and R.E. Yoder (eds.) *Evapotranspiration and Irrigation Scheduling*, Proceedings of the International Conference, Nov. 3-6, 1996, San Antonio, TX, American Society of Agricultural Engineers, St. Joseph, MI.
- Howell, T.A., J.A. Tolk, A.D. Schneider, and S.R. Evett. 1998. Evapotranspiration, yield, and water use efficiency of corn hybrids differing in maturity. *Agronomy Journal*. 90(1): 3-9.
- Klose, S., S. Amosson, S. Bevers, B. Thompson, J. Smith, M. Young and M. Waller. "2013 Texas Agricultural Custom Rates." May, 2013. Texas A&M AgriLife Extension Service, College Station, Texas.
- Personal communication. Curry Drilling. Canyon, Texas. November, 2014.
- TDLR. 2014. Harvesting the Texas skies in 2011 – A summary of rain enhancement (cloud seeding) operations in Texas. Texas Department of Licensing and Regulation. Available at <http://www.tdlr.texas.gov/weather/summary.htm>
- USDA. 2014. Index for prices paid for farm machinery, 2011 base. USDA NASS Quick Stats. Available at http://www.nass.usda.gov/Quick_Stats/



Appendix E
Cost Estimates

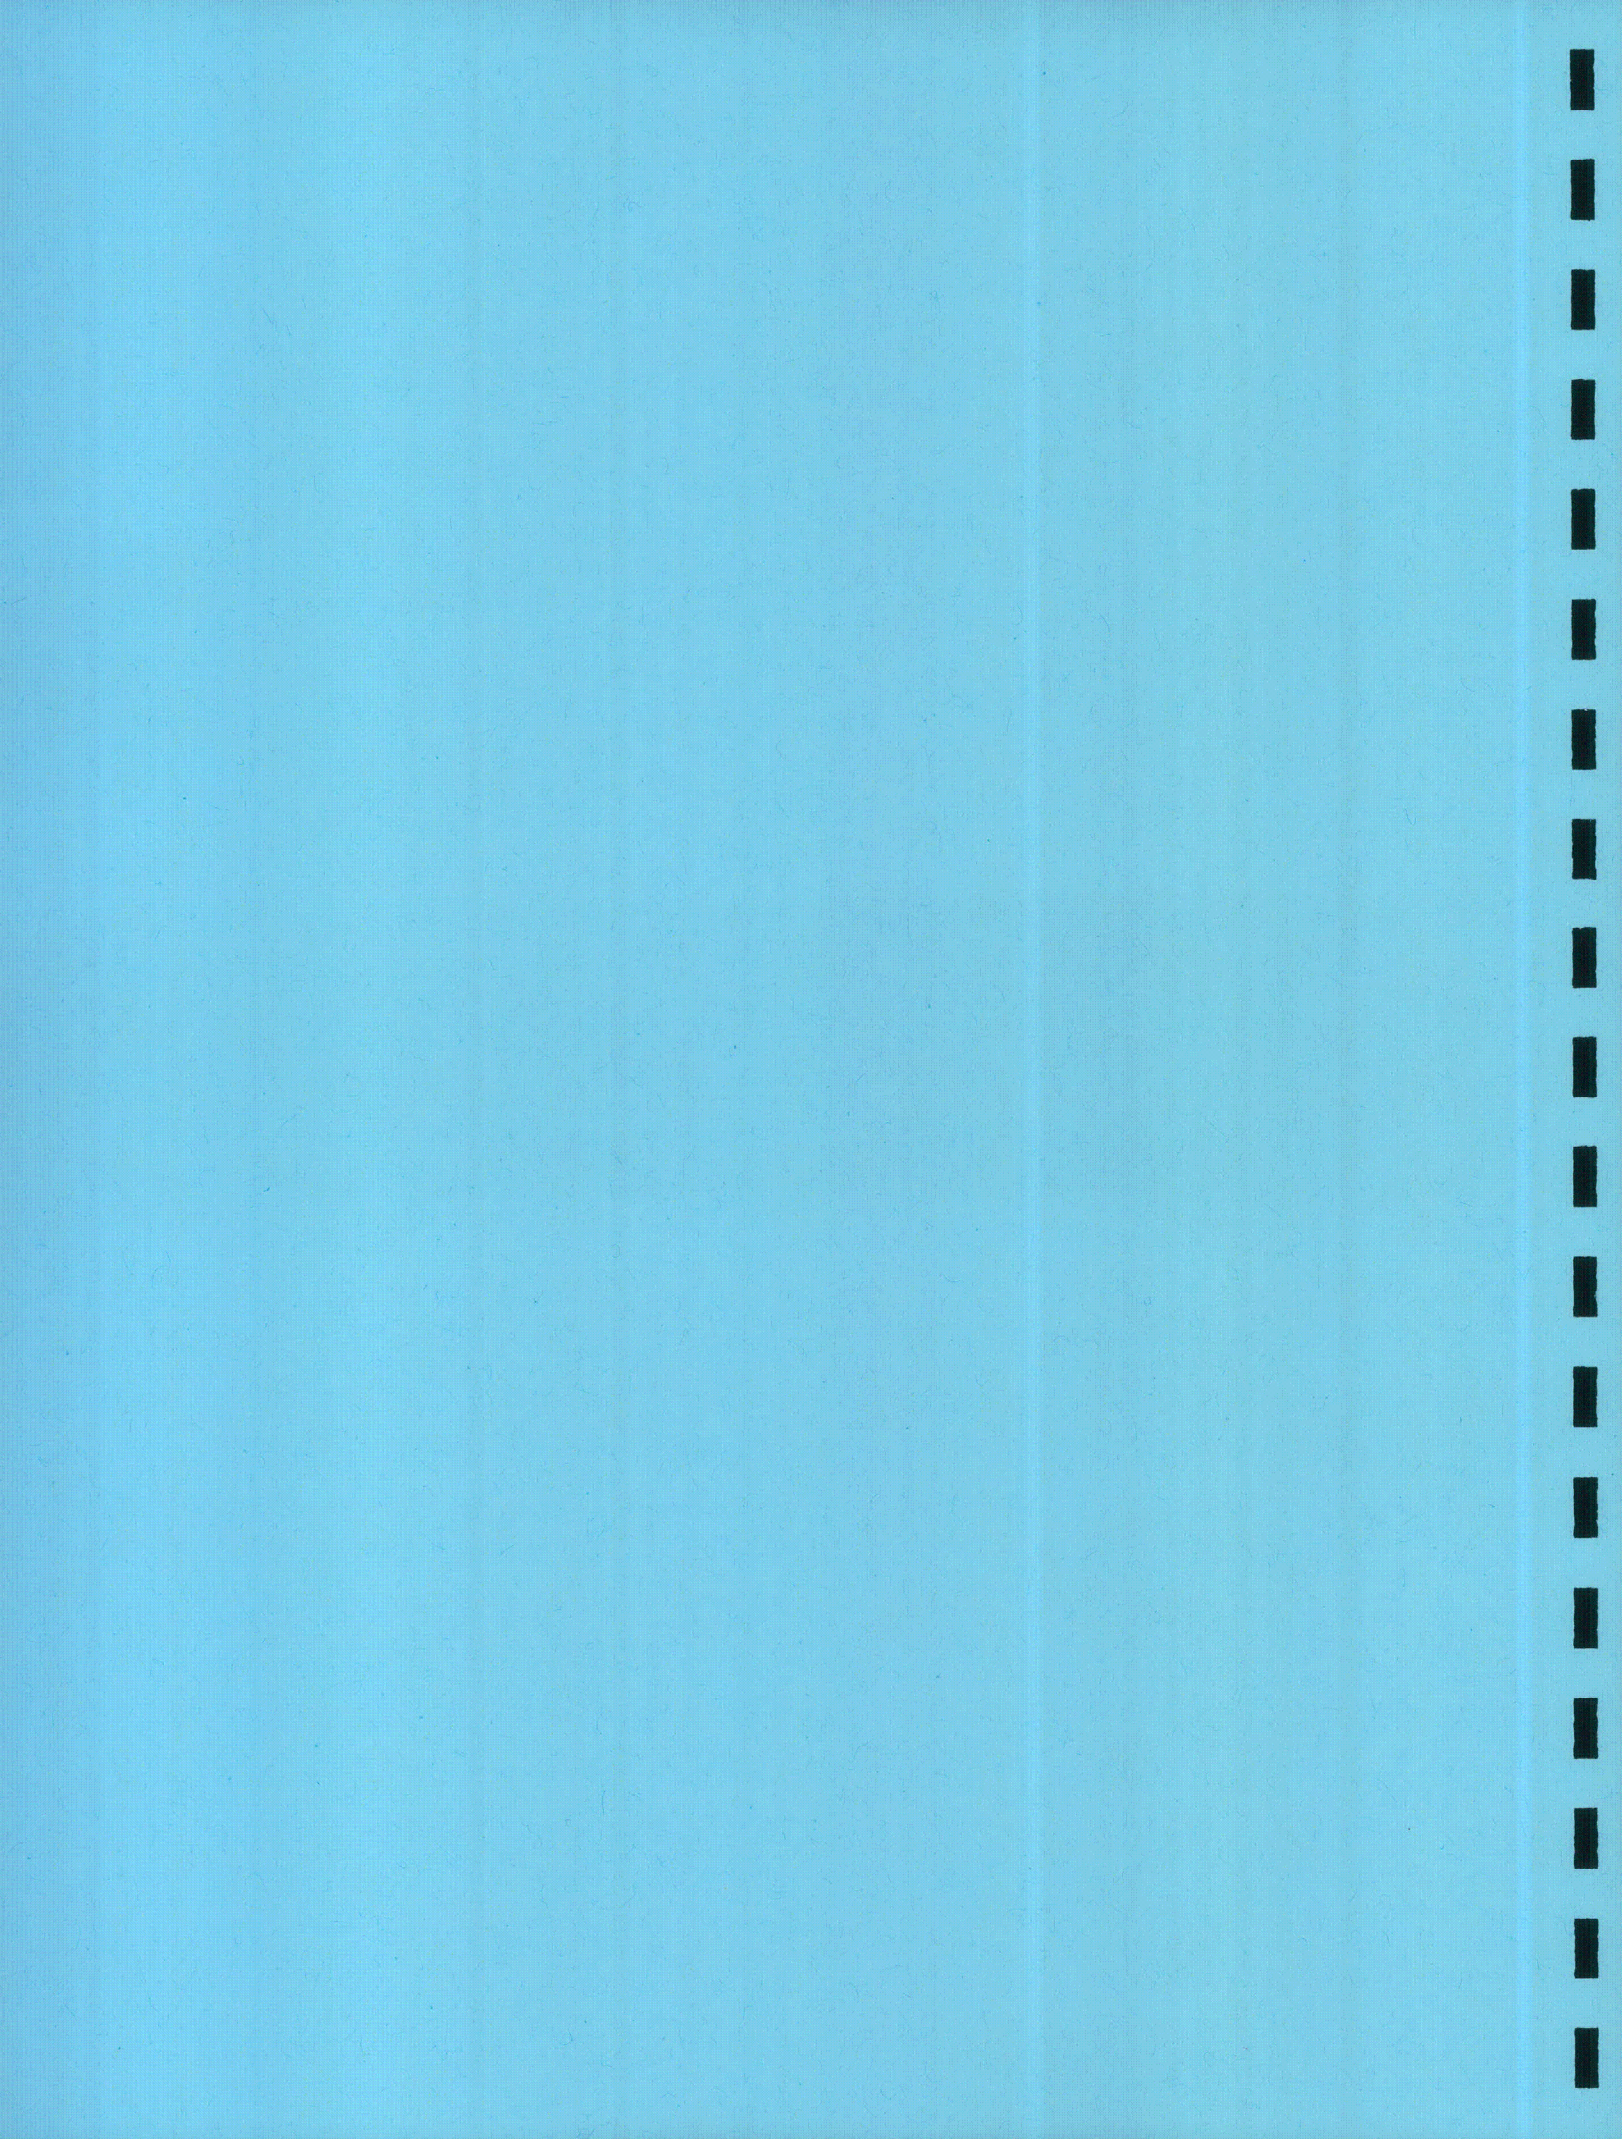

Appendix E
Cost Estimates

| Table | WUG | Strategy | Page |
|------------|--|--|------|
| Table E-1 | City of Amarillo | Develop Potter County Well Field (Ogallala Aquifer) | E-12 |
| Table E-2 | City of Amarillo | Develop Carson County Well Field (Ogallala Aquifer) | E-13 |
| Table E-3 | City of Amarillo | Develop Roberts County Well Field (Ogallala Aquifer) | E-14 |
| Table E-4 | City of Amarillo | Direct Reuse | E-15 |
| Table E-5 | Canadian River Municipal Water Authority | Replace Capacity of Roberts County Well Field (Ogallala Aquifer) in 2030 | E-16 |
| Table E-6 | Canadian River Municipal Water Authority | Replace Capacity of Roberts County Well Field (Ogallala Aquifer) in 2050 | E-17 |
| Table E-7 | Canadian River Municipal Water Authority | Expansion of Roberts County Well Field (Ogallala Aquifer) in 2024 | E-18 |
| Table E-8 | Canadian River Municipal Water Authority | Aquifer Storage and Recovery | E-19 |
| Table E-9 | City of Borger | Develop New Well Field (Ogallala Aquifer) | E-20 |
| Table E-10 | City of Cactus | Develop New Well Field (Ogallala Aquifer) | E-21 |
| Table E-11 | Palo Duro River Authority | Connecting to Palo Duro Reservoir | E-22 |
| Table E-12 | Greenbelt Municipal and Industrial Water Authority | Ogallala Aquifer in Donley County | E-30 |
| Table E-13 | City of Claude | Develop Ogallala Aquifer Supplies | E-31 |
| Table E-14 | City of Panhandle | Develop Ogallala Aquifer Supplies | E-32 |
| Table E-15 | City of Wellington | Develop Seymour Aquifer Supplies | E-33 |
| Table E-16 | City of Wellington | Advanced Treatment (Nitrate Removal) | E-34 |
| Table E-17 | City of Dalhart | Develop Ogallala Aquifer Supplies | E-35 |
| Table E-18 | City of Texline | Develop Ogallala Aquifer Supplies | E-36 |
| Table E-19 | City of McLean | Develop Ogallala Aquifer Supplies | E-37 |
| Table E-20 | City of Pampa | Develop Ogallala Aquifer Supplies | E-38 |
| Table E-21 | City of Memphis | Develop Ogallala Aquifer Supplies | E-39 |
| Table E-22 | County Other - Hall County (Brice-Lesley) | New Groundwater Source | E-40 |
| Table E-23 | County Other - Hall County (Estelline) | New Groundwater Source | E-41 |
| Table E-24 | County Other - Hall County (Lakeview) | Advanced Treatment (Nitrate Removal) | E-42 |
| Table E-25 | County Other - Hall County (Turkey) | New Groundwater Source | E-43 |
| Table E-26 | City of Gruver | Develop Ogallala Aquifer Supplies | E-44 |
| Table E-27 | City of Spearman | Develop Ogallala Aquifer Supplies | E-45 |
| Table E-28 | City of Stinnett | Develop Ogallala Aquifer Supplies | E-46 |
| Table E-29 | TCW Supply Inc. | Develop Ogallala Aquifer Supplies | E-47 |
| Table E-30 | City of Booker | Develop Ogallala Aquifer Supplies | E-48 |
| Table E-31 | City of Dumas | Develop Ogallala Aquifer Supplies | E-49 |
| Table E-32 | City of Sunray | Develop Ogallala Aquifer Supplies | E-50 |
| Table E-33 | Manufacturing Moore County | Develop Ogallala Aquifer Supplies | E-51 |
| Table E-34 | City of Perryton | Develop Ogallala Aquifer Supplies | E-52 |
| Table E-35 | County Other - Potter County | Develop Ogallala Aquifer Supplies | E-53 |
| Table E-36 | County Other - Potter County | Develop Dockum Aquifer Supplies | E-54 |
| Table E-37 | Manufacturing Potter County | Direct Reuse | E-55 |
| Table E-38 | City of Canyon | Drill Nine Wells (Dockum Aquifer) | E-56 |

Appendix E
Cost Estimates

| Table | WUG | Strategy | Page |
|--------------|--------------------------------|-----------------------------------|-------------|
| Table E-39 | Lake Tanglewood | Develop Ogallala Aquifer Supplies | E-57 |
| Table E-40 | County Other - Randall County | Develop Ogallala Aquifer Supplies | E-58 |
| Table E-41 | Manufacturing - Randall County | Develop Ogallala Aquifer Supplies | E-59 |
| Table E-42 | City of Wheeler | Develop Ogallala Aquifer Supplies | E-60 |

Region A Regional Water Planning Area Cost Estimates

As part of the 2011 PWPA Regional Water Plan, cost estimates were developed for each of the recommended water management strategies in Region A. As appropriate, these cost estimates have been updated for the 2016 regional water plan. In accordance with the Texas Water Development Board guidance the costs for water management strategies are to be updated from second quarter 2008 dollars to September 2013 dollars. The methodology used to develop the 2016 costs is described in the following sections. Where updated unit costs were not available, the Engineering News Record (ENR) Index for construction was used to increase the costs from second quarter 2008 (September) costs to September 2013 costs. An increase of 111.6% from September 2008 to September 2013 was determined using the ENR Index method.

Introduction

1. The evaluation of water management strategies requires developing cost estimates. Guidance for cost estimates may be found in the TWDB's "First Amended General Guidelines for Regional Water Plan Development (2012-2017)", Section 5.1. Costs are to be reported in September 2013 dollars.
2. Standard unit costs for installed pipe, pump stations, standard treatment facilities, and well fields were developed and/or updated using the costing tool provided by the TWDB. The unit costs do not include engineering, contingency, financial and legal services, costs for land and rights-of-way, permits, environmental and archeological studies, or mitigation. The costs for these items are determined separately in the cost tables.
3. The information presented in this section is intended to be 'rule-of-thumb' guidance. Specific situations may call for alteration of the procedures and costs. Note that the costs in this memorandum provide a planning level estimate for comparison purposes.
4. It is important that when comparing alternatives that the cost estimates be similar and include similar items. If an existing reliable cost estimate is available for a project it should be used where appropriate. All cost estimates must meet the requirements set forth in the TWDB's "First Amended General Guidelines for Regional Water Plan Development (2012-2017)".
5. The cost estimates have two components:
 - Initial Capital Costs: Including total construction cost of facilities, engineering and legal contingencies, environmental and archaeology studies and mitigation, land acquisition and surveying, and interest incurred during construction (4.0% annual interest rate less a 1.0% rate of return on investment of unspent funds).

- Average Annual Costs: Including annual operation and maintenance costs, pumping energy costs, purchase of water and debt service.

TWDB does not require the consultant to determine life cycle or present value analysis. For most situations annual costs are sufficient for comparison purposes and a life-cycle analysis is not required.

ASSUMPTIONS FOR CAPITAL COSTS:

Conveyance Systems

The unit costs and factors shown in Tables 1-7 were developed directly from the TWDB costing tool. These costs are the basis of the capital costs developed for this plan. Standard pipeline costs used for these cost estimates are shown in Table 1. Pump station costs are based on required Horsepower capacity and are listed in Table 2. The power capacity is to be determined from the hydraulic analyses included in the TWDB costing tool (or detailed analysis if available). Pipelines and pump stations are to be sized for peak pumping capacity.

- Pump efficiency is assumed to be 70 percent.
- Peaking factor of 2 times the average demand is to be used for strategies when the water is pumped directly to a water treatment plant. (or historical peaking factor, if available)
- The target flow velocity in pipes is 5 fps and the Hazen-Williams Factor is assumed to be 120.
- Peaking factor of 1.2 to 1.5 can be used if there are additional water sources and/or the water is transported to a terminal storage facility.
- Ground storage is to be provided at each booster pump station along the transmission line unless there is a more detailed design.
- Ground storage tanks should provide sufficient storage for 2.5 to 4 hours of pumping at peak capacity. Costs for ground storage are shown in Table 3. Covered storage tanks are used for all strategies transporting treated water.

Water Treatment Plants

Water treatment plants are to be sized for peak day capacity (assume peaking factor of 2 if no specific data is available). Costs estimated include six different treatment levels of varying degree. These levels are groundwater chlorine disinfection, iron and manganese removal, simple filtration, construction of a

Appendix E
Cost Estimates

new conventional treatment plant, expansion of a conventional treatment plant, brackish desalination, and seawater desalination. Costs are also based upon a TDS factor that will increase or decrease the cost of treatment accordingly. These costs are summarized in Table 4. **All treatment plants are to be sized for finished water capacity.**

Direct Reuse

Direct reuse refers to the introduction of reclaimed water directly from a water reclamation plant to a distribution system. The following assumptions were made for direct potable and non-potable reuse strategies.

Direct Non-Potable Reuse

Non-potable reuse is the use of reclaimed water that is used directly for non-potable beneficial uses such as landscape irrigation. The TWDB costing tool currently does not have a direct non-potable reuse treatment plant improvements option, therefore the following assumptions were made.

- It was assumed that the cost of an iron and manganese removal plant would be an appropriate approximation of the improvements that would be needed at the Wastewater Treatment Plant. This cost was further refined by assuming that only upgrades to an existing facility would be required, and not construction of an entirely new plant.
- Approximately two miles of 6-inch pipeline was also included in the cost estimates for transport of the treated water to the destination. Since reuse is still relatively new, there is a lack of piping infrastructure for reuse water. It was also assumed that the pump station was included in the WWTP improvements.

Direct Potable Reuse

Direct potable reuse is the use of reclaimed water that is transported directly from a wastewater treatment plant to a drinking water system. The TWDB costing tool currently does not have a direct potable reuse treatment plant improvements option, therefore the following assumptions were made.

- Due to the high level of treatment that is required for direct potable reuse, the wastewater treatment plant improvements cost was assumed to be equivalent to 75% of a conventional treatment plant expansion plus brackish desalination treatment

improvements. The 25% discount was given to Level 3 Treatment in order to alleviate any redundancy being assumed by the costing tool.

New Groundwater Wells

Cost estimates required for water management strategies that include additional wells or well fields were determined through the TWDB costing tool (unless a more detailed design was available). The associated costs are shown in Table 5. The costing tool differentiated the wells based upon purpose. The categories were Public Supply, Irrigation, and ASR. These cost relationships are “rule-of-thumb” in nature and are only appropriate in the broad context of the cost evaluations for the RWP process.

The cost relationships assume construction methods required for public water supply wells, including carbon steel surface casing and pipe-based, stainless steel, and wire-wrap screen. The cost estimates assume that wells would be gravel-packed in the screen sections and the surface casing cemented to their total depth. Estimates include the cost of drilling, completion, well development, well testing, pump, motor, motor controls, column pipe, installation and mobilization. The cost relationships do not include engineering, contingency, financial and legal services, land costs, or permits. A more detailed cost analysis should be completed prior to developing a project.

The costs associated with conveyance systems for multi-well systems can vary widely based on the distance between wells, terrain characteristics, well production, and distance to the treatment facility. These costs should be estimated using standard engineering approaches and site-specific information. For planning purposes, these costs were estimated using the TWDB costing tool’s assumptions for conveyance. It is important to note that conveyance costs were not included for point of use water user groups such as mining.

Other Costs

- Engineering, contingency, construction management, financial and legal costs are to be estimated at 30 percent of construction cost for pipelines and 35 percent of construction costs for pump stations, treatment facilities and reservoir projects. (This is in accordance with TWDB guidance.)
- Permitting and mitigation for transmission and treatment projects are to be estimated at \$25,000 per mile. For reservoirs, mitigation and permitting costs are assumed equal to twice the land purchase cost, unless site specific data is available.

Appendix E
Cost Estimates

- Right-of-way (ROW) costs for transmission lines are estimated through costs provided by the Texas A&M University Real Estate Center (<http://recenter.tamu.edu/data/rland/>) which gives current land costs based on county. The ROW width is assumed to be 20 ft. If a small pipeline follows existing right-of-ways (such as highways), no additional right-of-way cost may be assumed. Large pipelines will require ROW costs regardless of routing.

Interest during construction is the total of interest accrued at the end of the construction period using a 4.0 percent annual interest rate on total borrowed funds, less a 1 percent rate of return on investment of unspent funds. This is calculated assuming that the total estimated project cost (excluding interest during construction) would be drawn down at a constant rate per month during the construction period. Factors were determined for different lengths of time for project construction. These factors were used in cost estimating and are presented in Table 6.

ASSUMPTIONS FOR ANNUAL COSTS:

Annual costs are to be estimated using the following assumptions:

- Debt service for all transmission and treatment facilities is to be annualized over 20 years, but not longer than the life of the project. [Note: uniform amortization periods should be used when evaluating similar projects for an entity.]
- Annual interest rate for debt service is 5.5 percent.
- Water purchase costs are to be based on wholesale rates reported by the selling entity when possible. In lieu of known rates, a typical regional cost for treated water and raw water will be developed.
- Operation and Maintenance costs are to be calculated based on the construction cost of the capital improvement. Engineering, permitting, etc. should not be included as a basis for this calculation. However, a 20% allowance for construction contingencies should be included for all O&M calculations. Per the “First Amended General Guidelines for Regional Water Plan Development (2012-2017)”, O&M should be calculated at:
 - 1 percent of the construction costs for pipelines
 - 1.5 percent for dams
 - 2.5 percent of the construction costs for pump stations
 - O&M Costs for the varying levels of water treatment plant improvements were developed by the TWDB and are shown in Table 7.
- Pumping costs are to be estimated using an electricity rate of \$0.09 per Kilowatt Hour. If local data is available, this can be used.

Table 1
Pipeline Costs

| Diameter (Inches) | Soil | | Rock | |
|----------------------|--------------------|--------------------|--------------------|-----------------|
| | Rural (\$/Foot) | Urban (\$/Foot) | Rural (\$/Foot) | Urban (Feet) |
| 6 | \$18 | \$25 | \$22 | \$30 |
| 8 | \$28 | \$39 | \$34 | \$47 |
| 10 | \$31 | \$44 | \$38 | \$53 |
| 12 | \$35 | \$48 | \$41 | \$58 |
| 14 | \$46 | \$64 | \$55 | \$78 |
| 16 | \$57 | \$81 | \$68 | \$97 |
| 18 | \$68 | \$97 | \$83 | \$116 |
| 20 | \$81 | \$112 | \$96 | \$135 |
| 24 | \$103 | \$144 | \$123 | \$172 |
| 30 | \$137 | \$191 | \$164 | \$230 |
| 36 | \$170 | \$239 | \$204 | \$287 |
| 42 | \$204 | \$286 | \$246 | \$343 |
| 48 | \$239 | \$334 | \$286 | \$401 |
| 54 | \$273 | \$382 | \$327 | \$457 |
| 60 | \$306 | \$429 | \$368 | \$515 |
| 66 | \$358 | \$501 | \$430 | \$602 |
| 72 | \$419 | \$587 | \$504 | \$705 |
| 78 | \$490 | \$687 | \$589 | \$825 |
| 84 | \$574 | \$804 | \$689 | \$965 |
| 90 | \$672 | \$941 | \$806 | \$1,129 |
| 96 | \$772 | \$1,082 | \$927 | \$1,298 |
| 102 | \$865 | \$1,211 | \$1,038 | \$1,453 |
| 108 | \$952 | \$1,332 | \$1,142 | \$1,599 |
| 114 | \$1,047 | \$1,465 | \$1,256 | \$1,758 |
| 120 | \$1,152 | \$1,612 | \$1,382 | \$1,934 |
| 132 | \$1,324 | \$1,854 | \$1,589 | \$2,225 |
| 144 | \$1,523 | \$2,132 | \$1,828 | \$2,559 |

**Table 2
 Pump Station Costs**

| Horsepower | Booster PS Cost (\$-million) | Intake PS cost (\$-millions) |
|-------------------|---|---|
| 0 | \$0.00 | \$0.00 |
| 5 | \$0.62 | \$0.67 |
| 10 | \$0.68 | \$0.72 |
| 20 | \$0.72 | \$0.77 |
| 25 | \$0.75 | \$0.82 |
| 50 | \$0.79 | \$1.03 |
| 100 | \$0.83 | \$1.55 |
| 200 | \$1.67 | \$2.06 |
| 300 | \$1.83 | \$2.58 |
| 400 | \$2.32 | \$3.09 |
| 500 | \$2.39 | \$3.61 |
| 600 | \$2.45 | \$4.12 |
| 700 | \$2.52 | \$4.64 |
| 800 | \$2.97 | \$5.15 |
| 900 | \$3.08 | \$5.67 |
| 1,000 | \$3.20 | \$6.18 |
| 2,000 | \$4.33 | \$8.66 |
| 3,000 | \$5.46 | \$10.00 |
| 4,000 | \$6.60 | \$11.34 |
| 5,000 | \$7.73 | \$12.37 |
| 6,000 | \$8.87 | \$13.40 |
| 7,000 | \$10.00 | \$14.43 |
| 8,000 | \$11.13 | \$15.46 |
| 9,000 | \$12.27 | \$16.49 |
| 10,000 | \$13.40 | \$17.52 |
| 20,000 | \$24.74 | \$28.86 |
| 30,000 | \$29.69 | \$38.13 |
| 40,000 | \$37.11 | \$48.44 |
| 50,000 | \$46.39 | \$57.72 |
| 60,000 | \$55.67 | \$66.99 |
| 70,000 | \$66.80 | \$77.30 |

Note:

1. Intake PS costs include intake and pump station.
2. Adjust pump station costs upward if the pump station is designed to move large quantities of water at a low head (i.e. low horsepower).
3. Assumed multiple pump setup for all pump stations.

Table 3
Ground Storage Tanks

| Tank Volume (MG) | With Roof (\$) | Without Roof (\$) |
|------------------|----------------|-------------------|
| 0.05 | \$178,301 | \$118,524 |
| 0.1 | \$192,730 | \$174,179 |
| 0.5 | \$412,257 | \$374,123 |
| 1 | \$698,776 | \$618,386 |
| 1.5 | \$967,774 | \$674,041 |
| 2 | \$1,236,772 | \$803,902 |
| 2.5 | \$1,339,836 | \$922,426 |
| 3 | \$1,442,900 | \$1,040,950 |
| 3.5 | \$1,649,029 | \$1,154,320 |
| 4 | \$1,855,158 | \$1,267,691 |
| 5 | \$2,061,286 | \$1,463,513 |
| 6 | \$2,370,479 | \$1,752,093 |
| 7 | \$2,782,736 | \$2,009,754 |
| 8 | \$3,194,994 | \$2,370,479 |
| 10 | \$3,997,864 | \$3,071,316 |
| 12 | \$4,997,331 | \$3,916,444 |
| 14 | \$6,021,017 | \$4,740,958 |

Note: Costs assume steel tanks smaller than 1 MG, concrete tanks 1 MG and larger.

Table 4
Conventional Water Treatment Plant Costs

| | Level 0 | Level 1 | Level 2 | Level 3 (new) | Level 3 (exp) | Level 4 | Level 5 |
|----------------|----------------------------|--------------------------|-------------------|------------------------|------------------------|-----------------------|-----------------------|
| | Chlorine Disinfection (GW) | Iron & Manganese Removal | Simple Filtration | Conventional Treatment | Conventional Treatment | Brackish Desalination | Seawater Desalination |
| Capacity (MGD) | Capital Cost (\$) | Capital Cost (\$) | Capital Cost (\$) | Capital Cost (\$) | Capital Cost (\$) | Capital Cost (\$) | Capital Cost (\$) |
| 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| 0.1 | 17,948 | 224,345 | 1,030,643 | 1,373,739 | 1,373,739 | 916,221 | 2,202,644 |
| 1 | 69,098 | 900,371 | 3,607,251 | 4,844,022 | 4,844,022 | 3,664,883 | 14,738,196 |
| 10 | 440,703 | 3,747,009 | 19,066,897 | 32,980,578 | 18,551,575 | 24,777,648 | 98,615,306 |
| 50 | 2,203,515 | 10,882,523 | 72,145,015 | 135,606,271 | 66,991,800 | 94,233,468 | 372,343,747 |
| 75 | 3,305,272 | 15,701,003 | 105,469,141 | 199,327,155 | 106,502,260 | 131,935,273 | 520,364,186 |
| 100 | 4,407,030 | 19,236,530 | 138,793,267 | 261,974,046 | 129,095,574 | 167,517,457 | 659,848,640 |
| 150 | 6,610,545 | 29,438,241 | 205,441,519 | 385,074,680 | 193,640,235 | 234,539,403 | 922,162,931 |
| 200 | 8,814,060 | 33,898,368 | 272,089,771 | 506,100,496 | 238,822,748 | 297,793,331 | 1,169,350,182 |

Note: Plant is sized for finished peak day capacity.

Table 5
Cost Elements for Water Wells

| Public Supply Well Costs | | | | | | |
|---------------------------------|------------|------------|-------------|-------------|-------------|-------------|
| Well Capacity (MGD) | | | | | | |
| Well Depth (ft) | 100 | 175 | 350 | 700 | 1000 | 1800 |
| 150 | \$124,138 | \$188,450 | \$321,561 | \$363,439 | \$453,177 | \$662,565 |
| 300 | \$167,510 | \$239,301 | \$382,882 | \$438,220 | \$541,419 | \$767,259 |
| 500 | \$216,867 | \$299,127 | \$454,672 | \$523,472 | \$644,618 | \$892,892 |
| 700 | \$261,736 | \$352,969 | \$518,984 | \$601,244 | \$737,347 | \$1,003,569 |
| 1000 | \$343,996 | \$451,681 | \$638,635 | \$743,330 | \$909,345 | \$1,209,967 |
| 1500 | \$481,594 | \$617,696 | \$836,059 | \$981,135 | \$1,193,515 | \$1,550,971 |
| 2000 | \$619,192 | \$782,216 | \$1,033,482 | \$1,218,941 | \$1,479,181 | \$1,893,471 |
| Irrigation Well Costs | | | | | | |
| 150 | \$68,800 | \$106,190 | \$180,972 | \$207,893 | \$263,231 | \$379,891 |
| 300 | \$91,234 | \$136,103 | \$221,353 | \$261,736 | \$332,031 | \$463,646 |
| 500 | \$113,669 | \$170,502 | \$264,727 | \$320,065 | \$406,812 | \$560,863 |
| 700 | \$131,615 | \$195,928 | \$302,118 | \$369,422 | \$472,620 | \$644,618 |
| 1000 | \$171,998 | \$252,762 | \$379,891 | \$471,124 | \$602,740 | \$809,137 |
| 1500 | \$240,797 | \$349,979 | \$508,515 | \$640,130 | \$818,111 | \$1,081,342 |
| 2000 | \$308,100 | \$444,203 | \$637,139 | \$807,642 | \$1,034,978 | \$1,355,043 |
| ASR Well Costs | | | | | | |
| 150 | \$137,598 | \$212,379 | \$369,422 | \$417,282 | \$520,480 | \$767,259 |
| 300 | \$180,972 | \$263,231 | \$430,742 | \$492,063 | \$608,723 | \$873,449 |
| 500 | \$230,327 | \$324,553 | \$502,532 | \$577,315 | \$713,417 | \$997,587 |
| 700 | \$276,692 | \$378,395 | \$568,341 | \$655,087 | \$804,651 | \$1,109,759 |
| 1000 | \$357,456 | \$477,107 | \$686,496 | \$797,173 | \$976,649 | \$1,314,662 |
| 1500 | \$496,550 | \$641,627 | \$883,919 | \$1,034,978 | \$1,260,819 | \$1,655,665 |
| 2000 | \$632,653 | \$806,146 | \$1,081,342 | \$1,272,783 | \$1,546,484 | \$1,998,165 |

Table 6
Factors for Interest During Construction

| Construction Period | Factor |
|----------------------------|---------------|
| 6 months | 0.0175 |
| 12 months | 0.035 |
| 18 months | 0.0525 |
| 24 months | 0.07 |
| 36 months | 0.105 |
| 48 month | 0.14 |
| 60 months | 0.175 |
| 72 months | 0.21 |
| 84 months | 0.245 |

Table 7
Annual Water Treatment Plant O&M Costs

| Capacity (MGD) | Level 0 Chlorine Disinfection (GW) | Level 1 Iron & Manganese Removal | Level 2 Simple Filtration | Level 3 (New) Conventional Treatment | Level (Exp) Conventional Treatment | Level 4 Brackish Desalination | Level 5 Seawater Desalination |
|----------------|---------------------------------------|-------------------------------------|------------------------------|---|---------------------------------------|----------------------------------|----------------------------------|
| 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| 0.1 | 5,384 | 37,017 | 103,064 | 68,687 | 68,687 | 83,293 | 374,449 |
| 1 | 20,729 | 148,561 | 360,725 | 242,201 | 242,201 | 333,171 | 2,505,493 |
| 10 | 132,211 | 618,256 | 1,906,690 | 1,649,029 | 927,579 | 2,252,513 | 16,764,602 |
| 50 | 661,054 | 1,795,616 | 7,214,502 | 6,780,314 | 3,349,590 | 8,566,679 | 63,298,437 |
| 75 | 991,582 | 2,590,666 | 10,546,914 | 9,966,358 | 5,325,113 | 11,994,116 | 88,461,912 |
| 100 | 1,322,109 | 3,174,027 | 13,879,327 | 13,098,702 | 6,454,779 | 15,228,860 | 112,174,269 |
| 150 | 1,983,163 | 4,857,310 | 20,544,152 | 19,253,734 | 9,682,012 | 21,321,764 | 156,767,698 |
| 200 | 2,644,218 | 5,593,231 | 27,208,977 | 25,305,025 | 11,941,137 | 27,072,121 | 198,789,531 |

| Table E-1 City of Amarillo Develop Potter County Well Field (Ogallala Aquifer) | | | | |
|--|------------------|--------------|-------------------|---------------------|
| Owner: | City of Amarillo | | | |
| Quantity: | 6,000 | | | |
| Capital Costs | Quantity | Unit | Unit Price | Cost |
| Wellfield and Treatment | | | | |
| Wells | 12 | EA | \$627,000 | \$7,524,000 |
| Well Field Collection Pipeline(s) | 211,200 | LF | \$88 | \$18,660,000 |
| Connection to Existing Infrastructure | 26,400 | LF | \$301 | \$7,944,000 |
| Pump Station Upgrade | 1 | EA | \$1,500,000 | \$1,500,000 |
| Storage Tank (3 MG) | 2 | EA | \$1,443,000 | \$2,886,000 |
| Total Capital Costs | | | | \$38,514,000 |
| Other Project Cost: | Quantity | Units | Unit Price | Cost |
| Engineering and Contingencies (30% for pipeline) | | | | \$7,981,000 |
| Engineering and Contingencies (35% for other items) | | | | \$3,644,000 |
| Land Acquisition | 273 | AC | \$1,200 | \$327,000 |
| Permitting and Mitigation | 45 | MI | \$25,000 | \$1,125,000 |
| Interest During Construction (12 months) | | | | \$1,806,000 |
| Groundwater Rights/ Purchase | | | | \$0 |
| TOTAL CAPITAL COST | | | | \$53,397,000 |
| Annual Costs | | | | |
| Debt Service (5.5 percent for 20 years) | | | | \$4,468,000 |
| Electricity | | | | \$468,000 |
| Water Treatment O&M | | | | \$75,000 |
| Operation and Maintenance | | | | \$632,000 |
| Total Annual Cost | | | | \$5,643,000 |
| UNIT COSTS (Until Amortized) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$941 |
| Water Cost (\$ per 1,000 gallons) | | | | \$2.89 |
| UNIT COSTS (After Amortization) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$196 |
| Water Cost (\$ per 1,000 gallons) | | | | \$0.60 |

| Table E-2 City of Amarillo Develop Carson County Well Field (Ogallala Aquifer) | | | | |
|--|------------------|--------------|-------------------|---------------------|
| Owner: | City of Amarillo | | | |
| Quantity: | 11,200 | | | |
| Capital Costs | Quantity | Unit | Unit Price | Cost |
| Wellfield and Treatment | | | | |
| Wells | 18 | EA | \$673,000 | \$12,114,000 |
| Well Field Collection Pipeline(s) (range 8" to 30") | 95,040 | LF | \$63 | \$5,998,000 |
| Connection to Existing Infrastructure (42") | 15,840 | LF | \$226 | \$3,575,000 |
| Storage Tank | 0 | EA | \$699,000 | \$0 |
| Pump Station Overhaul | 1 | EA | \$1,000,000 | \$1,000,000 |
| Total Capital Costs | | | | \$22,687,000 |
| Other Project Cost: | Quantity | Units | Unit Price | Cost |
| Engineering and Contingencies (30% for pipeline) | | | | \$2,872,000 |
| Engineering and Contingencies (35% for other items) | | | | \$4,590,000 |
| Land Acquisition | 145 | AC | \$1,200 | \$174,000 |
| Permitting and Mitigation | 21 | MI | \$25,000 | \$525,000 |
| Interest During Construction (12 months) | | | | \$1,080,000 |
| Groundwater Rights/ Purchase | 11,200 | Ac-Ft | \$500 | \$5,600,000 |
| TOTAL CAPITAL COST | | | | \$37,528,000 |
| Annual Costs | | | | |
| Debt Service (5.5 percent for 20 years) | | | | \$3,140,000 |
| Electricity | | | | \$1,160,000 |
| Water Treatment O&M | | | | \$132,000 |
| Operation and Maintenance | | | | \$508,000 |
| Total Annual Cost | | | | \$4,940,000 |
| UNIT COSTS (Until Amortized) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$441 |
| Water Cost (\$ per 1,000 gallons) | | | | \$1.35 |
| UNIT COSTS (After Amortization) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$161 |
| Water Cost (\$ per 1,000 gallons) | | | | \$0.49 |

| Table E-3 City of Amarillo Develop Roberts County Well Field (Ogallala Aquifer) | | | | |
|---|------------------|--------------|-------------------|----------------------|
| Owner: | City of Amarillo | | | |
| Quantity: | 11,200 | | | |
| Capital Costs | Quantity | Unit | Unit Price | Cost |
| Wellfield and Treatment | | | | |
| Wells | 18 | EA | \$584,000 | \$10,512,000 |
| Well Field Collection Pipeline(s) (12" to 42") | 95,040 | LF | \$88 | \$8,397,000 |
| Connection to Existing Infrastructure (42") | 396,000 | LF | \$226 | \$89,366,000 |
| Storage Tank (3 MG) | 2 | EA | \$1,443,000 | \$2,886,000 |
| Pump Station | 2 | EA | \$6,030,000 | \$12,060,000 |
| Total Capital Costs | | | | \$123,221,000 |
| Other Project Cost: | Quantity | Units | Unit Price | Cost |
| Engineering and Contingencies (30% for pipeline) | | | | \$29,329,000 |
| Engineering and Contingencies (35% for other items) | | | | \$8,910,000 |
| Land Acquisition | 564 | AC | \$1,200 | \$676,000 |
| Permitting and Mitigation | 93 | MI | \$25,000 | \$2,325,000 |
| Interest During Construction (12 months) | | | | \$5,756,000 |
| Groundwater Rights/ Purchase | | | | \$0 |
| TOTAL CAPITAL COST | | | | \$170,217,000 |
| Annual Costs | | | | |
| Debt Service (5.5 percent for 20 years) | | | | \$14,244,000 |
| Electricity | | | | \$910,000 |
| Water Treatment O&M | | | | \$132,000 |
| Operation and Maintenance | | | | \$1,937,000 |
| Total Annual Cost | | | | \$17,223,000 |
| UNIT COSTS (Until Amortized) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$1,538 |
| Water Cost (\$ per 1,000 gallons) | | | | \$4.72 |
| UNIT COSTS (After Amortization) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$266 |
| Water Cost (\$ per 1,000 gallons) | | | | \$0.82 |

| Table E-4 City of Amarillo Direct Reuse | | | | |
|--|-----------------|------------------|--------------------|---------------------|
| Owner: | | City of Amarillo | | |
| Quantity: | | 6,100 AF/Y | (5.45 MGD Average) | |
| Capital Costs | Quantity | Units | Unit Price | Cost |
| 20- inch pipeline | 36,960 | LF | \$124 | \$4,572,000 |
| 8 MGD Pre-Treatment WTP | 1 | EA | \$11,629,000 | \$11,629,000 |
| 8 MGD RO Plant | 1 | EA | \$21,303,000 | \$21,303,000 |
| Wastewater Treatment Plant Improvements | 1 | LS | \$2,500,000 | \$2,500,000 |
| Pump Station at WWTP | 1 | LS | \$1,500,000 | \$1,500,000 |
| 12 inch RO Discharge Line | 36,960 | LF | \$54 | \$1,978,000 |
| Total Capital Cost | | | | \$43,482,000 |
| Other Project Cost: | Quantity | Units | Unit Price | Cost |
| Engineering, Legal Costs and Contingencies (30% pipelines) | | | | \$1,965,000 |
| Engineering, Legal Costs and Contingencies (35% all other) | | | | \$12,401,200 |
| Land Acquisition | 170 | Ac | \$10,000 | \$1,697,000 |
| Permitting and Mitigation | 14 | mi | \$25,000 | \$850,000 |
| Interest During Construction (18 months) | | | | \$3,171,000 |
| Total Project Cost | | | | \$63,566,200 |
| Annual Costs | | | | |
| Debt Service (5.5 percent for 20 years) | | | | \$5,319,000 |
| Pipeline and Well Operation and Maintenance | | | | \$128,000 |
| Treatment O&M | | | | \$2,601,265 |
| Pumping Energy Costs (\$0.09/kWh) | | | | \$295,000 |
| Total Annual Cost | | | | \$8,343,265 |
| UNIT COST (Until Amortized) | | | | |
| Annual Cost of Water (\$ per acft) | | | | \$1,368 |
| Annual Cost of Water (\$ per 1,000 gallons) | | | | \$4.20 |
| UNIT COSTS (After Amortization) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$496 |
| Water Cost (\$ per 1,000 gallons) | | | | \$1.52 |

| Table E-5 Canadian River Municipal Water Authority Replace Capacity of Roberts County Well Field (Ogallala Aquifer) in 2030 | | | | |
|--|-----------------|--|-------------------|--------------------|
| Owner: | | Canadian River Municipal Water Authority | | |
| Quantity: | | 9,500 AF/Y | | |
| Capital Costs | | | | |
| | Quantity | Units | Unit Price | Cost |
| Collection Pipeline(s) | 5 | EA | \$100,000 | \$500,000 |
| Well Field(s) and Wells | 5 | EA | \$1,087,000 | \$5,435,000 |
| Total Capital Cost | | | | \$5,935,000 |
| Other Project Cost: | | | | |
| | Quantity | Units | Unit Price | Cost |
| Engineering, Legal Costs and Contingencies (30% for pipelines) | | | | \$150,000 |
| Engineering, Legal Costs and Contingencies (35% for wellfield) | | | | \$1,902,250 |
| Interest During Construction (1 year) | | | | \$280,000 |
| Total Project Cost | | | | \$8,267,250 |
| Annual Costs | | | | |
| Debt Service (5.5 percent for 20 years) | | | | \$692,000 |
| Pipeline and Well Operation and Maintenance | | | | \$141,000 |
| Pumping Energy Costs (\$0.09/kWh) | | | | \$850,000 |
| Total Annual Cost | | | | \$1,683,000 |
| Unit Cost | | | | |
| Annual Cost of Water (\$ per acft) | | | | \$177 |
| Annual Cost of Water (\$ per 1,000 gallons) | | | | \$0.54 |

| Table E-6 Canadian River Municipal Water Authority Replace Capacity of Roberts County Well Field (Ogallala Aquifer) in 2040 | | | | |
|---|-----------------|--|-------------------|---------------------|
| Owner: | | Canadian River Municipal Water Authority | | |
| Quantity: | | 18,500 AF/Y | | |
| Capital Costs: | Quantity | Units | Unit Price | Cost |
| Collection Pipeline(s) | 10 | EA | \$100,000 | \$1,000,000 |
| Well Field(s) and Wells | 10 | EA | \$1,087,000 | \$10,870,000 |
| Total Capital Cost | | | | \$11,870,000 |
| Other Project Cost: | Quantity | Units | Unit Price | Cost |
| Engineering, Legal Costs and Contingencies (30% for pipelines) | | | | \$300,000 |
| Engineering, Legal Costs and Contingencies (35% for wellfield) | | | | \$3,804,500 |
| Interest During Construction (1 year) | | | | \$559,000 |
| Total Project Cost | | | | \$16,533,500 |
| Annual Costs | | | | |
| Debt Service (5.5 percent for 20 years) | | | | \$1,384,000 |
| Pipeline and Well Operation and Maintenance | | | | \$282,000 |
| Pumping Energy Costs (\$0.09/kWh) | | | | \$1,654,000 |
| Total Annual Cost | | | | \$3,320,000 |
| Unit Cost | | | | |
| Annual Cost of Water (\$ per acft) | | | | \$179 |
| Annual Cost of Water (\$ per 1,000 gallons) | | | | \$0.55 |

| Table E-7 | | | | |
|--|-----------------|--|-------------------|----------------------|
| Canadian River Municipal Water Authority | | | | |
| Expansion of Roberts County Well Field (Ogallala Aquifer) in 2024 | | | | |
| Owner: | | Canadian River Municipal Water Authority | | |
| Quantity: | | 48,000 AF/Y | | |
| Capital Costs | Quantity | Units | Unit Price | Cost |
| 54 inch line (Amarillo) | 354,486 | LF | \$342 | \$121,234,000 |
| 14 inch line (Pampa) | 3,587 | LF | \$88 | \$316,000 |
| 8" Air Valve in Vault | 98 | EA | \$14,000 | \$1,372,000 |
| 8" Air Valve in Vault | 47 | EA | \$10,000 | \$470,000 |
| Tunneled Crossing (72" STL Casing) | 1,700 | LF | \$1,000 | \$1,700,000 |
| Water Crossing (Slope Protected) | 18 | EA | \$25,000 | \$450,000 |
| Pipeline Connections | 2 | EA | \$250,000 | \$500,000 |
| Well Field Collection Pipeline(s) | 20 | EA | \$100,000 | \$2,000,000 |
| Well Field(s) and Wells | 20 | EA | \$1,268,000 | \$25,360,000 |
| Impressed Current Deep Well Groundbed | 24 | EA | \$50,000 | \$1,182,000 |
| 54 MGD Pump Station | 2 | EA | \$16,000,000 | \$32,000,000 |
| 9 MG Storage Tank | 1 | EA | \$4,000,000 | \$4,000,000 |
| Total Capital Cost | | | | \$190,584,000 |
| Other Project Cost: | Quantity | Units | Unit Price | Cost |
| Contingency/Land Acquisition (16%) | | | | \$30,493,000 |
| Engineering (10%) | | | | \$19,058,000 |
| Permitting and Mitigation | 68 mi | | \$25,000 | \$1,700,000 |
| Interest During Construction (1 year) | | | | \$8,464,000 |
| Total Project Cost | | | | \$250,299,000 |
| UNIT COST (Until Amortized) | | | | |
| Debt Service (5.5 percent for 20 years) | | | | \$20,945,000 |
| Pipeline and Well Operation and Maintenance | | | | \$2,844,000 |
| Pumping Energy Costs (\$0.09/kWh) | | | | \$8,677,000 |
| Total Annual Cost | | | | \$32,466,000 |
| Unit Cost (Until Amortized) | | | | |
| Annual Cost of Water (\$ per acft) | | | | \$676 |
| Annual Cost of Water (\$ per 1,000 gallons) | | | | \$2.08 |
| UNIT COSTS (After Amortization) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$240 |
| Water Cost (\$ per 1,000 gallons) | | | | \$0.74 |

| Table E-8 Canadian River Municipal Water Authority Aquifer Storage and Recovery | | | | |
|---|-----------------|--|-------------------|---------------------|
| Owner: | | Canadian River Municipal Water Authority | | |
| Quantity: | | 6,400 AF/Y | | |
| Capital Costs: | Quantity | Units | Unit Price | Cost |
| 16" Wellfield Pipeline(s) | 220,000 | EA | \$63 | \$13,884,000 |
| Pump Improvements | 11 | EA | \$1,833,000 | \$20,163,000 |
| Injection Wells | 11 | EA | \$1,353,000 | \$14,883,000 |
| Total Capital Cost | | | | \$48,930,000 |
| Other Project Cost: | Quantity | Units | Unit Price | Cost |
| Engineering, Legal Costs and Contingencies (30% for pipelines) | | | | \$4,165,200 |
| Engineering, Legal Costs and Contingencies (35% for wellfield) | | | | \$12,266,100 |
| Interest During Construction (1 year) | | | | \$2,288,000 |
| Total Project Cost | | | | \$67,649,300 |
| Annual Costs | | | | |
| Debt Service (5.5 percent for 20 years) | | | | \$5,661,000 |
| Pipeline and Well Operation and Maintenance | | | | \$792,000 |
| Pumping Energy Costs (\$0.09/kWh) | | | | \$743,000 |
| Total Annual Cost | | | | \$7,196,000 |
| Unit Cost (Until Amortized) | | | | |
| Annual Cost of Water (\$ per acft) | | | | \$1,124 |
| Annual Cost of Water (\$ per 1,000 gallons) | | | | \$3.45 |
| UNIT COSTS (After Amortization) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$240 |
| Water Cost (\$ per 1,000 gallons) | | | | \$0.74 |

| Table E-9 City of Borger Develop New Well Field (Ogallala Aquifer) | | | | |
|--|-----------------|--------------|-------------------|---------------------|
| Owner: | City of Borger | | | |
| Quantity: | 6,000 AF/Y | | | |
| Capital Costs | Quantity | Unit | Unit Price | Cost |
| Wellfield and Treatment | | | | |
| Water Wells (600 GPM) | 13 | EA | \$504,000 | \$6,552,000 |
| Well Field Collection Pipeline(s) | 13 | EA | \$100,000 | \$1,300,000 |
| Connection to Pump Station | 13 | EA | \$140,000 | \$1,820,000 |
| Storage Tank (Closed) | 1 | EA | \$2,370,000 | \$2,370,000 |
| Subtotal for Wellfield and Treatment | | | | \$12,042,000 |
| Transmission System | | | | |
| 24" Pipeline - Transmission Main | 73,920 | LF | \$113 | \$8,353,000 |
| Pump Station | 1 | LS | \$813,000 | \$813,000 |
| Subtotal for Transmission | | | | \$9,166,000 |
| TOTAL CONSTRUCTION COST | | | | \$21,208,000 |
| Other Project Cost: | Quantity | Units | Unit Price | Cost |
| Engineering and Contingencies (30% for pipelines) | | | | \$3,313,600 |
| Engineering and Contingencies (35% for well field) | | | | \$4,044,300 |
| Easement - Rural | 34 | AC | \$1,200 | \$41,000 |
| Permitting and Mitigation | 14 | MI | \$25,000 | \$350,000 |
| Groundwater Rights/ Purchase | | | | \$0 |
| Interest During Construction (6 Months) | | | | \$507,000 |
| TOTAL CAPITAL COST | | | | \$29,463,900 |
| Annual Costs | | | | |
| Debt Service (5.5 percent for 20 years) | | | | \$2,466,000 |
| Electricity | | | | \$456,100 |
| Water Treatment | | | | \$74,641 |
| Operation and Maintenance | | | | \$462,500 |
| Total Annual Cost | | | | \$3,459,241 |
| UNIT COSTS (Until Amortized) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$577 |
| Water Cost (\$ per 1,000 gallons) | | | | \$1.77 |
| UNIT COSTS (After Amortization) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$166 |
| Water Cost (\$ per 1,000 gallons) | | | | \$0.51 |

| Table E-10 City of Cactus Develop New Well Field (Ogallala Aquifer) | | | | |
|---|-----------------|--------------|-------------------|---------------------|
| Owner: | City of Cactus | | | |
| Quantity: | 5,500 AF/Y | | | |
| Capital Costs | Quantity | Unit | Unit Price | Cost |
| Wellfield and Treatment | | | | |
| Water Wells (850 GPM) | 8 | EA | \$627,000 | \$5,016,000 |
| Well Field Collection Pipeline(s) | 8 | EA | \$100,000 | \$800,000 |
| Connection to Pump Station | 8 | EA | \$140,000 | \$1,120,000 |
| Storage Tank (Closed) | 1 | EA | \$699,000 | \$699,000 |
| Subtotal for Wellfield and Treatment | | | | \$7,635,000 |
| Transmission System | | | | |
| 24" Pipeline - Transmission Main | 15,840 | LF | \$113 | \$1,790,000 |
| Pump Station | 1 | LS | \$1,749,000 | \$1,749,000 |
| Subtotal for Transmission | | | | \$3,539,000 |
| TOTAL CONSTRUCTION COST | | | | \$11,174,000 |
| Other Project Cost: | Quantity | Units | Unit Price | Cost |
| Engineering and Contingencies (30% for pipelines) | | | | \$866,500 |
| Engineering and Contingencies (35% for well field) | | | | \$3,004,400 |
| Easement - Rural | 7 | AC | \$1,200 | \$9,000 |
| Permitting and Mitigation | 3 | MI | \$25,000 | \$75,000 |
| Groundwater Rights/ Purchase | 5,500 | AC-FT | \$500 | \$2,750,000 |
| Interest During Construction (6 Months) | | | | \$313,000 |
| TOTAL CAPITAL COST | | | | \$18,191,900 |
| Annual Costs | | | | |
| Debt Service (5.5 percent for 20 years) | | | | \$1,522,000 |
| Electricity | | | | \$439,100 |
| Water Treatment | | | | \$69,116 |
| Operation and Maintenance | | | | \$288,600 |
| Total Annual Cost | | | | \$2,318,816 |
| UNIT COSTS (Until Amortized) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$422 |
| Water Cost (\$ per 1,000 gallons) | | | | \$1.29 |
| UNIT COSTS (After Amortization) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$145 |
| Water Cost (\$ per 1,000 gallons) | | | | \$0.44 |

| Table E-11 Connecting to Palo Duro Reservoir | | | | | | |
|---|---|---------------------|----------------|-------------------------|---------------------|----------|
| Owner: | Palo Duro River Authority | | Percentage | | | |
| Quantity: | Cactus | 1,744 | | 45.0% | | |
| | Dumas | 1,356 | | 35.0% | | |
| | Sunray | 271 | | 7.0% | | |
| | Gruver | 116 | | 3.0% | | |
| | Spearman | 271 | | 7.0% | | |
| | Stinnet | 116 | | 3.0% | | |
| | Total | 3,875 | | 100.0% | | |
| Water Treatment Plant | | | | | | |
| | | Quantity | Units | Unit Price | Cost | |
| | 9 MGD Conventional Treatment Plant | 1 | LS | \$29,854,000 | \$29,854,000 | |
| | Engineering and Contingencies (35%) | | | | \$10,449,000 | |
| | Subtotal for Water Treatment Plant | | | | \$40,303,000 | |
| | | Construction | Capital | O&M | | |
| | Cactus | \$13,434,000 | \$18,136,000 | \$672,000 | | |
| | Dumas | \$10,449,000 | \$14,106,000 | \$522,000 | | |
| | Sunray | \$2,090,000 | \$2,821,000 | \$104,000 | | |
| | Gruver | \$896,000 | \$1,209,000 | \$45,000 | | |
| | Spearman | \$2,090,000 | \$2,821,000 | \$104,000 | | |
| | Stinnet | \$896,000 | \$1,209,000 | \$45,000 | | |
| | check total | \$29,855,000 | \$40,302,000 | \$1,492,000 | | |
| Pipeline System Components | | | | | | |
| | | Quantity | Units | Unit Price | Cost | |
| | 24" line from Res. to WTP | 9,000 | LF | \$124 | \$1,113,000 | |
| | 24" line from WTP to Spearman | 51,000 | LF | \$124 | \$6,308,000 | |
| | Crossings | 230 | LF | \$617 | \$142,000 | |
| | Connection to Spearman | 1 | LS | | \$20,000 | |
| | ROW | 20 | 23 | AC | \$1,200 | \$28,000 |
| | Engineering and Contingencies (30%) | | | | \$2,275,000 | |
| | Pipeline Subtotal at Spearman | | | | \$9,886,000 | |
| | | Construction | Capital | Electricity (\$) | | |
| | Cactus | \$3,339,000 | \$4,449,000 | \$90,000 | | |
| | Dumas | \$2,597,000 | \$3,460,000 | \$70,000 | | |
| | Sunray | \$519,000 | \$692,000 | \$14,000 | | |
| | Gruver | \$223,000 | \$297,000 | \$6,000 | | |
| | Spearman | \$519,000 | \$692,000 | \$14,000 | | |
| | Stinnet | \$223,000 | \$297,000 | \$6,000 | | |
| | check total | \$7,420,000 | \$9,887,000 | \$200,000 | | |

| Table E-10, Continued | | | | | |
|--|---------------------|----------------|-------------------------|---------------------|----------|
| | Quantity | Units | Unit Price | Cost | |
| 8" line from Spearman to Gruver | 71,300 | LF | \$34 | \$2,412,000 | |
| Crossings | 460 | LF | \$206 | \$95,000 | |
| Connection to Gruver | 1 | LS | | \$15,000 | |
| ROW | 15 | 25 | AC | \$1,200 | \$30,000 |
| Engineering and Contingencies (30%) | | | | \$757,000 | |
| Pipeline Subtotal at Gruver | | | | \$3,309,000 | |
| | Construction | Capital | Electricity (\$) | | |
| Cactus | \$0 | \$0 | \$0 | | |
| Dumas | \$0 | \$0 | \$0 | | |
| Sunray | \$0 | \$0 | \$0 | | |
| Gruver | \$2,412,000 | \$3,309,000 | \$4,700 | | |
| Spearman | \$0 | \$0 | \$0 | | |
| Stinnet | \$0 | \$0 | \$0 | | |
| check total | \$2,412,000 | \$3,309,000 | \$4,700 | | |
| | Quantity | Units | Unit Price | Cost | |
| 24" line from Spearman to Stinnet | 133,500 | LF | \$124 | \$16,512,700 | |
| Crossings | 460 | LF | \$617 | \$284,000 | |
| ROW | 20 | 61 | AC | \$1,200 | \$73,000 |
| Engineering and Contingencies (30%) | | | | \$5,039,000 | |
| Pipeline Subtotal at Stinnet | | | | \$21,908,700 | |
| | Construction | Capital | Electricity (\$) | | |
| Cactus | \$8,256,000 | \$10,954,000 | \$72,000 | | |
| Dumas | \$6,422,000 | \$8,520,000 | \$56,000 | | |
| Sunray | \$1,284,000 | \$1,704,000 | \$11,000 | | |
| Gruver | \$0 | \$0 | \$0 | | |
| Spearman | \$0 | \$0 | \$0 | | |
| Stinnet | \$550,000 | \$730,000 | \$5,000 | | |
| check total | \$16,512,000 | \$21,908,000 | \$144,000 | | |
| | Quantity | Units | Unit Price | Cost | |
| 8" line Stinnet Spur | 83,350 | LF | \$34 | \$2,819,000 | |
| Crossings | 1,680 | LF | \$206 | \$345,000 | |
| Connection to Stinnet | 1 | LS | | \$15,000 | |
| ROW | 20 | 38 | AC | \$1,200 | \$46,000 |
| Engineering and Contingencies (30%) | | | | \$954,000 | |
| Pipeline Subtotal at Stinnet | | | | \$4,179,000 | |
| | Construction | Capital | Electricity (\$) | | |
| Cactus | \$0 | \$0 | \$0 | | |
| Dumas | \$0 | \$0 | \$0 | | |
| Sunray | \$0 | \$0 | \$0 | | |
| Gruver | \$0 | \$0 | \$0 | | |
| Spearman | \$0 | \$0 | \$0 | | |
| Stinnet | \$2,819,000 | \$4,179,000 | \$5,900 | | |
| check total | \$2,819,000 | \$4,179,000 | \$5,900 | | |

| Table E-10, Continued | | | | |
|-------------------------------------|---------------------|----------------|-------------------------|---------------------|
| | Quantity | Units | Unit Price | Cost |
| 24" line from Stinnet Spur to Dumas | 122,800 | LF | \$124 | \$15,189,000 |
| Crossings | 460 | LF | \$617 | \$284,000 |
| Connection to Dumas | 1 | LS | | \$20,000 |
| ROW | 20 | AC | \$1,200 | \$67,000 |
| Engineering and Contingencies (30%) | | | | \$4,648,000 |
| Pipeline Subtotal at Dumas | | | | \$20,208,000 |
| | Construction | Capital | Electricity (\$) | |
| Cactus | \$7,856,000 | \$10,452,000 | \$108,000 | |
| Dumas | \$6,111,000 | \$8,130,000 | \$84,000 | |
| Sunray | \$1,222,000 | \$1,626,000 | \$17,000 | |
| Gruver | \$0 | \$0 | \$0 | |
| Spearman | \$0 | \$0 | \$0 | |
| Stinnet | \$0 | \$0 | \$0 | |
| check total | \$15,189,000 | \$20,208,000 | \$209,000 | |
| | Quantity | Units | Unit Price | Cost |
| 8" line Sunray Spur | 28,000 | LF | \$34 | \$947,000 |
| Crossings | 460 | LF | \$206 | \$95,000 |
| Pressure Reducing Valve | 1 | EA | | \$35,000 |
| Connection to Sunray | 1 | LS | | \$15,000 |
| ROW | 15 | AC | \$1,200 | \$12,000 |
| Engineering and Contingencies (30%) | | | | \$328,000 |
| Pipeline Subtotal at Sunray | | | | \$485,000 |
| | Construction | Capital | Electricity (\$) | |
| Cactus | 0 | \$0 | \$0 | |
| Dumas | 0 | \$0 | \$0 | |
| Sunray | \$947,000 | \$485,000 | \$0 | |
| Gruver | 0 | \$0 | \$0 | |
| Spearman | 0 | \$0 | \$0 | |
| Stinnet | 0 | \$0 | \$0 | |
| check total | \$947,000 | \$485,000 | \$0 | |
| | Quantity | Units | Unit Price | Cost |
| 18" line from Dumas to Cactus | 67,150 | LF | \$83 | \$5,560,000 |
| Crossings | 460 | LF | \$463 | \$213,000 |
| Connection to Cactus | 1 | LS | | \$17,500 |
| ROW | 20 | AC | \$1,200 | \$37,000 |
| Engineering and Contingencies (30%) | | | | \$1,737,000 |
| Pipeline Subtotal at Sunray | | | | \$7,564,500 |

| Table E-10, Continued | | | |
|-----------------------|--------------|-------------|------------------|
| | Construction | Capital | Electricity (\$) |
| Cactus | \$5,560,000 | \$7,564,500 | \$21,700 |
| Dumas | 0 | \$0 | \$0 |
| Sunray | 0 | \$0 | \$0 |
| Gruver | 0 | \$0 | \$0 |
| Spearman | 0 | \$0 | \$0 |
| Stinnet | 0 | \$0 | \$0 |
| check total | \$5,560,000 | \$7,564,500 | \$21,700 |

| Pump Station Components | Quantity | Units | Unit Price | Cost |
|-------------------------------------|----------|-------|------------|---------------------|
| 9 MGD PS at intake | 250 | HP | | \$2,319,000 |
| 9 MGD PS at WTP | 250 | HP | | \$2,319,000 |
| 9 MGD PS at Spearman | 400 | HP | | \$3,092,000 |
| 8.12 MGD at Stinnet Spur | 400 | HP | | \$3,092,000 |
| 4.04 MGD at Dumas | 100 | HP | | \$1,546,000 |
| Engineering and Contingencies (35%) | | | | \$4,329,000 |
| Pump Station Subtotal | | | | \$16,697,000 |

| | 9 MGD PS at intake | 9 MGD PS at WTP | 9 MGD PS at Spearman | 8.12 MGD at Stinnet Spur | 4.04 MGD at Dumas |
|---------------------------|--------------------|-----------------|----------------------|--------------------------|-------------------|
| Construction Costs | | | | | |
| Cactus | \$1,044,000 | \$1,044,000 | \$1,391,000 | \$1,546,000 | \$870,000 |
| Dumas | \$812,000 | \$812,000 | \$1,082,000 | \$1,202,000 | \$676,000 |
| Sunray | \$162,000 | \$162,000 | \$216,000 | \$240,000 | \$0 |
| Gruver | \$70,000 | \$70,000 | \$93,000 | \$0 | \$0 |
| Spearman | \$162,000 | \$162,000 | \$216,000 | \$0 | \$0 |
| Stinnet | \$70,000 | \$70,000 | \$93,000 | \$103,000 | \$0 |
| check total | \$2,320,000 | \$2,320,000 | \$3,091,000 | \$3,091,000 | \$1,546,000 |
| Capital Costs | | | | | |
| Cactus | \$1,409,000 | \$1,409,000 | \$1,878,000 | \$2,087,000 | \$1,174,000 |
| Dumas | \$1,096,000 | \$1,096,000 | \$1,461,000 | \$1,623,000 | \$913,000 |
| Sunray | \$219,000 | \$219,000 | \$292,000 | \$325,000 | \$0 |
| Gruver | \$94,000 | \$94,000 | \$125,000 | \$0 | \$0 |
| Spearman | \$219,000 | \$219,000 | \$292,000 | \$0 | \$0 |
| Stinnet | \$94,000 | \$94,000 | \$125,000 | \$139,000 | \$0 |
| check total | \$3,131,000 | \$3,131,000 | \$4,173,000 | \$4,174,000 | \$2,087,000 |

| Ground Storage Tanks | Quantity | Units | Unit Price | Cost |
|-------------------------------------|----------|-------|-------------|--------------------|
| 3 MG at WTP | 1 | LS | \$1,041,000 | \$1,041,000 |
| 3 MG at Spearman | 1 | LS | \$1,041,000 | \$1,041,000 |
| 2.5 MG at Stinnet Spur | 1 | LS | \$922,000 | \$922,000 |
| 1.5 MG at Dumas | 1 | LS | \$674,000 | \$674,000 |
| Engineering and Contingencies (35%) | | | | \$1,287,000 |
| Pump Station Subtotal | | | | \$4,965,000 |

| Table E-10, Continued | | | | | |
|-------------------------------------|---------------|------------------|------------------------|-----------------|-------------|
| | 3 MG at WTP | 3 MG at Spearman | 2.5 MG at Stinnet Spur | 1.5 MG at Dumas | |
| Construction Costs | | | | | |
| Cactus | \$468,000 | \$468,000 | \$461,000 | \$379,000 | |
| Dumas | \$364,000 | \$364,000 | \$359,000 | \$295,000 | |
| Sunray | \$73,000 | \$73,000 | \$72,000 | \$0 | |
| Gruver | \$31,000 | \$31,000 | \$0 | \$0 | |
| Spearman | \$73,000 | \$73,000 | \$0 | \$0 | |
| Stinnet | \$31,000 | \$31,000 | \$31,000 | \$0 | |
| check total | \$1,040,000 | \$1,040,000 | \$923,000 | \$674,000 | \$3,677,000 |
| Capital Costs | | | | | |
| | 3 MG at WTP | 3 MG at Spearman | 2.5 MG at Stinnet Spur | 1.5 MG at Dumas | |
| Cactus | \$632,000 | \$632,000 | \$622,000 | \$512,000 | |
| Dumas | \$492,000 | \$492,000 | \$484,000 | \$398,000 | |
| Sunray | \$98,000 | \$98,000 | \$97,000 | \$0 | |
| Gruver | \$42,000 | \$42,000 | \$0 | \$0 | |
| Spearman | \$98,000 | \$98,000 | \$0 | \$0 | |
| Stinnet | \$42,000 | \$42,000 | \$41,000 | \$0 | |
| check total | \$1,404,000 | \$1,404,000 | \$1,244,000 | \$910,000 | \$4,962,000 |
| TOTAL CONSTRUCTION COST | | | | | |
| Cactus | \$61,910,500 | | | | |
| Dumas | \$42,271,000 | | | | |
| Sunray | \$8,676,000 | | | | |
| Gruver | \$5,212,000 | | | | |
| Spearman | \$4,439,000 | | | | |
| Stinnet | \$6,992,000 | | | | |
| check total | \$129,500,500 | | | | |
| Interest During Construction | | | | | |
| (24 month) | | | | | |
| Cactus | \$4,334,000 | | | | |
| Dumas | \$2,959,000 | | | | |
| Sunray | \$607,000 | | | | |
| Gruver | \$365,000 | | | | |
| Spearman | \$311,000 | | | | |
| Stinnet | \$489,000 | | | | |
| check total | \$9,065,000 | | | | |
| Permitting and Mitigation | | | | | |
| Cactus | \$479,000 | | | | |
| Dumas | \$321,000 | | | | |
| Sunray | \$76,000 | | | | |
| Gruver | \$44,000 | | | | |
| Spearman | \$34,000 | | | | |
| Stinnet | \$55,000 | | | | |
| check total | \$1,009,000 | | | | |

| Table E-10, Continued | |
|--|--------------------|
| TOTAL CAPITAL COST | |
| Cactus | \$66,723,500 |
| Dumas | \$45,551,000 |
| Sunray | \$9,359,000 |
| Gruver | \$5,621,000 |
| Spearman | \$4,784,000 |
| Stinnet | \$7,536,000 |
| check total | \$139,574,500 |
| | |
| Annual Costs - Cactus | Cost |
| Debt Service (5.5 percent for 20 years) | \$5,583,400 |
| Electricity (\$0.09 per kwh) | \$291,700 |
| Price to Purchase Water (\$0.15 per 1,000 gal) | \$85,000 |
| Operation and Maintenance | \$1,114,000 |
| Total Annual Cost | \$7,074,100 |
| | |
| UNIT COSTS (Until Amortized) | |
| Water Cost (\$ per ac-ft) | \$4,057 |
| Water Cost (\$ per 1,000 gallons) | \$12.45 |
| | |
| UNIT COSTS (After Amortization) | |
| Water Cost (\$ per ac-ft) | \$855 |
| Water Cost (\$ per 1,000 gallons) | \$2.62 |
| | |
| Annual Costs - Dumas | Cost |
| Debt Service (5.5 percent for 20 years) | \$3,812,000 |
| Electricity (\$0.09 per kwh) | \$210,000 |
| Price to Purchase Water (\$0.15 per 1,000 gal) | \$66,000 |
| Operation and Maintenance | \$822,000 |
| Total Annual Cost | \$4,910,000 |
| | |
| UNIT COSTS (Until Amortized) | |
| Water Cost (\$ per ac-ft) | \$3,620 |
| Water Cost (\$ per 1,000 gallons) | \$11.11 |
| | |
| UNIT COSTS (After Amortization) | |
| Water Cost (\$ per ac-ft) | \$810 |
| Water Cost (\$ per 1,000 gallons) | \$2.48 |

| Table E-10, Continued | |
|--|--------------------|
| Annual Costs - Sunray | |
| | Cost |
| Debt Service (5.5 percent for 20 years) | \$783,000 |
| Electricity (\$0.09 per kwh) | \$42,000 |
| Price to Purchase Water (\$0.15 per 1,000 gal) | \$13,000 |
| Operation and Maintenance | \$169,000 |
| Total Annual Cost | \$1,007,000 |
| UNIT COSTS (Until Amortized) | |
| Water Cost (\$ per ac-ft) | \$3,712 |
| Water Cost (\$ per 1,000 gallons) | \$11.39 |
| UNIT COSTS (After Amortization) | |
| Water Cost (\$ per ac-ft) | \$826 |
| Water Cost (\$ per 1,000 gallons) | \$2.53 |
| Annual Costs - Gruver | |
| | Cost |
| Debt Service (5.5 percent for 20 years) | \$470,000 |
| Electricity (\$0.09 per kwh) | \$10,700 |
| Price to Purchase Water (\$0.15 per 1,000 gal) | \$6,000 |
| Operation and Maintenance | \$79,000 |
| Total Annual Cost | \$565,700 |
| UNIT COSTS (Until Amortized) | |
| Water Cost (\$ per ac-ft) | \$4,866 |
| Water Cost (\$ per 1,000 gallons) | \$14.93 |
| UNIT COSTS (After Amortization) | |
| Water Cost (\$ per ac-ft) | \$823 |
| Water Cost (\$ per 1,000 gallons) | \$2.53 |
| Annual Costs - Spearman | |
| | Cost |
| Debt Service (5.5 percent for 20 years) | \$400,000 |
| Electricity (\$0.09 per kwh) | \$14,000 |
| Price to Purchase Water (\$0.15 per 1,000 gal) | \$13,300 |
| Operation and Maintenance | \$36,000 |
| Total Annual Cost | \$463,300 |
| UNIT COSTS (Until Amortized) | |
| Water Cost (\$ per ac-ft) | \$1,708 |
| Water Cost (\$ per 1,000 gallons) | \$5.24 |
| UNIT COSTS (After Amortization) | |
| Water Cost (\$ per ac-ft) | \$233 |
| Water Cost (\$ per 1,000 gallons) | \$0.72 |

| Table E-10, Continued | |
|--|------------------|
| Annual Costs - Stinnet | Cost |
| Debt Service (5.5 percent for 20 years) | \$630,600 |
| Electricity (\$0.09 per kwh) | \$16,900 |
| Price to Purchase Water (\$0.15 per 1,000 gal) | \$5,700 |
| Operation and Maintenance | \$91,600 |
| Total Annual Cost | \$744,800 |
| UNIT COSTS (Until Amortized) | |
| Water Cost (\$ per ac-ft) | \$6,407 |
| Water Cost (\$ per 1,000 gallons) | \$19.66 |
| UNIT COSTS (After Amortization) | |
| Water Cost (\$ per ac-ft) | \$982 |
| Water Cost (\$ per 1,000 gallons) | \$3.01 |

| Table E-12 | | | | |
|---|-------------------------------------|--------------|-------------------|---------------------|
| Greenbelt Municipal and Industrial Water Authority | | | | |
| Ogallala Aquifer in Donley County | | | | |
| Owner: | Greenbelt Municipal Water Authority | | | |
| Quantity: | 2,000 AF/Y | | | |
| Capital Costs | Quantity | Units | Unit Price | Cost |
| 16 inch Pipeline from North Ogallala toWTP | 80,083 | LF | \$69 | \$5,499,000 |
| Wellfield infrastructure pipelines | 2 | EA | \$100,000 | \$200,000 |
| Wells | 2 | EA | \$755,000 | \$1,510,000 |
| 0.5 MG Storage Tank | 1 | EA | \$467,000 | \$467,000 |
| Electricity Connection | 1 | LS | \$100,000 | \$100,000 |
| Groundwater rights | 2,000 | AC | \$500 | \$1,000,000 |
| CONSTRUCTION TOTAL | | | | \$8,776,000 |
| Other Project Cost: | Quantity | Units | Unit Price | Cost |
| Engineering and Contingencies (30% for pipelines) | | | | \$1,710,000 |
| Engineering and Contingencies (35% for well field) | | | | \$727,000 |
| Right of Way Easements (ROW) | 80,083 | LF | \$5.00 | \$400,000 |
| Permitting and Mitigation | 15 | MI | \$25,000 | \$375,000 |
| Interest During Construction (1 year) | | | | \$629,000 |
| TOTAL PROJECT COST | | | | \$12,617,000 |
| ANNUAL COSTS | | | | |
| Debt Service (5.5 percent for 20 years) | | | | \$1,056,000 |
| Electricity (\$0.09 kWh) | | | | \$92,844 |
| Operation & Maintenance | | | | \$109,540 |
| Total Annual Costs | | | | \$1,258,384 |
| UNIT COSTS | | | | |
| UNIT COSTS (Pre Amort.) | | | | |
| Per Acre-Foot | | | | \$629.19 |
| Per 1,000 Gallons | | | | \$1.93 |
| UNIT COSTS (Post Amort.) | | | | |
| Per Acre-Foot | | | | \$101 |
| Per 1,000 Gallons | | | | \$0.31 |

| Table E-13 City of Claude Develop Ogallala Aquifer Supplies | | | | |
|---|-----------------|--------------|-------------------|--------------------|
| Owner: | City of Claude | | | |
| Quantity: | 400 AF/Y | | | |
| Capital Costs | Quantity | Unit | Unit Price | Cost |
| Wellfield and Treatment | | | | |
| Water Wells (300 GPM) | 2 | EA | \$283,508 | \$567,000 |
| 8" Well Field Piping | 2,000 | LF | \$31 | \$62,000 |
| Connection to Pump Station | 2 | EA | \$140,000 | \$280,000 |
| Subtotal for Wellfield and Treatment | | | | \$909,000 |
| Transmission System | | | | |
| 8" Pipeline - Transmission Main | 13,200 | LF | \$31 | \$409,000 |
| Pump Station | 1 | LS | \$728,000 | \$728,000 |
| Subtotal for Transmission | | | | \$1,137,000 |
| TOTAL CONSTRUCTION COST | | | | \$2,046,000 |
| Other Project Cost: | Quantity | Units | Unit Price | Cost |
| Engineering and Contingencies (30% for pipelines) | | | | \$161,800 |
| Engineering and Contingencies (35% for well field) | | | | \$551,300 |
| Easement - Rural | 6 | AC | \$1,200 | \$7,000 |
| Permitting and Mitigation | 3 | MI | \$25,000 | \$75,000 |
| Groundwater Rights/ Purchase | 0 | AC-FT | \$500 | \$0 |
| Interest During Construction (6 Months) | | | | \$50,000 |
| TOTAL CAPITAL COST | | | | \$2,891,100 |
| Annual Costs | | | | |
| Debt Service (5.5 percent for 20 years) | | | | \$242,000 |
| Electricity | | | | \$11,200 |
| Water Treatment | | | | \$9,763 |
| Operation and Maintenance | | | | \$53,000 |
| Total Annual Cost | | | | \$315,963 |
| UNIT COSTS (Until Amortized) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$790 |
| Water Cost (\$ per 1,000 gallons) | | | | \$2.42 |
| UNIT COSTS (After Amortization) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$185 |
| Water Cost (\$ per 1,000 gallons) | | | | \$0.57 |

| Table E-14 City of Panhandle Develop Ogallala Aquifer Supplies | | | | |
|--|-------------------|-------------|-------------------|--------------------|
| Owner: | City of Panhandle | | | |
| Quantity: | 600 AF/Y | | | |
| Capital Costs | Quantity | Unit | Unit Price | Cost |
| Wellfield and Treatment | | | | |
| Water Wells (475 GPM) | 2 | EA | \$616,000 | \$1,232,000 |
| Well Field Collection Pipeline(s) | 2 | EA | \$100,000 | \$200,000 |
| Subtotal for Wellfield and Treatment | | | | \$1,432,000 |
| Transmission System | | | | |
| Pump Station | 1 | LS | \$696,000 | \$696,000 |
| Subtotal for Transmission | | | | \$696,000 |
| TOTAL CONSTRUCTION COST | | | | \$2,128,000 |
| Engineering and Contingencies (30% for pipelines) | | | | \$60,000 |
| Engineering and Contingencies (35% for well field) | | | | \$674,800 |
| Easement - Rural | 0 | AC | \$1,200 | \$0 |
| Permitting and Mitigation | 0 | MI | \$25,000 | \$0 |
| Groundwater Rights/ Purchase | 600 | AC-FT | \$500 | \$300,000 |
| Interest During Construction (6 Months) | | | | \$55,000 |
| TOTAL CAPITAL COST | | | | \$3,217,800 |
| Annual Costs | | | | |
| Debt Service (5.5 percent for 20 years) | | | | \$269,000 |
| Electricity | | | | \$30,700 |
| Water Treatment | | | | \$12,805 |
| Operation and Maintenance | | | | \$60,200 |
| Total Annual Cost | | | | \$372,705 |
| UNIT COSTS (Until Amortized) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$621 |
| Water Cost (\$ per 1,000 gallons) | | | | \$1.91 |
| UNIT COSTS (After Amortization) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$173 |
| Water Cost (\$ per 1,000 gallons) | | | | \$0.53 |

| Table E-15 City of Wellington Develop Seymour Aquifer Supplies | | | | |
|--|--------------------|-------------|-------------------|--------------------|
| Owner: | City of Wellington | | | |
| Quantity: | 180 AF/Y | | | |
| Capital Costs | Quantity | Unit | Unit Price | Cost |
| Wellfield and Treatment | | | | |
| Water Wells (100 GPM) | 2 | EA | \$127,029 | \$254,000 |
| 6" Well Field Collection Lines | 5,280 | LF | \$20 | \$106,000 |
| Connection to Pump Station | 2 | EA | \$140,000 | \$280,000 |
| Subtotal for Wellfield and Treatment | | | | \$640,000 |
| Transmission System | | | | |
| 8" Pipeline - Transmission Main | 15,840 | LF | \$31 | \$491,000 |
| Pump Station | 1 | LS | \$629,000 | \$629,000 |
| Subtotal for Transmission | | | | \$1,120,000 |
| TOTAL CONSTRUCTION COST | | | | \$1,760,000 |
| Engineering and Contingencies (30% for pipelines) | | | | \$203,700 |
| Engineering and Contingencies (35% for well field) | | | | \$407,100 |
| Easement - Rural | 7 | AC | \$1,200 | \$9,000 |
| Permitting and Mitigation | 3 | MI | \$25,000 | \$75,000 |
| Groundwater Rights/ Purchase | 180 AC-FT | | \$500 | \$90,000 |
| Interest During Construction (6 Months) | | | | \$45,000 |
| TOTAL CAPITAL COST | | | | \$2,589,800 |
| Annual Costs | | | | |
| Debt Service (5.5 percent for 20 years) | | | | \$217,000 |
| Electricity | | | | \$1,700 |
| Water Treatment | | | | \$6,417 |
| Operation and Maintenance | | | | \$42,100 |
| Total Annual Cost | | | | \$267,217 |
| UNIT COSTS (Until Amortized) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$1,485 |
| Water Cost (\$ per 1,000 gallons) | | | | \$4.56 |
| UNIT COSTS (After Amortization) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$279 |
| Water Cost (\$ per 1,000 gallons) | | | | \$0.86 |

| Table E-16 City of Wellington Advanced Treatment (Nitrate Removal) | | | | |
|--|--------------------|-------------|-------------------|--------------------|
| Owner: | City of Wellington | | | |
| Quantity: | 500 AF/Y | | | |
| Capital Costs | Quantity | Unit | Unit Price | Cost |
| Wellfield and Treatment | | | | |
| 0.5 MGD RO Treatment Facility | 1 | EA | \$2,267,000 | \$2,267,000 |
| Storage Tank (Closed) | 1 | EA | \$412,000 | \$412,000 |
| Subtotal for Wellfield and Treatment | | | | \$2,679,000 |
| Transmission System | | | | |
| Subtotal for Transmission | | | | \$0 |
| TOTAL CONSTRUCTION COST | | | | \$2,679,000 |
| Engineering and Contingencies (30% for pipelines) | | | | \$0 |
| Engineering and Contingencies (35% for well field) | | | | \$937,700 |
| Groundwater Rights/ Purchase | 0 AC-FT | | \$500 | \$0 |
| Interest During Construction (6 Months) | | | | \$63,000 |
| TOTAL CAPITAL COST | | | | \$3,679,700 |
| Annual Costs | | | | |
| Debt Service (5.5 percent for 20 years) | | | | \$308,000 |
| Electricity | | | | \$0 |
| Water Treatment | | | | \$194,350 |
| Operation and Maintenance | | | | \$12,400 |
| Total Annual Cost | | | | \$514,750 |
| UNIT COSTS (Until Amortized) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$1,029 |
| Water Cost (\$ per 1,000 gallons) | | | | \$3.16 |
| UNIT COSTS (After Amortization) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$413 |
| Water Cost (\$ per 1,000 gallons) | | | | \$1.27 |

| Table E-17 City of Dalhart Develop Ogallala Aquifer Supplies | | | | |
|--|-----------------|-------------|-------------------|--------------------|
| Owner: | City of Dalhart | | | |
| Quantity: | 2,700 AF/Y | | | |
| Capital Costs | Quantity | Unit | Unit Price | Cost |
| Wellfield and Treatment | | | | |
| Rehab Existing wells | 3 | EA | \$100,000 | \$300,000 |
| Water Wells (800 GPM) | 1 | EA | \$552,871 | \$553,000 |
| Rehab Well Field Collection Pipeline(s) | 3 | EA | \$50,000 | \$150,000 |
| Connection to Pump Station | 1 | EA | \$140,000 | \$140,000 |
| Storage Tank (Closed) | 1 | EA | \$412,000 | \$412,000 |
| Subtotal for Wellfield and Treatment | | | | \$1,255,000 |
| Transmission System | | | | |
| 24" Pipeline - Transmission Main | 10,560 | LF | \$113 | \$1,193,000 |
| Pump Station | 1 | LS | \$809,000 | \$809,000 |
| Subtotal for Transmission | | | | \$2,002,000 |
| TOTAL CONSTRUCTION COST | | | | \$3,257,000 |
| Engineering and Contingencies (30% for pipelines) | | | | \$87,000 |
| Engineering and Contingencies (35% for well field) | | | | \$725,900 |
| Groundwater Rights/ Purchase | 0 AC-FT | | \$500 | \$0 |
| Interest During Construction (6 Months) | | | | \$72,000 |
| TOTAL CAPITAL COST | | | | \$4,197,900 |
| Annual Costs | | | | |
| Debt Service (5.5 percent for 20 years) | | | | \$351,000 |
| Electricity | | | | \$119,000 |
| Water Treatment | | | | \$38,177 |
| Operation and Maintenance | | | | \$65,700 |
| Total Annual Cost | | | | \$573,877 |
| UNIT COSTS (Until Amortized) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$213 |
| Water Cost (\$ per 1,000 gallons) | | | | \$0.65 |
| UNIT COSTS (After Amortization) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$83 |
| Water Cost (\$ per 1,000 gallons) | | | | \$0.25 |

| Table E-18 City of Texline Develop Ogallala Aquifer Supplies | | | | |
|--|-----------------|-------------|-------------------|--------------------|
| Owner: | City of Texline | | | |
| Quantity: | 150 AF/Y | | | |
| Capital Costs | Quantity | Unit | Unit Price | Cost |
| Wellfield and Treatment | | | | |
| Water Wells (200 GPM) | 1 | EA | \$477,000 | \$477,000 |
| Well Field Collection Pipeline(s) | 1 | EA | \$100,000 | \$100,000 |
| Connection to Pump Station | 1 | EA | \$140,000 | \$140,000 |
| Subtotal for Wellfield and Treatment | | | | \$717,000 |
| TOTAL CONSTRUCTION COST | | | | \$717,000 |
| Engineering and Contingencies (30% for pipelines) | | | | \$30,000 |
| Engineering and Contingencies (35% for well field) | | | | \$216,000 |
| Groundwater Rights/ Purchase | 150 AC-FT | | \$500 | \$75,000 |
| Interest During Construction (6 Months) | | | | \$18,000 |
| TOTAL CAPITAL COST | | | | \$1,056,000 |
| Annual Costs | | | | |
| Debt Service (5.5 percent for 20 years) | | | | \$88,000 |
| Electricity | | | | \$3,100 |
| Water Treatment | | | | \$5,960 |
| Operation and Maintenance | | | | \$19,700 |
| Total Annual Cost | | | | \$116,760 |
| UNIT COSTS (Until Amortized) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$778 |
| Water Cost (\$ per 1,000 gallons) | | | | \$2.39 |
| UNIT COSTS (After Amortization) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$192 |
| Water Cost (\$ per 1,000 gallons) | | | | \$0.59 |

| Table E-19 City of McLean Develop Ogallala Aquifer Supplies | | | | |
|--|-----------------|----------------|-------------------|------------------|
| Owner: | | City of McLean | | |
| Quantity: | | 200 AF/Y | | |
| Capital Costs | Quantity | Unit | Unit Price | Cost |
| Wellfield | | | | |
| Water Wells (260 GPM) | 1 | EA | \$264,291 | \$264,000 |
| Well Field Collection Pipeline(s) | 1 | EA | \$100,000 | \$100,000 |
| Connection to Pump Station | 1 | EA | \$140,000 | \$140,000 |
| Subtotal for Wellfield | | | | \$504,000 |
| TOTAL CONSTRUCTION COST | | | | \$504,000 |
| Engineering and Contingencies (30% for pipelines) | | | | \$30,000 |
| Engineering and Contingencies (35% for well field) | | | | \$141,400 |
| Groundwater Rights/ Purchase | 200 AC-FT | | \$500 | \$100,000 |
| Interest During Construction (6 Months) | | | | \$14,000 |
| TOTAL CAPITAL COST | | | | \$789,400 |
| Annual Costs | | | | |
| Debt Service (5.5 percent for 20 years) | | | | \$66,000 |
| Electricity | | | | \$3,200 |
| Water Treatment | | | | \$6,721 |
| Operation and Maintenance | | | | \$13,300 |
| Total Annual Cost | | | | \$89,221 |
| UNIT COSTS (Until Amortized) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$446 |
| Water Cost (\$ per 1,000 gallons) | | | | \$1.37 |
| UNIT COSTS (After Amortization) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$116 |
| Water Cost (\$ per 1,000 gallons) | | | | \$0.36 |

| Table E-20 City of Pampa Develop Ogallala Aquifer Supplies | | | | |
|--|-----------------|-------------|-------------------|--------------------|
| Owner: | City of Pampa | | | |
| Quantity: | 2,000 AF/Y | | | |
| Capital Costs | Quantity | Unit | Unit Price | Cost |
| Wellfield and Treatment | | | | |
| Water Wells (620 GPM) | 4 | EA | \$525,288 | \$2,101,000 |
| Well Field Collection Pipeline(s) | 4 | EA | \$100,000 | \$400,000 |
| Connection to Pump Station | 4 | EA | \$140,000 | \$560,000 |
| Storage Tank (Closed) | 1 | EA | \$412,000 | \$412,000 |
| Subtotal for Wellfield and Treatment | | | | \$3,473,000 |
| Transmission System | | | | |
| 18" Pipeline - Transmission Main | 15,840 | LF | \$76 | \$1,204,000 |
| Pump Station | 1 | LS | \$809,000 | \$809,000 |
| Subtotal for Transmission | | | | \$2,013,000 |
| TOTAL CONSTRUCTION COST | | | | \$5,486,000 |
| Engineering and Contingencies (30% for pipelines) | | | | \$541,400 |
| Engineering and Contingencies (35% for well field) | | | | \$1,358,700 |
| Easement - Rural | 7 | AC | \$1,200 | \$9,000 |
| Permitting and Mitigation | 3 | MI | \$25,000 | \$75,000 |
| Groundwater Rights/ Purchase | 2,000 | AC-FT | \$500 | \$1,000,000 |
| Interest During Construction (6 Months) | | | | \$148,000 |
| TOTAL CAPITAL COST | | | | \$8,618,100 |
| Annual Costs | | | | |
| Debt Service (5.5 percent for 20 years) | | | | \$721,000 |
| Electricity | | | | \$93,500 |
| Water Treatment | | | | \$30,442 |
| Operation and Maintenance | | | | \$135,700 |
| Total Annual Cost | | | | \$980,642 |
| UNIT COSTS (Until Amortized) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$490 |
| Water Cost (\$ per 1,000 gallons) | | | | \$1.50 |
| UNIT COSTS (After Amortization) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$130 |
| Water Cost (\$ per 1,000 gallons) | | | | \$0.40 |

| Table E-21 City of Memphis Develop Ogallala Aquifer Supplies | | | | |
|---|-----------------|-----------------|-------------------|--------------------|
| Owner: | | City of Memphis | | |
| Quantity: | | 150 AF/Y | | |
| Capital Costs | Quantity | Unit | Unit Price | Cost |
| Wellfield and Treatment | | | | |
| Water Wells (150 GPM) | 2 | EA | \$167,000 | \$334,000 |
| Well Field Collection Pipeline(s) | 2 | EA | \$100,000 | \$200,000 |
| Connection to Pump Station | 2 | EA | \$140,000 | \$280,000 |
| Subtotal for Wellfield and Treatment | | | | \$814,000 |
| TOTAL CONSTRUCTION COST | | | | \$814,000 |
| Engineering and Contingencies (30% for pipelines) | | | | \$60,000 |
| Engineering and Contingencies (35% for well field) | | | | \$214,900 |
| Groundwater Rights/ Purchase | 150 AC-FT | | \$500 | \$75,000 |
| Interest During Construction (6 Months) | | | | \$20,000 |
| TOTAL CAPITAL COST | | | | \$1,183,900 |
| Annual Costs | | | | |
| Debt Service (5.5 percent for 20 years) | | | | \$99,000 |
| Electricity | | | | \$1,500 |
| Water Treatment | | | | \$5,960 |
| Operation and Maintenance | | | | \$20,800 |
| Total Annual Cost | | | | \$127,260 |
| UNIT COSTS (Until Amortized) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$848 |
| Water Cost (\$ per 1,000 gallons) | | | | \$2.60 |
| UNIT COSTS (After Amortization) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$188 |
| Water Cost (\$ per 1,000 gallons) | | | | \$0.58 |

| Table E-22 County Other - Hall County (Brice-Lesly) New Groundwater Source | | | | |
|--|----------------------------|-------------|-------------------|------------------|
| Owner: | County Other - Hall County | | | |
| Quantity: | 50 AF/Y | | | |
| Capital Costs | Quantity | Unit | Unit Price | Cost |
| Wellfield and Treatment | | | | |
| Water Wells (75 GPM) | 1 | EA | \$217,731 | \$218,000 |
| Subtotal for Wellfield and Treatment | | | | \$218,000 |
| TOTAL CONSTRUCTION COST | | | | \$218,000 |
| Engineering and Contingencies (30% for pipelines) | | | | \$0 |
| Engineering and Contingencies (35% for well field) | | | | \$76,300 |
| Groundwater Rights/ Purchase | 0 AC-FT | | \$500 | \$0 |
| Interest During Construction (6 Months) | | | | \$5,000 |
| TOTAL CAPITAL COST | | | | \$299,300 |
| Annual Costs | | | | |
| Debt Service (5.5 percent for 20 years) | | | | \$25,000 |
| Electricity | | | | \$500 |
| Water Treatment | | | | \$2,401 |
| Operation and Maintenance | | | | \$6,500 |
| Total Annual Cost | | | | \$34,401 |
| UNIT COSTS (Until Amortized) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$688 |
| Water Cost (\$ per 1,000 gallons) | | | | \$2.11 |
| UNIT COSTS (After Amortization) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$188 |
| Water Cost (\$ per 1,000 gallons) | | | | \$0.58 |

| Table E-23 County Other - Hall County (Estelline) New Groundwater Source | | | | |
|--|----------------------------|-------------|-------------------|------------------|
| Owner: | County Other - Hall County | | | |
| Quantity: | 50 AF/Y | | | |
| Capital Costs | Quantity | Unit | Unit Price | Cost |
| Wellfield and Treatment | | | | |
| Water Wells (75 GPM) | 1 | EA | \$102,700 | \$103,000 |
| Subtotal for Wellfield and Treatment | | | | \$103,000 |
| TOTAL CONSTRUCTION COST | | | | \$103,000 |
| Engineering and Contingencies (30% for pipelines) | | | | \$0 |
| Engineering and Contingencies (35% for well field) | | | | \$36,100 |
| Groundwater Rights/ Purchase | 0 AC-FT | | \$500 | \$0 |
| Interest During Construction (6 Months) | | | | \$2,000 |
| TOTAL CAPITAL COST | | | | \$141,100 |
| Annual Costs | | | | |
| Debt Service (5.5 percent for 20 years) | | | | \$12,000 |
| Electricity | | | | \$500 |
| Water Treatment | | | | \$2,401 |
| Operation and Maintenance | | | | \$3,100 |
| Total Annual Cost | | | | \$18,001 |
| UNIT COSTS (Until Amortized) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$360 |
| Water Cost (\$ per 1,000 gallons) | | | | \$1.10 |
| UNIT COSTS (After Amortization) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$120 |
| Water Cost (\$ per 1,000 gallons) | | | | \$0.37 |

| Table E-24 County Other - Hall County (Lakeview) Advanced Treatment (Nitrate Removal) | | | | |
|---|----------------------------|-------------|-------------------|--------------------|
| Owner: | County Other - Hall County | | | |
| Quantity: | 75 AF/Y | | | |
| Capital Costs | Quantity | Unit | Unit Price | Cost |
| Wellfield and Treatment | | | | |
| 0.1 MGD RO Treatment Facility | 1 | EA | \$972,000 | \$972,000 |
| Storage Tank (Closed) | 1 | EA | \$193,000 | \$193,000 |
| Subtotal for Wellfield and Treatment | | | | \$1,165,000 |
| TOTAL CONSTRUCTION COST | | | | \$1,165,000 |
| Engineering and Contingencies (30% for pipelines) | | | | \$0 |
| Engineering and Contingencies (35% for well field) | | | | \$407,800 |
| Groundwater Rights/ Purchase | 0 AC-FT | | \$500 | \$0 |
| Interest During Construction (6 Months) | | | | \$28,000 |
| TOTAL CAPITAL COST | | | | \$1,600,800 |
| Annual Costs | | | | |
| Debt Service (5.5 percent for 20 years) | | | | \$134,000 |
| Electricity | | | | \$0 |
| Water Treatment | | | | \$111,057 |
| Operation and Maintenance | | | | \$5,800 |
| Total Annual Cost | | | | \$250,857 |
| UNIT COSTS (Until Amortized) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$3,345 |
| Water Cost (\$ per 1,000 gallons) | | | | \$10.26 |
| UNIT COSTS (After Amortization) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$1,558 |
| Water Cost (\$ per 1,000 gallons) | | | | \$4.78 |

| Table E-25 County Other - Hall County (Turkey) New Groundwater Source | | | | |
|---|----------------------------|-------------|-------------------|--------------------|
| Owner: | County Other - Hall County | | | |
| Quantity: | 100 AF/Y | | | |
| Capital Costs | Quantity | Unit | Unit Price | Cost |
| Wellfield and Treatment | | | | |
| Water Wells (170 GPM) | 2 | EA | \$264,079 | \$528,000 |
| Subtotal for Wellfield and Treatment | | | | \$528,000 |
| Transmission System | | | | |
| 6" Pipeline - Transmission Main | 18,480 | LF | \$20 | \$370,000 |
| Subtotal for Transmission | | | | \$370,000 |
| TOTAL CONSTRUCTION COST | | | | \$898,000 |
| Engineering and Contingencies (30% for pipelines) | | | | \$129,500 |
| Engineering and Contingencies (35% for well field) | | | | \$184,800 |
| Groundwater Rights/ Purchase | 0 AC-FT | | \$500 | \$0 |
| Interest During Construction (6 Months) | | | | \$23,000 |
| TOTAL CAPITAL COST | | | | \$1,345,300 |
| Annual Costs | | | | |
| Debt Service (5.5 percent for 20 years) | | | | \$113,000 |
| Electricity | | | | \$0 |
| Water Treatment | | | | \$4,803 |
| Operation and Maintenance | | | | \$20,200 |
| Total Annual Cost | | | | \$138,003 |
| UNIT COSTS (Until Amortized) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$1,380 |
| Water Cost (\$ per 1,000 gallons) | | | | \$4.24 |
| UNIT COSTS (After Amortization) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$250 |
| Water Cost (\$ per 1,000 gallons) | | | | \$0.77 |

| Table E-26 City of Gruver Develop Ogallala Aquifer Supplies | | | | |
|--|-----------------|----------------|-------------------|--------------------|
| Owner: | | City of Gruver | | |
| Quantity: | | 350 AF/Y | | |
| Capital Costs | Quantity | Unit | Unit Price | Cost |
| Wellfield and Treatment | | | | |
| Water Wells (265 GPM) | 2 | EA | \$268,154 | \$536,000 |
| Well Field Collection Pipeline(s) | 2 | EA | \$100,000 | \$200,000 |
| Connection to Pump Station | 2 | EA | \$140,000 | \$280,000 |
| Subtotal for Wellfield and Treatment | | | | \$1,016,000 |
| TOTAL CONSTRUCTION COST | | | | \$1,016,000 |
| Engineering and Contingencies (30% for pipelines) | | | | \$60,000 |
| Engineering and Contingencies (35% for well field) | | | | \$285,600 |
| Groundwater Rights/ Purchase | 0 AC-FT | | \$500 | \$0 |
| Interest During Construction (6 Months) | | | | \$24,000 |
| TOTAL CAPITAL COST | | | | \$1,385,600 |
| Annual Costs | | | | |
| Debt Service (5.5 percent for 20 years) | | | | \$116,000 |
| Electricity | | | | \$5,500 |
| Water Treatment | | | | \$9,002 |
| Operation and Maintenance | | | | \$26,900 |
| Total Annual Cost | | | | \$157,402 |
| UNIT COSTS (Until Amortized) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$450 |
| Water Cost (\$ per 1,000 gallons) | | | | \$1.38 |
| UNIT COSTS (After Amortization) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$118 |
| Water Cost (\$ per 1,000 gallons) | | | | \$0.36 |

| Table E-27 City of Spearman Develop Ogallala Aquifer Supplies | | | | |
|---|------------------|-------------|-------------------|--------------------|
| Owner: | City of Spearman | | | |
| Quantity: | 650 AF/Y | | | |
| Capital Costs | Quantity | Unit | Unit Price | Cost |
| Wellfield and Treatment | | | | |
| Water Wells (620 GPM) | 2 | EA | \$527,914 | \$1,056,000 |
| Well Field Collection Pipeline(s) | 2 | EA | \$100,000 | \$200,000 |
| Connection to Pump Station | 2 | EA | \$140,000 | \$280,000 |
| Subtotal for Wellfield and Treatment | | | | \$1,536,000 |
| Transmission System | | | | |
| Pump Station | 1 | LS | \$700,000 | \$700,000 |
| 14" Pipeline | 5,280 | LF | \$51 | \$269,000 |
| Subtotal for Transmission | | | | \$969,000 |
| TOTAL CONSTRUCTION COST | | | | \$2,505,000 |
| Engineering and Contingencies (30% for pipelines) | | | | \$60,000 |
| Engineering and Contingencies (35% for well field) | | | | \$712,600 |
| Groundwater Rights/ Purchase | 650 AC-FT | | \$500 | \$325,000 |
| Interest During Construction (6 Months) | | | | \$63,000 |
| TOTAL CAPITAL COST | | | | \$3,665,600 |
| Annual Costs | | | | |
| Debt Service (5.5 percent for 20 years) | | | | \$307,000 |
| Electricity | | | | \$29,600 |
| Water Treatment | | | | \$13,565 |
| Operation and Maintenance | | | | \$63,500 |
| Total Annual Cost | | | | \$413,665 |
| UNIT COSTS (Until Amortized) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$636 |
| Water Cost (\$ per 1,000 gallons) | | | | \$1.95 |
| UNIT COSTS (After Amortization) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$164 |
| Water Cost (\$ per 1,000 gallons) | | | | \$0.50 |

| Table E-28 City of Stinnett Develop Ogallala Aquifer Supplies | | | | |
|--|-----------|------------------|------------|------------------|
| Owner: | | City of Stinnett | | |
| Quantity: | | 225 AF/Y | | |
| Capital Costs | Quantity | Unit | Unit Price | Cost |
| Wellfield and Treatment | | | | |
| Water Wells (625 GPM) | 1 | EA | \$436,658 | \$437,000 |
| Well Field Collection Pipeline(s) | 0 | EA | \$100,000 | \$0 |
| Connection to Pump Station | 1 | EA | \$140,000 | \$140,000 |
| Subtotal for Wellfield and Treatment | | | | \$577,000 |
| TOTAL CONSTRUCTION COST | | | | \$577,000 |
| Engineering and Contingencies (30% for pipelines) | | | | \$0 |
| Engineering and Contingencies (35% for well field) | | | | \$202,000 |
| Groundwater Rights/ Purchase | 225 AC-FT | | \$500 | \$113,000 |
| Interest During Construction (6 Months) | | | | \$16,000 |
| TOTAL CAPITAL COST | | | | \$908,000 |
| Annual Costs | | | | |
| Debt Service (5.5 percent for 20 years) | | | | \$76,000 |
| Electricity | | | | \$6,900 |
| Water Treatment | | | | \$7,101 |
| Operation and Maintenance | | | | \$17,300 |
| Total Annual Cost | | | | \$107,301 |
| UNIT COSTS (Until Amortized) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$477 |
| Water Cost (\$ per 1,000 gallons) | | | | \$1.46 |
| UNIT COSTS (After Amortization) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$139 |
| Water Cost (\$ per 1,000 gallons) | | | | \$0.43 |

| Table E-29 TCW Supply Inc. Develop Ogallala Aquifer Supplies | | | | |
|--|-----------------|-----------------|-------------------|--------------------|
| Owner: | | TCW Supply Inc. | | |
| Quantity: | | 575 AF/Y | | |
| Capital Costs | Quantity | Unit | Unit Price | Cost |
| Wellfield and Treatment | | | | |
| Water Wells (360 GPM) | 2 | EA | \$480,899 | \$962,000 |
| Well Field Collection Pipeline(s) | 2 | EA | \$100,000 | \$200,000 |
| Connection to Pump Station | 2 | EA | \$140,000 | \$280,000 |
| Storage Tank (Closed) | 1 | EA | \$193,000 | \$193,000 |
| Subtotal for Wellfield and Treatment | | | | \$1,635,000 |
| Transmission System | | | | |
| Pump Station | 1 | LS | \$694,000 | \$694,000 |
| 12" Pipeline - Transmission Main | 10,560 | LF | \$38 | \$401,000 |
| Subtotal for Transmission | | | | \$1,095,000 |
| TOTAL CONSTRUCTION COST | | | | \$2,730,000 |
| Engineering and Contingencies (30% for pipelines) | | | | \$60,000 |
| Engineering and Contingencies (35% for well field) | | | | \$745,200 |
| Groundwater Rights/ Purchase | 575 AC-FT | | \$500 | \$288,000 |
| Interest During Construction (6 Months) | | | | \$67,000 |
| TOTAL CAPITAL COST | | | | \$3,890,200 |
| Annual Costs | | | | |
| Debt Service (5.5 percent for 20 years) | | | | \$326,000 |
| Electricity | | | | \$18,200 |
| Water Treatment | | | | \$12,425 |
| Operation and Maintenance | | | | \$66,300 |
| Total Annual Cost | | | | \$422,925 |
| UNIT COSTS (Until Amortized) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$736 |
| Water Cost (\$ per 1,000 gallons) | | | | \$2.26 |
| UNIT COSTS (After Amortization) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$169 |
| Water Cost (\$ per 1,000 gallons) | | | | \$0.52 |

| Table E-30 City of Booker Develop Ogallala Aquifer Supplies | | | | |
|--|-----------------|----------------|-------------------|--------------------|
| Owner: | | City of Booker | | |
| Quantity: | | 700 AF/Y | | |
| Capital Costs | Quantity | Unit | Unit Price | Cost |
| Wellfield and Treatment | | | | |
| Water Wells (620 GPM) | 2 | EA | \$341,916 | \$684,000 |
| Well Field Collection Pipeline(s) | 2 | EA | \$100,000 | \$200,000 |
| Connection to Pump Station | 0 | EA | \$140,000 | \$0 |
| Subtotal for Wellfield and Treatment | | | | \$884,000 |
| TOTAL CONSTRUCTION COST | | | | \$884,000 |
| Engineering and Contingencies (30% for pipelines) | | | | \$60,000 |
| Engineering and Contingencies (35% for well field) | | | | \$239,400 |
| Groundwater Rights/ Purchase | 700 AC-FT | | \$500 | \$350,000 |
| Interest During Construction (6 Months) | | | | \$27,000 |
| TOTAL CAPITAL COST | | | | \$1,560,400 |
| Annual Costs | | | | |
| Debt Service (5.5 percent for 20 years) | | | | \$131,000 |
| Electricity | | | | \$20,900 |
| Water Treatment | | | | \$14,326 |
| Operation and Maintenance | | | | \$22,900 |
| Total Annual Cost | | | | \$189,126 |
| UNIT COSTS (Until Amortized) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$270 |
| Water Cost (\$ per 1,000 gallons) | | | | \$0.83 |
| UNIT COSTS (After Amortization) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$83 |
| Water Cost (\$ per 1,000 gallons) | | | | \$0.25 |

| Table E-31 City of Dumas Develop Ogallala Aquifer Supplies | | | | |
|--|-----------------|-------------|-------------------|---------------------|
| Owner: | City of Dumas | | | |
| Quantity: | 4,500 AF/Y | | | |
| Capital Costs | Quantity | Unit | Unit Price | Cost |
| Wellfield and Treatment | | | | |
| Water Wells (690 GPM) | 9 | EA | \$496,046 | \$4,464,000 |
| Well Field Collection Pipeline(s) | 9 | EA | \$100,000 | \$900,000 |
| Connection to Pump Station | 9 | EA | \$140,000 | \$1,260,000 |
| Subtotal for Wellfield and Treatment | | | | \$6,624,000 |
| Transmission System | | | | |
| Pump Station | 1 | LS | \$875,000 | \$875,000 |
| Subtotal for Transmission | | | | \$875,000 |
| TOTAL CONSTRUCTION COST | | | | \$7,499,000 |
| Engineering and Contingencies (30% for pipelines) | | | | \$270,000 |
| Engineering and Contingencies (35% for well field) | | | | \$2,309,700 |
| Groundwater Rights/ Purchase | 4,500 AC-FT | | \$500 | \$2,250,000 |
| Interest During Construction (6 Months) | | | | \$216,000 |
| TOTAL CAPITAL COST | | | | \$12,544,700 |
| Annual Costs | | | | |
| Debt Service (5.5 percent for 20 years) | | | | \$1,050,000 |
| Electricity | | | | \$175,900 |
| Water Treatment | | | | \$58,066 |
| Operation and Maintenance | | | | \$208,800 |
| Total Annual Cost | | | | \$1,492,766 |
| UNIT COSTS (Until Amortized) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$332 |
| Water Cost (\$ per 1,000 gallons) | | | | \$1.02 |
| UNIT COSTS (After Amortization) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$98 |
| Water Cost (\$ per 1,000 gallons) | | | | \$0.30 |

| Table E-32 City of Sunray Develop Ogallala Aquifer Supplies | | | | |
|--|-----------------|----------------|-------------------|--------------------|
| Owner: | | City of Sunray | | |
| Quantity: | | 850 AF/Y | | |
| Capital Costs | Quantity | Unit | Unit Price | Cost |
| Wellfield and Treatment | | | | |
| Water Wells (470 GPM) | 3 | EA | \$422,867 | \$1,269,000 |
| 8" Well Field Piping | 10,560 | LF | \$31 | \$327,000 |
| Connection to Pump Station | 3 | EA | \$140,000 | \$420,000 |
| Storage Tank (Closed) | 1 | EA | \$248,000 | \$248,000 |
| Subtotal for Wellfield and Treatment | | | | \$2,264,000 |
| TOTAL CONSTRUCTION COST | | | | \$2,264,000 |
| Engineering and Contingencies (30% for pipelines) | | | | \$98,100 |
| Engineering and Contingencies (35% for well field) | | | | \$678,000 |
| Groundwater Rights/ Purchase | 850 AC-FT | | \$500 | \$425,000 |
| Interest During Construction (6 Months) | | | | \$61,000 |
| TOTAL CAPITAL COST | | | | \$3,526,100 |
| Annual Costs | | | | |
| Debt Service (5.5 percent for 20 years) | | | | \$295,000 |
| Electricity | | | | \$28,900 |
| Water Treatment | | | | \$16,607 |
| Operation and Maintenance | | | | \$62,000 |
| Total Annual Cost | | | | \$402,507 |
| UNIT COSTS (Until Amortized) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$474 |
| Water Cost (\$ per 1,000 gallons) | | | | \$1.45 |
| UNIT COSTS (After Amortization) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$126 |
| Water Cost (\$ per 1,000 gallons) | | | | \$0.39 |

| Table E-33 Manufacturing - Moore County New Groundwater Source | | | | |
|--|------------------------------|-------------|-------------------|---------------------|
| Owner: | Manufacturing - Moore County | | | |
| Quantity: | 4,000 AF/Y | | | |
| Capital Costs | Quantity | Unit | Unit Price | Cost |
| Wellfield and Treatment | | | | |
| Water Wells (450 GPM) | 15 | EA | \$422,000 | \$6,330,000 |
| Connection to User | 15 | EA | \$25,000 | \$375,000 |
| Subtotal for Wellfield and Treatment | | | | \$6,705,000 |
| TOTAL CONSTRUCTION COST | | | | \$6,705,000 |
| Engineering and Contingencies (30% for pipelines) | | | | \$0 |
| Engineering and Contingencies (35% for well field) | | | | \$2,346,800 |
| Groundwater Rights/ Purchase | 4,000 AC-FT | | \$500 | \$2,000,000 |
| Interest During Construction (6 Months) | | | | \$193,000 |
| TOTAL CAPITAL COST | | | | \$11,244,800 |
| Annual Costs | | | | |
| Debt Service (5.5 percent for 20 years) | | | | \$941,000 |
| Electricity | | | | \$132,300 |
| Water Treatment | | | | \$52,542 |
| Operation and Maintenance | | | | \$201,200 |
| Total Annual Cost | | | | \$1,327,042 |
| UNIT COSTS (Until Amortized) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$332 |
| Water Cost (\$ per 1,000 gallons) | | | | \$1.02 |
| UNIT COSTS (After Amortization) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$97 |
| Water Cost (\$ per 1,000 gallons) | | | | \$0.30 |

| Table E-34 | | | | |
|--|------------------|-------------|-------------------|---------------------|
| City of Perryton | | | | |
| Develop Ogallala Aquifer Supplies | | | | |
| Owner: | City of Perryton | | | |
| Quantity: | 2,800 AF/Y | | | |
| Capital Costs | Quantity | Unit | Unit Price | Cost |
| Wellfield and Treatment | | | | |
| Water Wells (490 GPM) | 8 | EA | \$492,647 | \$3,941,000 |
| Well Field Collection Pipeline(s) | 8 | EA | \$100,000 | \$800,000 |
| Connection to Pump Station | 4 | EA | \$140,000 | \$560,000 |
| Subtotal for Wellfield and Treatment | | | | \$5,301,000 |
| Transmission System | | | | |
| Pump Station | 1 | LS | \$802,000 | \$802,000 |
| Pipeline | 10,560 | LF | \$76 | \$803,000 |
| Subtotal for Transmission | | | | \$1,605,000 |
| TOTAL CONSTRUCTION COST | | | | \$6,906,000 |
| Engineering and Contingencies (30% for pipelines) | | | | \$240,000 |
| Engineering and Contingencies (35% for well field) | | | | \$1,856,100 |
| Groundwater Rights/ Purchase | 2,800 AC-FT | | \$500 | \$1,400,000 |
| Interest During Construction (6 Months) | | | | \$182,000 |
| TOTAL CAPITAL COST | | | | \$10,584,100 |
| Annual Costs | | | | |
| Debt Service (5.5 percent for 20 years) | | | | \$886,000 |
| Electricity | | | | \$96,200 |
| Water Treatment | | | | \$39,282 |
| Operation and Maintenance | | | | \$168,700 |
| Total Annual Cost | | | | \$1,190,182 |
| UNIT COSTS (Until Amortized) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$425 |
| Water Cost (\$ per 1,000 gallons) | | | | \$1.30 |
| UNIT COSTS (After Amortization) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$109 |
| Water Cost (\$ per 1,000 gallons) | | | | \$0.33 |

| Table E-35 County Other - Potter County Develop Ogallala Aquifer Supplies | | | | |
|---|---------------------|------|------------|--------------------|
| Owner: | Potter County-Other | | | |
| Quantity: | 900 AF/Y | | | |
| Capital Costs | Quantity | Unit | Unit Price | Cost |
| Wellfield and Treatment | | | | |
| Water Wells (70 GPM) | 15 | EA | \$122,642 | \$1,840,000 |
| Subtotal for Wellfield and Treatment | | | | \$1,840,000 |
| Transmission System | | | | |
| Pump Station | 1 | LS | \$724,000 | \$724,000 |
| Subtotal for Transmission | | | | \$724,000 |
| TOTAL CONSTRUCTION COST | | | | \$2,564,000 |
| Engineering and Contingencies (30% for pipelines) | | | | \$0 |
| Engineering and Contingencies (35% for well field) | | | | \$897,400 |
| Groundwater Rights/ Purchase | 900 AC-FT | | \$500 | \$450,000 |
| Interest During Construction (6 Months) | | | | \$68,000 |
| TOTAL CAPITAL COST | | | | \$3,979,400 |
| Annual Costs | | | | |
| Debt Service (5.5 percent for 20 years) | | | | \$333,000 |
| Electricity | | | | \$11,700 |
| Water Treatment | | | | \$17,368 |
| Operation and Maintenance | | | | \$76,900 |
| Total Annual Cost | | | | \$438,968 |
| UNIT COSTS (Until Amortized) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$488 |
| Water Cost (\$ per 1,000 gallons) | | | | \$1.50 |
| UNIT COSTS (After Amortization) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$118 |
| Water Cost (\$ per 1,000 gallons) | | | | \$0.36 |

| Table E-36 County Other - Potter County Develop Dockum Aquifer Supplies | | | | |
|--|-----------------|---------------------|-------------------|--------------------|
| Owner: | | Potter County-Other | | |
| Quantity: | | 700 AF/Y | | |
| Capital Costs | Quantity | Unit | Unit Price | Cost |
| Wellfield and Treatment | | | | |
| Water Wells (70 GPM) | 12 | EA | \$122,642 | \$1,472,000 |
| Subtotal for Wellfield and Treatment | | | | \$1,472,000 |
| Transmission System | | | | |
| Pump Station | 1 | LS | \$704,000 | \$704,000 |
| Subtotal for Transmission | | | | \$704,000 |
| TOTAL CONSTRUCTION COST | | | | \$2,176,000 |
| Engineering and Contingencies (30% for pipelines) | | | | \$0 |
| Engineering and Contingencies (35% for well field) | | | | \$761,600 |
| Groundwater Rights/ Purchase | 700 AC-FT | | \$500 | \$350,000 |
| Interest During Construction (6 Months) | | | | \$58,000 |
| TOTAL CAPITAL COST | | | | \$3,345,600 |
| Annual Costs | | | | |
| Debt Service (5.5 percent for 20 years) | | | | \$280,000 |
| Electricity | | | | \$9,100 |
| Water Treatment | | | | \$14,326 |
| Operation and Maintenance | | | | \$65,300 |
| Total Annual Cost | | | | \$368,726 |
| UNIT COSTS (Until Amortized) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$527 |
| Water Cost (\$ per 1,000 gallons) | | | | \$1.62 |
| UNIT COSTS (After Amortization) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$127 |
| Water Cost (\$ per 1,000 gallons) | | | | \$0.39 |

| Table E-37 | | | | |
|--|-----------------------------|--------------|-------------------|---------------------|
| Manufacturing Potter County | | | | |
| Direct Reuse | | | | |
| Owner: | Manufacturing Potter County | | | |
| Quantity: | 5,700 AF/Y | | | |
| Capital Costs | Quantity | Units | Unit Price | Cost |
| 18- inch pipeline | 52,800 | LF | \$107 | \$5,625,000 |
| 6.5 MGD Pre-Treatment WTP | 1 | EA | \$9,916,000 | \$9,916,000 |
| 6.5 MGD RO Plant | 1 | EA | \$17,571,000 | \$17,571,000 |
| Wastewater Treatment Plant Improvements | 1 | LS | \$2,500,000 | \$2,500,000 |
| Pump Station at WWTP | 1 | LS | \$1,500,000 | \$1,500,000 |
| 12 inch RO Discharge Line | 36,960 | LF | \$54 | \$1,978,000 |
| TOTAL CONSTRUCTION COST | | | | \$39,090,000 |
| Other Project Cost: | Quantity | Units | Unit Price | Cost |
| Engineering, Legal Costs and Contingencies (30% pipelines) | | | | \$2,280,900 |
| Engineering, Legal Costs and Contingencies (35% all other) | | | | \$10,495,450 |
| Land Acquisition | 206 | Ac | \$10,000 | \$2,061,000 |
| Permitting and Mitigation | 17 mi | | \$25,000 | \$925,000 |
| Interest During Construction (18 months) | | | | \$2,880,000 |
| TOTAL CAPITAL COST | | | | \$57,732,350 |
| Annual Costs | | | | |
| Debt Service (5.5 percent for 20 years) | | | | \$4,831,000 |
| Operation and Maintenance | | | | \$139,000 |
| Treatment O&M | | | | \$2,167,145 |
| Pumping Energy Costs (\$0.09/kWh) | | | | \$340,000 |
| Total Annual Cost | | | | \$7,477,145 |
| UNIT COST (Until Amortized) | | | | |
| Annual Cost of Water (\$ per acft) | | | | \$1,312 |
| Annual Cost of Water (\$ per 1,000 gallons) | | | | \$4.03 |
| UNIT COSTS (After Amortization) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$464 |
| Water Cost (\$ per 1,000 gallons) | | | | \$1.42 |

| Table E-38 City of Canyon Drill Nine Wells (Dockum Aquifer) | | | | |
|---|-----------------|----------------|-------------------|---------------------|
| Owner: | | City of Canyon | | |
| Quantity: | | 4,300 AF/Y | | |
| Capital Costs | Quantity | Unit | Unit Price | Cost |
| Mobilization | 1 | LS | \$335,000 | \$335,000 |
| Wells | 9 | Ea. | \$447,000 | \$4,023,000 |
| Subtotal for Wellfield and Treatment | | | | \$4,358,000 |
| Transmission System | | | | |
| PVC C905 Pipe | 15,000 | LF | \$112 | \$1,680,000 |
| PVC C900 Pipe | 21,300 | LF | \$56 | \$1,192,800 |
| GV & B | 4 | EA | \$22,000 | \$88,000 |
| GV & B | 10 | EA | \$5,600 | \$56,000 |
| Bore Under Railroad | 340 | LF | \$391 | \$132,900 |
| Casing thru Bore | 340 | LF | \$223 | \$75,800 |
| Ground Storage Tank | 1 | EA | \$1,116,000 | \$1,116,000 |
| Controls | 1 | EA | \$56,000 | \$56,000 |
| Fittings | 20,000 | LBS | \$6 | \$120,000 |
| Electrical Service | 1 | LS | \$111,628 | \$111,600 |
| Subtotal for Transmission | | | | \$4,629,100 |
| TOTAL CONSTRUCTION COST | | | | \$8,987,100 |
| Other Project Cost: | Quantity | Units | Unit Price | Cost |
| Contingencies (10%) | | | | \$899,000 |
| Engineering (11%) | | | | \$989,000 |
| Engineering Survey (1%) | | | | \$99,000 |
| Testing (0.55%) | | | | \$49,000 |
| Project Representation (2.2%) | | | | \$198,000 |
| Interest During Construction (1 year) | | | | \$393,000 |
| TOTAL CAPITAL COST | | | | \$11,614,100 |
| Annual Costs | | | | |
| Debt Service (5.5 percent for 20 years) | | | | \$1,012,600 |
| Electricity | | | | \$202,700 |
| Water Treatment (\$0.30 per 1,000 gal) | | | | \$420,300 |
| Operation and Maintenance | | | | \$191,200 |
| Total Annual Cost | | | | \$1,826,800 |
| UNIT COSTS (Until Amortized) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$425 |
| Water Cost (\$ per 1,000 gallons) | | | | \$1.30 |
| UNIT COSTS (After Amortization) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$189 |
| Water Cost (\$ per 1,000 gallons) | | | | \$0.58 |

| Table E-39 Lake Tanglewood Develop Ogallala Aquifer Supplies | | | | |
|--|-----------------|-------------|-------------------|--------------------|
| Owner: | Lake Tanglewood | | | |
| Quantity: | 300 AF/Y | | | |
| Capital Costs | Quantity | Unit | Unit Price | Cost |
| Wellfield and Treatment | | | | |
| Water Wells (200 GPM) | 2 | EA | \$238,000 | \$476,000 |
| Well Field Collection Pipeline(s) | 2 | EA | \$100,000 | \$200,000 |
| Connection to Pump Station | 1 | EA | \$140,000 | \$140,000 |
| Subtotal for Wellfield and Treatment | | | | \$816,000 |
| Transmission System | | | | |
| 8" Pipeline - Transmission Main | 15,840 | LF | \$31 | \$491,000 |
| Pump Station | 1 | LS | \$694,000 | \$694,000 |
| Subtotal for Transmission | | | | \$1,185,000 |
| TOTAL CONSTRUCTION COST | | | | \$2,001,000 |
| Engineering and Contingencies (30% for pipelines) | | | | \$231,900 |
| Engineering and Contingencies (35% for well field) | | | | \$458,500 |
| Easement - Rural | 7 | AC | \$1,200 | \$9,000 |
| Permitting and Mitigation | 3 | MI | \$25,000 | \$75,000 |
| Groundwater Rights/ Purchase | 300 AC-FT | | \$500 | \$150,000 |
| Interest During Construction (6 Months) | | | | \$51,000 |
| TOTAL CAPITAL COST | | | | \$2,976,400 |
| Annual Costs | | | | |
| Debt Service (5.5 percent for 20 years) | | | | \$249,000 |
| Electricity | | | | \$5,800 |
| Water Treatment | | | | \$8,242 |
| Operation and Maintenance | | | | \$47,600 |
| Total Annual Cost | | | | \$310,642 |
| UNIT COSTS (Until Amortized) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$1,035 |
| Water Cost (\$ per 1,000 gallons) | | | | \$3.18 |
| UNIT COSTS (After Amortization) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$205 |
| Water Cost (\$ per 1,000 gallons) | | | | \$0.63 |

| Table E-40 County Other - Randall County Develop Ogallala Aquifer Supplies | | | | |
|---|-----------------|----------------------|-------------------|--------------------|
| Owner: | | Randall County-Other | | |
| Quantity: | | 2,800 AF/Y | | |
| Capital Costs | Quantity | Unit | Unit Price | Cost |
| Wellfield and Treatment | | | | |
| Water Wells (490 GPM) | 8 | EA | \$482,192 | \$3,858,000 |
| Subtotal for Wellfield and Treatment | | | | \$3,858,000 |
| TOTAL CONSTRUCTION COST | | | | \$3,858,000 |
| Engineering and Contingencies (35% for wells) | | | | \$1,350,300 |
| Interest During Construction (6 Months) | | | | \$91,000 |
| TOTAL CAPITAL COST | | | | \$5,299,300 |
| Annual Costs | | | | |
| Debt Service (5.5 percent for 20 years) | | | | \$443,000 |
| Electricity | | | | \$96,600 |
| Water Treatment | | | | \$39,282 |
| Operation and Maintenance | | | | \$115,700 |
| Total Annual Cost | | | | \$694,582 |
| UNIT COSTS (Until Amortized) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$248 |
| Water Cost (\$ per 1,000 gallons) | | | | \$0.76 |
| UNIT COSTS (After Amortization) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$90 |
| Water Cost (\$ per 1,000 gallons) | | | | \$0.28 |


| Table E-41 Manufacturing - Randall County Develop Ogallala Aquifer Supplies | | | | |
|---|------------------------------|-------------|-------------------|------------------|
| Owner: | Randall County Manufacturing | | | |
| Quantity: | 300 AF/Y | | | |
| Capital Costs | Quantity | Unit | Unit Price | Cost |
| Wellfield and Treatment | | | | |
| Water Wells (150 GPM) | 2 | EA | \$271,707 | \$543,000 |
| Subtotal for Wellfield and Treatment | | | | \$543,000 |
| TOTAL CONSTRUCTION COST | | | | \$543,000 |
| Engineering and Contingencies (35% for wells) | | | | \$190,000 |
| Interest During Construction (6 Months) | | | | \$13,000 |
| TOTAL CAPITAL COST | | | | \$746,000 |
| Annual Costs | | | | |
| Debt Service (5.5 percent for 20 years) | | | | \$62,000 |
| Electricity | | | | \$11,900 |
| Operation and Maintenance | | | | \$16,300 |
| Total Annual Cost | | | | \$90,200 |
| UNIT COSTS (Until Amortized) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$301 |
| Water Cost (\$ per 1,000 gallons) | | | | \$0.92 |
| UNIT COSTS (After Amortization) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$94 |
| Water Cost (\$ per 1,000 gallons) | | | | \$0.29 |

| Table E-42 City of Wheeler Develop Ogallala Aquifer Supplies | | | | |
|--|-----------------|-----------------|-------------------|--------------------|
| Owner: | | City of Wheeler | | |
| Quantity: | | 500 AF/Y | | |
| Capital Costs | Quantity | Unit | Unit Price | Cost |
| Wellfield and Treatment | | | | |
| Water Wells (400 GPM) | 2 | EA | \$283,529 | \$567,000 |
| 8" Well Field Piping | 2,000 | LF | \$31 | \$62,000 |
| Connection to Pump Station | 2 | EA | \$140,000 | \$280,000 |
| Subtotal for Wellfield and Treatment | | | | \$909,000 |
| Transmission System | | | | |
| 8" Pipeline - Transmission Main | 10,560 | LF | \$31 | \$327,000 |
| Pump Station | 1 | LS | \$760,000 | \$760,000 |
| Subtotal for Transmission | | | | \$1,087,000 |
| TOTAL CONSTRUCTION COST | | | | \$1,996,000 |
| Other Project Cost: | Quantity | Units | Unit Price | Cost |
| Engineering and Contingencies (30% for pipelines) | | | | \$133,100 |
| Engineering and Contingencies (35% for well field) | | | | \$562,500 |
| Easement - Rural | 5 | AC | \$1,200 | \$6,000 |
| Permitting and Mitigation | 2 | MI | \$25,000 | \$50,000 |
| Groundwater Rights/ Purchase | 0 | AC-FT | \$500 | \$0 |
| Interest During Construction (6 Months) | | | | \$48,000 |
| TOTAL CAPITAL COST | | | | \$2,795,600 |
| Annual Costs | | | | |
| Debt Service (5.5 percent for 20 years) | | | | \$234,000 |
| Electricity | | | | \$14,300 |
| Water Treatment | | | | \$11,284 |
| Operation and Maintenance | | | | \$52,900 |
| Total Annual Cost | | | | \$312,484 |
| UNIT COSTS (Until Amortized) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$625 |
| Water Cost (\$ per 1,000 gallons) | | | | \$1.92 |
| UNIT COSTS (After Amortization) | | | | |
| Water Cost (\$ per ac-ft) | | | | \$157 |
| Water Cost (\$ per 1,000 gallons) | | | | \$0.48 |



Appendix F
Consistency Matrix





CHECKLIST FOR COMPARISON OF THE REGIONAL WATER PLAN TO APPLICABLE WATER PLANNING REGULATIONS

The purpose of this attachment is to facilitate the determination of how the Regional Water Plan is consistent with the long-term protection of the water, agricultural, and natural resources of the State of Texas, particularly within this region. The following checklist includes a regulatory citation (Column 1) for all subsections and paragraphs contained in the following applicable portions of the water planning regulations:

- 31 TAC Chapter 358.3
- 31 TAC Chapter 357.3
- 31 TAC Chapter 357.4
- 31 TAC Chapter 357.2
- 31 TAC Chapter 357.5

According to 31 TAC Chapter 357.41, the Regional Water Plan is considered to be consistent with the long-term protection of the State's resources if it complies with the above listed requirements. Therefore, the Regional Water Plan has been compared to each applicable section of the regulations as a means of determining consistency.

The checklist also includes a summary description of each cited regulation (Column 2). It should be understood that this summary is intended only to provide a general description of the particular section of the regulation and should not be assumed to contain all specifics of the actual regulation. The evaluation of the Regional Water Plan should be performed against the complete regulation, as contained in the actual 31 TAC 358 and 31 TAC 357 regulations.

Column 3 of the checklist provides the evaluation response as affirmative, negative, or not applicable. A "Yes" in this column indicates that the Regional Water Plan has been evaluated to comply with the stated section of the regulation. A "No" response indicates that the Regional Water Plan does not comply with the stated regulation. A response of "NA" (or not applicable) indicates that the stated section of the regulation does not apply to this Regional Water Plan.

The evidence of where, in the Regional Water Plan, the stated regulation is addressed is provided in Column 4. Where the regulation is addressed in multiple locations within the Regional Water Plan, this column may cite only the primary locations. In addition to identifying where the regulation is addressed, this column may include commentary about the application of the regulation in the Regional Water Plan.

The above-listed regulations are repetitive, in some instances. One section of the regulations may be restated or paraphrased elsewhere within the regulations. In some cases, multiple sections of the regulations may be combined into one separate regulation section. Therefore, Column 5 provides cross-referencing.




| Regulatory Citation (Col 1) | Summary of Requirement (Col 2) | Response (Yes/No/ NA) (Col 3) | Location(s) in Regional Plan and/or Commentary (Col 4) | Regulatory Cross References (Col 5) |
|--------------------------------|--|-------------------------------------|---|---|
| Guidance Principles | | | | |
| 31 TAC §358.3 | | | | |
| 358.3 (1) | The state water plan shall provide for the preparation for and response to drought conditions. | Yes | Chapters 1, 2, 3, 5, 7 | |
| (2) | The RWP and SWP shall serve as water supply plans under drought of record conditions. | Yes | See above | |
| (3) | Consideration shall be given to the construction and improvement of surface water resources and the application of principles that result in voluntary redistribution of water resources. | Yes | Chapter 5 | |
| (4) | Provide for the orderly development, management, and conservation of water resources and preparation for and response to drought conditions so that sufficient water will be available at a reasonable cost to satisfy a reasonable projected use of water to ensure public health, safety, and welfare; further economic development; and protect the agricultural and natural resources of the regional water planning area. | Yes | Chapters 5, 6 | |
| (5) | Include identification of those policies and action that may be needed to meet Texas' water supply needs and prepare for and respond to drought conditions. | Yes | Chapters 5 and 7 | |
| (6) | Decision-making shall be open to and accountable to the public with decisions based on accurate, objective and reliable information with full dissemination of planning results except for those matters made confidential by law. | Yes | Chapter 10 | |
| (7) | Establish terms of participation in water planning efforts that shall be equitable and shall not unduly hinder participation. | Yes | Chapter 10 | |
| (8) | Consideration of the effect of policies or water management strategies on the public interest of the state, water supply, and those entities involved in providing this supply throughout the entire state. | Yes | Chapter 8 | |
| (9) | Consideration of all water management strategies the regional water plan determines to be potentially feasible when developing plans to meet future water needs and to respond to drought so that cost effective water management strategies which are consistent with long-term protection of the state's water resources, agricultural resources, and natural resources are considered and approved. | Yes | Chapters 5 and 6 | |
| (10) | Consideration of opportunities that encourage and result in voluntary transfers of water resources, including but not limited to regional water banks, sales, leases, options, subordination agreements, and financing agreements. | Yes | Chapter 5 | |
| (11) | Consideration of a balance of economic, social, aesthetic, and ecological viability. | Yes | Chapter 5 | |
| (12) | For regional water planning areas without approved regional water plans or water providers for which revised plans are not developed through the regional water planning process, the use of information from the adopted state water plan and other completed studies that are sufficient for water planning shall represent the water supply plan for that area or water provider. | NA | | |
| (13) | All surface waters are held in trust by the state, their use is subject to rights granted and administered by the Commission, and the use of surface water is governed by the prior appropriation doctrine, unless adjudicated otherwise. | Yes | Chapter 3 | |
| (14) | Existing water rights, water contracts, and option agreements shall be protected. However, potential amendments of water rights, contracts and agreements may be considered and evaluated. Any amendments will require the eventual consent of the owner. | Yes | Chapters 3 and 5 | |
| (15) | The production and use of groundwater in Texas is governed by the rule of capture doctrine unless and to the extent that such production and use is regulated by a groundwater conservation district. | Yes | Chapter 3 | \$36.002 |
| (16) | Consideration of recommendations of river and stream segments of unique ecological value to the legislature for potential protection. | Yes | Chapter 8 | |
| (17) | Consideration of recommendation of sites of unique value for the construction of reservoirs to the legislature for potential protection. | Yes | Chapter 8 | |
| (18) | Consideration of water planning and management activities of local, regional, state, and federal agencies, along with existing local, regional, and state water plans and information and existing state and federal programs and goals. | Yes | Chapters 1 and 5 | |
| (19) | Designated water quality and related water uses as shown in the state water quality management plan shall be improved or maintained. | Yes | Chapter 6 | |



| Regulatory Citation (Col 1) | Summary of Requirement (Col 2) | Response (Yes/No/ NA) (Col 3) | Location(s) In Regional Plan and/or Commentary (Col 4) | Regulatory Cross References (Col 5) |
|--|--|-------------------------------------|---|---|
| (20) | Coordination of water planning and management activities of RWPGs to identify common needs and issues and achieve efficient use of water supplies, including the Board and other relevant RWPGs, working together to identify common needs, issues, and challenges while working together to resolve conflicts in a fair, equitable, and efficient manner. | Yes | Entire RWP | |
| (21) | The water management strategies identified in approved RWPs to meet needs shall be described in sufficient detail to allow a state agency making a financial or regulatory decision to determine if a proposed action before the state agency is consistent with an approved RWP. | Yes | Chapter 5, Appendix E | |
| (22) | The evaluation of water management strategies shall use environmental information in accordance with the Commission's adopted environmental flow standards where applicable or, in basins where standards are not available or have not been adopted, information from existing site-specific studies or state consensus environmental planning criteria. | NA | No new appropriations are recommended. | 30 TAC Chapter 298 |
| (23) | Consideration of environmental water needs including instream flows and bay and estuary inflows, including adjustments by the RWPGs to water management strategies to provide for environmental water needs including instream flows and bay and estuary needs. Consideration shall be consistent with the Commission's adopted environmental flow standards in basins where standards have been adopted. | NA | No new appropriations are recommended. Existing instream regulations considered. | 30 TAC Chapter 298 |
| (24) | Planning shall be consistent with all laws applicable to water use for the state and regional water planning area. | Yes | Entire RWP | |
| (25) | The inclusion of ongoing water development projects that have been permitted by the Commission or a predecessor agency. | NA | None in PWPA | |
| (26) | Specific recommendations of water management strategies shall be based upon identification, analysis, and comparison of all water management strategies the RWPG determines to be potentially feasible so that the cost effective water management strategies which are environmentally sensitive are considered and adopted unless the RWPG demonstrates that adoption of such strategies is not appropriate. | Yes | Chapter 5 | §357.34(d)(3)(A) §357.34(d)(3)(B) |
| (27) | Achieve efficient use of existing water supplies, explore opportunities for and the benefits of developing regional water supply facilities or providing regional management of water facilities, coordinate the actions of local and regional water resource management agencies, provide substantial involvement by the public in the decision-making process, and provide full dissemination of planning results. | Yes | Chapters 5 and 10 | |
| (28) | Consideration of existing regional water planning efforts when developing RWPs. | Yes | Chapters 1 and 5 | |
| Chapter One Description of the Regional Water Planning Area 31 TAC §357.30 | | | | |
| | RWPGs shall describe their regional water planning area including the following: | | | |
| 357.3 (1) | Social and economic aspects of a region such as information on current population, economic activity and economic sectors heavily dependent on water resources | Yes | 1.3 | |
| (2) | Current water use and major water demand centers | Yes | 1.6 | |
| (3) | Current groundwater, surface water, and reuse supplies including major springs that are important for water supply or protection of natural resources | Yes | 1.5 | |
| (4) | Wholesale water providers | Yes | 1.4 | |
| (5) | Agricultural and natural resources | Yes | 1.7 | |
| (6) | Identified water quality problems | Yes | 1.5, 1.7 and 1.8 | |
| (7) | Identified threats to agricultural and natural resources due to water quantity problems or water quality problems related to water supply | Yes | 1.8 and 1.9 | |
| (8) | Summary of existing local and regional water plans | Yes | 1.1 | |
| (9) | The identified historic drought(s) of record within the planning area | Yes | 1.8.2 and Chapter 7 1.8.3, Chapter 7, and http://www.panhandlewater.org/ | |
| (10) | Current preparations for drought within the RWPA | Yes | 1.8.1 | §358.6 |
| (11) | Information compiled by the Board from water loss audits | Yes | 1.8.1 | |
| (12) | An identification of each threat to agricultural and natural resources and a discussion of how that threat will be addressed or affected by the water management strategies evaluated in the plan. | | 1.8 and Chapter 6 | |



| Regulatory Citation (Col 1) | Summary of Requirement (Col 2) | Response (Yes/No/NA) (Col 3) | Location(s) In Regional Plan and/or Commentary (Col 4) | Regulatory Cross References (Col 5) |
|--|--|------------------------------------|---|---|
| Chapter Two Projected Non-Municipal, Municipal and Population Water Demands | | | | |
| 31 TAC §357.31 | | | | |
| 357.31 (a) | Present projected population and water demands by WUG. | Yes | 2.2, 2.3, Attachment 2-1 | §357.10 |
| (b) | Present projected water demands associated with WWPs by category of water use, including municipal, manufacturing, irrigation, steam electric power generation, mining, and livestock for each county or portion of a county in the RWPA. | Yes | 2.7 | |
| (c) | Report the current contractual obligations of WUG and WWPs to supply water in addition to any demands projected for the WUG or WWP. | Yes | 2.7 | §357.32 |
| (d) | Municipal demands shall be adjusted to reflect water savings due to plumbing fixture requirements identified in the Texas Health and Safety Code, Chapter 372. | Yes | 2.4 and Attachment 2-1 | Texas Health and Safety Code, Chapter 372 |
| (e) | In developing RWPs, RWPGs shall use: | | | |
| (e) (1) | Population and water demand projections developed by the EA that will be contained in the next state water plan and adopted by the Board after consultation with the RWPGs, Commission, Texas Department of Agriculture, and the Texas Parks and Wildlife Department. | Yes | 2.2, 2.3, 2.4, 2.5, 2.6 | |
| (e) (2) | RWPGs may request revisions of Board adopted population or water demand projections if the request demonstrates that population or water demand projections no longer represents a reasonable estimate of anticipated conditions based on changed conditions and or new information. | Yes | 2.2-Adjustments to population projections were made to eight municipal water user groups. Water demand adjustments were made to municipal water user group based on baseline GPCD errors and alternative dry year. Agricultural demand users were changed based on the Texas A&M AgriLife Memorandum included as Appendix B | §357.21(c) |
| (f) | Population and water demand projections shall be presented for each planning decade for each of the above reporting categories. | Yes | 2.2, 2.3, 2.4, 2.5, 2.6 | |
| Chapter Three Water Supply Analysis | | | | |
| 31 TAC §357.32 | | | | |
| 357.32 (a) | RWPGs shall evaluate: | | | |
| (a) (1) | Source water availability during drought of record conditions. | Yes | Chapter 3 | |
| (a) (2) | Existing water supplies that are legally and physically available to WUGs and wholesale water suppliers within the RWPA for use during the drought of record. | Yes | 3.1, 3.2 | |
| (b) | Consider surface water and groundwater data from the state water plan, existing water rights, contracts and option agreements relating to water rights, other planning and water supply studies, and analysis of water supplies existing in and available to the RWPA during drought of record conditions | Yes | 3.1, 3.2 | |
| (c) | Evaluation of the existing surface water available during drought of record shall be based on firm yield. The analysis may be based on justified operational procedures other than firm yield. | Yes | 3.1.3 | |
| (d) | Use modeled available groundwater volumes for groundwater availability, as issued by the Board, and incorporate such information in its RWP unless no modeled available groundwater volumes are provided. | Yes | 3.1.2 | |
| (e) | Evaluate the existing water supplies for each WUG and WWP | Yes | 3.2 | |
| (f) | Water supplies based on contracted agreements will be based on the terms of the contract, which may be assumed to renew upon contract termination if the contract contemplates renewal or extensions. | Yes | 3.5, 3.6 | |
| (g) | Evaluation results shall be reported by WUG in accordance with §357.31(a) of this title (relating to Projected Population and Water Demands) and WWPs in accordance with §357.31(b) of this title | Yes | 2.7, Chapter 3 | §357.31(a) §357.31(b) |
| Chapter Four Identification of Water Needs | | | | |
| 31 TAC §357.33 | | | | |
| 357.33 (a) | Include comparisons of existing water supplies and projected water demands to identify water needs. | Yes | 4.2 | |
| (b) | Compare projected water demands with existing water supplies available to WUGs and WWPs in a planning area to determine whether WUGs will experience water surpluses or needs for additional supplies. Results will be reported for WUGs and for WWPs by categories of use including municipal, manufacturing, irrigation, steam electric, mining, and livestock watering for each county or portion of a county in a RWPA. | Yes | 4.2, and Attachment 4-1 | §357.31 §357.32 |
| (c) | The social and economic impacts of not meeting water needs will be evaluated by RWPGs and reported for each RWPA. | Yes | Chapter 6 and Appendix G | |
| (d) | Results of evaluations will be reported by WUG in accordance with §357.31(a) of this title and WWPs in accordance with §357.31(b) of this title. | Yes | Attachment 4-1 | §357.31(a) §357.31(b) |
| (e) | Perform a secondary water needs analysis for all WUGs and WWPs for which conservation water management strategies or direct reuse water management strategies are recommended. This secondary water needs analysis will calculate the water needs that would remain after assuming all recommended conservation and direct reuse water management strategies are fully implemented. The resulting secondary water needs volumes shall be presented in the RWP by WUG and WWP and decade. | Yes | 4.3 and data table reports in Appendix K | |

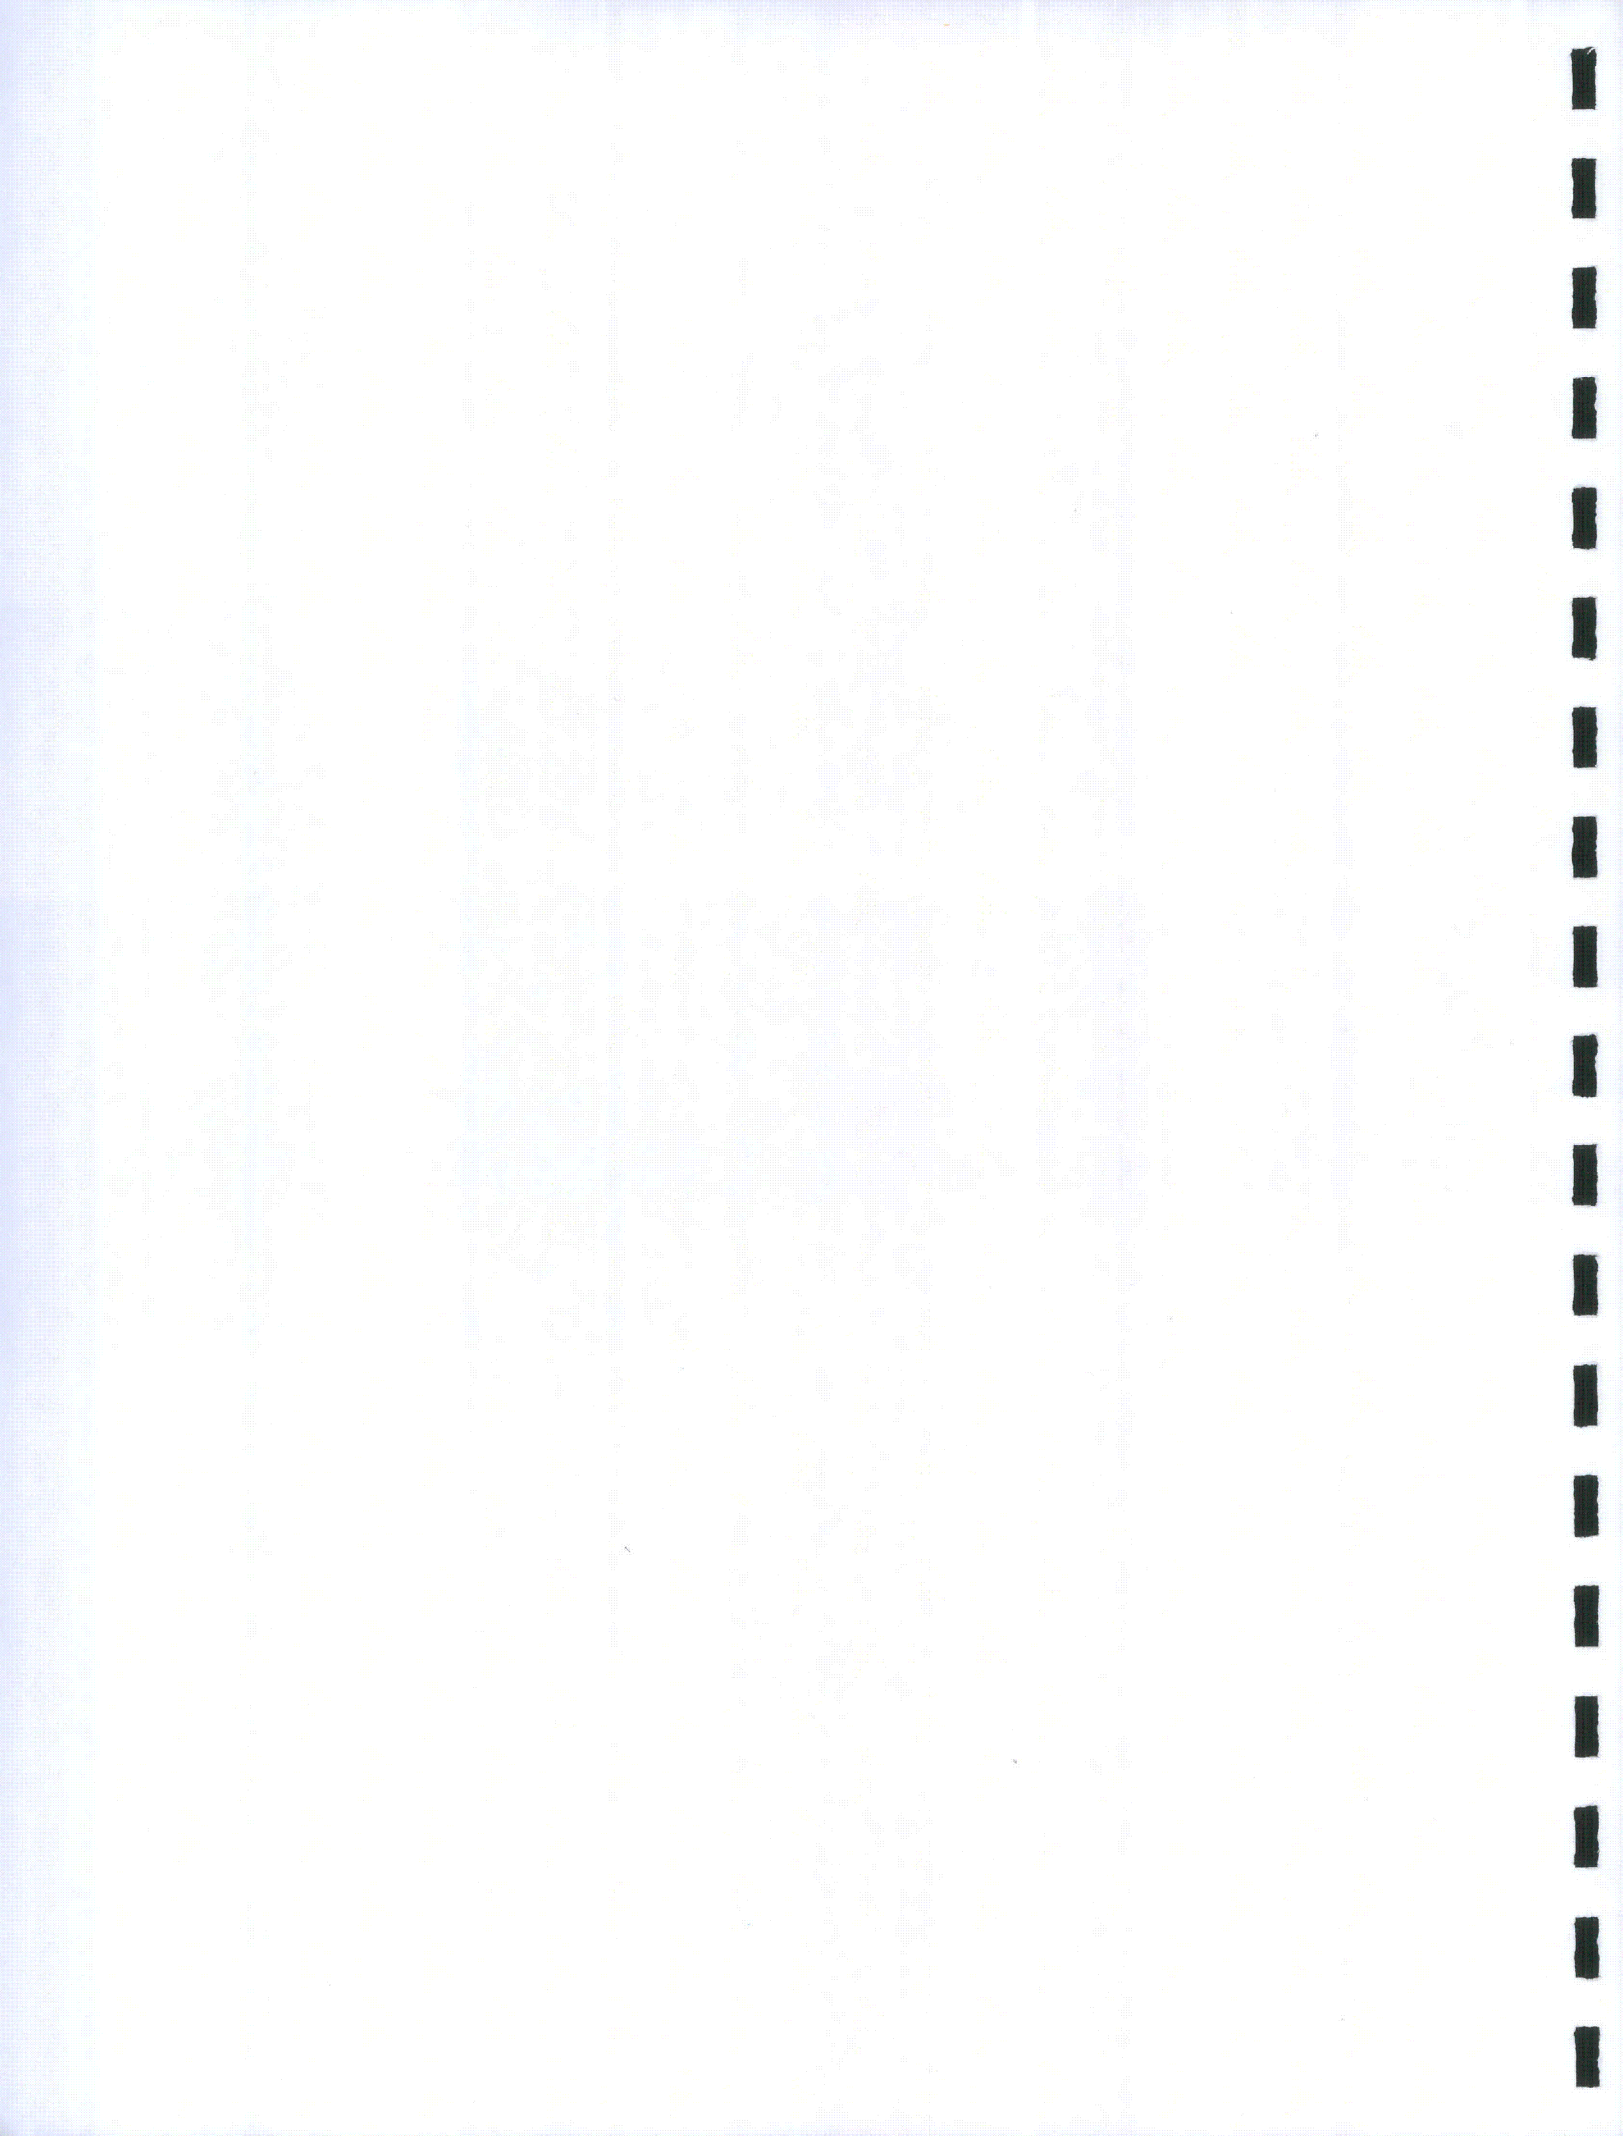


| Regulatory Citation (Col 1) | Summary of Requirement (Col 2) | Response (Yes/No/ NA) (Col 3) | Location(s) in Regional Plan and/or Commentary (Col 4) | Regulatory Cross References (Col 5) |
|---|--|-------------------------------------|---|---|
| Chapter Five Identification and Evaluation of Potentially Feasible Water Management Strategies | | | | |
| 31 TAC §357.34 | | | | |
| 357.34 (a) | Identify and evaluate potentially feasible water management strategies for all WUGs and WWP with identified water needs. | Yes | Chapter 5 | |
| (b) | Identify potentially feasible water management strategies to meet water supply needs. Strategies shall be developed for WUGs and WWPs. The strategies shall meet new water supply obligations necessary to implement recommended water management strategies of WWPs and WUGs. | Yes | Subchapter 5A | §357.33 §357.12(b) |
| (c) | Potential Feasible Water Management Strategies should include, but are not limited to: | | | |
| (c) (1) | Expanded use of existing supplies including system optimization and conjunctive use of water resources, reallocation of reservoir storage to new uses, voluntary redistribution of water resources including contracts, water marketing, regional water banks, sales, leases, options, subordination agreements, and financing agreements, subordination of existing water rights through voluntary agreements, enhancements of yields of existing sources, and improvement of water quality including control of naturally occurring chlorides. | Yes | Subchapters 5A.1.3, Reallocation of reservoir storage is extremely limited in PWPA. Due to limited supply, this strategy was not considered for PWPA. | |
| (c) (2) | New supply development including construction and improvement of surface water and groundwater resources, brush control, precipitation enhancement, desalination, water supply that could be made available by cancellation of water rights based on data provided by the Commission, rainwater harvesting, and aquifer storage and recovery. | Yes | Subchapters 5A.1.4 (Groundwater), 5A.1.5 (Brush Control), 5A.1.6 (Precipitation Enhancement) - PWPG did not consider water right cancellation to be a feasible strategy for PWPA. | |
| (c) (3) | Conservation and drought management measures including demand management. | Yes | Subchapters 5A.1.1, 5B and Chapter 7 | |
| (c) (4) | Reuse of wastewater. | Yes | Subchapter 5A.1.2 | |
| (c) (5) | Interbasin transfers of surface water. | NA | There are no new interbasin strategies for PWPA | |
| (c) (6) | Emergency transfers of surface water including a determination of the part of each water right for non-municipal use in the RWPA that may be transferred without causing unreasonable damage to the property of the non-municipal water rights holder in accordance with Texas Water Code §11.139 (relating to Emergency Authorizations). | Yes | Chapter 7 | §11.139 |
| (d) | Evaluations of Potentially Feasible Water Management Strategies should include the following analyses: | | | |
| (d) (1) | For the purpose of evaluating potentially feasible water management strategies, the Commission's most current Water Availability Model with assumptions of no return flows and full utilization of senior water rights, is to be used. Alternative assumptions may be used with written approval from the EA. | Yes | There are no proposed new appropriations of surface water for PWPA. | |
| (d) (2) | An equitable comparison between and consistent evaluation and application of all water management strategies the RWPGs determine to be potentially feasible for each water supply need. | Yes | Subchapter 5C, 5D and Attachment 5-2 | |
| (d) (3) (A) | A quantitative reporting of the net quantity, reliability, and cost of water delivered and treated for the end user's requirements during drought of record conditions, taking into account and reporting anticipated strategy water losses, incorporating factors used calculating infrastructure debt payments and may include present costs and discounted present value costs. Costs do not include distribution of water within a WUG after treatment. | Yes | Subchapters 5B, 5C, 5D, Attachments 5-2 and 5-3 | |
| (d) (3) (B) | A quantitative reporting of the environmental factors including effects on environmental water needs, wildlife habitat, cultural resources, and effect of upstream development on bays, estuaries, and arms of the Gulf of Mexico. | Yes | Attachment 5-3 | 30 TAC Chapter 298 |
| (d) (3) (C) | A quantitative reporting of the impacts to agricultural resources. | Yes | Attachment 5-3 | |
| (d) (4) | Discussion of the plan's impact on other water resources of the state including other water management strategies and groundwater and surface water interrelationships. | Yes | Chapter 6 and Attachment 5-3 | |
| (d) (5) | Discussion of each threat to agricultural or natural resources identified pursuant to §357.30(7) of this title (relating to Description of the Regional Water Planning Area) including how that threat will be addressed or affected by the water management strategies evaluated | Yes | Chapter 6 and Attachment 5-3 | §357.30(7) |
| (d) (6) | If applicable, consideration and discussion of the provisions in Texas Water Code §11.085(k)(1) for interbasin transfers of surface water. At minimum, this consideration will include a summation of water needs in the basin of origin and in the receiving basin. | NA | There are no new interbasin strategies for PWPA. | §11.085(k)(1) |
| (d) (7) | Consideration of third-party social and economic impacts resulting from voluntary redistributions of water including analysis of third-party impacts of moving water from rural and agricultural areas. | Yes | Chapter 6 | |
| (d) (8) | A description of the major impacts of recommended water management strategies on key parameters of water quality identified by RWPGs as important to the use of a water resource and comparing conditions with the recommended water management strategies to current conditions using best available data. | Yes | Chapter 6 | |
| (d) (9) | Consideration of water pipelines and other facilities that are currently used for water conveyance as described in §357.22(a)(3) of this title (relating to General Considerations for Development of Regional Water Plans). | Yes | Chapter 1 and Subchapter 5B.1 | §357.22(a)(3) |
| (d) (10) | Other factors as deemed relevant by the RWPG including recreational impacts. | Yes | Attachment 5-3 | |
| (e) | Evaluate and present potentially feasible water management strategies with sufficient specificity to allow state agencies to make financial or regulatory decisions to determine consistency of the proposed action before the state agency with an approved RWP. | Yes | Chapter 5 | |




| Regulatory Citation (Col 1) | Summary of Requirement (Col 2) | Response (Yes/No/ NA) (Col 3) | Location(s) in Regional Plan and/or Commentary (Col 4) | Regulatory Cross References (Col 5) |
|---|--|-------------------------------------|---|---|
| (f) | Conservation, Drought Management Measures, and Drought Contingency Plans shall be considered by RWPGs when developing the regional plans, particularly during the process of identifying, evaluating, and recommending water management strategies. RWPGs shall incorporate water conservation planning and drought contingency planning in the regional water planning area. | Yes | Chapter 5 and 7 | |
| (f) (1) | Drought management measures including water demand management. RWPGs shall consider drought management measures for each need identified in §357.33 of this title and shall include such measures for each user group to which Texas Water Code §11.1272 (relating to Drought Contingency Plans for Certain Applicants and Water Right Holders) applies. Impacts of the drought management measures on water needs must be consistent with guidance provided by the Commission in its administrative rules implementing Texas Water Code §11.1272. If a RWPG does not adopt a drought management strategy for a need it must document the reason in the RWP. | Yes | Chapter 7 and Subchapter 5A - Drought management considered for all users with needs but not recommended. | §357.33 §11.1272 |
| (f) (2) | Must consider water conservation practices, including potentially applicable best management practices, for each identified water need. | Yes | Subchapter 5B, 5C and 5D | |
| (f) (2) (A) | Include water conservation practices for each user group to which Texas Water Code §11.1271 and §13.146 (relating to Water Conservation Plans) apply. The impact of these water conservation practices on water needs must be consistent with requirements in appropriate Commission administrative rules. | Yes | Subchapter 5B and Attachment 5-2 | §11.1271 §13.146 |
| (f) (2) (B) | Consider water conservation practices for each WUG beyond the minimum requirements of subparagraph (A) of this paragraph, whether or not the WUG is subject to Texas Water Code §11.1271 and §13.146. If RWPGs do not adopt a water conservation strategy to meet an identified need, they shall document the reason in the RWP. | Yes | Subchapters 5B, 5C, 5D and Attachment 5-2 | §11.1271 §13.146 |
| (f) (2) (C) | For each WUG or WWP that is to obtain water from a proposed interbasin transfer, RWPGs will include a water conservation strategy that will result in the highest practicable level of water conservation and efficiency achievable. | NA | There are no new interbasin strategies for PWPA. | §11.085 |
| (f) (2) (D) | Consider strategies to address any issues identified in the information compiled by the Board from the water loss audits performed by retail public utilities pursuant to §358.6 of this title (relating to Water Loss Audits). | Yes | Subchapter 5B | §358.6 |
| (g) | Include a subchapter consolidating the RWPG's recommendations regarding water conservation. RWPGs shall include in the RWPGs model water conservation plans pursuant to Texas Water Code §11.1271 | Yes | Subchapter 5B | §11.1271 |
| 31 TAC §357.35 | | | | |
| 357.35 (a) | Recommend water management strategies to be used during a drought of record based on the potentially feasible water management strategies evaluated under §357.34 of this title (relating to Identification and Evaluation of Potentially Feasible Water Management Strategies). | Yes | Chapter 5, Attachments 5-1 through 5-3 | §357.34 |
| (b) | Recommend specific water management strategies based upon the identification, analysis, and comparison of water management strategies by the RWPG that the RWPG determines are potentially feasible so that the cost effective water management strategies that are environmentally sensitive are considered and adopted unless a RWPG demonstrates that adoption of such strategies is inappropriate. | Yes | Chapter 5, Attachments 5-1 through 5-3 | §357.34 |
| (c) | Strategies will be selected by the RWPGs so that cost effective water management strategies, which are consistent with long-term protection of the state's water resources, agricultural resources, and natural resources are adopted. | Yes | Chapter 5, Attachments 5-1 through 5-3 | |
| (d) | Identify and recommend water management strategies for all WUGs and WWPs with identified water needs and that meet all water needs during the drought of record except in cases where: (1) no water management strategy is feasible. In such cases, RWPGs must explain why no management strategies are feasible; or (2) a political subdivision that provides water supply other than water supply corporations, counties, or river authorities explicitly does not participate in the regional water planning process for needs located within its boundaries or extraterritorial jurisdiction. | Yes | Chapter 5, Attachments 5-1 through 5-3 | |
| (e) | Specific recommendations of water management strategies to meet an identified need will not be shown as meeting a need for a political subdivision if the political subdivision in question objects to inclusion of the strategy for the political subdivision and specifies its reasons for such objection. This does not prevent the inclusion of the strategy to meet other needs. | Yes | Chapter 5, Attachments 5-1 through 5-3 | |
| (f) | Recommended strategies shall protect existing water rights, water contracts, and option agreements, but may consider potential amendments of water rights, contracts and agreements, which would require the eventual consent of the owner. | Yes | Chapter 5, Attachments 5-1 through 5-3 | |
| (g) | RWPGs shall report the following | | | |
| (g) (1) | Recommended water management strategies and the associated results of all the potentially feasible water management strategy evaluations by WUG and WWP. If a WUG or WWP lies in one or more counties or RWPA's or river basins, data will be reported for each river basin, RWPA, and county. | Yes | Chapter 5, Data table reports in Appendix K | |
| (g) (2) | Calculated planning management supply factors for each WUG and WWP included in the RWP assuming all recommended water management strategies are implemented. This calculation shall be based on the sum of: the total existing water supplies, plus all water supplies from recommended water management strategies for each entity; divided by that entity's total projected water demand, within the planning decade. The resulting calculated safety factor shall be presented in the plan by entity and decade for every WUG and WWP | Yes | Data table reports in Appendix K | |
| (g) (3) | Fully evaluated Alternative Water Management Strategies included in the adopted RWP shall be presented together in one place in the RWP. | Yes | Attachment 5-2 and Attachment 5-3 | |
| Chapter Six Impacts of Regional Water Plan and Consistency with Protection of Water Resources, Agricultural Resources, and Natural Resources | | | | |



| Regulatory Citation (Col 1) | Summary of Requirement (Col 2) | Response (Yes/No/ NA) (Col 3) | Location(s) in Regional Plan and/or Commentary (Col 4) | Regulatory Cross References (Col 5) |
|---|---|-------------------------------------|---|---|
| 31 TAC §357.40 | | | | |
| 357.40 (a) | RWPs shall include a description of the impacts of the RWP regarding: | | | |
| (b) (1) | Agricultural resources pursuant to §357.34(d)(3)(C) of this title (relating to Identification and Evaluation of Potentially Feasible Water Management Strategies) | Yes | Chapter 6 and Attachment 5-3 | §357.34(d)(3)(C) |
| (b) (2) | Other water resources of the state including other water management strategies and groundwater and surface water interrelationships pursuant to §357.34(d)(4) of this title | Yes | Chapter 6 and Attachment 5-3 | §357.34(d)(4) |
| (b) (3) | Threats to agricultural and natural resources identified pursuant to §357.34(d)(5) of this title | Yes | Chapter 6 and Attachment 5-3 | §357.34(d)(5) |
| (b) (4) | Third-party social and economic impacts resulting from voluntary redistributions of water including analysis of third-party impacts of moving water from rural and agricultural areas pursuant to §357.34(d)(7) of this title | Yes | Chapter 6 | §357.34(d)(7) |
| (b) (5) | Major impacts of recommended water management strategies on key parameters of water quality pursuant to §357.34(d)(8) of this title | Yes | 6.1 | §357.34(d)(8) |
| (b) (6) | Effects on navigation | Yes | 6.4 - The PWPA Plan does not have an impact on navigation. | |
| (c) | Include a summary of the identified water needs that remain unmet by the RWP. | Yes | Subchapter 5D | |
| 31 TAC §357.41 | | | | |
| 357.41 | Describe how RWPs are consistent with the long-term protection of the state's water resources, agricultural resources, and natural resources as embodied in the guidance principles in §358.3(4) and (8) of this title (relating to Guidance Principles). | Yes | 6.6, 6.7, 6.8, 6.9, and 6.10 | §358.3(4) and (8) |
| Chapter Seven Drought Response Information, Activities, and Recommendations | | | | |
| 31 TAC §357.42 | | | | |
| 357.42 (a) | Consolidate and present information on current and planned preparations for, and responses to, drought conditions in the region including, but not limited to, drought of record conditions based on the following subsections. | Yes | Chapter 7 | |
| (b) | Conduct an overall assessment of current preparations for drought within the RWPA including a description of how water suppliers in the RWPA identify and respond to the onset of drought. This may include information from local drought contingency plans. | Yes | 7.2 | |
| (c) | Develop drought response recommendations regarding the management of existing groundwater and surface water sources in the RWPA designated in accordance with §357.32 of this title (relating to Water Supply Analysis), including: | | | |
| (c) (1) | Factors specific to each source of water supply to be considered in determining whether to initiate a drought response for each water source including specific recommended drought response triggers | Yes | 7.5 | §357.32 |
| (c) (2) | Actions to be taken as part of the drought response by the manager of each water source and the entities relying on each source, including the number of drought stages | Yes | 7.5 and Attachment 7-1 | §357.32 |
| (c) (3) | Triggers and actions developed in paragraphs (1) and (2) of this subsection may consider existing triggers and actions associated with existing drought contingency plans. | Yes | 7.5 and Attachment 7-1 | §357.32 |
| (d) | Collect information on existing major water infrastructure facilities that may be used for interconnections in event of an emergency shortage of water. In accordance with Texas Water Code §16.053(r), this information is CONFIDENTIAL INFORMATION and cannot be disseminated to the public. The associated information is to be collected by a subgroup of RWPG members in a closed meeting and submitted separately to the EA in accordance with guidance to be provided by EA. | Yes | No confidential information received. | Texas Water Code §16.053(r) |
| (e) | Provide general descriptions of local drought contingency plans that involve making emergency connections between water systems or WWP systems that do not include locations or descriptions of facilities that are disallowed under subsection (d) of this section. | Yes | 7.4 | |
| (f) | RWPGs may designate recommended and alternative drought management water management strategies and other recommended drought measures in the RWP including: | | | |
| (f) (1) | List and description of the recommended drought management water management strategies and associated WUGs and WWPs, if any, that are recommended by the RWPG. Information to include associated triggers to initiate each of the recommended drought management water management strategies | NA | 7.6 - PWPG does not recommend specific drought management strategies. PWPG recommends the implementation of drought contingency plans by suppliers when appropriate to reduce demand during drought and prolong current supplies. | |
| (f) (2) | List and description of alternative drought management water management strategies and associated WUGs and WWPs, if any, that are included in the plan. Information to include associated triggers to initiate each of the alternative drought management water management strategies | NA | No alternative drought management strategies were included in the PWPA Plan. | |
| (f) (3) | List of all potentially feasible drought management water management strategies that were considered or evaluated by the RWPG but not recommended | NA | PWPG does not recommend specific drought management strategies. | |
| (f) (4) | List and summary of any other recommended drought management measures, if any, that are included in the RWP, including associated triggers if applicable | NA | PWPG does not recommend specific drought management strategies. | |

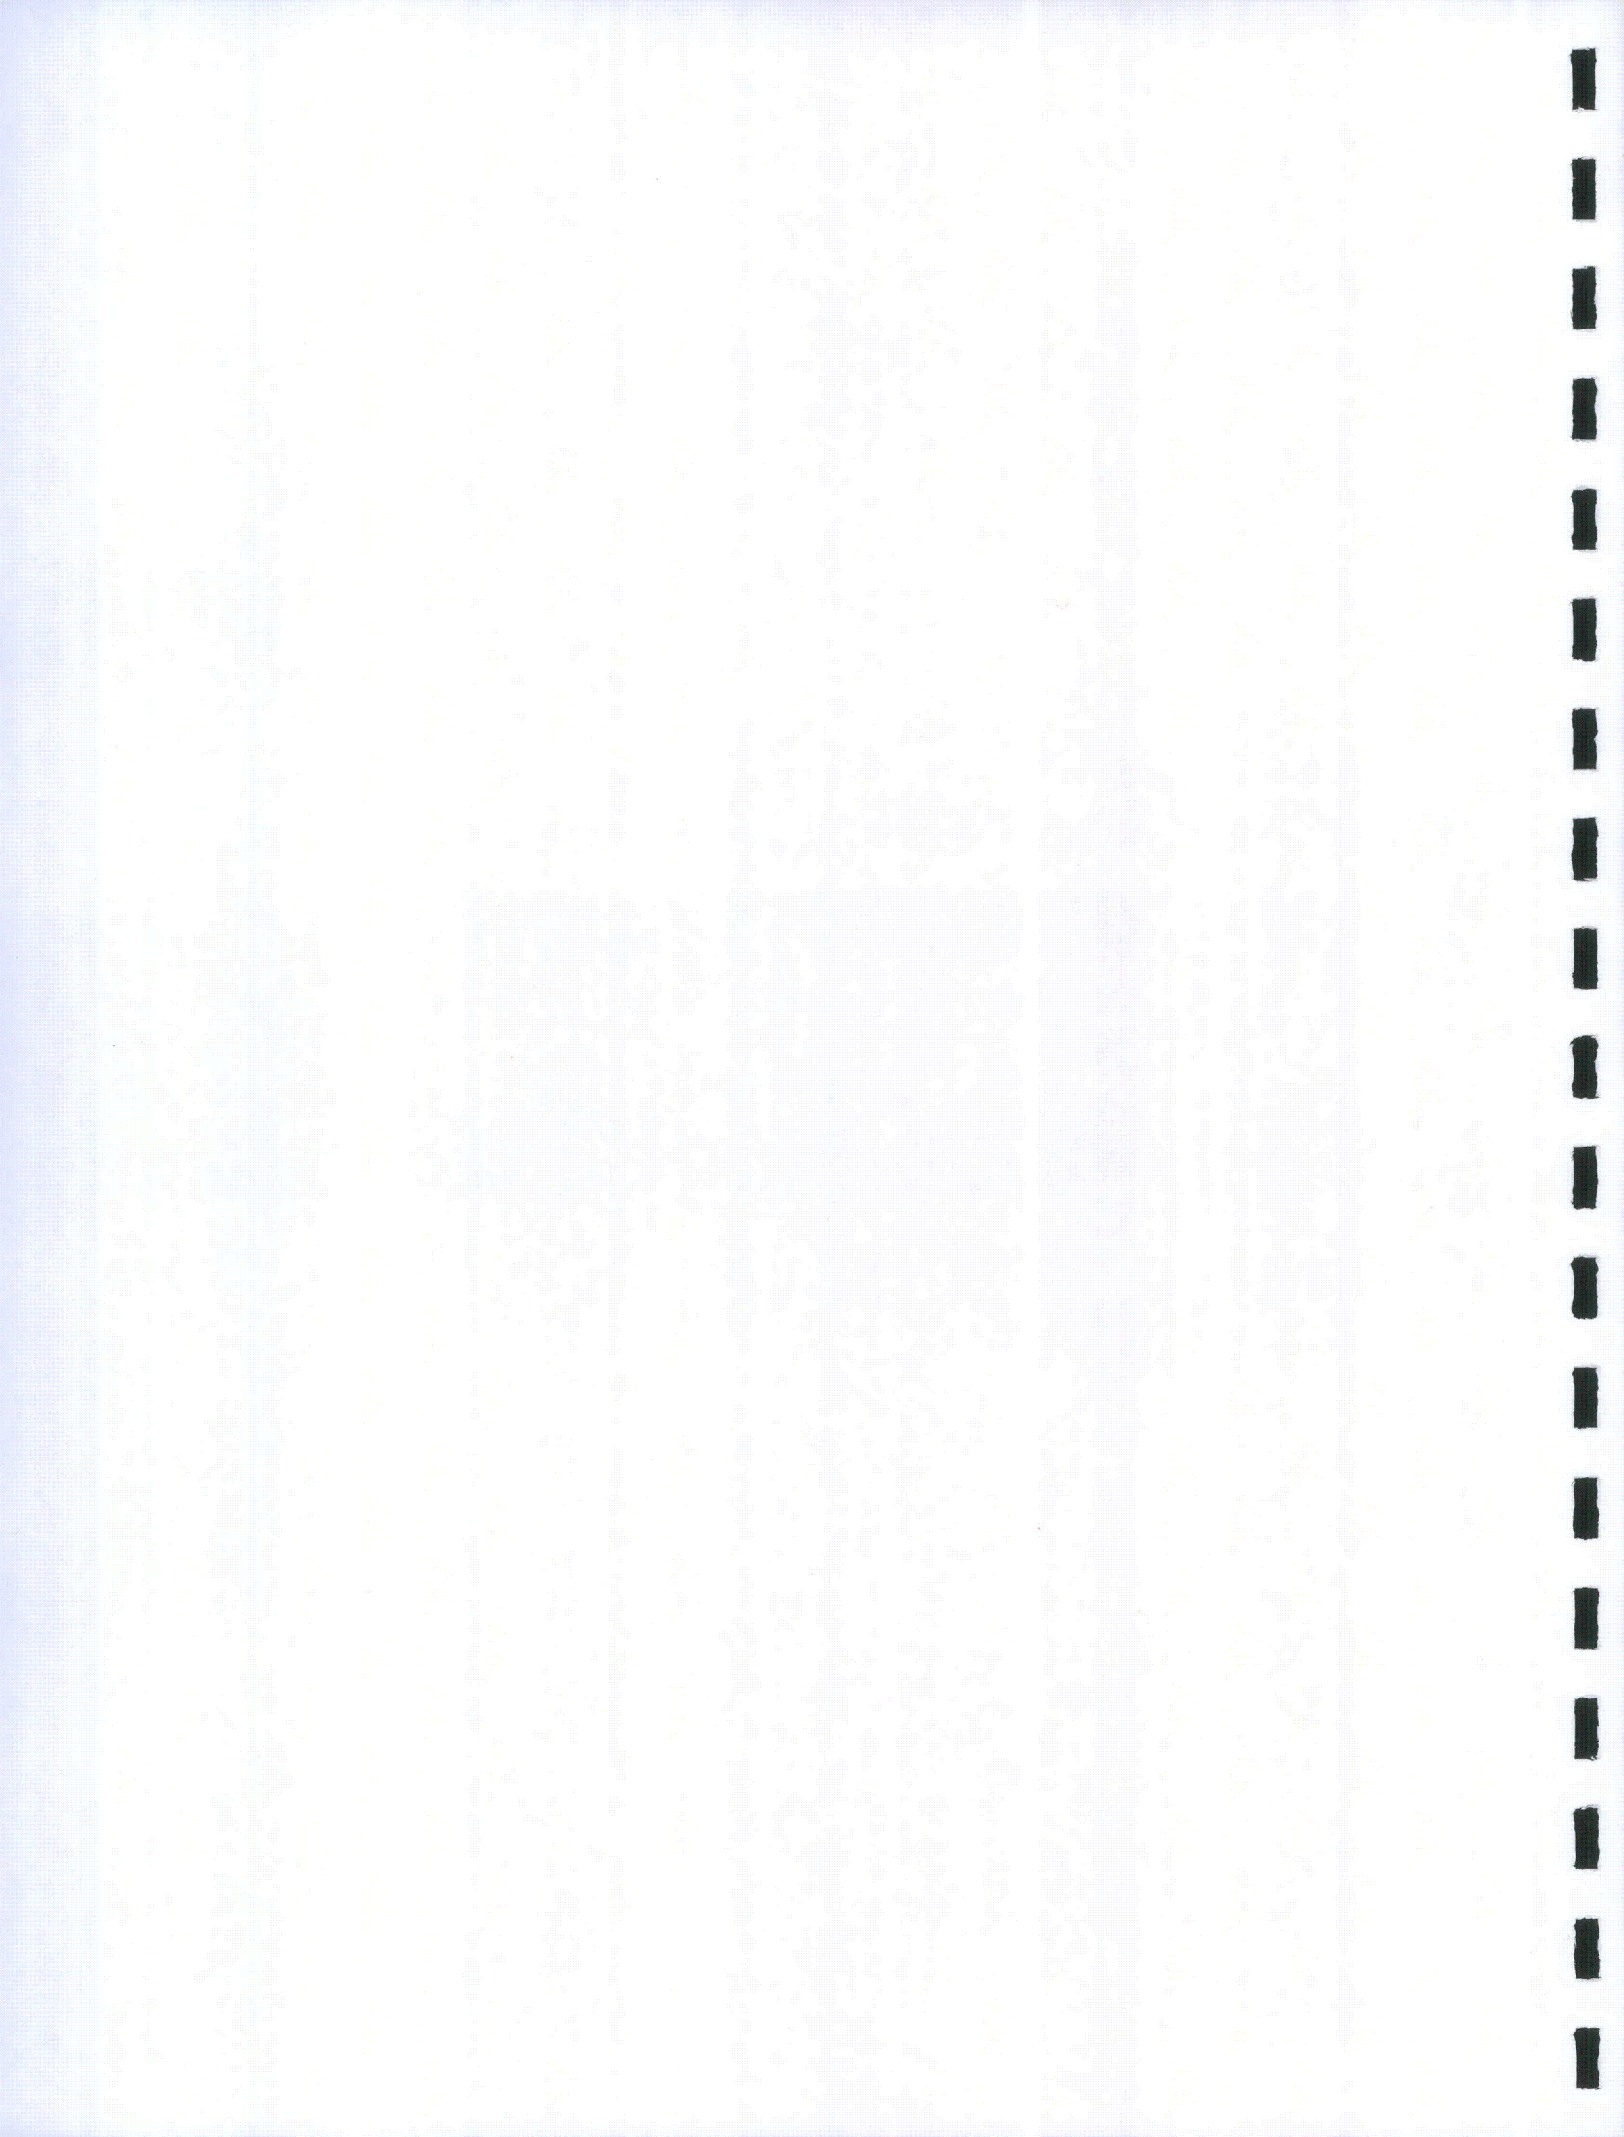

| Regulatory Citation (Col 1) | Summary of Requirement (Col 2) | Response (Yes/No/ NA) (Col 3) | Location(s) in Regional Plan and/or Commentary (Col 4) | Regulatory Cross References (Col 5) |
|--|---|-------------------------------------|--|---|
| (g) | Evaluate potential emergency responses to local drought conditions or loss of existing water supplies; the evaluation shall include identification of potential alternative water sources that may be considered for temporary emergency use by WUGs and WWP in the event that the existing water supply sources become temporarily unavailable to the WUGs and WWPs due to unforeseeable hydrologic conditions such as emergency water right curtailment, unanticipated loss of reservoir conservation storage, or other localized drought impacts. RWPGs shall evaluate, at a minimum, municipal WUGs that: (1) have existing populations less than 7,500 (2) rely on a sole source for its water supply regardless of whether the water is provided by a WWP (3) all county-other WUGs | Yes | 7.4 | |
| (h) | Consider any relevant recommendations from the Drought Preparedness Council. | Yes | Chapter 7 | |
| (i) | Make drought preparation and response recommendations regarding: | | | |
| (i) (1) | Development of, content contained within, and implementation of local drought contingency plans required by the Commission | Yes | 7.2, 7.5 and Attachment 7-1 | |
| (i) (2) | Current drought management preparations in the RWPA including: (A) drought response triggers; and (B) responses to drought conditions; | Yes | 7.2, 7.5 and Attachment 7-1 | |
| (i) (3) | The Drought Preparedness Council and the State Drought Preparedness Plan | Yes | 7.7.1 | |
| (i) (4) | Any other general recommendations regarding drought management in the region or state | Yes | 7.7.2 | |
| (j) | Develop region-specific model drought contingency plans. | Yes | 7.5.3, http://www.panhandlewater.org/ | |
| Chapter Eight Policy Recommendations and Unique Sites | | | | |
| 31 TAC §357.43 | | | | |
| 357.43 (a) | The RWPGs shall contain any regulatory, administrative, or legislative recommendations developed by the RWPGs | Yes | 8.5, 8.6, 8.7 | |
| (b) | May include in adopted RWPGs recommendations for all or parts of river and stream segments of unique ecological value located within the RWPA by preparing a recommendation package consisting of a physical description giving the location of the stream segment, maps, and photographs of the stream segment and a site characterization of the stream segment documented by supporting literature and data. The recommendation package shall address each of the criteria for designation of river and stream segments of ecological value found in this subsection. The RWPG shall forward the recommendation package to the Texas Parks and Wildlife Department and allow the Texas Parks and Wildlife Department 30 days for its written evaluation of the recommendation. The adopted RWP shall include, if available, Texas Parks and Wildlife Department's written evaluation of each river and stream segment recommended as a river or stream segment of unique ecological value. | NA | 8.3 | |
| (b) (1) | May recommend a river or stream segment as being of unique ecological value based upon the criteria set forth in §358.2 of this title (relating to Definitions) | NA | 8.3 | §358.2 |
| (b) (2) | For every river and stream segment that has been designated as a unique river or stream segment by the legislature, during a session that ends not less than one year before the required date of submittal of an adopted RWP to the Board, or recommended as a unique river or stream segment in the RWP, the RWPG shall assess the impact of the RWP on these segments. The assessment shall be a quantitative analysis of the impact of the plan on the flows important to the river or stream segment, as determined by the RWPG, comparing current conditions to conditions with implementation of all recommended water management strategies. The assessment shall also describe the impact of the plan on the unique features cited in the region's recommendation of that segment | NA | 8.3 | |
| (c) | May recommend sites of unique value for construction of reservoirs by including descriptions of the sites, reasons for the unique designation and expected beneficiaries of the water supply to be developed at the site. The criteria at §358.2 of this title shall be used to determine if a site is unique for reservoir construction. | NA | 8.4 | §358.2 |
| (d) | Any other recommendations that the RWPG believes are needed and desirable to achieve the stated goals of state and regional water planning including to facilitate the orderly development, management, and conservation of water resources and prepare for and respond to drought conditions. | Yes | 8.8 | |
| (e) | May develop information as to the potential impacts of any proposed changes in law prior to or after changes are enacted. | Yes | 8.5 | |
| (f) | Consider making legislative recommendations to facilitate more voluntary water transfers in the region. | Yes | 8.5 | |
| Chapter Nine Infrastructure Financing Analysis | | | | |
| 31 TAC §357.44 | | | | |
| 357.44 | Assess and quantitatively report on how individual local governments, regional authorities, and other political subdivisions in their RWPA propose to finance recommended water management strategies. | Yes | Appendix H | |
| Chapter Ten Public Participation and Plan Adoption | | | | |
| 31 TAC §357.21 | | | | |
| 357.21 (a) | Conduct all business in meetings posted and held in accordance with the Texas Open Meetings Act, Texas Government Code Chapter 551, with a copy of all materials presented or discussed available for public inspection prior to and following the meetings. | Yes | Chapter 10 | Texas Government Code Chapter 551 |
| (b-d) | All public notices required by the TWDB by the RWPG shall comply with 31 TAC §357.21 and shall meet the requirements specified therein. | Yes | Chapter 10 | |
| 31 TAC §357.50 | | | | |

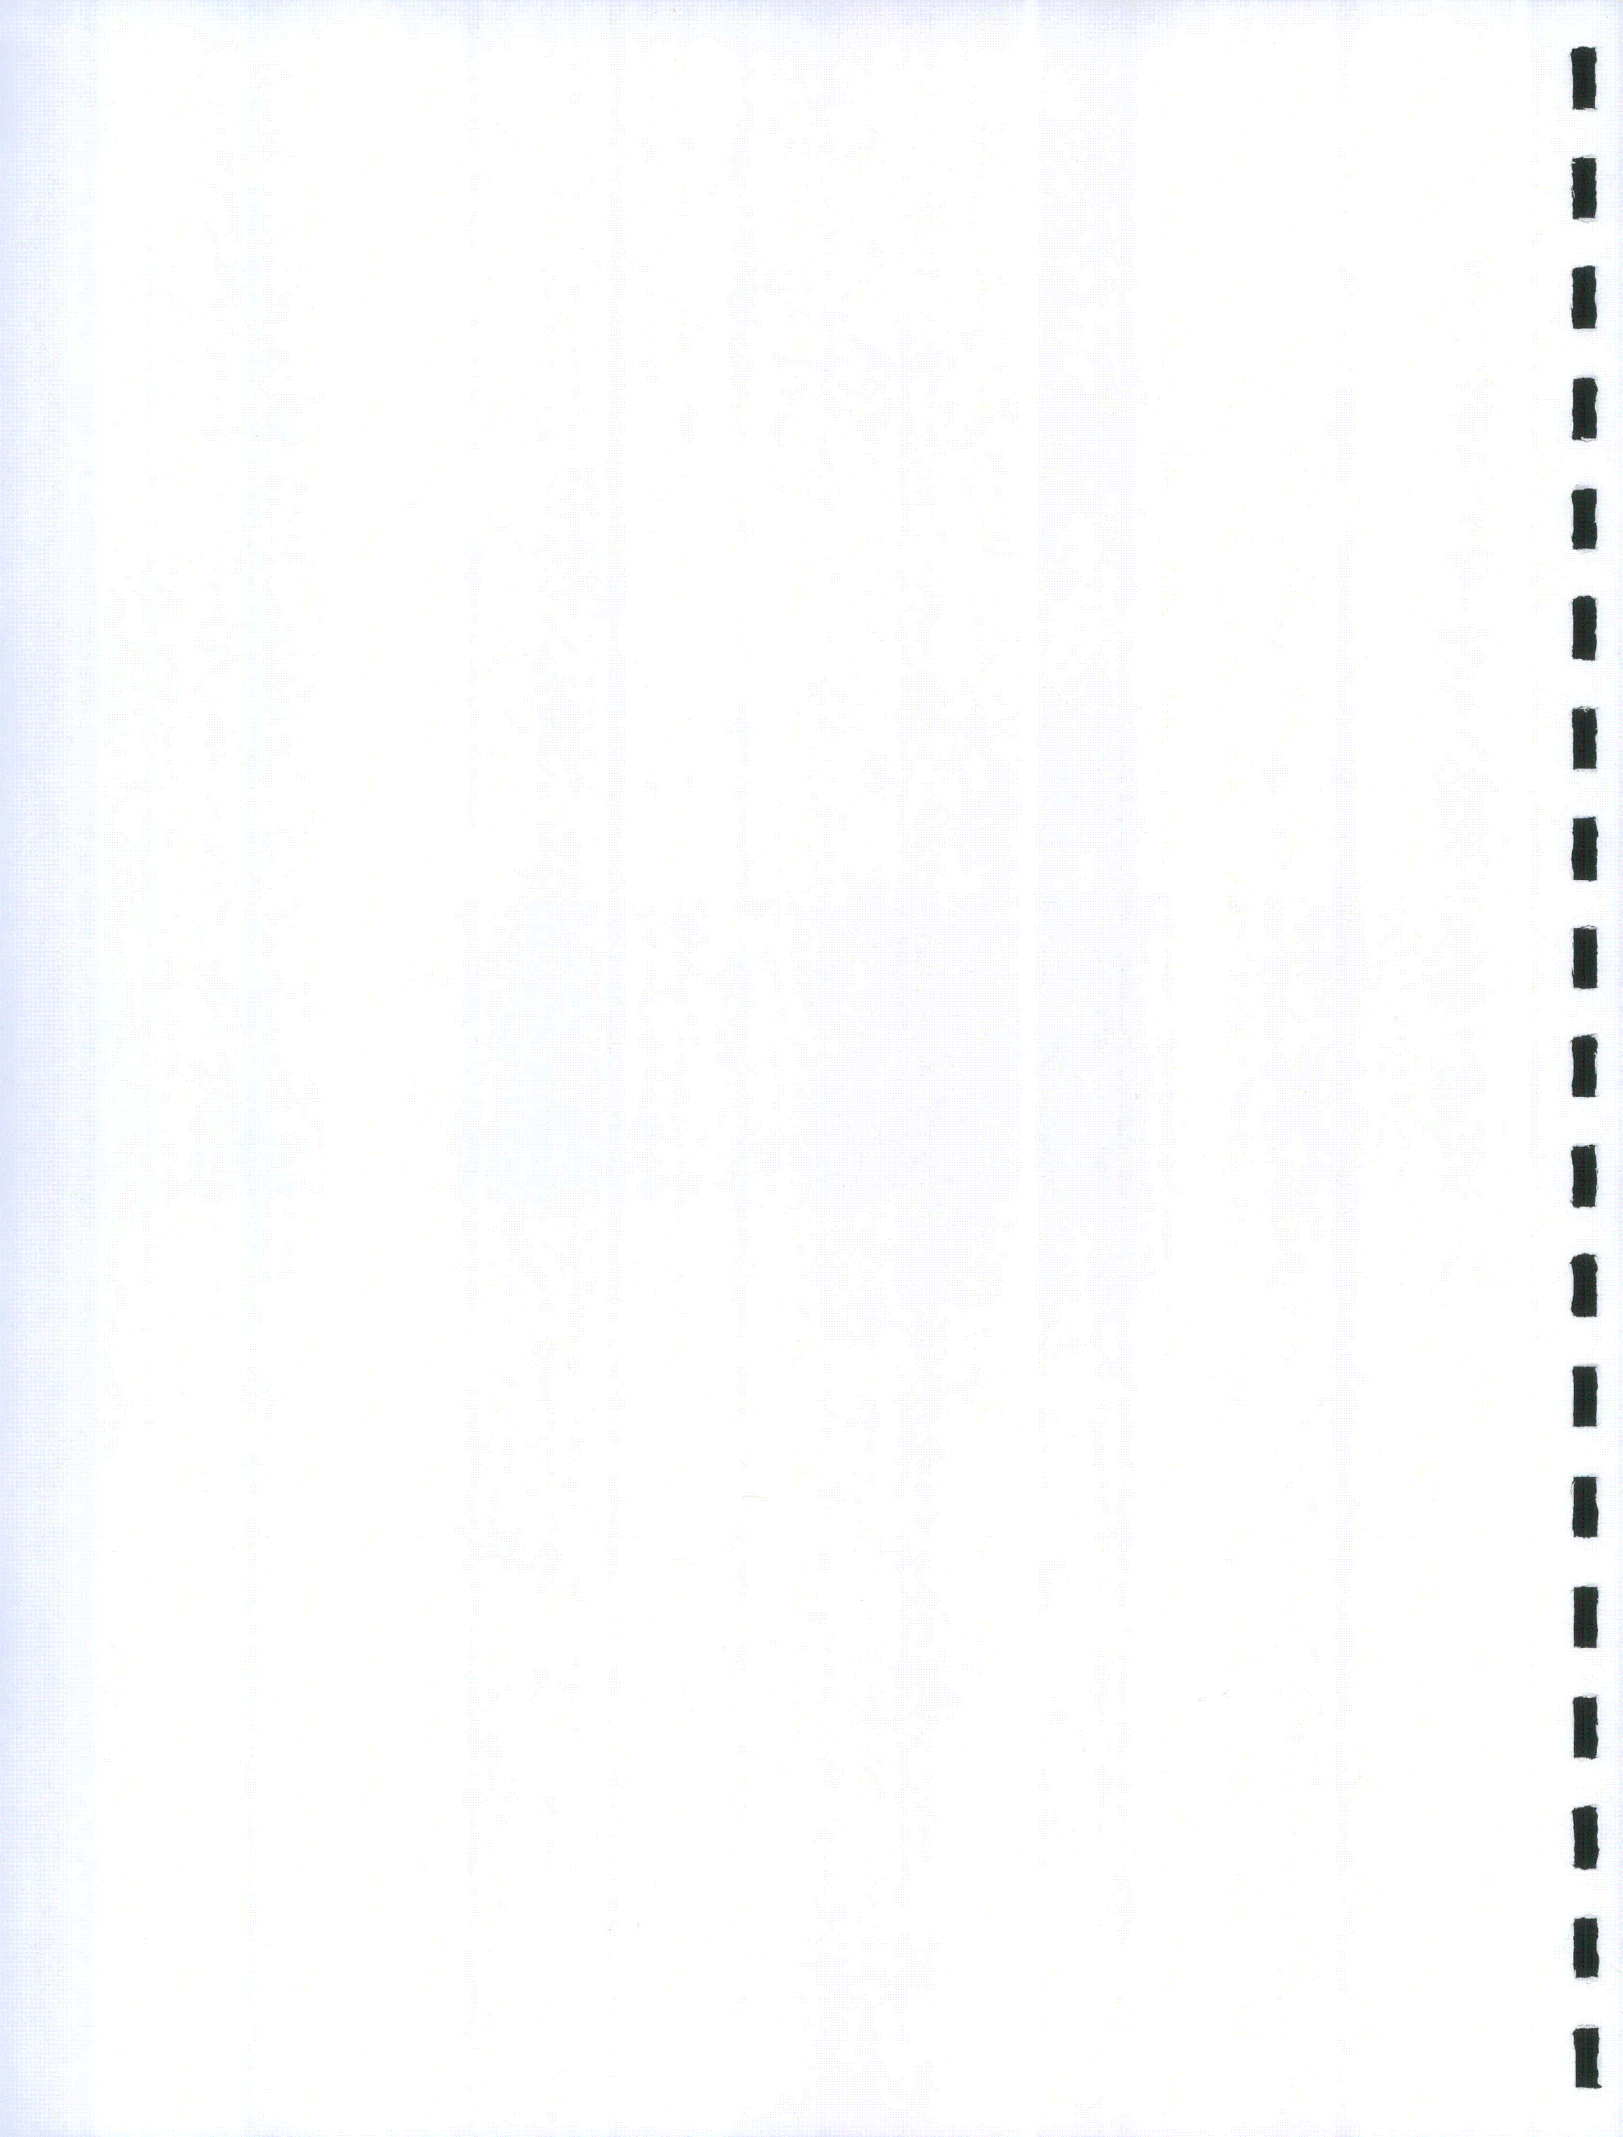

| Regulatory Citation (Col 1) | Summary of Requirement (Col 2) | Response (Yes/No/ NA) (Col 3) | Location(s) in Regional Plan and/or Commentary (Col 4) | Regulatory Cross References (Col 5) |
|--|--|-------------------------------------|--|---|
| 357.5 (a) | Submit their adopted RWPs to the Board every five years on a date to be disseminated by the EA, as modified by subsection (e)(2) of this section, for approval and inclusion in the state water plan. | Yes | The PWPA Water Plan will be submitted to the EA accordingly. | |
| (b) | Prior to the adoption of the RWP, the RWPGs shall submit concurrently to the EA and the public an IPP. The IPP submitted to the EA must be in the electronic and paper format specified by the EA. Each RWPG must certify that the IPP is complete and adopted by the RWPG. | Yes | Chapter 10 | |
| (c) | Distribute the IPP in accordance with §357.21(d)(5) of this title (relating to Notice and Public Participation). | Yes | Plan was distributed by May 1, 2015 | |
| (d) | Solicit, and consider the necessary comments when adopting a RWP. | Yes | Comments are included in Chapter 10 and Appendix I. | |
| (e) | Submit the IPP and the adopted RWPs and amendments to approved RWPs to the EA in conformance with 31 TAC §357.50 (e). | Yes | The PWPA Water Plan was submitted to the EA accordingly. | |
| (f) | Submit in a timely manner to the EA information on any known interregional conflict between RWPs. | NA | There are no known interregional conflicts between RWPs. | |
| (g) | Modify the RWP to incorporate Board resolutions of interregional conflicts | NA | See above | |
| (h) | Seek to resolve conflicts with other RWPGs and shall participate in any Board sponsored efforts to resolve interregional conflicts. | NA | See above | |
| Chapter Eleven Implementation and Comparison to the Previous Regional Water Plan 31 TAC §357.45 | | | | |
| 357.45 (a) | Describe the level of implementation of previously recommended water management strategies. Information on the progress of implementation of all water management strategies that were recommended in the previous RWP, including conservation and drought management water management strategies; and the implementation of projects that have affected progress in meeting the state's future water needs. | Yes | 11.3 | |
| (b) | RWPGs shall provide a brief summary of how the RWP differs from the previously adopted RWP with regards to: | | | |
| (b) (1) | Water demand projections | Yes | 11.2.2 | |
| (b) (2) | Drought of record and hydrologic and modeling assumptions used in planning for the region | Yes | 11.2.3 | |
| (b) (3) | Groundwater and surface water availability, existing water supplies, and identified water needs for WUGs and WWPs | Yes | 11.2.4, 11.2.5, 11.2.6, 11.2.7 | |
| (b) (4) | Recommended and alternative water management strategies. | Yes | 11.2.7 | |





Appendix G

Socio-economic Impacts



**Socioeconomic Impacts of Projected Water Shortages
for the Region A Regional Water Planning Area**

Prepared in Support of the 2016 Region A Regional Water Plan



Dr. John R. Ellis
Water Use Projections & Planning Division
Texas Water Development Board

Yun Cho, Team Lead
Water Use Projections & Planning Division
Texas Water Development Board

Kevin Kluge, Manager
Water Use Projections & Planning Division
Texas Water Development Board

August, 2015

Table of Contents

| | |
|--|----|
| Executive Summary | 1 |
| 1 Introduction..... | 3 |
| 1.1 Identified Regional Water Needs (Potential Shortages) | 3 |
| 2 Economic Impact Assessment Methodology Summary | 4 |
| 2.1 Impact Assessment Measures | 5 |
| 2.1.1 Regional Economic Impacts | 6 |
| 2.1.2 Financial Transfer Impacts..... | 6 |
| 2.1.3 Social Impacts..... | 7 |
| 2.2 Analysis Context..... | 8 |
| 2.2.1 IMPLAN Model and Data..... | 8 |
| 2.2.2 Elasticity of Economic Impacts | 9 |
| 2.3 Analysis Assumptions and Limitations..... | 10 |
| 3 Analysis Results..... | 13 |
| 3.1 Overview of the Regional Economy..... | 13 |
| 3.2 Impacts for Irrigation Water Shortages..... | 13 |
| 3.3 Impacts for Livestock Water Shortages | 14 |
| 3.4 Impacts for Municipal Water Shortages | 14 |
| 3.5 Impacts of Manufacturing Water Shortages | 15 |
| 3.6 Impacts of Mining Water Shortages | 16 |
| 3.7 Impacts of Steam-Electric Water Shortages | 16 |
| 3.8 Regional Social Impacts..... | 17 |
| Appendix A - County Level Summary of Estimated Economic Impacts for Region A | 18 |

Executive Summary

Evaluating the social and economic impacts of not meeting identified water needs is a required part of the regional water planning process. The Texas Water Development Board (TWDB) estimates those impacts for regional water planning groups, and summarizes the impacts in the state water plan. The analysis presented is for the Region A Regional Water Planning Group.

Based on projected water demands and existing water supplies, the Region A planning group identified water needs (potential shortages) that would occur within its region under a repeat of the drought of record for six water use categories. The TWDB then estimated the socioeconomic impacts of those needs—if they are not met—for each water use category and as an aggregate for the region.

The analysis was performed using an economic modeling software package, IMPLAN (Impact for Planning Analysis), as well as other economic analysis techniques, and represents a snapshot of socioeconomic impacts that may occur during a single year during a drought of record within each of the planning decades. For each water use category, the evaluation focused on estimating income losses and job losses. The income losses represent an approximation of gross domestic product (GDP) that would be foregone if water needs are not met.

The analysis also provides estimates of financial transfer impacts, which include tax losses (state, local, and utility tax collections); water trucking costs; and utility revenue losses. In addition, social impacts were estimated, encompassing lost consumer surplus (a welfare economics measure of consumer wellbeing); as well as population and school enrollment losses.

It is estimated that not meeting the identified water needs in Region A would result in an annually combined lost income impact of approximately \$219 million in 2020, increasing to \$3.3 billion in 2070 (Table ES-1). In 2020, the region would lose approximately 3,100 jobs, and by 2070 job losses would increase to approximately 52,300.

All impact estimates are in year 2013 dollars and were calculated using a variety of data sources and tools including the use of a region-specific IMPLAN model, data from the TWDB annual water use estimates, the U.S. Census Bureau, Texas Agricultural Statistics Service, and Texas Municipal League.

Table ES-1: Region A Socioeconomic Impact Summary

| Regional Economic Impacts | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
|--|-------------|-------------|-------------|-------------|-------------|-------------|
| Income losses (\$ millions)* | \$219 | \$424 | \$708 | \$1,166 | \$2,171 | \$3,312 |
| Job losses | 3,138 | 6,194 | 10,536 | 16,185 | 32,489 | 52,273 |
| Financial Transfer Impacts | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| Tax losses on production and imports (\$ millions)* | \$14 | \$27 | \$47 | \$77 | \$155 | \$246 |
| Water trucking costs (\$ millions)* | - | \$0 | \$0 | \$1 | \$1 | \$2 |
| Utility revenue losses (\$ millions)* | \$20 | \$41 | \$64 | \$86 | \$93 | \$134 |
| Utility tax revenue losses (\$ millions)* | \$0 | \$1 | \$1 | \$1 | \$2 | \$2 |
| Social Impacts | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| Consumer surplus losses (\$ millions)* | \$1 | \$7 | \$22 | \$43 | \$92 | \$175 |
| Population losses | 576 | 1,137 | 1,934 | 2,972 | 5,965 | 9,597 |
| School enrollment losses | 107 | 210 | 358 | 550 | 1,104 | 1,775 |

** Year 2013 dollars, rounded. Entries denoted by a dash (-) indicate no economic impact. Entries denoted by a zero (\$0) indicate income losses less than \$500,000.*

1 Introduction

Water shortages during a repeat of the drought of record would likely curtail or eliminate certain economic activity in businesses and industries that rely heavily on water. Insufficient water supplies could not only have an immediate and real impact on existing businesses and industry, but they could also adversely and chronically affect economic development in Texas. From a social perspective, water supply reliability is critical as well. Shortages could disrupt activity in homes, schools and government and could adversely affect public health and safety. For these reasons, it is important to evaluate and understand how water supply shortages during drought could impact communities throughout the state.

Administrative rules (31 Texas Administrative Code §357.33 (c)) require that regional water planning groups evaluate the social and economic impacts of not meeting water needs as part of the regional water planning process, and rules direct the TWDB staff to provide technical assistance upon request. Staff of the TWDB's Water Use, Projections, & Planning Division designed and conducted this analysis in support of the Region A Regional Water Planning Group.

This document summarizes the results of the analysis and discusses the methodology used to generate the results. Section 1 summarizes the water needs calculation performed by the TWDB based on the regional water planning group's data. Section 2 describes the methodology for the impact assessment and discusses approaches and assumptions specific to each water use category (i.e., irrigation, livestock, mining, steam-electric, municipal and manufacturing). Section 3 presents the results for each water use category with results summarized for the region as a whole. Appendix A presents details on the socioeconomic impacts by county.

1.1 Identified Regional Water Needs (Potential Shortages)

As part of the regional water planning process, the TWDB adopted water demand projections for each water user group (WUG) with input from the planning groups. WUGs are composed of cities, utilities, combined rural areas (designated as county-other), and the county-wide water use of irrigation, livestock, manufacturing, mining and steam-electric power. The demands are then compared to the existing water supplies of each WUG to determine potential shortages, or needs, by decade. Existing water supplies are legally and physically accessible for immediate use in the event of drought. Projected water demands and existing supplies are compared to identify either a surplus or a need for each WUG.

Table 1-1 summarizes the region's identified water needs in the event of a repeat of drought of the record. Demand management, such as conservation, or the development of new infrastructure to increase supplies are water management strategies that may be recommended by the planning group to meet those needs. This analysis assumes that no strategies are implemented, and that the identified needs correspond to future water shortages. Note that projected water needs generally increase over time, primarily due to anticipated population and economic growth. To provide a general sense of proportion, total projected needs as an overall percentage of total demand by water use category are presented in aggregate in Table 1-1. Projected needs for individual water user groups within the aggregate vary greatly, and may reach 100% for a given WUG and water use category. Detailed water needs by WUG and county appear in Chapter 4 of the 2016 Region A Regional Water Plan.

Table 1-1 Regional Water Needs Summary by Water Use Category

| Water Use Category | | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
|-----------------------------|--|----------------|----------------|----------------|----------------|----------------|----------------|
| Irrigation | Water Needs (acre-feet per year) | 156,704 | 185,043 | 192,876 | 180,151 | 165,133 | 148,519 |
| | % of the category's total water demand | 10% | 13% | 15% | 15% | 16% | 17% |
| Livestock | Water Needs (acre-feet per year) | - | - | - | - | - | - |
| | % of the category's total water demand | - | - | - | - | - | - |
| Manufacturing | Water Needs (acre-feet per year) | 4,941 | 7,529 | 10,219 | 14,243 | 18,369 | 22,538 |
| | % of the category's total water demand | 10% | 14% | 18% | 25% | 30% | 35% |
| Mining | Water Needs (acre-feet per year) | - | - | - | - | - | - |
| | % of the category's total water demand | - | - | - | - | - | - |
| Municipal | Water Needs (acre-feet per year) | 12,528 | 24,073 | 37,971 | 52,057 | 66,265 | 80,964 |
| | % of the category's total water demand | 14% | 24% | 36% | 45% | 53% | 61% |
| Steam-electric power | Water Needs (acre-feet per year) | - | - | - | - | - | - |
| | % of the category's total water demand | - | - | - | - | - | - |
| Total water needs | | 174,173 | 216,645 | 241,066 | 246,451 | 249,767 | 252,021 |

2 Economic Impact Assessment Methodology Summary

This portion of the report provides a summary of the methodology used to estimate the potential economic impacts of future water shortages. The general approach employed in the analysis was to obtain estimates for income and job losses on the smallest geographic level that the available data would support, tie those values to their accompanying historic water use estimate (volume), and thereby determine a maximum impact per acre-foot of shortage for each of the socioeconomic measures. The calculations of economic impacts were based on the overall composition of the economy using many underlying economic "sectors." Sectors in this analysis refer to one or more of the 440 specific production sectors of the economy designated within IMPLAN (Impact for Planning Analysis), the economic impact modeling software used for this assessment. Economic impacts within this report are

estimated for approximately 310 of those sectors, with the focus on the more water intense production sectors. The economic impacts for a single water use category consist of an aggregation of impacts to multiple related economic sectors.

2.1 Impact Assessment Measures

A required component of the regional and state water plans is to estimate the potential economic impacts of shortages due to a drought of record. Consistent with previous water plans, several key variables were estimated and are described in Table 2-1.

Table 2-1 Socioeconomic Impact Analysis Measures

| Regional Economic Impacts | Description |
|--|---|
| Income losses - value added | The value of output less the value of intermediate consumption; it is a measure of the contribution to GDP made by an individual producer, industry, sector, or group of sectors within a year. For a shortage, value added is a measure of the income losses to the region, county, or WUG and includes the direct, indirect and induced monetary impacts on the region. |
| Income losses - electrical power purchase costs | Proxy for income loss in the form of additional costs of power as a result of impacts of water shortages. |
| Job losses | Number of part-time and full-time jobs lost due to the shortage. |
| Financial Transfer Impacts | Description |
| Tax losses on production and imports | Sales and excise taxes (not collected due to the shortage), customs duties, property taxes, motor vehicle licenses, severance taxes, other taxes, and special assessments less subsidies. |
| Water trucking costs | Estimate for shipping potable water. |
| Utility revenue losses | Foregone utility income due to not selling as much water. |
| Utility tax revenue losses | Foregone miscellaneous gross receipts tax collections. |
| Social Impacts | Description |
| Consumer surplus losses | A welfare measure of the lost value to consumers accompanying less water use. |
| Population losses | Population losses accompanying job losses. |
| School enrollment losses | School enrollment losses (K-12) accompanying job losses. |

2.1.1 Regional Economic Impacts

Two key measures were included within the regional economic impacts classification: income losses and job losses. Income losses presented consist of the sum of value added losses and additional purchase costs of electrical power. Job losses are also presented as a primary economic impact measure.

Income Losses - Value Added Losses

Value added is the value of total output less the value of the intermediate inputs also used in production of the final product. Value added is similar to Gross Domestic Product (GDP), a familiar measure of the productivity of an economy. The loss of value added due to water shortages was estimated by input-output analysis using the IMPLAN software package, and includes the direct, indirect, and induced monetary impacts on the region.

Income Losses - Electric Power Purchase Costs

The electrical power grid and market within the state is a complex interconnected system. The industry response to water shortages, and the resulting impact on the region, are not easily modeled using traditional input/output impact analysis and the IMPLAN model. Adverse impacts on the region will occur, and were represented in this analysis by the additional costs associated with power purchases from other generating plants within the region or state. Consequently, the analysis employed additional power purchase costs as a proxy for the value added impacts for that water use category, and these are included as a portion of the overall income impact for completeness.

For the purpose of this analysis, it was assumed that power companies with insufficient water will be forced to purchase power on the electrical market at a projected higher rate of 5.60 cents per kilowatt hour. This rate is based upon the average day-ahead market purchase price of electricity in Texas from the recent drought period in 2011.

Job Losses

The number of jobs lost due to the economic impact was estimated using IMPLAN output associated with the water use categories noted in Table 1-1. Because of the difficulty in predicting outcomes and a lack of relevant data, job loss estimates were not calculated for the steam-electric power production or for certain municipal water use categories.

2.1.2 Financial Transfer Impacts

Several of the impact measures estimated within the analysis are presented as supplemental information, providing additional detail concerning potential impacts on a sub-portion of the economy or government. Measures included in this category include lost tax collections (on production and imports), trucking costs for imported water, declines in utility revenues, and declines in utility tax revenue collected by the state. Many of these measures are not solely adverse, with some having both positive and negative impacts. For example, cities and residents would suffer if forced to pay large costs for trucking in potable water. Trucking firms, conversely, would benefit from the transaction. Additional detail for each of these measures follows.

Tax Losses on Production and Imports

Reduced production of goods and services accompanying water shortages adversely impacts the collection of taxes by state and local government. The regional IMPLAN model was used to estimate reduced tax collections associated with the reduced output in the economy.

Water Trucking Costs

In instances where water shortages for a municipal water user group were estimated to be 80 percent or more of water demands, it was assumed that water would be trucked in to support basic consumption and sanitation needs. For water shortages of 80 percent or greater, a fixed cost of \$20,000 per acre-foot of water was calculated and presented as an economic cost. This water trucking cost was applied for both the residential and non-residential portions of municipal water needs and only impacted a small number of WUGs statewide.

Utility Revenue Losses

Lost utility income was calculated as the price of water service multiplied by the quantity of water not sold during a drought shortage. Such estimates resulted from city-specific pricing data for both water and wastewater. These water rates were applied to the potential water shortage to determine estimates of lost utility revenue as water providers sold less water during the drought due to restricted supplies.

Utility Tax Losses

Foregone utility tax losses included estimates of uncollected miscellaneous gross receipts taxes. Reduced water sales reduce the amount of utility tax that would be collected by the State of Texas for water and wastewater service sales.

2.1.3 Social Impacts

Consumer Surplus Losses of Municipal Water Users

Consumer surplus loss is a measure of impact to the wellbeing of municipal water users when their water use is restricted. Consumer surplus is the difference between how much a consumer is willing and able to pay for the commodity (i.e., water) and how much they actually have to pay. The difference is a benefit to the consumer's wellbeing since they do not have to pay as much for the commodity as they would be willing to pay. However, consumer's access to that water may be limited, and the associated consumer surplus loss is an estimate of the equivalent monetary value of the negative impact to the consumer's wellbeing, for example, associated with a diminished quality of their landscape (i.e., outdoor use). Lost consumer surplus estimates for reduced outdoor and indoor use, as well as residential and commercial/institutional demands, were included in this analysis. Consumer surplus is an attempt to measure effects on wellbeing by monetizing those effects; therefore, these values should not be added to the other monetary impacts estimated in the analysis.

Lost consumer surplus estimates varied widely by location and type. For a 50 percent shortage, the estimated statewide consumer surplus values ranged from \$55 to \$2,500 per household (residential use), and from \$270 to \$17,400 per firm (non-residential).

Population and School Enrollment Losses

Population losses due to water shortages, as well as the related loss of school enrollment, were based upon the job loss estimates and upon a recent study of job layoffs and the resulting adjustment of the labor market, including the change in population.¹ The study utilized Bureau of Labor Statistics data regarding layoffs between 1996 and 2013, as well as Internal Revenue Service data regarding migration, to model an estimate of the change in the population as the result of a job layoff event. Layoffs impact both out-migration, as well as in-migration into an area, both of which can negatively affect the population of an area. In addition, the study found that a majority of those who did move following a layoff moved to another labor market rather than an adjacent county. Based on this study, a simplified ratio of job and net population losses was calculated for the state as a whole: for every 100 jobs lost, 18 people were assumed to move out of the area. School enrollment losses were estimated as a proportion of the population lost.

2.2 Analysis Context

The context of the economic impact analysis involves situations where there are physical shortages of surface or groundwater due to drought of record conditions. Anticipated shortages may be nonexistent in earlier decades of the planning horizon, yet population growth or greater industrial, agricultural or other sector demands in later decades may result in greater overall demand, exceeding the existing supplies. Estimated socioeconomic impacts measure what would happen if water user groups experience water shortages for a period of one year. Actual socioeconomic impacts would likely become larger as drought of record conditions persist for periods greater than a single year.

2.2.1 IMPLAN Model and Data

Input-Output analysis using the IMPLAN (Impact for Planning Analysis) software package was the primary means of estimating value added, jobs, and taxes. This analysis employed county and regional level models to determine key impacts. IMPLAN is an economic impact model, originally developed by the U.S. Forestry Service in the 1970's to model economic activity at varying geographic levels. The model is currently maintained by the Minnesota IMPLAN Group (MIG Inc.) which collects and sells county and state specific data and software. The year 2011 version of IMPLAN, employing data for all 254 Texas counties, was used to provide estimates of value added, jobs, and taxes on production for the economic sectors associated with the water user groups examined in the study. IMPLAN uses 440 sector-specific Industry Codes, and those that rely on water as a primary input were assigned to their relevant planning water user categories (manufacturing, mining, irrigation, etc.). Estimates of value added for a water use category were obtained by summing value added estimates across the relevant IMPLAN sectors

¹ Foote, Andrew, Grosz, Michel, Stevens, Ann. "Locate Your Nearest Exit: Mass Layoffs and Local Labor Market Response." University of California, Davis. April 2015. <http://paa2015.princeton.edu/uploads/150194>

associated with that water use category. Similar calculations were performed for the job and tax losses on production and import impact estimates.

Note that the value added estimates, as well as the job and tax estimates from IMPLAN, include three components:

- *Direct effects* representing the initial change in the industry analyzed;
- *Indirect effects* that are changes in inter-industry transactions as supplying industries respond to reduced demands from the directly affected industries; and,
- *Induced effects* that reflect changes in local spending that result from reduced household income among employees in the directly and indirectly affected industry sectors.

2.2.2 Elasticity of Economic Impacts

The economic impact of a water need is based on the relative size of the water need to the water demand for each water user group (Figure 2-1). Smaller water shortages, for example, less than 5 percent, were anticipated to result in no initial negative economic impact because water users are assumed to have a certain amount of flexibility in dealing with small shortages. As a water shortage deepens, however, such flexibility lessens and results in actual and increasing economic losses, eventually reaching a representative maximum impact estimate per unit volume of water. To account for such ability to adjust, an elasticity adjustment function was used in estimating impacts for several of the measures. Figure 2-1 illustrates the general relationship for the adjustment functions. Negative impacts are assumed to begin accruing when the shortage percentage reaches the lower bound b1 (10 percent in Figure 2-1), with impacts then increasing linearly up to the 100 percent impact level (per unit volume) once the upper bound for adjustment reaches the b2 level shortage (50 percent in Figure 2-1 example).

Initially, the combined total value of the three value added components (direct, indirect, and induced) was calculated and then converted into a per acre-foot economic value based on historical TWDB water use estimates within each particular water use category. As an example, if the total, annual value added for livestock in the region was \$2 million and the reported annual volume of water used in that industry was 10,000 acre-feet, the estimated economic value per acre-foot of water shortage would be \$200 per acre-foot. Negative economic impacts of shortages were then estimated using this value as the maximum impact estimate (\$200 per acre-foot in the example) applied to the anticipated shortage volume in acre-feet and adjusted by the economic impact elasticity function. This adjustment varied with the severity as percentage of water demand of the anticipated shortage. If one employed the sample elasticity function shown in Figure 2-1, a 30% shortage in the water use category would imply an economic impact estimate of 50% of the original \$200 per acre-foot impact value (i.e., \$100 per acre-foot).

Such adjustments were not required in estimating consumer surplus, nor for the estimates of utility revenue losses or utility tax losses. Estimates of lost consumer surplus relied on city-specific demand curves with the specific lost consumer surplus estimate calculated based on the relative percentage of the city's water shortage. Estimated changes in population as well as changes in school enrollment were indirectly related to the elasticity of job losses.

Assumed values for the bounds b1 and b2 varied with water use category under examination and are presented in Table 2-2.

Figure 2-1 Example Economic Impact Elasticity Function (as applied to a single water user's shortage)

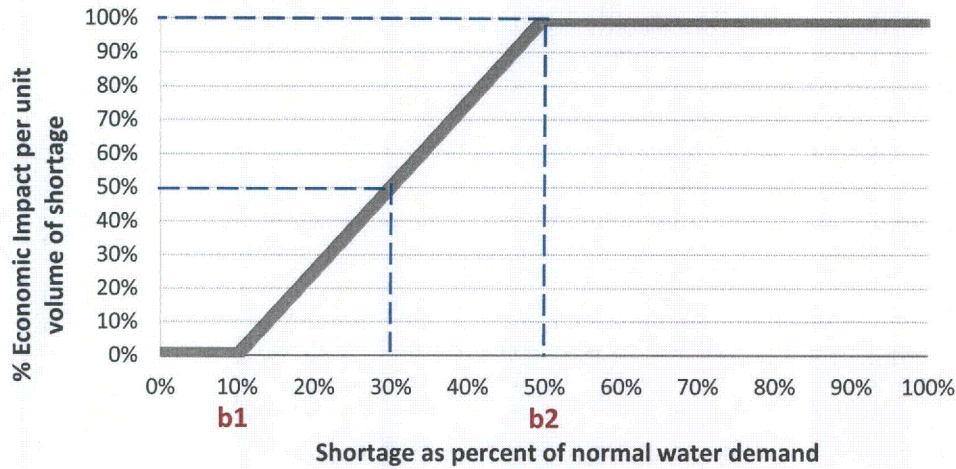


Table 2-2 Economic Impact Elasticity Function Lower and Upper Bounds

| Water Use Category | Lower Bound (b1) | Upper Bound (b2) |
|---|------------------|------------------|
| Irrigation | 5% | 50% |
| Livestock | 5% | 10% |
| Manufacturing | 10% | 50% |
| Mining | 10% | 50% |
| Municipal (non-residential water intensive) | 50% | 80% |
| Steam-electric power | 20% | 70% |

2.3 Analysis Assumptions and Limitations

Modeling of complex systems requires making assumptions and accepting limitations. This is particularly true when attempting to estimate a wide variety of economic impacts over a large geographic area and into future decades. Some of the key assumptions and limitations of the methodology include:

1. The foundation for estimating socioeconomic impacts of water shortages resulting from a drought are the water needs (potential shortages) that were identified as part of the regional water planning process. These needs have some uncertainty associated with them, but serve as a reasonable basis for evaluating potential economic impacts of a drought of record event.

2. All estimated socioeconomic impacts are snapshot estimates of impacts for years in which water needs were identified (i.e., 2020, 2030, 2040, 2050, 2060, and 2070). The estimates are independent and distinct "what if" scenarios for each particular year, and water shortages are assumed to be temporary events resulting from severe drought conditions. The evaluation assumed that no recommended water management strategies are implemented. In other words, growth occurs, future shocks are imposed on an economy at 10-year intervals, and the resulting impacts are estimated. Note that the estimates presented were not cumulative (i.e., summing up expected impacts from today up to the decade noted), but were simply an estimate of the magnitude of annual socioeconomic impacts should a drought of record occur in each particular decade based on anticipated supplies and demands for that same decade.
3. Input-output models such as IMPLAN rely on a static profile of the structure of the economy as it appears today. This presumes that the relative contributions of all sectors of the economy would remain the same, regardless of changes in technology, supplies of limited resources, and other structural changes to the economy that may occur into the future. This was a significant assumption and simplification considering the 50-year time period examined in this analysis. To presume an alternative future economic makeup, however, would entail positing many other major assumptions that would very likely generate as much or more error.
4. This analysis is not a cost-benefit analysis. That approach to evaluating the economic feasibility of a specific policy or project employs discounting future benefits and costs to their present value dollars using some assumed discount rate. The methodology employed in this effort to estimate the economic impacts of future water shortages did not use any discounting procedures to weigh future costs differently through time.
5. Monetary figures are reported in constant year 2013 dollars.
6. Impacts are annual estimates. The estimated economic model does not reflect the full extent of impacts that might occur as a result of persistent water shortages occurring over an extended duration. The drought of record in most regions of Texas lasted several years.
7. Value added estimates are the primary estimate of the economic impacts within this report. One may be tempted to add consumer surplus impacts to obtain an estimate of total adverse economic impacts to the region, but the consumer surplus measure represents the change to the wellbeing of households (and other water users), not an actual change in the flow of dollars through the economy. The two categories (value added and consumer surplus) are both valid impacts but should not be summed.
8. The value added, jobs, and taxes on production and import impacts include the direct, indirect and induced effects described in Section 2.2.1. Population and school enrollment losses also indirectly include such effects as they are based on the associated losses in employment. The remaining measures (consumer surplus, utility revenue, utility taxes, additional electrical power purchase costs, and potable water trucking costs), however, do not include any induced or indirect effects.

9. The majority of impacts estimated in this analysis may be considered smaller than those that might occur under drought of record conditions. Input-output models such as IMPLAN only capture “backward linkages” on suppliers (including households that supply labor to directly affected industries). While this is a common limitation in these types of economic impact modeling efforts, it is important to note that “forward linkages” on the industries that use the outputs of the directly affected industries can also be very important. A good example is impacts on livestock operators. Livestock producers tend to suffer substantially during droughts, not because there is not enough water for their stock, but because reductions in available pasture and higher prices for purchased hay have significant economic effects on their operations. Food processors could be in a similar situation if they cannot get the grains or other inputs that they need. These effects are not captured in IMPLAN, which is one reason why the impact estimates are likely conservative.
10. The methodology did not capture “spillover” effects between regions – or the secondary impacts that occur outside of the region where the water shortage is projected to occur.
11. The model did not reflect dynamic economic responses to water shortages as they might occur, nor does the model reflect economic impacts associated with a recovery from a drought of record including:
 - a. The likely significant economic rebound to the landscaping industry immediately following a drought;
 - b. The cost and years to rebuild liquidated livestock herds (a major capital item in that industry);
 - c. Direct impacts on recreational sectors (i.e., stranded docks and reduced tourism); or,
 - d. Impacts of negative publicity on Texas’ ability to attract population and business in the event that it was not able to provide adequate water supplies for the existing economy.
12. Estimates for job losses and the associated population and school enrollment changes may exceed what would actually occur. In practice, firms may be hesitant to lay off employees, even in difficult economic times. Estimates of population and school enrollment changes are based on regional evaluations and therefore do not accurately reflect what might occur on a statewide basis.
13. The results must be interpreted carefully. It is the general and relative magnitudes of impacts as well as the changes of these impacts over time that should be the focus rather than the absolute numbers. Analyses of this type are much better at predicting relative percent differences brought about by a shock to a complex system (i.e., a water shortage) than the precise size of an impact. To illustrate, assuming that the estimated economic impacts of a drought of record on the manufacturing and mining water user categories are \$2 and \$1 million, respectively, one should be more confident that the economic impacts on manufacturing are twice as large as those on mining and that these impacts will likely be in the millions of dollars. But one should have less confidence that the actual total economic impact experienced would be \$3 million.

3 Analysis Results

This section presents a breakdown of the results of the regional analysis for Region A. Projected economic impacts for six water use categories (irrigation, livestock, municipal, manufacturing, mining, and steam-electric power) are also reported by decade.

3.1 Overview of the Regional Economy

Table 3-1 presents the 2011 economic baseline as represented by the IMPLAN model and adjusted to 2013 dollars for Region A. In year 2011, Region A generated about \$20 billion in gross state product associated with 231,000 jobs based on the 2011 IMPLAN data. These values represent an approximation of the current regional economy for a reference point.

Table 3-1 Region A Economy

| Income (\$ millions)* | Jobs | Taxes on production and imports (\$ millions)* |
|-----------------------|---------|--|
| \$20,300 | 230,660 | \$1,789 |

¹Year 2013 dollars based on 2011 IMPLAN model value added estimates for the region.

The remainder of Section 3 presents estimates of potential economic impacts for each water use category that could reasonably be expected in the event of water shortages associated with a drought of record and if no recommended water management strategies were implemented.

3.2 Impacts for Irrigation Water Shortages

Three of the 21 counties in the region are projected to experience water shortages in the irrigated agriculture water use category for one or more decades within the planning horizon. Estimated impacts to this water use category appear in Table 3-2. Note that tax collection impacts were not estimated for this water use category. IMPLAN data indicates a negative tax impact (i.e., increased tax collections) for the associated production sectors, primarily due to past subsidies from the federal government. Two factors led to excluding any reported tax impacts: 1) Federal support (subsidies) has lessened greatly since the year 2011 IMPLAN data was collected, and 2) It was not considered realistic to report increasing tax revenue collections for a drought of record.

Table 3-2 Impacts of Water Shortages on Irrigation in Region

| Impact Measure | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
|------------------------------|------|------|------|------|------|------|
| Income losses (\$ millions)* | \$20 | \$31 | \$38 | \$38 | \$35 | \$32 |
| Job losses | 338 | 531 | 645 | 639 | 588 | 540 |

** Year 2013 dollars, rounded. Entries denoted by a dash (-) indicate no economic impact. Entries denoted by a zero (\$0) indicate income losses less than \$500,000.*

3.3 Impacts for Livestock Water Shortages

None of the 21 counties in the region are projected to experience water shortages in the livestock water use category for one or more decades within the planning horizon. Estimated impacts to this water use category appear in Table 3-3. Note that tax impacts are not reported for this water use category for similar reasons that apply to the irrigation water use category described above.

Table 3-3 Impacts of Water Shortages on Livestock in Region

| Impact Measures | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
|------------------------------|------|------|------|------|------|------|
| Income losses (\$ millions)* | - | - | - | - | - | - |
| Jobs losses | - | - | - | - | - | - |

** Year 2013 dollars, rounded. Entries denoted by a dash (-) indicate no economic impact. Entries denoted by a zero (\$0) indicate income losses less than \$500,000.*

3.4 Impacts for Municipal Water Shortages

Fourteen of the 21 counties in the region are projected to experience water shortages in the municipal water use category for one or more decades within the planning horizon. Impact estimates were made for the two subtypes of use within municipal use: residential, and non-residential. The latter includes commercial and institutional users. Consumer surplus measures were made for both residential and non-residential demands. In addition, available data for the non-residential, water-intensive portion of municipal demand allowed use of IMPLAN and TWDB Water Use Survey data to estimate income loss, jobs, and taxes. Trucking cost estimates, calculated for shortages exceeding 80 percent, assumed a fixed cost of \$20,000 per acre-foot to transport water for municipal use. The estimated impacts to this water use category appear in Table 3-4.

Table 3-4 Impacts of Water Shortages on Municipal Water Users in Region

| Impact Measures | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
|--|------|------|-------|-------|--------|---------|
| Income losses ¹ (\$ millions)* | \$3 | \$19 | \$53 | \$135 | \$762 | \$1,586 |
| Job losses ¹ | 57 | 381 | 1,059 | 2,672 | 15,093 | 31,429 |
| Tax losses on production and imports ¹ (\$ millions)* | \$0 | \$2 | \$5 | \$12 | \$66 | \$138 |
| Consumer surplus losses (\$ millions)* | \$1 | \$7 | \$22 | \$43 | \$92 | \$175 |
| Trucking costs (\$ millions)* | - | \$0 | \$0 | \$1 | \$1 | \$2 |
| Utility revenue losses (\$ millions)* | \$20 | \$41 | \$64 | \$86 | \$93 | \$134 |
| Utility tax revenue losses (\$ millions)* | - | \$1 | \$1 | \$1 | \$2 | \$2 |

¹ Estimates apply to the water-intensive portion of non-residential municipal water use.

* Year 2013 dollars, rounded. Entries denoted by a dash (-) indicate no economic impact. Entries denoted by a zero (\$0) indicate income losses less than \$500,000.

3.5 Impacts of Manufacturing Water Shortages

Manufacturing water shortages in the region are projected to occur in 5 of the 21 counties in the region for at least one decade of the planning horizon. Estimated impacts to this water use category appear in Table 3-5.

Table 3-5 Impacts of Water Shortages on Manufacturing in Region

| Impacts Measures | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
|---|-------|-------|-------|--------|---------|---------|
| Income losses (\$ millions)* | \$196 | \$374 | \$617 | \$993 | \$1,375 | \$1,695 |
| Job losses | 2,743 | 5,282 | 8,832 | 12,874 | 16,807 | 20,305 |
| Tax losses on production and Imports (\$ millions)* | \$13 | \$24 | \$40 | \$63 | \$87 | \$107 |

* Year 2013 dollars, rounded. Entries denoted by a dash (-) indicate no economic impact. Entries denoted by a zero (\$0) indicate income losses less than \$500,000.

3.6 Impacts of Mining Water Shortages

Mining water shortages in the region are projected to occur in none of the 21 counties in the region for at least one decade of the planning horizon. Estimated impacts to this water use type appear in Table 3-6.

Table 3-6 Impacts of Water Shortages on Mining in Region

| Impact Measures | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
|---|------|------|------|------|------|------|
| Income losses (\$ millions)* | - | - | - | - | - | - |
| Job losses | - | - | - | - | - | - |
| Tax losses on production and Imports (\$ millions)* | - | - | - | - | - | - |

** Year 2013 dollars, rounded. Entries denoted by a dash (-) indicate no economic impact. Entries denoted by a zero (\$0) indicate income losses less than \$500,000.*

3.7 Impacts of Steam-Electric Water Shortages

Steam-electric water shortages in the region are projected to occur in none of the 21 counties in the region for at least one decade of the planning horizon. Estimated impacts to this water use category appear in Table 3-7.

Note that estimated economic impacts to steam-electric water users:

- Are reflected as an income loss proxy in the form of the estimated additional purchasing costs for power from the electrical grid that could not be generated due to a shortage;
- Do not include estimates of impacts on jobs. Because of the unique conditions of power generators during drought conditions and lack of relevant data, it was assumed that the industry would retain, perhaps relocating or repurposing, their existing staff in order to manage their ongoing operations through a severe drought.
- Does not presume a decline in tax collections. Associated tax collections, in fact, would likely increase under drought conditions since, historically, the demand for electricity increases during times of drought, thereby increasing taxes collected on the additional sales of power.

Table 3-7 Impacts of Water Shortages on Steam-Electric Power in Region

| Impact Measures | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
|------------------------------|------|------|------|------|------|------|
| Income Losses (\$ millions)* | - | - | - | - | - | - |

** Year 2013 dollars, rounded. Entries denoted by a dash (-) indicate no economic impact. Entries denoted by a zero (\$0) indicate income losses less than \$500,000.*

3.8 Regional Social Impacts

Projected changes in population, based upon several factors (household size, population, and job loss estimates), as well as the accompanying change in school enrollment, were also estimated and are summarized in Table 3-8.

Table 3-8 Region-wide Social Impacts of Water Shortages in Region

| Impact Measures | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
|--|------|-------|-------|-------|-------|-------|
| Consumer surplus losses (\$ millions)* | \$1 | \$7 | \$22 | \$43 | \$92 | \$175 |
| Population losses | 576 | 1,137 | 1,934 | 2,972 | 5,965 | 9,597 |
| School enrollment losses | 107 | 210 | 358 | 550 | 1,104 | 1,775 |

** Year 2013 dollars, rounded. Entries denoted by a dash (-) indicate no economic impact. Entries denoted by a zero (\$0) indicate income losses less than \$500,000.*


Appendix A - County Level Summary of Estimated Economic Impacts for Region A

County level summary of estimated economic impacts of not meeting identified water needs by water use category and decade (in 2013 dollars, rounded). Values presented only for counties with projected economic impacts for at least one decade.

* Entries denoted by a dash (-) indicate no economic impact. Entries denoted by a zero (\$0) indicate income losses less than \$500,000

| County | Water Use Category | Income losses (Million \$)* | | | | | | Job losses | | | | | | Consumer Surplus (Million \$)* | | | | | |
|-------------------------|--------------------|-----------------------------|------|-------|-------|-------|-------|------------|------|------|-------|-------|-------|--------------------------------|------|------|------|------|------|
| | | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| ARMSTRONG | MUNICIPAL | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | \$0 | \$0 | \$0 |
| ARMSTRONG Total | | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | \$0 | \$0 | \$0 |
| CARSON | MUNICIPAL | - | \$11 | \$12 | \$12 | \$12 | \$12 | - | 214 | 239 | 237 | 236 | 236 | \$0 | \$2 | \$2 | \$2 | \$2 | \$2 |
| CARSON Total | | - | \$11 | \$12 | \$12 | \$12 | \$12 | - | 214 | 239 | 237 | 236 | 236 | \$0 | \$2 | \$2 | \$2 | \$2 | \$2 |
| DALLAM | IRRIGATION | \$10 | \$15 | \$17 | \$17 | \$15 | \$14 | 169 | 254 | 299 | 293 | 266 | 239 | - | - | - | - | - | - |
| DALLAM | MUNICIPAL | - | - | \$0 | \$11 | \$24 | \$41 | - | - | 2 | 213 | 483 | 803 | \$0 | \$0 | \$1 | \$1 | \$3 | \$6 |
| DALLAM Total | | \$10 | \$15 | \$17 | \$28 | \$40 | \$54 | 169 | 254 | 301 | 506 | 749 | 1,042 | \$0 | \$0 | \$1 | \$1 | \$3 | \$6 |
| GRAY | MUNICIPAL | - | - | \$12 | - | \$11 | \$38 | - | - | 232 | - | 215 | 756 | - | \$1 | \$3 | \$1 | \$4 | \$9 |
| GRAY Total | | - | - | \$12 | - | \$11 | \$38 | - | - | 232 | - | 215 | 756 | - | \$1 | \$3 | \$1 | \$4 | \$9 |
| HALL | MUNICIPAL | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | \$0 | \$0 | \$0 |
| HALL Total | | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | \$0 | \$0 | \$0 |
| HANSFORD | MUNICIPAL | - | - | - | \$0 | \$5 | \$12 | - | - | - | 3 | 99 | 247 | - | - | \$0 | \$0 | \$1 | \$4 |
| HANSFORD Total | | - | - | - | \$0 | \$5 | \$12 | - | - | - | 3 | 99 | 247 | - | - | \$0 | \$0 | \$1 | \$4 |
| HARTLEY | IRRIGATION | \$10 | \$16 | \$21 | \$21 | \$19 | \$18 | 169 | 278 | 345 | 346 | 322 | 298 | - | - | - | - | - | - |
| HARTLEY | MUNICIPAL | - | - | \$0 | \$4 | \$8 | \$13 | - | - | 1 | 77 | 163 | 253 | - | \$0 | \$0 | \$0 | \$1 | \$2 |
| HARTLEY Total | | \$10 | \$16 | \$21 | \$24 | \$27 | \$31 | 169 | 278 | 346 | 424 | 485 | 552 | - | \$0 | \$0 | \$0 | \$1 | \$2 |
| HUTCHINSON | MANUFACTURING | - | - | - | - | \$9 | \$32 | - | - | - | - | 28 | 104 | - | - | - | - | - | - |
| HUTCHINSON | MUNICIPAL | - | - | - | \$3 | \$7 | \$20 | - | - | - | 60 | 145 | 400 | \$0 | \$0 | \$0 | \$1 | \$2 | \$4 |
| HUTCHINSON Total | | - | - | - | \$3 | \$16 | \$52 | - | - | - | 60 | 173 | 504 | \$0 | \$0 | \$0 | \$1 | \$2 | \$4 |
| LIPSCOMB | MANUFACTURING | - | - | \$0 | \$3 | \$6 | \$8 | - | - | 2 | 66 | 119 | 152 | - | - | - | - | - | - |
| LIPSCOMB | MUNICIPAL | - | - | - | - | \$1 | \$3 | - | - | - | - | 14 | 67 | - | - | \$0 | \$0 | \$0 | \$0 |
| LIPSCOMB Total | | - | - | \$0 | \$3 | \$7 | \$11 | - | - | 2 | 66 | 133 | 219 | - | - | \$0 | \$0 | \$0 | \$0 |
| MOORE | IRRIGATION | - | - | - | - | - | \$0 | - | - | - | - | - | 2 | - | - | - | - | - | - |
| MOORE | MANUFACTURING | \$45 | \$77 | \$108 | \$325 | \$553 | \$697 | 321 | 544 | 764 | 2,297 | 3,914 | 4,932 | - | - | - | - | - | - |
| MOORE | MUNICIPAL | \$3 | \$8 | \$28 | \$46 | \$86 | \$133 | 57 | 167 | 550 | 908 | 1,695 | 2,644 | \$0 | \$1 | \$6 | \$9 | \$12 | \$20 |

| County | Water Use Category | Income losses (Million \$)* | | | | | | Job losses | | | | | | Consumer Surplus (Million \$)* | | | | | |
|------------------------|--------------------|-----------------------------|--------------|--------------|----------------|----------------|----------------|--------------|--------------|---------------|---------------|---------------|---------------|--------------------------------|------------|-------------|-------------|-------------|--------------|
| | | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| MOORE Total | | \$48 | \$85 | \$136 | \$370 | \$639 | \$831 | 378 | 711 | 1,314 | 3,205 | 5,609 | 7,578 | \$0 | \$1 | \$6 | \$9 | \$12 | \$20 |
| OCHILTREE | MUNICIPAL | - | - | - | \$5 | \$17 | \$30 | - | - | - | 97 | 330 | 586 | \$0 | \$0 | \$0 | \$1 | \$3 | \$5 |
| OCHILTREE Total | | - | - | - | \$5 | \$17 | \$30 | - | - | - | 97 | 330 | 586 | \$0 | \$0 | \$0 | \$1 | \$3 | \$5 |
| POTTER | MANUFACTURING | \$151 | \$292 | \$490 | \$635 | \$768 | \$910 | 2,422 | 4,682 | 7,869 | 10,188 | 12,337 | 14,618 | - | - | - | - | - | - |
| POTTER | MUNICIPAL | - | - | - | \$16 | \$279 | \$648 | - | - | - | 317 | 5,523 | 12,833 | \$0 | \$1 | \$4 | \$11 | \$24 | \$51 |
| POTTER Total | | \$151 | \$292 | \$490 | \$651 | \$1,047 | \$1,558 | 2,422 | 4,682 | 7,869 | 10,506 | 17,860 | 27,451 | \$0 | \$1 | \$4 | \$11 | \$24 | \$51 |
| RANDALL | MANUFACTURING | - | \$5 | \$19 | \$31 | \$39 | \$47 | - | 56 | 197 | 323 | 409 | 498 | - | - | - | - | - | - |
| RANDALL | MUNICIPAL | - | - | \$0 | \$34 | \$306 | \$628 | - | - | 4 | 679 | 6,068 | 12,444 | \$0 | \$2 | \$5 | \$15 | \$39 | \$70 |
| RANDALL Total | | - | \$5 | \$19 | \$65 | \$345 | \$675 | - | 56 | 201 | 1,001 | 6,477 | 12,942 | \$0 | \$2 | \$5 | \$15 | \$39 | \$70 |
| WHEELER | MUNICIPAL | - | - | \$2 | \$4 | \$6 | \$8 | - | - | 32 | 80 | 123 | 160 | \$0 | \$0 | \$0 | \$0 | \$1 | \$1 |
| WHEELER Total | | - | - | \$2 | \$4 | \$6 | \$8 | - | - | 32 | 80 | 123 | 160 | \$0 | \$0 | \$0 | \$0 | \$1 | \$1 |
| Grand Total | | \$219 | \$424 | \$708 | \$1,166 | \$2,171 | \$3,312 | 3,138 | 6,194 | 10,536 | 16,185 | 32,489 | 52,273 | \$1 | \$7 | \$22 | \$43 | \$92 | \$175 |

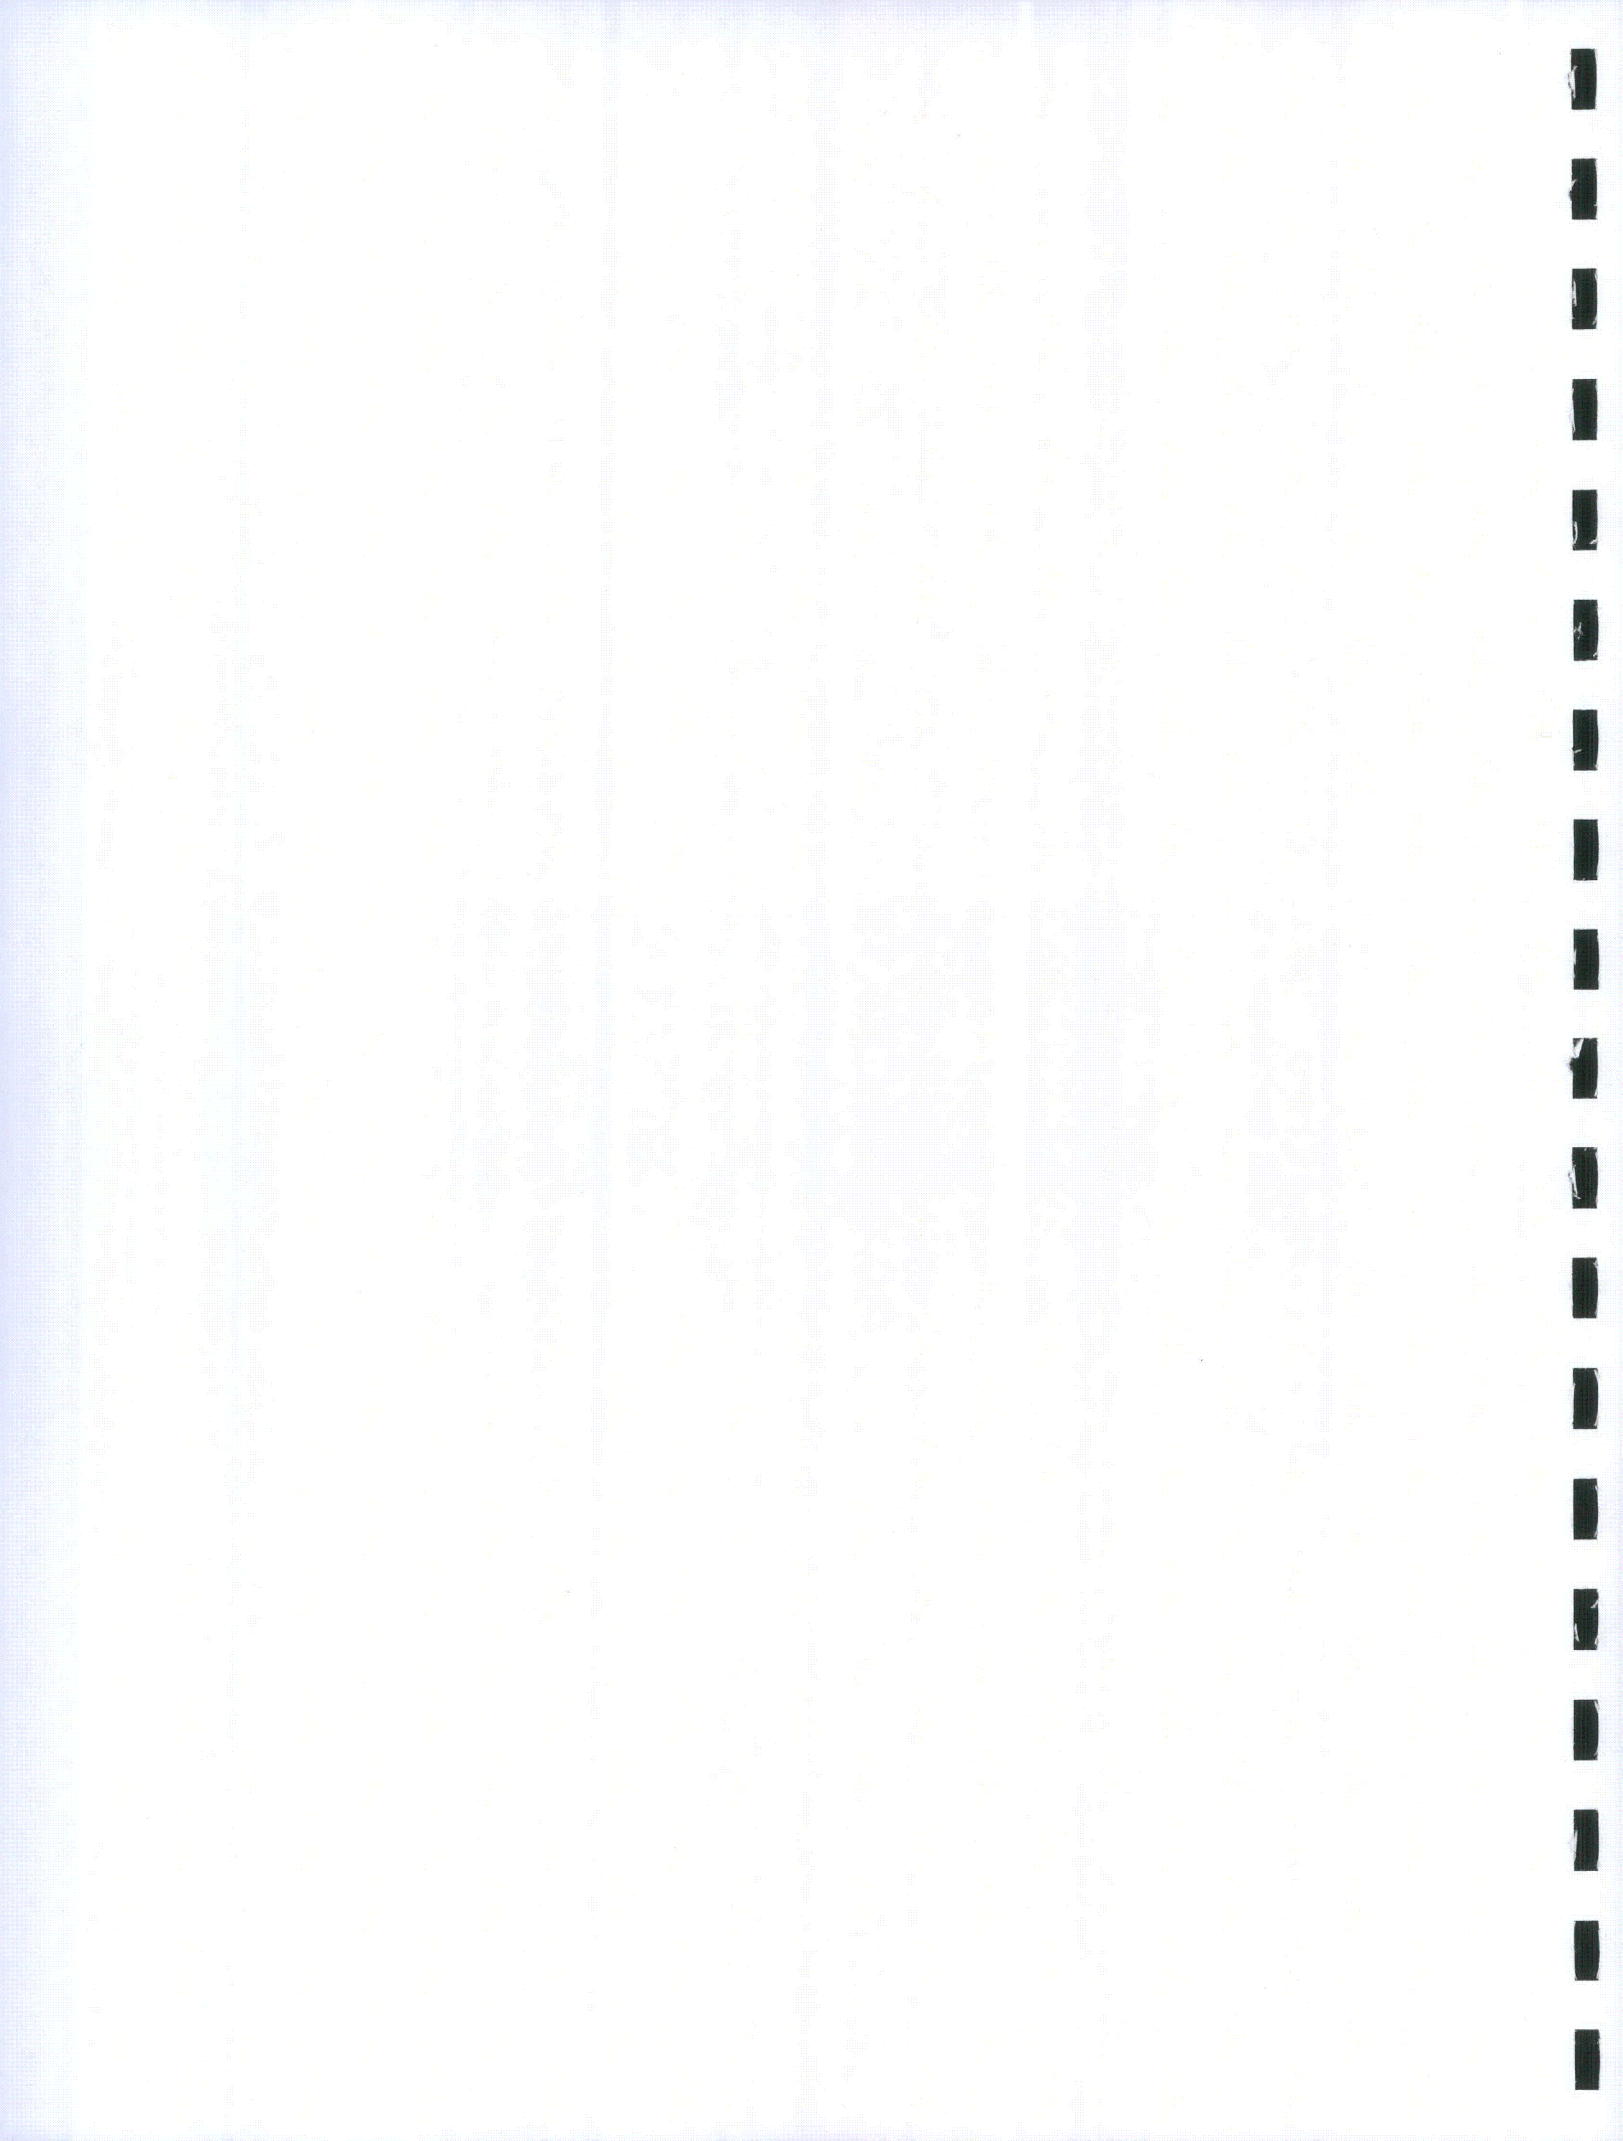



Appendix H
Infrastructure Financing Survey Results



PWPA INFRASTRUCTURE FINANCING SURVEY RESULTS

| SponsorEntityName | SponsorEntity PrimaryRegion | ProjectName | WMSProject SponsorRegion | IFRElementName | IFRElementValue | YearOfNeed | IFRProject DataId | EntityRwpId | WMSProjectId | IFRProject ElementsId |
|--|-----------------------------|--|--------------------------|---|------------------|------------|-------------------|-------------|--------------|-----------------------|
| AMARILLO | A | DEVELOP CARSON COUNTY WELL FIELD (OGALLALA AQUIFER) - AMARILLO | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 2 | 882 | 1 |
| AMARILLO | A | DEVELOP CARSON COUNTY WELL FIELD (OGALLALA AQUIFER) - AMARILLO | A | CONSTRUCTION FUNDING | | | | 2 | 882 | 2 |
| AMARILLO | A | DEVELOP CARSON COUNTY WELL FIELD (OGALLALA AQUIFER) - AMARILLO | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 2 | 882 | 3 |
| AMARILLO | A | DEVELOP POTTER COUNTY WELL FIELD (OGALLALA AQUIFER) - AMARILLO | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 2 | 881 | 1 |
| AMARILLO | A | DEVELOP POTTER COUNTY WELL FIELD (OGALLALA AQUIFER) - AMARILLO | A | CONSTRUCTION FUNDING | | | | 2 | 881 | 2 |
| AMARILLO | A | DEVELOP POTTER COUNTY WELL FIELD (OGALLALA AQUIFER) - AMARILLO | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 2 | 881 | 3 |
| AMARILLO | A | DEVELOP ROBERTS COUNTY WELL FIELD (OGALLALA AQUIFER) - AMARILLO | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 2 | 883 | 1 |
| AMARILLO | A | DEVELOP ROBERTS COUNTY WELL FIELD (OGALLALA AQUIFER) - AMARILLO | A | CONSTRUCTION FUNDING | | | | 2 | 883 | 2 |
| AMARILLO | A | DEVELOP ROBERTS COUNTY WELL FIELD (OGALLALA AQUIFER) - AMARILLO | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 2 | 883 | 3 |
| AMARILLO | A | DIRECT REUSE - AMARILLO | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 2 | 884 | 1 |
| AMARILLO | A | DIRECT REUSE - AMARILLO | A | CONSTRUCTION FUNDING | | | | 2 | 884 | 2 |
| AMARILLO | A | DIRECT REUSE - AMARILLO | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 2 | 884 | 3 |
| BOOKER | A | DEVELOP OGALLALA AQUIFER SUPPLIES - BOOKER | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 257 | 769 | 1 |
| BOOKER | A | DEVELOP OGALLALA AQUIFER SUPPLIES - BOOKER | A | CONSTRUCTION FUNDING | | | | 257 | 769 | 2 |
| BOOKER | A | DEVELOP OGALLALA AQUIFER SUPPLIES - BOOKER | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 257 | 769 | 3 |
| BORGER | A | DEVELOP NEW WELL FIELD (OGALLALA AQUIFER) - BORGER | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 12 | 888 | 1 |
| BORGER | A | DEVELOP NEW WELL FIELD (OGALLALA AQUIFER) - BORGER | A | CONSTRUCTION FUNDING | | | | 12 | 888 | 2 |
| BORGER | A | DEVELOP NEW WELL FIELD (OGALLALA AQUIFER) - BORGER | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 12 | 888 | 3 |
| CACTUS | A | DEVELOP NEW WELL FIELD (OGALLALA AQUIFER) - CACTUS | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 17 | 945 | 1 |
| CACTUS | A | DEVELOP NEW WELL FIELD (OGALLALA AQUIFER) - CACTUS | A | CONSTRUCTION FUNDING | | | | 17 | 945 | 2 |
| CACTUS | A | DEVELOP NEW WELL FIELD (OGALLALA AQUIFER) - CACTUS | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 17 | 945 | 3 |
| CANADIAN | A | MUNICIPAL CONSERVATION - CANADIAN | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 301 | 774 | 1 |
| CANADIAN | A | MUNICIPAL CONSERVATION - CANADIAN | A | CONSTRUCTION FUNDING | | | | 301 | 774 | 2 |
| CANADIAN | A | MUNICIPAL CONSERVATION - CANADIAN | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 301 | 774 | 3 |
| CANADIAN RIVER MUNICIPAL WATER AUTHORITY | A | EXPANSION OF ROBERTS COUNTY WELL FIELD (OGALLALA AQUIFER) IN 2024 - CRMWA2 | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | \$37,544,850.00 | 2020 | | 19 | 887 | 1 |
| CANADIAN RIVER MUNICIPAL WATER AUTHORITY | A | EXPANSION OF ROBERTS COUNTY WELL FIELD (OGALLALA AQUIFER) IN 2024 - CRMWA2 | A | CONSTRUCTION FUNDING | \$212,754,150.00 | 2021 | | 19 | 887 | 2 |
| CANADIAN RIVER MUNICIPAL WATER AUTHORITY | A | EXPANSION OF ROBERTS COUNTY WELL FIELD (OGALLALA AQUIFER) IN 2024 - CRMWA2 | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | 0 | | | 19 | 887 | 3 |
| CANADIAN RIVER MUNICIPAL WATER AUTHORITY | A | REPLACE CAPACITY OF ROBERTS COUNTY WELL FIELD (OGALLALA AQUIFER) IN 2030 - CRMWA | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 19 | 885 | 1 |
| CANADIAN RIVER MUNICIPAL WATER AUTHORITY | A | REPLACE CAPACITY OF ROBERTS COUNTY WELL FIELD (OGALLALA AQUIFER) IN 2030 - CRMWA | A | CONSTRUCTION FUNDING | | | | 19 | 885 | 2 |
| CANADIAN RIVER MUNICIPAL WATER AUTHORITY | A | REPLACE CAPACITY OF ROBERTS COUNTY WELL FIELD (OGALLALA AQUIFER) IN 2030 - CRMWA | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 19 | 885 | 3 |
| CANADIAN RIVER MUNICIPAL WATER AUTHORITY | A | REPLACE CAPACITY OF ROBERTS COUNTY WELL FIELD (OGALLALA AQUIFER) IN 2050 - CRMWA | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 19 | 886 | 1 |
| CANADIAN RIVER MUNICIPAL WATER AUTHORITY | A | REPLACE CAPACITY OF ROBERTS COUNTY WELL FIELD (OGALLALA AQUIFER) IN 2050 - CRMWA | A | CONSTRUCTION FUNDING | | | | 19 | 886 | 2 |
| CANADIAN RIVER MUNICIPAL WATER AUTHORITY | A | REPLACE CAPACITY OF ROBERTS COUNTY WELL FIELD (OGALLALA AQUIFER) IN 2050 - CRMWA | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 19 | 886 | 3 |
| CANYON | A | DEVELOP DOCKUM/OGALLALA AQUIFER SUPPLIES - CANYON | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | \$3,484,200.00 | 2020 | | 303 | 735 | 1 |
| CANYON | A | DEVELOP DOCKUM/OGALLALA AQUIFER SUPPLIES - CANYON | A | CONSTRUCTION FUNDING | \$8,129,900.00 | 2025 | | 303 | 735 | 2 |
| CANYON | A | DEVELOP DOCKUM/OGALLALA AQUIFER SUPPLIES - CANYON | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | 0 | | | 303 | 735 | 3 |
| CHILDRESS | A | MUNICIPAL CONSERVATION - CHILDRESS | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 317 | 775 | 1 |
| CHILDRESS | A | MUNICIPAL CONSERVATION - CHILDRESS | A | CONSTRUCTION FUNDING | | | | 317 | 775 | 2 |
| CHILDRESS | A | MUNICIPAL CONSERVATION - CHILDRESS | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 317 | 775 | 3 |
| CLAUDE | A | DEVELOP OGALLALA AQUIFER SUPPLIES - CLAUDE | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | \$722,775.00 | 2020 | | 330 | 896 | 1 |
| CLAUDE | A | DEVELOP OGALLALA AQUIFER SUPPLIES - CLAUDE | A | CONSTRUCTION FUNDING | \$2,168,325.00 | 2020 | | 330 | 896 | 2 |
| CLAUDE | A | DEVELOP OGALLALA AQUIFER SUPPLIES - CLAUDE | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | 0 | | | 330 | 896 | 3 |
| CLAUDE | A | MUNICIPAL CONSERVATION - CLAUDE | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 330 | 776 | 1 |
| CLAUDE | A | MUNICIPAL CONSERVATION - CLAUDE | A | CONSTRUCTION FUNDING | \$721,800.00 | 2020 | | 330 | 776 | 2 |
| CLAUDE | A | MUNICIPAL CONSERVATION - CLAUDE | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | 0 | | | 330 | 776 | 3 |
| COUNTY-OTHER, HALL | A | ADVANCED TREATMENT - HALL COUNTY OTHER (LAKEVIEW) | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 462 | 904 | 1 |
| COUNTY-OTHER, HALL | A | ADVANCED TREATMENT - HALL COUNTY OTHER (LAKEVIEW) | A | CONSTRUCTION FUNDING | | | | 462 | 904 | 2 |
| COUNTY-OTHER, HALL | A | ADVANCED TREATMENT - HALL COUNTY OTHER (LAKEVIEW) | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 462 | 904 | 3 |
| COUNTY-OTHER, HALL | A | MUNICIPAL CONSERVATION - HALL COUNTY OTHER | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | \$165,000.00 | 2035 | | 462 | 777 | 1 |
| COUNTY-OTHER, HALL | A | MUNICIPAL CONSERVATION - HALL COUNTY OTHER | A | CONSTRUCTION FUNDING | \$495,000.00 | 2035 | | 462 | 777 | 2 |
| COUNTY-OTHER, HALL | A | MUNICIPAL CONSERVATION - HALL COUNTY OTHER | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | 0 | | | 462 | 777 | 3 |
| COUNTY-OTHER, HALL | A | NEW GROUNDWATER SOURCE - HALL COUNTY OTHER (BRICE-LESLEY) | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | \$74,825.00 | 2035 | | 462 | 901 | 1 |
| COUNTY-OTHER, HALL | A | NEW GROUNDWATER SOURCE - HALL COUNTY OTHER (BRICE-LESLEY) | A | CONSTRUCTION FUNDING | \$224,475.00 | 2035 | | 462 | 901 | 2 |
| COUNTY-OTHER, HALL | A | NEW GROUNDWATER SOURCE - HALL COUNTY OTHER (BRICE-LESLEY) | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | 0 | | | 462 | 901 | 3 |
| COUNTY-OTHER, HALL | A | NEW GROUNDWATER SOURCE - HALL COUNTY OTHER (ESTELLINE) | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 462 | 902 | 1 |
| COUNTY-OTHER, HALL | A | NEW GROUNDWATER SOURCE - HALL COUNTY OTHER (ESTELLINE) | A | CONSTRUCTION FUNDING | | | | 462 | 902 | 2 |
| COUNTY-OTHER, HALL | A | NEW GROUNDWATER SOURCE - HALL COUNTY OTHER (ESTELLINE) | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 462 | 902 | 3 |
| COUNTY-OTHER, HALL | A | NEW GROUNDWATER SOURCE - HALL COUNTY OTHER (TURKEY) | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 462 | 909 | 1 |
| COUNTY-OTHER, HALL | A | NEW GROUNDWATER SOURCE - HALL COUNTY OTHER (TURKEY) | A | CONSTRUCTION FUNDING | | | | 462 | 909 | 2 |
| COUNTY-OTHER, HALL | A | NEW GROUNDWATER SOURCE - HALL COUNTY OTHER (TURKEY) | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 462 | 909 | 3 |
| COUNTY-OTHER, MOORE | A | DEVELOP OGALLALA AQUIFER SUPPLIES - MOORE COUNTY OTHER | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 537 | 737 | 1 |
| COUNTY-OTHER, MOORE | A | DEVELOP OGALLALA AQUIFER SUPPLIES - MOORE COUNTY OTHER | A | CONSTRUCTION FUNDING | | | | 537 | 737 | 2 |
| COUNTY-OTHER, MOORE | A | DEVELOP OGALLALA AQUIFER SUPPLIES - MOORE COUNTY OTHER | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 537 | 737 | 3 |
| COUNTY-OTHER, POTTER | A | DEVELOP DOCKUM AQUIFER SUPPLIES - POTTER COUNTY OTHER | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 554 | 916 | 1 |
| COUNTY-OTHER, POTTER | A | DEVELOP DOCKUM AQUIFER SUPPLIES - POTTER COUNTY OTHER | A | CONSTRUCTION FUNDING | | | | 554 | 916 | 2 |
| COUNTY-OTHER, POTTER | A | DEVELOP DOCKUM AQUIFER SUPPLIES - POTTER COUNTY OTHER | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 554 | 916 | 3 |
| COUNTY-OTHER, POTTER | A | DEVELOP OGALLALA AQUIFER SUPPLIES - POTTER COUNTY OTHER | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 554 | 912 | 1 |
| COUNTY-OTHER, POTTER | A | DEVELOP OGALLALA AQUIFER SUPPLIES - POTTER COUNTY OTHER | A | CONSTRUCTION FUNDING | | | | 554 | 912 | 2 |
| COUNTY-OTHER, POTTER | A | DEVELOP OGALLALA AQUIFER SUPPLIES - POTTER COUNTY OTHER | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 554 | 912 | 3 |




PWPA INFRASTRUCTURE FINANCING SURVEY RESULTS

| SponsorEntityName | SponsorEntity PrimaryRegion | ProjectName | WMSProject SponsorRegion | IFRElementName | IFRElementValue | YearOfNeed | IFRProject DataId | EntityRwpld | WMSProjectId | IFRProject ElementsId |
|--|-----------------------------|--|--------------------------|---|-----------------|------------|-------------------|-------------|--------------|-----------------------|
| COUNTY-OTHER, POTTER | A | MUNICIPAL CONSERVATION - POTTER COUNTY OTHER | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 554 | 778 | 1 |
| COUNTY-OTHER, POTTER | A | MUNICIPAL CONSERVATION - POTTER COUNTY OTHER | A | CONSTRUCTION FUNDING | | | | 554 | 778 | 2 |
| COUNTY-OTHER, POTTER | A | MUNICIPAL CONSERVATION - POTTER COUNTY OTHER | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 554 | 778 | 3 |
| COUNTY-OTHER, RANDALL | A | DEVELOP OGALLALA AQUIFER SUPPLIES - RANDALL COUNTY OTHER | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 557 | 733 | 1 |
| COUNTY-OTHER, RANDALL | A | DEVELOP OGALLALA AQUIFER SUPPLIES - RANDALL COUNTY OTHER | A | CONSTRUCTION FUNDING | | | | 557 | 733 | 2 |
| COUNTY-OTHER, RANDALL | A | DEVELOP OGALLALA AQUIFER SUPPLIES - RANDALL COUNTY OTHER | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 557 | 733 | 3 |
| DALHART | A | DEVELOP OGALLALA AQUIFER SUPPLIES - DALHART | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 645 | 831 | 1 |
| DALHART | A | DEVELOP OGALLALA AQUIFER SUPPLIES - DALHART | A | CONSTRUCTION FUNDING | | | | 645 | 831 | 2 |
| DALHART | A | DEVELOP OGALLALA AQUIFER SUPPLIES - DALHART | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 645 | 831 | 3 |
| DUMAS | A | DEVELOP OGALLALA AQUIFER SUPPLIES - DUMAS | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 41 | 766 | 1 |
| DUMAS | A | DEVELOP OGALLALA AQUIFER SUPPLIES - DUMAS | A | CONSTRUCTION FUNDING | | | | 41 | 766 | 2 |
| DUMAS | A | DEVELOP OGALLALA AQUIFER SUPPLIES - DUMAS | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 41 | 766 | 3 |
| FRITCH | A | MUNICIPAL CONSERVATION - FRITCH | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 744 | 779 | 1 |
| FRITCH | A | MUNICIPAL CONSERVATION - FRITCH | A | CONSTRUCTION FUNDING | | | | 744 | 779 | 2 |
| FRITCH | A | MUNICIPAL CONSERVATION - FRITCH | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 744 | 779 | 3 |
| GREENBELT MUNICIPAL & INDUSTRIAL WATER AUTHORITY | A | DEVELOP OGALLALA AQUIFER IN DONLEY COUNTY - GREENBELT MIWA | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 61 | 895 | 1 |
| GREENBELT MUNICIPAL & INDUSTRIAL WATER AUTHORITY | A | DEVELOP OGALLALA AQUIFER IN DONLEY COUNTY - GREENBELT MIWA | A | CONSTRUCTION FUNDING | | | | 61 | 895 | 2 |
| GREENBELT MUNICIPAL & INDUSTRIAL WATER AUTHORITY | A | DEVELOP OGALLALA AQUIFER IN DONLEY COUNTY - GREENBELT MIWA | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 61 | 895 | 3 |
| GRUVER | A | DEVELOP OGALLALA AQUIFER SUPPLIES - GRUVER | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 786 | 773 | 1 |
| GRUVER | A | DEVELOP OGALLALA AQUIFER SUPPLIES - GRUVER | A | CONSTRUCTION FUNDING | | | | 786 | 773 | 2 |
| GRUVER | A | DEVELOP OGALLALA AQUIFER SUPPLIES - GRUVER | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 786 | 773 | 3 |
| GRUVER | A | MUNICIPAL CONSERVATION - GRUVER | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 786 | 780 | 1 |
| GRUVER | A | MUNICIPAL CONSERVATION - GRUVER | A | CONSTRUCTION FUNDING | | | | 786 | 780 | 2 |
| GRUVER | A | MUNICIPAL CONSERVATION - GRUVER | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 786 | 780 | 3 |
| IRRIGATION, ARMSTRONG | A | IRRIGATION CONSERVATION - ARMSTRONG COUNTY | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 884 | 709 | 1 |
| IRRIGATION, ARMSTRONG | A | IRRIGATION CONSERVATION - ARMSTRONG COUNTY | A | CONSTRUCTION FUNDING | | | | 884 | 709 | 2 |
| IRRIGATION, ARMSTRONG | A | IRRIGATION CONSERVATION - ARMSTRONG COUNTY | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 884 | 709 | 3 |
| IRRIGATION, CARSON | A | IRRIGATION CONSERVATION - CARSON COUNTY | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 910 | 710 | 1 |
| IRRIGATION, CARSON | A | IRRIGATION CONSERVATION - CARSON COUNTY | A | CONSTRUCTION FUNDING | | | | 910 | 710 | 2 |
| IRRIGATION, CARSON | A | IRRIGATION CONSERVATION - CARSON COUNTY | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 910 | 710 | 3 |
| IRRIGATION, CHILDRESS | A | IRRIGATION CONSERVATION - CHILDRESS COUNTY | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 915 | 711 | 1 |
| IRRIGATION, CHILDRESS | A | IRRIGATION CONSERVATION - CHILDRESS COUNTY | A | CONSTRUCTION FUNDING | | | | 915 | 711 | 2 |
| IRRIGATION, CHILDRESS | A | IRRIGATION CONSERVATION - CHILDRESS COUNTY | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 915 | 711 | 3 |
| IRRIGATION, COLLINGSWORTH | A | IRRIGATION CONSERVATION - COLLINGSWORTH COUNTY | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 921 | 712 | 1 |
| IRRIGATION, COLLINGSWORTH | A | IRRIGATION CONSERVATION - COLLINGSWORTH COUNTY | A | CONSTRUCTION FUNDING | | | | 921 | 712 | 2 |
| IRRIGATION, COLLINGSWORTH | A | IRRIGATION CONSERVATION - COLLINGSWORTH COUNTY | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 921 | 712 | 3 |
| IRRIGATION, DALLAM | A | IRRIGATION CONSERVATION - DALLAM COUNTY | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 932 | 713 | 1 |
| IRRIGATION, DALLAM | A | IRRIGATION CONSERVATION - DALLAM COUNTY | A | CONSTRUCTION FUNDING | | | | 932 | 713 | 2 |
| IRRIGATION, DALLAM | A | IRRIGATION CONSERVATION - DALLAM COUNTY | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 932 | 713 | 3 |
| IRRIGATION, DONLEY | A | IRRIGATION CONSERVATION - DONLEY COUNTY | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 941 | 714 | 1 |
| IRRIGATION, DONLEY | A | IRRIGATION CONSERVATION - DONLEY COUNTY | A | CONSTRUCTION FUNDING | | | | 941 | 714 | 2 |
| IRRIGATION, DONLEY | A | IRRIGATION CONSERVATION - DONLEY COUNTY | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 941 | 714 | 3 |
| IRRIGATION, GRAY | A | IRRIGATION CONSERVATION - GRAY COUNTY | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 965 | 715 | 1 |
| IRRIGATION, GRAY | A | IRRIGATION CONSERVATION - GRAY COUNTY | A | CONSTRUCTION FUNDING | | | | 965 | 715 | 2 |
| IRRIGATION, GRAY | A | IRRIGATION CONSERVATION - GRAY COUNTY | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 965 | 715 | 3 |
| IRRIGATION, HALL | A | IRRIGATION CONSERVATION - HALL COUNTY | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 970 | 716 | 1 |
| IRRIGATION, HALL | A | IRRIGATION CONSERVATION - HALL COUNTY | A | CONSTRUCTION FUNDING | | | | 970 | 716 | 2 |
| IRRIGATION, HALL | A | IRRIGATION CONSERVATION - HALL COUNTY | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 970 | 716 | 3 |
| IRRIGATION, HANSFORD | A | IRRIGATION CONSERVATION - HANSFORD COUNTY | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 972 | 717 | 1 |
| IRRIGATION, HANSFORD | A | IRRIGATION CONSERVATION - HANSFORD COUNTY | A | CONSTRUCTION FUNDING | | | | 972 | 717 | 2 |
| IRRIGATION, HANSFORD | A | IRRIGATION CONSERVATION - HANSFORD COUNTY | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 972 | 717 | 3 |
| IRRIGATION, HARTLEY | A | IRRIGATION CONSERVATION - HARTLEY COUNTY | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 977 | 718 | 1 |
| IRRIGATION, HARTLEY | A | IRRIGATION CONSERVATION - HARTLEY COUNTY | A | CONSTRUCTION FUNDING | | | | 977 | 718 | 2 |
| IRRIGATION, HARTLEY | A | IRRIGATION CONSERVATION - HARTLEY COUNTY | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 977 | 718 | 3 |
| IRRIGATION, HEMPHILL | A | IRRIGATION CONSERVATION - HEMPHILL COUNTY | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 980 | 719 | 1 |
| IRRIGATION, HEMPHILL | A | IRRIGATION CONSERVATION - HEMPHILL COUNTY | A | CONSTRUCTION FUNDING | | | | 980 | 719 | 2 |
| IRRIGATION, HEMPHILL | A | IRRIGATION CONSERVATION - HEMPHILL COUNTY | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 980 | 719 | 3 |
| IRRIGATION, HUTCHINSON | A | IRRIGATION CONSERVATION - HUTCHINSON COUNTY | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 991 | 720 | 1 |
| IRRIGATION, HUTCHINSON | A | IRRIGATION CONSERVATION - HUTCHINSON COUNTY | A | CONSTRUCTION FUNDING | | | | 991 | 720 | 2 |
| IRRIGATION, HUTCHINSON | A | IRRIGATION CONSERVATION - HUTCHINSON COUNTY | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 991 | 720 | 3 |
| IRRIGATION, LIPSCOMB | A | IRRIGATION CONSERVATION - LIPSCOMB COUNTY | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 1019 | 721 | 1 |
| IRRIGATION, LIPSCOMB | A | IRRIGATION CONSERVATION - LIPSCOMB COUNTY | A | CONSTRUCTION FUNDING | | | | 1019 | 721 | 2 |
| IRRIGATION, LIPSCOMB | A | IRRIGATION CONSERVATION - LIPSCOMB COUNTY | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 1019 | 721 | 3 |
| IRRIGATION, MOORE | A | IRRIGATION CONSERVATION - MOORE COUNTY | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 1041 | 722 | 1 |
| IRRIGATION, MOORE | A | IRRIGATION CONSERVATION - MOORE COUNTY | A | CONSTRUCTION FUNDING | | | | 1041 | 722 | 2 |
| IRRIGATION, MOORE | A | IRRIGATION CONSERVATION - MOORE COUNTY | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 1041 | 722 | 3 |
| IRRIGATION, OCHILTREE | A | IRRIGATION CONSERVATION - OCHILTREE COUNTY | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 1047 | 723 | 1 |
| IRRIGATION, OCHILTREE | A | IRRIGATION CONSERVATION - OCHILTREE COUNTY | A | CONSTRUCTION FUNDING | | | | 1047 | 723 | 2 |
| IRRIGATION, OCHILTREE | A | IRRIGATION CONSERVATION - OCHILTREE COUNTY | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 1047 | 723 | 3 |



PWPA INFRASTRUCTURE FINANCING SURVEY RESULTS


| SponsorEntityName | SponsorEntity PrimaryRegion | ProjectName | WMSProject SponsorRegion | IFRElementName | IFRElementValue | YearOfNeed | IFRProject DataId | EntityRwpld | WMSProjectId | IFRProject ElementsId |
|------------------------|-----------------------------|--|--------------------------|---|-----------------|------------|-------------------|-------------|--------------|-----------------------|
| IRRIGATION, OLDHAM | A | IRRIGATION CONSERVATION - OLDHAM COUNTY | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 1048 | 724 | 1 |
| IRRIGATION, OLDHAM | A | IRRIGATION CONSERVATION - OLDHAM COUNTY | A | CONSTRUCTION FUNDING | | | | 1048 | 724 | 2 |
| IRRIGATION, OLDHAM | A | IRRIGATION CONSERVATION - OLDHAM COUNTY | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 1048 | 724 | 3 |
| IRRIGATION, POTTER | A | IRRIGATION CONSERVATION - POTTER COUNTY | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 1055 | 725 | 1 |
| IRRIGATION, POTTER | A | IRRIGATION CONSERVATION - POTTER COUNTY | A | CONSTRUCTION FUNDING | | | | 1055 | 725 | 2 |
| IRRIGATION, POTTER | A | IRRIGATION CONSERVATION - POTTER COUNTY | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 1055 | 725 | 3 |
| IRRIGATION, RANDALL | A | IRRIGATION CONSERVATION - RANDALL COUNTY | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 1057 | 726 | 1 |
| IRRIGATION, RANDALL | A | IRRIGATION CONSERVATION - RANDALL COUNTY | A | CONSTRUCTION FUNDING | \$661,700.00 | | | 1057 | 726 | 2 |
| IRRIGATION, RANDALL | A | IRRIGATION CONSERVATION - RANDALL COUNTY | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 1057 | 726 | 3 |
| IRRIGATION, ROBERTS | A | IRRIGATION CONSERVATION - ROBERTS COUNTY | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 1063 | 727 | 1 |
| IRRIGATION, ROBERTS | A | IRRIGATION CONSERVATION - ROBERTS COUNTY | A | CONSTRUCTION FUNDING | | | | 1063 | 727 | 2 |
| IRRIGATION, ROBERTS | A | IRRIGATION CONSERVATION - ROBERTS COUNTY | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 1063 | 727 | 3 |
| IRRIGATION, SHERMAN | A | IRRIGATION CONSERVATION - SHERMAN COUNTY | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 1076 | 728 | 1 |
| IRRIGATION, SHERMAN | A | IRRIGATION CONSERVATION - SHERMAN COUNTY | A | CONSTRUCTION FUNDING | | | | 1076 | 728 | 2 |
| IRRIGATION, SHERMAN | A | IRRIGATION CONSERVATION - SHERMAN COUNTY | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 1076 | 728 | 3 |
| IRRIGATION, WHEELER | A | IRRIGATION CONSERVATION - WHEELER COUNTY | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 1106 | 729 | 1 |
| IRRIGATION, WHEELER | A | IRRIGATION CONSERVATION - WHEELER COUNTY | A | CONSTRUCTION FUNDING | | | | 1106 | 729 | 2 |
| IRRIGATION, WHEELER | A | IRRIGATION CONSERVATION - WHEELER COUNTY | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 1106 | 729 | 3 |
| LAKE TANGLEWOOD | A | DEVELOP OGALLALA AQUIFER SUPPLIES - LAKE TANGLEWOOD | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 1190 | 734 | 1 |
| LAKE TANGLEWOOD | A | DEVELOP OGALLALA AQUIFER SUPPLIES - LAKE TANGLEWOOD | A | CONSTRUCTION FUNDING | | | | 1190 | 734 | 2 |
| LAKE TANGLEWOOD | A | DEVELOP OGALLALA AQUIFER SUPPLIES - LAKE TANGLEWOOD | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 1190 | 734 | 3 |
| LAKE TANGLEWOOD | A | MUNICIPAL CONSERVATION - LAKE TANGLEWOOD | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 1190 | 782 | 1 |
| LAKE TANGLEWOOD | A | MUNICIPAL CONSERVATION - LAKE TANGLEWOOD | A | CONSTRUCTION FUNDING | | | | 1190 | 782 | 2 |
| LAKE TANGLEWOOD | A | MUNICIPAL CONSERVATION - LAKE TANGLEWOOD | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 1190 | 782 | 3 |
| MANUFACTURING, MOORE | A | DEVELOP NEW WELL FIELD (OGALLALA AQUIFER) - MANUFACTURING MOORE COUNTY | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 1623 | 2202 | 1 |
| MANUFACTURING, MOORE | A | DEVELOP NEW WELL FIELD (OGALLALA AQUIFER) - MANUFACTURING MOORE COUNTY | A | CONSTRUCTION FUNDING | | | | 1623 | 2202 | 2 |
| MANUFACTURING, MOORE | A | DEVELOP NEW WELL FIELD (OGALLALA AQUIFER) - MANUFACTURING MOORE COUNTY | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 1623 | 2202 | 3 |
| MANUFACTURING, POTTER | A | DIRECT REUSE - POTTER COUNTY MANUFACTURING | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 1638 | 918 | 1 |
| MANUFACTURING, POTTER | A | DIRECT REUSE - POTTER COUNTY MANUFACTURING | A | CONSTRUCTION FUNDING | | | | 1638 | 918 | 2 |
| MANUFACTURING, POTTER | A | DIRECT REUSE - POTTER COUNTY MANUFACTURING | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 1638 | 918 | 3 |
| MANUFACTURING, RANDALL | A | DEVELOP OGALLALA AQUIFER SUPPLIES - RANDALL COUNTY MANUFACTURING | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 1640 | 731 | 1 |
| MANUFACTURING, RANDALL | A | DEVELOP OGALLALA AQUIFER SUPPLIES - RANDALL COUNTY MANUFACTURING | A | CONSTRUCTION FUNDING | | | | 1640 | 731 | 2 |
| MANUFACTURING, RANDALL | A | DEVELOP OGALLALA AQUIFER SUPPLIES - RANDALL COUNTY MANUFACTURING | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 1640 | 731 | 3 |
| MCLEAN | A | DEVELOP OGALLALA AQUIFER SUPPLIES - MCLEAN | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 1703 | 829 | 1 |
| MCLEAN | A | DEVELOP OGALLALA AQUIFER SUPPLIES - MCLEAN | A | CONSTRUCTION FUNDING | | | | 1703 | 829 | 2 |
| MCLEAN | A | DEVELOP OGALLALA AQUIFER SUPPLIES - MCLEAN | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 1703 | 829 | 3 |
| MCLEAN | A | MUNICIPAL CONSERVATION - MCLEAN | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 1703 | 783 | 1 |
| MCLEAN | A | MUNICIPAL CONSERVATION - MCLEAN | A | CONSTRUCTION FUNDING | | | | 1703 | 783 | 2 |
| MCLEAN | A | MUNICIPAL CONSERVATION - MCLEAN | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 1703 | 783 | 3 |
| MEMPHIS | A | DEVELOP OGALLALA AQUIFER SUPPLIES - MEMPHIS | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 1709 | 900 | 1 |
| MEMPHIS | A | DEVELOP OGALLALA AQUIFER SUPPLIES - MEMPHIS | A | CONSTRUCTION FUNDING | | | | 1709 | 900 | 2 |
| MEMPHIS | A | DEVELOP OGALLALA AQUIFER SUPPLIES - MEMPHIS | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 1709 | 900 | 3 |
| MEMPHIS | A | MUNICIPAL CONSERVATION - MEMPHIS | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 1709 | 784 | 1 |
| MEMPHIS | A | MUNICIPAL CONSERVATION - MEMPHIS | A | CONSTRUCTION FUNDING | | | | 1709 | 784 | 2 |
| MEMPHIS | A | MUNICIPAL CONSERVATION - MEMPHIS | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 1709 | 784 | 3 |
| MIAMI | A | MUNICIPAL CONSERVATION - MIAMI | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 1717 | 785 | 1 |
| MIAMI | A | MUNICIPAL CONSERVATION - MIAMI | A | CONSTRUCTION FUNDING | | | | 1717 | 785 | 2 |
| MIAMI | A | MUNICIPAL CONSERVATION - MIAMI | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 1717 | 785 | 3 |
| PAMPA | A | DEVELOP OGALLALA AQUIFER SUPPLIES - PAMPA | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 2045 | 828 | 1 |
| PAMPA | A | DEVELOP OGALLALA AQUIFER SUPPLIES - PAMPA | A | CONSTRUCTION FUNDING | | | | 2045 | 828 | 2 |
| PAMPA | A | DEVELOP OGALLALA AQUIFER SUPPLIES - PAMPA | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 2045 | 828 | 3 |
| PANHANDLE | A | DEVELOP OGALLALA AQUIFER SUPPLIES - PANHANDLE | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 2046 | 897 | 1 |
| PANHANDLE | A | DEVELOP OGALLALA AQUIFER SUPPLIES - PANHANDLE | A | CONSTRUCTION FUNDING | | | | 2046 | 897 | 2 |
| PANHANDLE | A | DEVELOP OGALLALA AQUIFER SUPPLIES - PANHANDLE | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 2046 | 897 | 3 |
| PANHANDLE | A | MUNICIPAL CONSERVATION - PANHANDLE | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 2046 | 786 | 1 |
| PANHANDLE | A | MUNICIPAL CONSERVATION - PANHANDLE | A | CONSTRUCTION FUNDING | | | | 2046 | 786 | 2 |
| PANHANDLE | A | MUNICIPAL CONSERVATION - PANHANDLE | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 2046 | 786 | 3 |
| PERRYTON | A | DEVELOP OGALLALA AQUIFER SUPPLIES - PERRYTON | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | \$2,114,200.00 | 2020 | | 2063 | 736 | 1 |
| PERRYTON | A | DEVELOP OGALLALA AQUIFER SUPPLIES - PERRYTON | A | CONSTRUCTION FUNDING | \$8,469,900.00 | 2022 | | 2063 | 736 | 2 |
| PERRYTON | A | DEVELOP OGALLALA AQUIFER SUPPLIES - PERRYTON | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 2063 | 736 | 3 |
| SHAMROCK | A | MUNICIPAL CONSERVATION - SHAMROCK | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 2205 | 787 | 1 |
| SHAMROCK | A | MUNICIPAL CONSERVATION - SHAMROCK | A | CONSTRUCTION FUNDING | | | | 2205 | 787 | 2 |
| SHAMROCK | A | MUNICIPAL CONSERVATION - SHAMROCK | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 2205 | 787 | 3 |
| SPEARMAN | A | DEVELOP OGALLALA AQUIFER SUPPLIES - SPEARMAN | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 2239 | 772 | 1 |
| SPEARMAN | A | DEVELOP OGALLALA AQUIFER SUPPLIES - SPEARMAN | A | CONSTRUCTION FUNDING | | | | 2239 | 772 | 2 |
| SPEARMAN | A | DEVELOP OGALLALA AQUIFER SUPPLIES - SPEARMAN | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 2239 | 772 | 3 |
| STINNETT | A | DEVELOP OGALLALA AQUIFER SUPPLIES - STINNETT | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 2334 | 771 | 1 |
| STINNETT | A | DEVELOP OGALLALA AQUIFER SUPPLIES - STINNETT | A | CONSTRUCTION FUNDING | | | | 2334 | 771 | 2 |
| STINNETT | A | DEVELOP OGALLALA AQUIFER SUPPLIES - STINNETT | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 2334 | 771 | 3 |

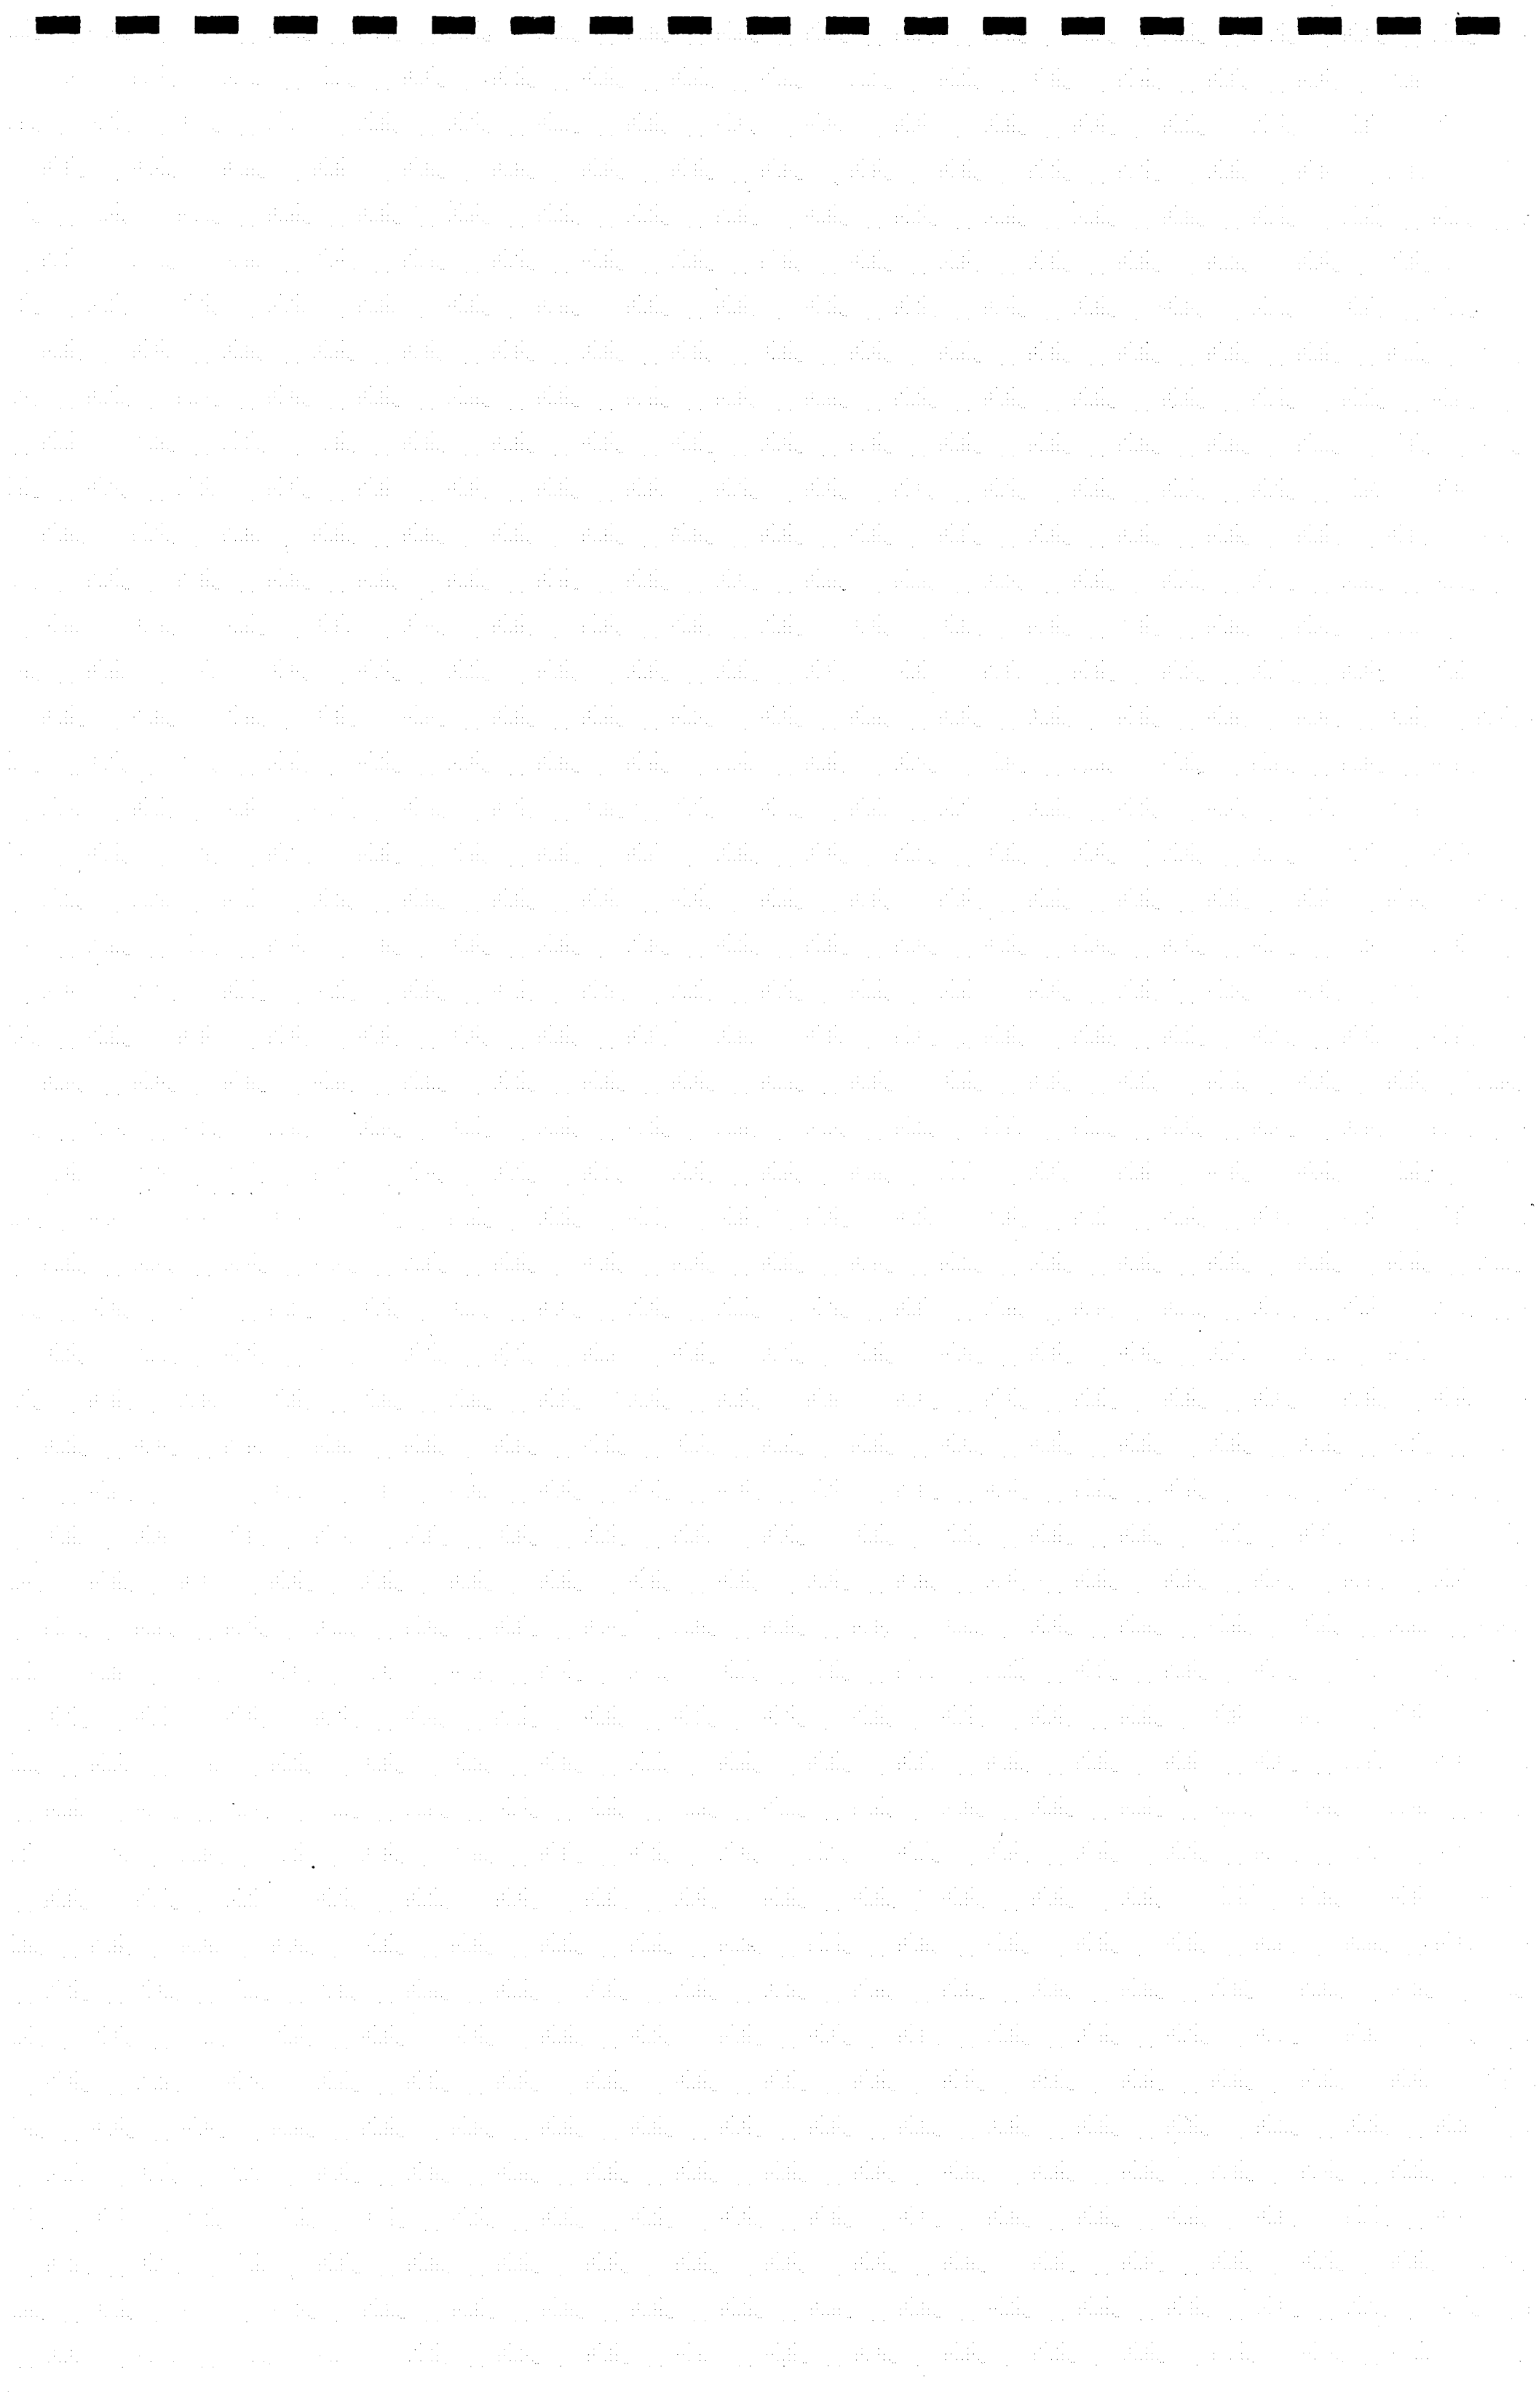

PWPA INFRASTRUCTURE FINANCING SURVEY RESULTS

| SponsorEntityName | SponsorEntity PrimaryRegion | ProjectName | WMSProject SponsorRegion | IFRElementName | IFRElementValue | YearOfNeed | IFRProject DataId | EntityRwpId | WMSProjectId | IFRProject ElementsId |
|-------------------|-----------------------------|---|--------------------------|---|-----------------|------------|-------------------|-------------|--------------|-----------------------|
| STINNETT | A | MUNICIPAL CONSERVATION - STINNETT | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 2334 | 788 | 1 |
| STINNETT | A | MUNICIPAL CONSERVATION - STINNETT | A | CONSTRUCTION FUNDING | | | | 2334 | 788 | 2 |
| STINNETT | A | MUNICIPAL CONSERVATION - STINNETT | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 2334 | 788 | 3 |
| STRATFORD | A | MUNICIPAL CONSERVATION - STRATFORD | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 2336 | 789 | 1 |
| STRATFORD | A | MUNICIPAL CONSERVATION - STRATFORD | A | CONSTRUCTION FUNDING | | | | 2336 | 789 | 2 |
| STRATFORD | A | MUNICIPAL CONSERVATION - STRATFORD | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 2336 | 789 | 3 |
| SUNRAY | A | DEVELOP OGALLALA AQUIFER SUPPLIES - SUNRAY | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 2345 | 739 | 1 |
| SUNRAY | A | DEVELOP OGALLALA AQUIFER SUPPLIES - SUNRAY | A | CONSTRUCTION FUNDING | | | | 2345 | 739 | 2 |
| SUNRAY | A | DEVELOP OGALLALA AQUIFER SUPPLIES - SUNRAY | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 2345 | 739 | 3 |
| SUNRAY | A | MUNICIPAL CONSERVATION - SUNRAY | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 2345 | 790 | 1 |
| SUNRAY | A | MUNICIPAL CONSERVATION - SUNRAY | A | CONSTRUCTION FUNDING | | | | 2345 | 790 | 2 |
| SUNRAY | A | MUNICIPAL CONSERVATION - SUNRAY | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 2345 | 790 | 3 |
| TCW SUPPLY INC | A | DEVELOP OGALLALA AQUIFER SUPPLIES - TCW SUPPLY | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 2356 | 770 | 1 |
| TCW SUPPLY INC | A | DEVELOP OGALLALA AQUIFER SUPPLIES - TCW SUPPLY | A | CONSTRUCTION FUNDING | | | | 2356 | 770 | 2 |
| TCW SUPPLY INC | A | DEVELOP OGALLALA AQUIFER SUPPLIES - TCW SUPPLY | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 2356 | 770 | 3 |
| TCW SUPPLY INC | A | MUNICIPAL CONSERVATION - TCW SUPPLY | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 2356 | 791 | 1 |
| TCW SUPPLY INC | A | MUNICIPAL CONSERVATION - TCW SUPPLY | A | CONSTRUCTION FUNDING | | | | 2356 | 791 | 2 |
| TCW SUPPLY INC | A | MUNICIPAL CONSERVATION - TCW SUPPLY | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 2356 | 791 | 3 |
| TEXLINE | A | DEVELOP OGALLALA AQUIFER SUPPLIES - TEXLINE | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 2362 | 830 | 1 |
| TEXLINE | A | DEVELOP OGALLALA AQUIFER SUPPLIES - TEXLINE | A | CONSTRUCTION FUNDING | | | | 2362 | 830 | 2 |
| TEXLINE | A | DEVELOP OGALLALA AQUIFER SUPPLIES - TEXLINE | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 2362 | 830 | 3 |
| TEXLINE | A | MUNICIPAL CONSERVATION - TEXLINE | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 2362 | 792 | 1 |
| TEXLINE | A | MUNICIPAL CONSERVATION - TEXLINE | A | CONSTRUCTION FUNDING | | | | 2362 | 792 | 2 |
| TEXLINE | A | MUNICIPAL CONSERVATION - TEXLINE | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 2362 | 792 | 3 |
| VEGA | A | MUNICIPAL CONSERVATION - VEGA | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 2406 | 793 | 1 |
| VEGA | A | MUNICIPAL CONSERVATION - VEGA | A | CONSTRUCTION FUNDING | | | | 2406 | 793 | 2 |
| VEGA | A | MUNICIPAL CONSERVATION - VEGA | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 2406 | 793 | 3 |
| WELLINGTON | A | ADVANCED TREATMENT (NITRATE REMOVAL) - WELLINGTON | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | \$679,700.00 | 2015 | | 2426 | 899 | 1 |
| WELLINGTON | A | ADVANCED TREATMENT (NITRATE REMOVAL) - WELLINGTON | A | CONSTRUCTION FUNDING | \$3,000,000.00 | 2017 | | 2426 | 899 | 2 |
| WELLINGTON | A | ADVANCED TREATMENT (NITRATE REMOVAL) - WELLINGTON | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | 0 | | | 2426 | 899 | 3 |
| WELLINGTON | A | DEVELOP SEYMOUR AQUIFER SUPPLIES - WELLINGTON | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | \$1,000,000.00 | 2015 | | 2426 | 898 | 1 |
| WELLINGTON | A | DEVELOP SEYMOUR AQUIFER SUPPLIES - WELLINGTON | A | CONSTRUCTION FUNDING | \$1,589,800.00 | 2018 | | 2426 | 898 | 2 |
| WELLINGTON | A | DEVELOP SEYMOUR AQUIFER SUPPLIES - WELLINGTON | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | 0 | | | 2426 | 898 | 3 |
| WELLINGTON | A | MUNICIPAL CONSERVATION - WELLINGTON | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | \$533,900.00 | 2015 | | 2426 | 794 | 1 |
| WELLINGTON | A | MUNICIPAL CONSERVATION - WELLINGTON | A | CONSTRUCTION FUNDING | \$1,000,000.00 | | | 2426 | 794 | 2 |
| WELLINGTON | A | MUNICIPAL CONSERVATION - WELLINGTON | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | 0 | | | 2426 | 794 | 3 |
| WHEELER | A | DEVELOP OGALLALA AQUIFER SUPPLIES - WHEELER | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 2445 | 730 | 1 |
| WHEELER | A | DEVELOP OGALLALA AQUIFER SUPPLIES - WHEELER | A | CONSTRUCTION FUNDING | | | | 2445 | 730 | 2 |
| WHEELER | A | DEVELOP OGALLALA AQUIFER SUPPLIES - WHEELER | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 2445 | 730 | 3 |
| WHITE DEER | A | MUNICIPAL CONSERVATION - WHITE DEER | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | | | | 2447 | 795 | 1 |
| WHITE DEER | A | MUNICIPAL CONSERVATION - WHITE DEER | A | CONSTRUCTION FUNDING | | | | 2447 | 795 | 2 |
| WHITE DEER | A | MUNICIPAL CONSERVATION - WHITE DEER | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | | | | 2447 | 795 | 3 |
| WHEELER | A | DEVELOP OGALLALA AQUIFER SUPPLIES - WHEELER | A | PLANNING, DESIGN, PERMITTING & ACQUISITION FUNDING | \$698,900.00 | 2017 | | | | 1 |
| WHEELER | A | DEVELOP OGALLALA AQUIFER SUPPLIES - WHEELER | A | CONSTRUCTION FUNDING | \$2,096,700.00 | 2017 | | | | 2 |
| WHEELER | A | DEVELOP OGALLALA AQUIFER SUPPLIES - WHEELER | A | PERCENT STATE PARTICIPATION IN OWNING EXCESS CAPACITY | \$0.00 | | | | | 3 |





Appendix I

Comments Received on the IPP and Responses





August 14, 2015

Life's better outside.®

Commissioners

Dan Allen Hughes, Jr.
Chairman
Beeville

Ralph H. Duggins
Vice-Chairman
Fort Worth

T. Dan Friedkin
Chairman-Emeritus
Houston

Bill Jones
Austin

James H. Lee
Houston

Margaret Martin
Boerne

S. Reed Morian
Houston

Dick Scott
Wimberley

Lee M. Bass
Chairman-Emeritus
Fort Worth

Carter P. Smith
Executive Director

Mr. Kyle G. Ingham, Local Government Services Director
Panhandle Regional Water Planning Group
P.O. Box 9257
Amarillo, TX 79105

Re: 2016 Panhandle Region A Initially Prepared Plan

Thank you for seeking review and comment from the Texas Parks and Wildlife Department ("TPWD") on the 2016 Initially Prepared Regional Water Plan for the Panhandle Water Planning Group (PWPA) Region A (IPP). As you know, water impacts every aspect of TPWD's mission to manage and conserve the natural and cultural resources of Texas. As the agency charged with primary responsibility for protecting the state's fish and wildlife resources, TPWD is positioned to provide technical assistance during the water planning process. Although TPWD has limited regulatory authority over the use of state waters, TPWD is committed to working with stakeholders and others to provide science-based information during the water planning process intended to avoid or minimize impacts to state fish and wildlife resources.

TPWD understands that regional water planning groups are guided by 31 TAC §357 when preparing regional water plans. These water planning rules spell out requirements related to natural resource and environmental protection. Accordingly, TPWD staff reviewed the IPP with a focus on the following questions:

- Does the IPP include a quantitative reporting of environmental factors including the effects on environmental water needs and habitat?
- Does the IPP include a description of natural resources and threats to natural resources due to water quantity or quality problems?
- Does the IPP discuss how these threats will be addressed?
- Does the IPP describe how it is consistent with long-term protection of natural resources?
- Does the IPP include water conservation as a water management strategy?
- Does the IPP include Drought Contingency Plans?
- Does the IPP recommend any stream segments be nominated as ecologically unique?
- If the IPP includes strategies identified in the 2010 regional water plan, does it address concerns raised by TPWD in connection with the 2010 Water Plan.

Mr. Kyle G. Ingham

Page 2 of 3

August 14, 2015

The population of the 21 counties that comprise the Panhandle Regional Water Planning Area (PWPA) was 380,733 in 2010 and is expected to increase to 639,220 by 2070. Projected water demands are about 1.7 million acre feet in 2020, decreasing to about 1.16 million acre-feet in 2070. The decline in demands is due in part to declining groundwater availability in the region but also due to increased irrigation efficiency and water conservation measures. The region's largest water demand is for irrigated agriculture (87 percent), followed by municipal demand (5 percent).

The PWPA is located within portions of the Canadian River Basin and Red River Basin. In 2010, only two percent of the total water use in the PWPA came from surface water sources. There are three major reservoirs in the PWPA: Lake Meredith, Palo Duro Reservoir, and Greenbelt Reservoir. Groundwater sources in the PWPA include the Ogallala, Seymour, Blaine, Dockum, and Rita Blanca aquifers. The Ogallala aquifer constitutes 90% of the total groundwater availability in the PWPA.

The PWPA IPP provides brief descriptions of natural resources in the region including vegetation types, soils, wetlands, aquatic resources, springs, wildlife and endangered/threatened species. A good discussion of the importance of playa basins is included in the IPP. In addition to their biological importance as wetlands, playas also provide local recharge to the Ogallala aquifer. The IPP states that environmental impacts and the protection of the region's resources were a priority in the water management strategies selection process, and potential impacts to sensitive environmental factors were considered for each strategy.

Water-related threats to natural resources, primarily insufficient groundwater and water quality concerns, are also described in the IPP. Surface and groundwater development as well as brush encroachment have altered natural stream flow patterns in the PWPA. In addition, spring flows have declined over the past several decades. Irrigation water conservation strategies are intended to help address this problem. However, according to the IPP, continued depletion of the local aquifers will likely continue to impact base flows of local streams and rivers in the PWPA. Salt cedar removal in the Lake Meredith watershed is a recommended strategy to increase flow into the Canadian River, improve water quality, and improve habitat. The North American Waterfowl Management Joint Venture is discussed as a means of protecting playas as wildlife habitat.

Water conservation and drought management, wastewater reuse, expanded use of existing supplies, new groundwater development, precipitation enhancement and brush control are recommended strategies for meeting future water needs. Drought contingency plans are also included in the IPP. The planning group has proposed water conservation strategies for all municipal and irrigation water users. As appropriate all municipal users are encouraged to reduce per capita water use to achieve the Texas Water Conservation Task Force goal of 140 gallons per person per day (gpcd). Even though conservation is expected to provide 488,165 acre-feet per year of water savings by 2070, the average gpcd for the PWPA is projected to be 195 in 2020, slowly declining to around 170 by 2070.

Mr. Kyle G. Ingham

Page 3 of 3

August 14, 2015


TPWD supports the planning group's consideration of brush control/management as an additional means of conserving water if done in a manner that can also benefit wildlife habitat. TPWD also supports the inclusion of reuse of treated municipal effluent for meeting future water needs however consideration should be given to the impact reduced return flows will have on water bodies like the Prairie Dog Town Fork of the Red River. In addition, disposal of brine concentrate from reverse osmosis treatment associated with direct potable reuse projects may have impacts to aquatic ecosystems if not disposed of properly.

The IPP includes a quantitative reporting of environmental factors (Attachment 5-3), scoring impacts on a scale of 1-5, where 5 is no or positive impact and 1 is highest impact. Narrative descriptions are given for several strategies that may have impacts, noting detailed evaluations will be performed if needed once project details are identified. Where appropriate potential impacts to spring flows, spring ecosystems and playa lakes should be identified, especially where these features continue to support fish and wildlife.

TPWD notes that the plan does not recommend nomination of any stream segments as ecologically unique. TPWD has identified several stream segments in the region that meet at least one of the criteria for classification as ecologically unique should the regional planning group decide to pursue nomination of an ecologically significant stream in the future. We are happy to assist the regional planning group should they elect to go in this direction.

Thank you for your consideration of these comments. TPWD looks forward to continuing to work with the planning group to develop water supply strategies that not only meet the future water supply needs of the region but also preserve the ecological health of the region's aquatic resources. Please contact Cindy Loeffler at (512) 389-8715 if you have any questions or comments.

Sincerely,

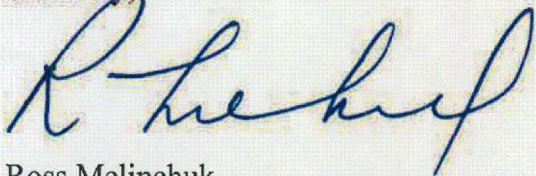

Ross Melinchuk,
Deputy Executive Director, Natural Resources

RM: CL:ms

cc: Craig Bonds, Division Director, Inland Fisheries Division, TPWD
Charlie Munger, Inland Fisheries Division, TPWD



Texas Water Development Board

P.O. Box 13231, 1700 N. Congress Ave.
Austin, TX 78711-3231, www.twdb.texas.gov
Phone (512) 463-7847, Fax (512) 475-2053

July 21, 2015

Mr. C.E. Williams, Chair
Panhandle Regional Water Planning Group
c/o Panhandle GCD
P.O. Box 637
White Deer, Texas 79097

Mr. Kyle Ingham
Panhandle Regional Planning Commission
415 SW 8th Ave
Amarillo, Texas 79101

Re: Texas Water Development Board Comments on the Panhandle Regional Water Planning Group
(Region A) Initially Prepared Plan, Contract No. 1148301312

Dear Mr. Williams and Mr. Ingham:

Texas Water Development Board (TWDB) staff completed a review of the Initially Prepared Plan (IPP) submitted by May 1, 2015 on behalf of the Region A Regional Water Planning Group. The attached comments follow this format:

- **Level 1:** Comments, questions, and online regional water planning database revisions that must be satisfactorily addressed in order to meet statutory, agency rule, and/or contract requirements; and,
- **Level 2:** Comments and suggestions for consideration that may improve the readability and overall understanding of the regional water plan.

The TWDB's statutory requirement for review of potential interregional conflicts under Title 31 Texas Administrative Code (TAC) §357.62 will not be completed until submittal and review of adopted regional water plans. However, as previously requested by our Executive Administrator, please inform TWDB in advance of your final plan if your planning group believes that an interregional conflict exists. Additionally, subsequent review will be performed as the planning group completes its data entry into the regional water planning database (DB17). If issues arise during our ongoing data review, they will be communicated promptly to the planning group to resolve.

Our Mission : Board Members

To provide leadership, information, education, and support for planning, financial assistance, and outreach for the conservation and responsible development of water for Texas

Bech Bruun, Chairman | Carlos Rubinstein, Member | Kathleen Jackson, Member
Kevin Patteson, Executive Administrator

Mr. C.E. Williams
Mr. Kyle Ingham
July 21, 2015
Page 2

Title 31 TAC §357.50(d) requires the regional water planning group to consider timely agency and public comment. Section 357.50(e) requires the final adopted plan include summaries of all timely written and oral comments received, along with a response explaining any resulting revisions or why changes are not warranted. Copies of TWDB's Level 1 and 2 written comments and the region's responses must be included in the final, adopted regional water plan. While the comments included in this letter represent TWDB's review to date, please anticipate the need to respond to additional comments regarding data integrity, including any water source overallocations, in the regional water planning database (DB17) once data entry is completed by the region.

Standard to all planning groups is the need to include certain content in the final regional water plans that was not yet available at the time that IPPs were prepared and submitted. In your final regional water plan, however please be sure to also incorporate the following:

- a) Completed results from the regional planning group's infrastructure financing survey (IFR) for sponsors of recommended projects with capital costs [31 TAC §357.44];
- b) Completed results from the implementation survey [31 TAC §357.45(a)];
- c) The socioeconomic impact evaluation provided by TWDB at the request of the planning group [31 TAC §357.33(c)];
- d) Documentation that comments received on the IPP were considered in the development of the final plan [31 TAC §357.50(d)];
- e) Evidence, such as a certification, that the final, adopted regional water plan is complete and adopted by the planning group [31 TAC §357.50(j)(1)]; and,
- f) The required DB17 reports, as made available by TWDB, in the executive summary or elsewhere in the plan as specified in the Contract [31 TAC §357.50(e)(2)(B), *Contract Scope of Work Task 4D(p), Contract Exhibit 'C', Table 2*]. Please ensure that the numerical values presented in the tables throughout the final, adopted regional water plan are consistent with the data provided in DB17. For the purpose of development of the 2017 State Water Plan, water management strategy and other data entered by the regional water group in DB17 (and as presented in the regional plan) shall take precedence over any conflicting data presented in the final regional water plan [*Contract Exhibit 'C', Sections 12.1.3. and 12.2.2*].

The following items must accompany, separately, the submission of the final, adopted regional water plan:

- The prioritized list of all recommended projects in the regional water plan [*Texas Water Code 15.436(a), Contract Scope of Work Task 13*]; and,
- Any remaining hydrologic modeling files or GIS files that may not have been provided at the time of the submission of the IPP but that were used in developing the final plan. [31 TAC §357.50(e)(2)(C), *Contract Exhibit 'C', Section 12.2.1; Contract Scope of Work Task 3-III-13*]

Note that provision of certain content in an electronic-only form is permissible as follows: Internet links are permissible as a method for including model conservation and drought contingency plans within the final regional water plan; hydrologic modeling files may be submitted as electronic appendices, however

Mr. C.E. Williams
Mr. Kyle Ingham
July 21, 2015
Page 3

all other regional water plan appendices should be incorporated in hard copy format within each plan [31 TAC §357.50(e)(2)(C), Contract Scope of Work Task 5e, Contract Exhibit 'C', Section 12.2.1].


The following general requirements that apply to recommended water management strategies must be adhered to in all final regional water plans including:

- Regional water plans must not include any strategies or costs that are associated with simply maintaining existing water supplies or replacing existing infrastructure. Plans may include only infrastructure costs that are associated with volumetric increases of treated water supplies delivered to water user groups or that result in more efficient use of existing supplies [31 TAC §357.10(28), §357.34(d)(3)(A), Contract Exhibit 'C', Section 5.1.2.2, Section 5.1.2.3]; and,
- Regional water plans must not include any retail distribution-level infrastructure costs (other than those costs related to conservation strategies such as water loss reduction) [31 TAC §357.10(28), §357.34(d)(3)(A), Contract Exhibit 'C', Section 5.1.2.3].

To facilitate efficient and timely completion, and Board approval, of your final regional water plan, please provide your TWDB project manager with early drafts of your responses to these IPP comments for preliminary review and feedback.

If you have any questions regarding these comments or would like to discuss your approach to addressing any of these comments, please do not hesitate to contact Sarah Backhouse at (512) 936-2387. TWDB staff will be available to assist you in any way possible to ensure successful completion of your final regional water plan.

Sincerely,



Jeff Walker
Deputy Executive Administrator
Water Supply and Infrastructure

Attachments

cc w/att: Ms. Simone Kiel, Freese & Nichols, Inc.

TWDB Comments on the Initially Prepared 2016 Panhandle (Region A) Regional Water Plan

Level 1: Comments and questions must be satisfactorily addressed in order to meet statutory, agency rule, and/or contract requirements.

1. Sections 5B.1 and 5B.2: For the municipal and irrigation conservation strategies, please specify the volume of water associated with each component of these strategies that have a capital cost in the final, adopted regional water plan. [*Contract Exhibit 'D', Section 5.4*]
2. Please provide a statement regarding any water availability requirements promulgated by a county commissioners court pursuant to Texas Water Code §35.109, which in Region A applies to the Dallam County Priority Groundwater Management Area. [*31 Texas Administrative Code (TAC) §357.22(a)(6)*]
3. Please indicate how the planning group considered the regionalization of water and wastewater services in the final, adopted regional water plan. [*31 TAC §357.22 (a)(10)*]
4. Section 2.7: The plan does not include projected demands associated with each wholesale water provider (WWP), by category of water use and county and river basin splits. Please include WWP demands in the final, adopted regional water plan. [*31 TAC §357.31(b)(d)*]
5. Section 2.7: It is not clear whether the plan presents the current contractual obligations of WWPs. Please include WWP contractual obligations in the final, adopted regional water plan. [*31 TAC §357.31 (c)*]
6. Please include a summary of the municipal demand savings due to plumbing fixture requirements (as previously provided by TWDB) in the final, adopted regional water plan. [*31 TAC §357.31(d)*]
7. The plan does not appear to include projected needs associated with each WWP, by category of use and county and river basin splits. Please include WWP needs in the final, adopted regional water plan. [*31 TAC §357.33 (b),(d)*]
8. Section 5D.5.1, pages 5-69, 5-70; and Section 5D.8.2, pages 5-85, 5-86: The plan appears to include water management strategies with treatment infrastructure that does not increase the volume of supply to water user groups. For example Nitrate Treatment for the City of Wellington and Nitrate Removal for the City of Lakeview. Regional water plans must not include any strategies or costs that are associated with simply maintaining existing water supplies or replacing infrastructure. Plans may include only infrastructure costs that are associated with volumetric increases of treated water supplies delivered to water user groups or that result in more efficient use of existing supplies. Please revise as appropriate throughout the final, adopted regional water plan. [*Contract Exhibit 'C', Sections 5.1.2.2 and 5.1.2.3*]

9. Section 5C.1.3, page 5-40 and Table 5C-2, page 5-41: The conjunctive use water management strategy appears to be combined with a brush management strategy. Unless the projects are directly interdependent, and reflected as such in DB17, each project and strategy must be associated with volumes of water provided by a single strategy type and should not be lumped together with other types of strategies. Strategy types must remain independent of one another for purposes of accounting of water availability, to reflect implementation, and to facilitate project prioritizations. Please revise as appropriate throughout the final, adopted regional water plan. *[31 TAC 357.34 (e); Contract Exhibit 'D', Section 5.3]*
10. Page ES-10, 5-40: Table ES-6 notes that costs for brush control were not calculated on an acre-feet per year basis and instead presents an annual cost for the strategy, as referenced on page 5-40, in unit costs column. Please present the unit cost of the strategy in the final, adopted regional plan. A footnote may be added to Table ES-6 to note the annual cost. *[31 TAC §357.34 (d)(2), Contract Exhibit 'C', Section 5.1.2]*
11. Table ES-6 and Sections 5D.12.4, 5D.13.2, and 5D.14.5: Please specify a quantified volume of water supply for the following strategies if they are to be included in the recommended water management strategy table: Manufacturing, Hutchinson: Purchase from Borger; Manufacturing, Lipscomb: Purchase from Booker; and Manufacturing, Moore: Purchase from Cactus. *[31 TAC 357.34 (d)(3)(A)]*
12. The plan in some instances, does not appear to include a quantitative reporting of environmental factors. For example: pages 5-40 and 5-45 provide qualitative descriptions as "concern" about habitat and "low" impacts, respectively, but the plan does not appear to include quantification of the impacts. Additionally, Attachment 5-3 presents a numeric scoring system but it is unclear if the scoring system is based upon quantitative data. Please include quantitative reporting in the final, adopted regional water plan. *[31 TAC 357.34 (d)(3)(B)]*
13. The plan in some instances, does not appear to include a quantitative reporting of impacts to agricultural resources. For example, page 5-45 provides a qualitative description as "low impact on agriculture" but does not appear to include quantification of the non-zero impact. Additionally, Attachment 5-2 presents a numeric, qualitative scoring system but it is unclear if the scoring system is based upon quantitative data. Please include quantitative reporting of impacts to agricultural resources in the final, adopted regional water plan. *[31 TAC 357.34 (d)(3)(C)]*
14. Chapter 7: The plan does not provide a general description of the local drought contingency plans that involve making emergency connections between water systems or wholesale systems. Please include these descriptions of local drought contingency plans, if any, in the final, adopted regional water plan or, if no local drought contingency plans involve making emergency connections, please indicate so in the final, adopted regional water plan. *[31 TAC §357.42 (e)]*


15. Section 11.2.7, page 11-11: The plan does not include a summary of how identified water needs for WVPs differ from the 2011 regional water plan. Please include summary in the final, adopted regional water plan. [31 TAC §357.45 (b)(3)]
16. The plan does not appear to include a listing of the water rights that are the basis for the surface water availability in the plan. Please include such a listing in the final, adopted regional water plan. [Contract Exhibit 'C', Section 3.1]
17. Page 3-17, Table 3-10: Please clarify how the run-of-river availabilities were calculated for municipal water users to ensure that all monthly demands are fully met for the entire simulation of the unmodified WAM Run 3 in the final, adopted regional water plan. [Contract Exhibit 'C', Section 3.4]
18. The technical evaluations of the water management strategies do not appear to estimate water losses from the associated strategies. Please include an estimate of water losses in the final, adopted regional water plan, for example in a format of an estimated percent loss. [31 TAC §357.34(d)(3)(A); Contract Exhibit 'C', Section 5.1.1]

| |
|---|
| <p>Level 2: Comments and suggestions for consideration that may improve the readability and overall understanding of the regional water plan.</p> |
|---|

1. Table ES-2, page ES-5 and Table 3-15, page 3-25: The DB17 source availability report shows Palo Duro Reservoir to have an availability volume ranging from 3,917 AFY through 3,708 AFY over the planning horizon but the referenced tables (Tables ES-2 and 3-15) show this availability as zero. Please reflect the DB17 availability numbers in these tables and throughout the plan as appropriate.
2. Table 3-21, page 3-33. Please consider relabeling the decade table headers. Decade 2020 is labeled twice, therefore the table header does not include the decade 2070.
3. Table 4-1, page 4-2. The supply volumes shown in Table 4-1 do not match the total existing supply from DB17 in all decades. For example, 2030 supply in Table 4-1 is 1,450,997 AFY compared to the 2030 value in the existing water supply report of 1,451,002 AFY. Please consider revising accordingly.
4. Page 5-41, Table 5C-2: The plan does not present strategy supply volumes for CRMWA conservation strategies for Region O Customers presented in Table 5C-2. Please consider including the conservation information for Region O customers in final, adopted regional water plan, or consider including a footnote that this information can be found in the Region O plan.
5. Section 5C.2.4, Pages 5-46 through 5-47: The "Impact on Water Resources and other Management strategies" subsection states that the direct potable reuse could impact the amount of direct non-potable reuse currently being made available in Potter County for steam electric and potentially for manufacturing. Please consider providing volumes to quantify the impact in the final, adopted regional water plan. For example, quantify the

volume of wastewater discharge from Amarillo and its associated allocations (direct potable reuse, steam electric power generation, and manufacturing).

6. Chapter 7: Please consider including more detailed information on drought triggers and actions from current drought contingency plans by entity in the final, adopted regional water plan.
7. Table 7-5: Given that County-Other sub-water user groups (WUG) are presented in the potential emergency response analysis, please clarify whether all entities in the County-Other WUG are represented. If not, please consider including an analysis for the remainder of the County-Other population, by County, in the final, adopted regional water plan.

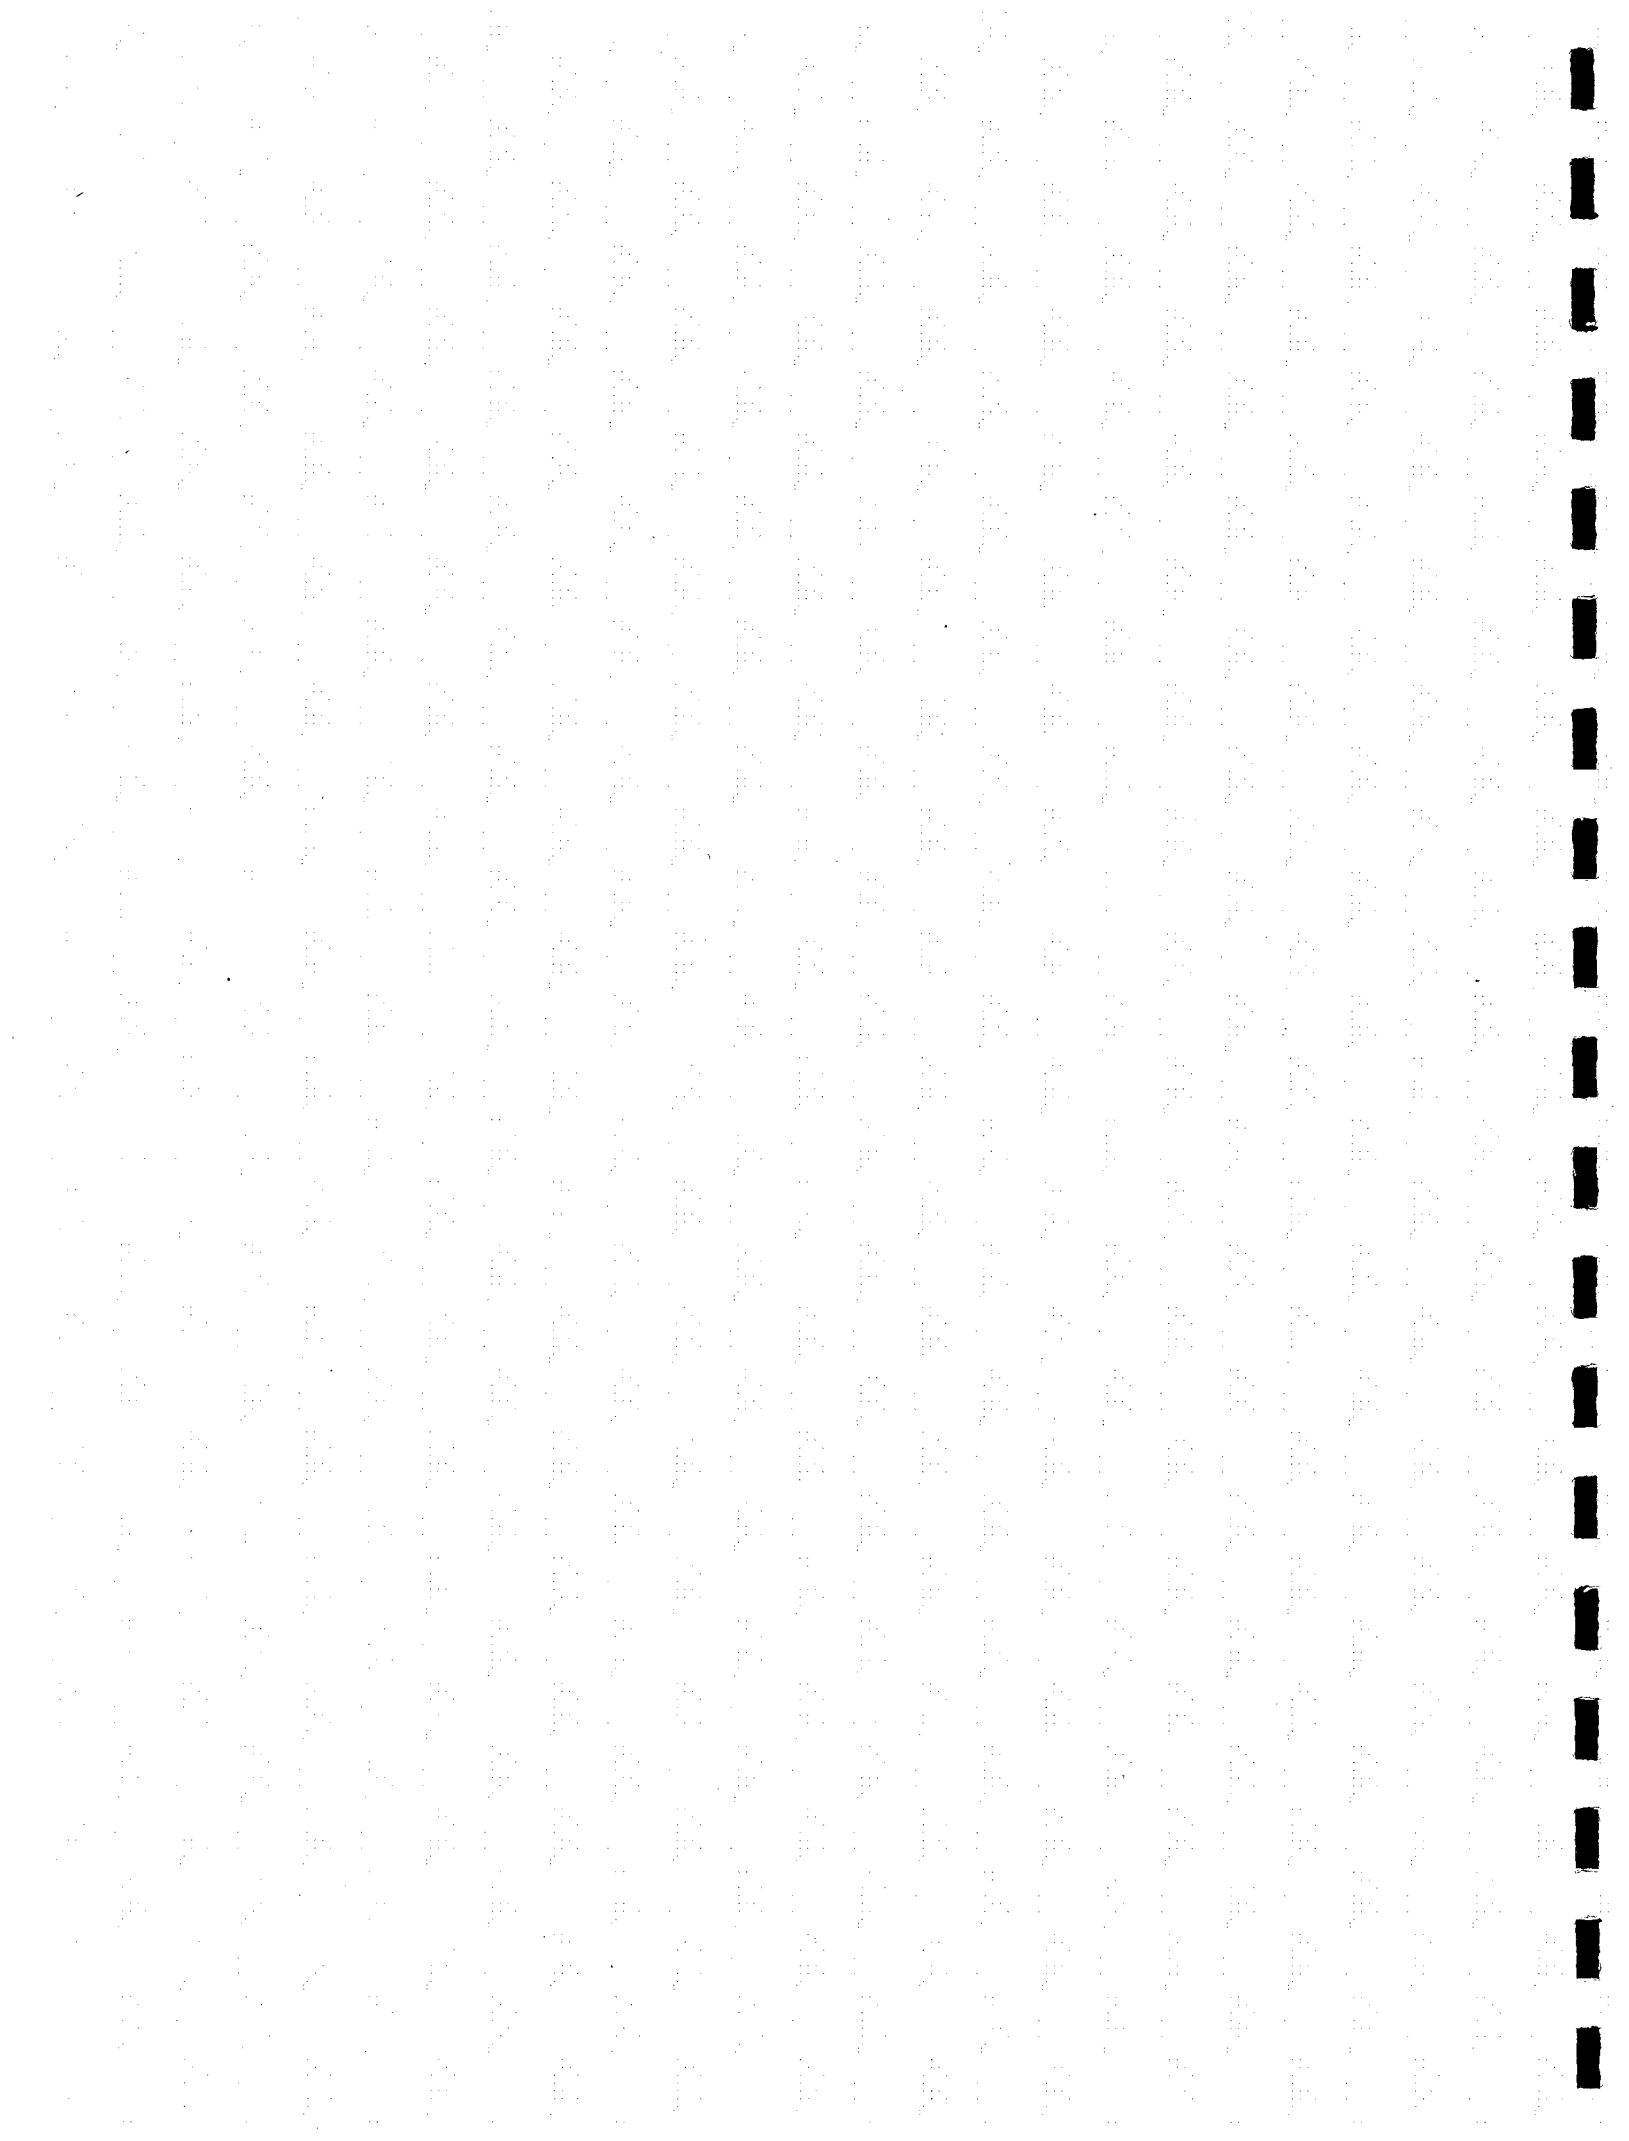

TWDB Comments on the Initially Prepared 2016 Panhandle (Region A) Regional Water Plan

Level 1: Comments and questions must be satisfactorily addressed in order to meet statutory, agency rule, and/or contract requirements.

1. Sections 5B.1 and 5B.2: For the municipal and irrigation conservation strategies, please specify the volume of water associated with each component of these strategies that have a capital cost in the final, adopted regional water plan. [*Contract Exhibit 'D', Section 5.4*]

The volume of water associated with a capital cost is detailed in the data tables in Appendix K. The text in Section 5B.1.3 was modified to show that the capital costs for municipal conservation are associated with leak detection and repair. A footnote was also added to Table 5B-9 that states the capital costs shown for the irrigation combination strategy is associated with irrigation equipment changes.

2. Please provide a statement regarding any water availability requirements promulgated by a county commissioners court pursuant to Texas Water Code §35.109, which in Region A applies to the Dallam County Priority Groundwater Management Area. [*31 Texas Administrative Code (TAC) §357.22(a)(6)*]

A discussion on Priority Groundwater Management Areas (PGMA) was added to Section 1.5.1, Groundwater Regulation. As of 2012, all of the area within the Dallam County PGMA has been incorporated into the North Plains GCD. Therefore, regulation of groundwater within the previously designated Dallam County PGMA is promulgated by the North Plains GCD. To our knowledge, no additional regulation has been promulgated by the Dallam County Commissioner's Court. This statement was added to Section 1.5.1.

3. Please indicate how the planning group considered the regionalization of water and wastewater services in the final, adopted regional water plan. [*31 TAC §357.22 (a)(10)*]

A statement was added in Chapter 5A indicating that where appropriate, regional strategies to supply water were considered. The PWPG did not consider regionalization of wastewater services since regional water planning focuses on water supply needs, not wastewater needs.

4. Section 2.7: The plan does not include projected demands associated with each wholesale water provider (WWP), by category of water use and county and river basin splits. Please include WWP demands in the final, adopted regional water plan. [*31 TAC §357.31(b)(d)*]

The details of the wholesale water provider demands are included in the data reports in Appendix K of the plan.

5. Section 2.7: It is not clear whether the plan presents the current contractual obligations of WWPs. Please include WWP contractual obligations in the final, adopted regional water plan. [31 TAC §357.31 (c)]

A statement was added to Section 2.7 that clarifies the demands represent the current contract obligations and expected future demands of existing customers. This was developed with input by the wholesale water provider and is truly representative of the demand on the wholesale water provider in the PWPA. To only include current contract obligations does not represent the intent of the provider or customer. Many of the providers are obligated to meet their customers' water needs without a contract limit. Also, the PWPG does not have copies of the contracts to provide this information.

6. Please include a summary of the municipal demand savings due to plumbing fixture requirements (as previously provided by TWDB) in the final, adopted regional water plan. [31 TAC §357.31(d)]

A new table was added to Chapter 2 that shows the municipal demand savings due to plumbing fixtures by county.

7. The plan does not appear to include projected needs associated with each WWP, by category of use and county and river basin splits. Please include WWP needs in the final, adopted regional water plan. [31 TAC §357.33 (b),(d)]

The details of the wholesale water provider needs are included in the data reports in Appendix K of the plan.

8. Section 5D.5.1, pages 5-69, 5-70; and Section 5D.8.2, pages 5-85, 5-86: The plan appears to include water management strategies with treatment infrastructure that does not increase the volume of supply to water user groups. For example Nitrate Treatment for the City of Wellington and Nitrate Removal for the City of Lakeview. Regional water plans must not include any strategies or costs that are associated with simply maintaining existing water supplies or replacing infrastructure. Plans may include only infrastructure costs that are associated with volumetric increases of treated water supplies delivered to water user groups or that result in more efficient use of existing supplies. Please revise as appropriate throughout the final, adopted regional water plan. [Contract Exhibit 'C', Sections 5.1.2.2 and 5.1.2.3]

The strategies for the cities of Wellington and Lakeview are included in the PWPA water plan because the current supplies do not meet federal drinking water standards for nitrate. To better represent this water quality limitation, the current supplies for these entities is now shown as zero (0) due to water quality limitations. The strategies are retained in the final plan and shown with the appropriate volume of water to meet the entity's water needs. Appropriate changes were made to Chapters 3 and 5.

9. Section 5C.1.3, page 5-40 and Table 5C-2, page 5-41: The conjunctive use water management strategy appears to be combined with a brush management strategy. Unless the projects are directly interdependent, and reflected as such in DB17, each project and strategy must be associated with volumes of water provided by a single strategy type and

should not be lumped together with other types of strategies. Strategy types must remain independent of one another for purposes of accounting of water availability, to reflect implementation, and to facilitate project prioritizations. Please revise as appropriate throughout the final, adopted regional water plan. [31 TAC 357.34 (e); Contract Exhibit 'D', Section 5.3]

The conjunctive use strategy and brush control are interdependent strategies for CRMWA. Under drought of record conditions, brush control has no supply. This is also the assumption for Lake Meredith for planning purposes (the drought of record is on-going). However, used conjunctively with CRMWA's groundwater sources, water is made available in Lake Meredith through brush control and periodic inflows to Lake Meredith. The strategy is conjunctive use, and brush control is a project component of that strategy. In addition, aquifer storage and recovery was also added to the conjunctive use strategy as a project component. This project would be used to storage water made available under conjunctive use. This is how the project is currently represented in the state's database (DB17). Where appropriate, clarifications were made in the plan to reflect this interdependent relationship.

10. Page ES-10, 5-40: Table ES-6 notes that costs for brush control were not calculated on an acre-feet per year basis and instead presents an annual cost for the strategy, as referenced on page 5-40, in unit costs column. Please present the unit cost of the strategy in the final, adopted regional plan. A footnote may be added to Table ES-6 to note the annual cost. [31 TAC §357.34 (d)(2), Contract Exhibit 'C', Section 5.1.2]

The costs were modified to represent the conjunctive use strategy that includes brush control.

11. Table ES-6 and Sections 5D.12.4, 5D.13.2, and 5D.14.5: Please specify a quantified volume of water supply for the following strategies if they are to be included in the recommended water management strategy table: Manufacturing, Hutchinson: Purchase from Borger; Manufacturing, Lipscomb: Purchase from Booker; and Manufacturing, Moore: Purchase from Cactus. [31 TAC 357.34 (d)(3)(A)]

The purchase of water from a water supplier is associated with supplies developed by the provider. These strategies were removed from Table ES-6. No changes were made to Subchapter 5D. Details of the supply amounts to customers of water suppliers are included in the database reports in Appendix K of the plan.

12. The plan in some instances, does not appear to include a quantitative reporting of environmental factors. For example: pages 5-40 and 5-45 provide qualitative descriptions as "concern" about habitat and "low" impacts, respectively, but the plan does not appear to include quantification of the impacts. Additionally, Attachment 5-3 presents a numeric scoring system but it is unclear if the scoring system is based upon quantitative data. Please include quantitative reporting in the final, adopted regional water plan. [31 TAC 357.34 (d)(3)(B)]

An explanation of the quantitative reporting of impacts was added to Attachment 5-3, Evaluation Matrix. Where appropriate, elaboration of impacts in the discussions in Chapter 5 was added. In many cases, there are no data available on quantifiable impacts. Therefore, assumptions were made that may or may not result in reasonable estimates of quantifiable impacts. Actual impacts will be developed during the design of the project, which is beyond the scope of regional water planning.

13. The plan in some instances, does not appear to include a quantitative reporting of impacts to agricultural resources. For example, page 5-45 provides a qualitative description as "low impact on agriculture" but does not appear to include quantification of the non-zero impact. Additionally, Attachment 5-2 presents a numeric, qualitative scoring system but it is unclear if the scoring system is based upon quantitative data. Please include quantitative reporting of impacts to agricultural resources in the final, adopted regional water plan. [31 TAC 357.34 (d)(3)(C)]

An explanation of the quantitative reporting of impacts was added to Attachment 5-3, Evaluation Matrix. Where appropriate, elaboration of impacts in the discussions in Chapter 5 was added. In many cases, there are no data available on quantifiable impacts. Therefore, assumptions were made that may or may not result in reasonable estimates of quantifiable impacts. Actual impacts will be developed during the design of the project, which is beyond the scope of regional water planning.

14. Chapter 7: The plan does not provide a general description of the local drought contingency plans that involve making emergency connections between water systems or wholesale systems. Please include these descriptions of local drought contingency plans, if any, in the final, adopted regional water plan or, if no local drought contingency plans involve making emergency connections, please indicate so in the final, adopted regional water plan. [31 TAC §357.42 (e)]

Existing emergency connections are discussed in Section 7.3.1. The PWPG did not receive any local drought contingency plans that specified emergency connections in response to drought. A summary of the local drought contingency plans was added as an attachment to Chapter 7.

15. Section 11.2.7, page 11-11: The plan does not include a summary of how identified water needs for WWPs differ from the 2011 regional water plan. Please include summary in the final, adopted regional water plan. [31 TAC §357.45 (b)(3)]

A summary of how identified water needs for wholesale water providers in the 2016 water plan differ from the 2011 regional water plan was added to Chapter 11.

16. The plan does not appear to include a listing of the water rights that are the basis for the surface water availability in the plan. Please include such a listing in the final, adopted regional water plan. [Contract Exhibit 'C', Section 3.1]

A listing of water rights was added to the Appendix C, WAM Analysis for PWPA Water Availability. A reference to this information was added to Chapter 3.

17. Page 3-17, Table 3-10: Please clarify how the run-of-river availabilities were calculated for municipal water users to ensure that all monthly demands are fully met for the entire simulation of the unmodified WAM Run 3 in the final, adopted regional water plan. [Contract Exhibit 'C', Section 3.4]

Additional documentation of how the run-of-river availabilities were calculated was added to Appendix C.

18. The technical evaluations of the water management strategies do not appear to estimate water losses from the associated strategies. Please include an estimate of water losses in the final, adopted regional water plan, for example in a format of an estimated percent loss. [31 TAC §357.34(d)(3)(A); Contract Exhibit 'C', Section 5.1.1]

The assumptions that were used to estimate of the water losses associated with strategies were added to the discussion in Chapter 5A.

| |
|---|
| <p>Level 2: Comments and suggestions for consideration that may improve the readability and overall understanding of the regional water plan.</p> |
|---|

1. Table ES-2, page ES-5 and Table 3-15, page 3-25: The DB17 source availability report shows Palo Duro Reservoir to have an availability volume ranging from 3,917 AFY through 3,708 AFY over the planning horizon but the referenced tables (Tables ES-2 and 3-15) show this availability as zero. Please reflect the DB17 availability numbers in these tables and throughout the plan as appropriate.

The availability values shown in DB17 were documented in the referenced tables with a footnote that clarifies there is no infrastructure to access these supplies.

2. Table 3-21, page 3-33. Please consider relabeling the decade table headers. Decade 2020 is labeled twice, therefore the table header does not include the decade 2070.

The decade table headers were relabeled.

3. Table 4-1, page 4-2. The supply volumes shown in Table 4-1 do not match the total existing supply from DB17 in all decades. For example, 2030 supply in Table 4-1 is 1,450,997 AFY compared to the 2030 value in the existing water supply report of 1,451,002 AFY. Please consider revising accordingly.

The final numbers in the plan were reviewed and updated, as needed, to match the values reported from DB17 in all decades. Where there were rounding differences, no changes were made.

4. Page 5-41, Table 5C-2: The plan does not present strategy supply volumes for CRMWA conservation strategies for Region O Customers presented in Table 5C-2. Please consider including the conservation information for Region O customers in final, adopted regional water plan, or consider including a footnote that this information can be found in the Region O plan.

The customer conservation for customers in the Llano Estacado Region (Region O) were added to Table 5C-2.

5. Section 5C.2.4, Pages 5-46 through 5-47: The "Impact on Water Resources and other Management strategies" subsection states that the direct potable reuse could impact the amount of direct non-potable reuse currently being made available in Potter County for steam electric and potentially for manufacturing. Please consider providing volumes to quantify the impact in the final, adopted regional water plan. For example, quantify the volume of wastewater discharge from Amarillo and its associated allocations (direct potable reuse, steam electric power generation, and manufacturing).


Over time the expected amount of wastewater generated by Amarillo will increase. The city has a contract to sell all of its reuse to Xcel Energy. However, Xcel Energy is not using 100% of the available treated wastewater. The water demands developed by the TWDB show SEP demands increasing over time in Potter County. However, Xcel Energy does not plan to significantly increase its production and there are no other known SEP facilities planned for Potter County. The PWPA plan currently shows 100% of the SEP demand in Potter County being met by reuse purchased from Amarillo, but some of that reuse water is likely to be available to other manufacturers and/or Amarillo. There is potentially up to 10 MGD of reuse water available above the projected demands for steam electric power. More may be available if the projected SEP demands are low. However, it is uncertain whether this water can be contracted without consent of Xcel Energy. These considerations were added to the strategy descriptions.

6. Chapter 7: Please consider including more detailed information on drought triggers and actions from current drought contingency plans by entity in the final, adopted regional water plan.

A summary of the local drought contingency plans was added as an attachment to Chapter 7, Attachment 7-2.

7. Table 7-5: Given that County-Other sub-water user groups (WUG) are presented in the potential emergency response analysis, please clarify whether all entities in the County-Other WUG are represented. If not, please consider including an analysis for the remainder of the County-Other population, by County, in the final, adopted regional water plan.


A footnote was added to Table 7-5 to clarify the selection of entities listed under County-Other.



Appendix J
Implementation Survey



| Sponsor | Recommended Water Management Strategy | DBProjectID | CapitalCost | SS2010 | SS2020 | SS2030 | SS2040 | SS2050 | SS2060 | Y denotes strategies with supply volumes included in other strategies | Project Description | Infrastructure Type* | At what level of implementation is the project?* | If not implemented, why?* | Initial Volume of Water Provided (acft/yr) | Funds Expended to Date (\$) | Project Cost (\$ (should include development and construction costs) | Year the Project is Online?* | Is this a phased project?* | (Phased) Ultimate Volume (acft/yr) | (Phased) Ultimate Project Cost (\$) | Year project reaches maximum capacity?* | What is the project funding source(s)?* | Included in the 2016 Plan?* | Comments |
|----------------------------------|---------------------------------------|-------------|---------------|--------|--------|---------|---------|---------|---------|---|---|----------------------|---|---------------------------|--|-----------------------------|--|------------------------------|--|------------------------------------|-------------------------------------|---|---|-----------------------------|--|
| AMARILLO | Municipal conservation | 188 | \$0 | 0 | 1,375 | 2,453 | 2,639 | 2,841 | 3,012 | N | Municipal Conservation | No Infrastructure | Sponsor Has Taken Official Action to Initiate Project | | | | | | | | | | | Yes | |
| AMARILLO | Potter County well field | 814 | \$128,511,300 | 0 | 9,467 | 10,292 | 11,182 | 11,141 | 10,831 | N | Phase 1 well field | Wells | Currently Operating | | 10000 | | | 2011 | Yes | 18000 | | 2030 | TWDB | Yes | Phase II included in the 2016 Plan; Supply amount limited by MAG |
| AMARILLO | Roberts County well field - Amarillo | 630 | \$287,377,200 | 0 | 0 | 0 | 11,210 | 11,210 | 22,420 | N | Develop wellfield | Wells | Not Implemented | Too soon | | | | | | | | | | Yes | |
| BORGER | Drill additional groundwater well | 194 | \$9,379,200 | 0 | 0 | 1,000 | 1,000 | 2,000 | 2,000 | N | Develop wellfield | Wells | Under Construction | | | | | 2015 | No | | | | | Yes | Production wells, pipelines, pumps, and storage facilities have been constructed and the project should be on-line in 2015 |
| BORGER | Municipal conservation | 188 | \$0 | 0 | 24 | 71 | 114 | 107 | 102 | N | Municipal Conservation | No Infrastructure | Sponsor Has Taken Official Action to Initiate Project | | | | | | | | | | | Yes | |
| CACTUS | Drill additional groundwater well | 194 | \$10,893,400 | 500 | 1,500 | 1,500 | 3,000 | 3,000 | 3,000 | N | Develop wellfield | Wells | Sponsor Has Taken Official Action to Initiate Project | | | | | | | | | | | Yes | |
| CACTUS | Municipal conservation | 188 | \$0 | 0 | 18 | 31 | 31 | 31 | 31 | N | Municipal Conservation | No Infrastructure | Sponsor Has Taken Official Action to Initiate Project | | | | | | | | | | | Yes | |
| CANADIAN RIVER MUNICIPAL WATER | CRMWA acquisition of water rights | 903 | \$88,200,000 | 0 | 0 | 0 | 0 | 0 | 0 | N | Acquire additional water rights in Roberts County | No Infrastructure | All Phases Fully Implemented | | | 0 | | 2011 | Yes | 448333 | | | | No | See related project to develop infrastructure to use water rights |
| CANADIAN RIVER MUNICIPAL WATER | CRMWA Roberts County well field | 816 | \$21,824,000 | 0 | 0 | 15,000 | 15,000 | 15,000 | 15,000 | N | Develop wellfield | Wells | Feasibility Study Ongoing | | | | | | | | | | | Yes | Phase II included in the 2016 Plan |
| CANYON | Drill additional groundwater well | 194 | \$9,528,800 | 700 | 1,400 | 2,100 | 2,800 | 2,800 | 3,800 | N | Develop wellfield | Wells | Under Construction | | | | | 2015 | Yes, but the Water Plan shows only 1 phase | | | | | Yes | |
| CANYON | Municipal conservation | 188 | \$0 | 0 | 80 | 176 | 191 | 208 | 227 | N | Municipal Conservation | No Infrastructure | Sponsor Has Taken Official Action to Initiate Project | | | | | | | | | | | Yes | |
| COUNTY-OTHER, HALL | Drill additional groundwater well | 194 | \$2,522,400 | 150 | 150 | 150 | 200 | 200 | 200 | N | Develop wellfield | Wells | Not Implemented | Other | | | | | | | | | | Yes | |
| COUNTY-OTHER, MOORE | Drill additional groundwater well | 194 | \$3,114,800 | 0 | 0 | 500 | 500 | 1,000 | 1,000 | N | Develop wellfield | Wells | Not Implemented | Other | | | | | | | | | | Yes | |
| COUNTY-OTHER, MOORE | Municipal conservation | 188 | \$0 | 0 | 29 | 63 | 75 | 83 | 87 | N | Municipal Conservation | No Infrastructure | Sponsor Has Taken Official Action to Initiate Project | | | | | | | | | | | Yes | |
| COUNTY-OTHER, MOORE | Voluntary transfers from other users | 192 | \$0 | 0 | 0 | 50 | 100 | 100 | 100 | Y | Purchase from Cactus, Dumas | Other | Not Implemented | Other | | | | | | | | | | No | New groundwater wells to meet need in 2016 Plan |
| COUNTY-OTHER, POTTER | Drill additional groundwater well | 194 | \$8,559,400 | 0 | 600 | 600 | 1,600 | 2,200 | 2,200 | N | Develop wellfield | Wells | Not Implemented | Other | | | | | | | | | | Yes | |
| COUNTY-OTHER, POTTER | Municipal conservation | 188 | \$0 | 0 | 69 | 143 | 174 | 209 | 236 | N | Municipal Conservation | No Infrastructure | Sponsor Has Taken Official Action to Initiate Project | | | | | | | | | | | Yes | |
| COUNTY-OTHER, RANDALL | Drill additional groundwater well | 194 | \$10,889,220 | 0 | 0 | 600 | 1,200 | 1,800 | 2,400 | N | Develop wellfield | Wells | Not Implemented | Other | | | | | | | | | | Yes | |
| COUNTY-OTHER, RANDALL | Municipal conservation | 188 | \$0 | 0 | 101 | 197 | 231 | 268 | 299 | N | Municipal Conservation | No Infrastructure | Sponsor Has Taken Official Action to Initiate Project | | | | | | | | | | | Yes | |
| DUMAS | Drill additional groundwater well | 194 | \$7,997,200 | 0 | 387 | 1,163 | 1,672 | 2,219 | 2,500 | N | Develop wellfield | Wells | Sponsor Has Taken Official Action to Initiate Project | | | 700 | | Yes | 2500 | | | | | Yes | Dumas has added new wells to its existing well fields. This project considers a new well field, which has not been initiated. The project in 2016 plan is larger. |
| DUMAS | Municipal conservation | 188 | \$0 | 0 | 89 | 158 | 166 | 171 | 174 | N | Municipal Conservation | No Infrastructure | Sponsor Has Taken Official Action to Initiate Project | | | | | | | | | | | Yes | |
| FRITCH | Drill additional groundwater well | 194 | \$4,006,900 | 200 | 400 | 400 | 400 | 400 | 400 | N | Develop wellfield | Wells | Not Implemented | Other | | | | | | | | | | No | No longer a need in the 2016 Plan GMIWA has constructed new wells near its lake. This strategy describes a larger well field in north Donley County, which has not been constructed. |
| GREENBELT MUNICIPAL & INDUSTRIAL | Drill additional groundwater well | 194 | \$1,865,900 | 0 | 800 | 800 | 800 | 800 | 800 | N | Develop wellfield | Wells | Not Implemented | Other | | | | | | | | | | Yes | |
| GRUVER | Drill additional groundwater well | 194 | \$1,968,500 | 0 | 350 | 350 | 350 | 350 | 350 | N | Develop wellfield | Wells | Not Implemented | Other | | | | | | | | | | Yes | |
| GRUVER | Municipal conservation | 188 | \$0 | 0 | 10 | 16 | 17 | 17 | 17 | N | Municipal Conservation | No Infrastructure | Sponsor Has Taken Official Action to Initiate Project | | | | | | | | | | | Yes | |
| IRRIGATION, ARMSTRONG | Irrigation conservation | 239 | \$0 | 0 | 2,170 | 2,251 | 2,397 | 2,478 | 2,558 | N | Irrigation Conservation | No Infrastructure | Sponsor Has Taken Official Action to Initiate Project | | | | | | | | | | | Yes | |
| IRRIGATION, ARMSTRONG | Precipitation enhancement | 815 | \$0 | 0 | 785 | 785 | 785 | 785 | 785 | N | Weather Modification to increase precipitation | No Infrastructure | Currently Operating | | | | | | | | | | | Yes | |
| IRRIGATION, CARSON | Irrigation conservation | 239 | \$0 | 0 | 17,316 | 17,957 | 19,112 | 19,754 | 20,395 | N | Irrigation Conservation | No Infrastructure | Sponsor Has Taken Official Action to Initiate Project | | | | | | | | | | | Yes | |
| IRRIGATION, CARSON | Precipitation enhancement | 815 | \$0 | 0 | 6,221 | 6,221 | 6,221 | 6,221 | 6,221 | N | Weather Modification to increase precipitation | No Infrastructure | Currently Operating | | | | | | | | | | | Yes | |
| IRRIGATION, CHILDRESS | Irrigation conservation | 239 | \$0 | 0 | 1,640 | 1,704 | 1,819 | 1,883 | 1,946 | N | Irrigation Conservation | No Infrastructure | Sponsor Has Taken Official Action to Initiate Project | | | | | | | | | | | Yes | |
| IRRIGATION, COLLINGSWORTH | Irrigation conservation | 239 | \$0 | 0 | 2,879 | 3,021 | 3,276 | 3,418 | 3,560 | N | Irrigation Conservation | No Infrastructure | Sponsor Has Taken Official Action to Initiate Project | | | | | | | | | | | Yes | |
| IRRIGATION, DALLAM | Irrigation conservation | 190 | \$0 | 0 | 59,275 | 108,476 | 121,561 | 122,958 | 122,958 | N | Irrigation Conservation | No Infrastructure | Sponsor Has Taken Official Action to Initiate Project | | | | | | | | | | | Yes | |
| IRRIGATION, DONLEY | Irrigation conservation | 239 | \$0 | 0 | 2,910 | 3,031 | 3,249 | 3,370 | 3,490 | N | Irrigation Conservation | No Infrastructure | Sponsor Has Taken Official Action to Initiate Project | | | | | | | | | | | Yes | |
| IRRIGATION, DONLEY | Precipitation enhancement | 815 | \$0 | 0 | 1,179 | 1,179 | 1,179 | 1,179 | 1,179 | N | Weather Modification to increase precipitation | No Infrastructure | Currently Operating | | | | | | | | | | | Yes | |
| IRRIGATION, GRAY | Irrigation conservation | 239 | \$0 | 0 | 5,279 | 5,475 | 5,825 | 6,019 | 6,214 | N | Irrigation Conservation | No Infrastructure | Sponsor Has Taken Official Action to Initiate Project | | | | | | | | | | | Yes | |
| IRRIGATION, GRAY | Precipitation enhancement | 815 | \$0 | 0 | 1,886 | 1,886 | 1,886 | 1,886 | 1,886 | N | Weather Modification to increase precipitation | No Infrastructure | Currently Operating | | | | | | | | | | | Yes | |
| IRRIGATION, HALL | Irrigation conservation | 239 | \$0 | 0 | 3,220 | 3,354 | 3,595 | 3,728 | 3,862 | N | Irrigation Conservation | No Infrastructure | Sponsor Has Taken Official Action to Initiate Project | | | | | | | | | | | Yes | |
| IRRIGATION, HANSFORD | Irrigation conservation | 239 | \$0 | 0 | 24,436 | 45,264 | 51,215 | 51,951 | 51,951 | N | Irrigation Conservation | No Infrastructure | Sponsor Has Taken Official Action to Initiate Project | | | | | | | | | | | Yes | |
| IRRIGATION, HARTLEY | Irrigation conservation | 190 | \$0 | 0 | 53,755 | 98,786 | 110,558 | 111,772 | 111,772 | N | Irrigation Conservation | No Infrastructure | Sponsor Has Taken Official Action to Initiate Project | | | | | | | | | | | Yes | |
| IRRIGATION, HEMPHILL | Irrigation conservation | 239 | \$0 | 0 | 228 | 237 | 255 | 260 | 268 | N | Irrigation Conservation | No Infrastructure | Sponsor Has Taken Official Action to Initiate Project | | | | | | | | | | | Yes | |
| IRRIGATION, HUTCHINSON | Irrigation conservation | 190 | \$0 | 0 | 7,514 | 14,044 | 15,905 | 16,128 | 16,128 | N | Irrigation Conservation | No Infrastructure | Sponsor Has Taken Official Action to Initiate Project | | | | | | | | | | | Yes | |
| IRRIGATION, HUTCHINSON | Precipitation enhancement | 815 | \$0 | 0 | 2,965 | 2,965 | 2,965 | 2,965 | 2,965 | N | Weather Modification to increase precipitation | No Infrastructure | Currently Operating | | | | | | | | | | | Yes | |
| IRRIGATION, LIPSCOMB | Irrigation conservation | 239 | \$0 | 0 | 2,279 | 2,360 | 2,506 | 2,587 | 2,668 | N | Irrigation Conservation | No Infrastructure | Sponsor Has Taken Official Action to Initiate Project | | | | | | | | | | | Yes | |
| IRRIGATION, MOORE | Irrigation conservation | 190 | \$0 | 0 | 31,602 | 58,995 | 66,995 | 67,846 | 67,846 | N | Irrigation Conservation | No Infrastructure | Sponsor Has Taken Official Action to Initiate Project | | | | | | | | | | | Yes | |
| IRRIGATION, OCHILTREE | Irrigation conservation | 239 | \$0 | 0 | 17,257 | 17,899 | 19,053 | 19,694 | 20,335 | N | Irrigation Conservation | No Infrastructure | Sponsor Has Taken Official Action to Initiate Project | | | | | | | | | | | Yes | |
| IRRIGATION, OLDHAM | Irrigation conservation | 239 | \$0 | 0 | 814 | 844 | 900 | 930 | 961 | N | Irrigation Conservation | No Infrastructure | Sponsor Has Taken Official Action to Initiate Project | | | | | | | | | | | Yes | |
| IRRIGATION, POTTER | Irrigation conservation | 239 | \$0 | 0 | 936 | 974 | 1,041 | 1,077 | 1,114 | N | Irrigation Conservation | No Infrastructure | Sponsor Has Taken Official Action to Initiate Project | | | | | | | | | | | Yes | |
| IRRIGATION, POTTER | Precipitation enhancement | 815 | \$0 | 0 | 361 | 361 | 361 | 361 | 361 | N | Weather Modification to increase precipitation | No Infrastructure | Currently Operating | | | | | | | | | | | Yes | |
| IRRIGATION, RANDALL | Irrigation conservation | 190 | \$0 | 0 | 18,028 | 18,673 | 19,835 | 20,481 | 21,126 | N | Irrigation Conservation | No Infrastructure | Sponsor Has Taken Official Action to Initiate Project | | | | | | | | | | | Yes | |
| IRRIGATION, ROBERTS | Irrigation conservation | 239 | \$0 | 0 | 2,772 | 2,893 | 3,114 | 3,236 | 3,357 | N | Irrigation Conservation | No Infrastructure | Sponsor Has Taken Official Action to Initiate Project | | | | | | | | | | | Yes | |
| IRRIGATION, ROBERTS | Precipitation enhancement | 815 | \$0 | 0 | 1,194 | 1,194 | 1,194 | 1,194 | 1,194 | N | Weather Modification to increase precipitation | No Infrastructure | Currently Operating | | | | | | | | | | | Yes | |
| IRRIGATION, SHERMAN | Irrigation conservation | 190 | \$0 | 0 | 41,128 | 77,102 | 86,803 | 87,896 | 87,896 | N | Irrigation Conservation | No Infrastructure | Sponsor Has Taken Official Action to Initiate Project | | | | | | | | | | | Yes | |
| IRRIGATION, WHEELER | Irrigation conservation | 239 | \$0 | 0 | 1,676 | 1,740 | 1,854 | 1,917 | 1,980 | N | Irrigation Conservation | No Infrastructure | Sponsor Has Taken Official Action to Initiate Project | | | | | | | | | | | Yes | |
| IRRIGATION, WHEELER | Precipitation enhancement | 815 | \$0 | 0 | 615 | 615 | 615 | 615 | 615 | N | Weather Modification to increase precipitation | No Infrastructure | Currently Operating | | | | | | | | | | | Yes | |
| LEFORS | Drill additional groundwater well | 194 | \$1,132,500 | 0 | 0 | 0 | 100 | 100 | 100 | N | Develop wellfield | Wells | Not Implemented | Other | | | | | | | | | | No | No longer a WUG |

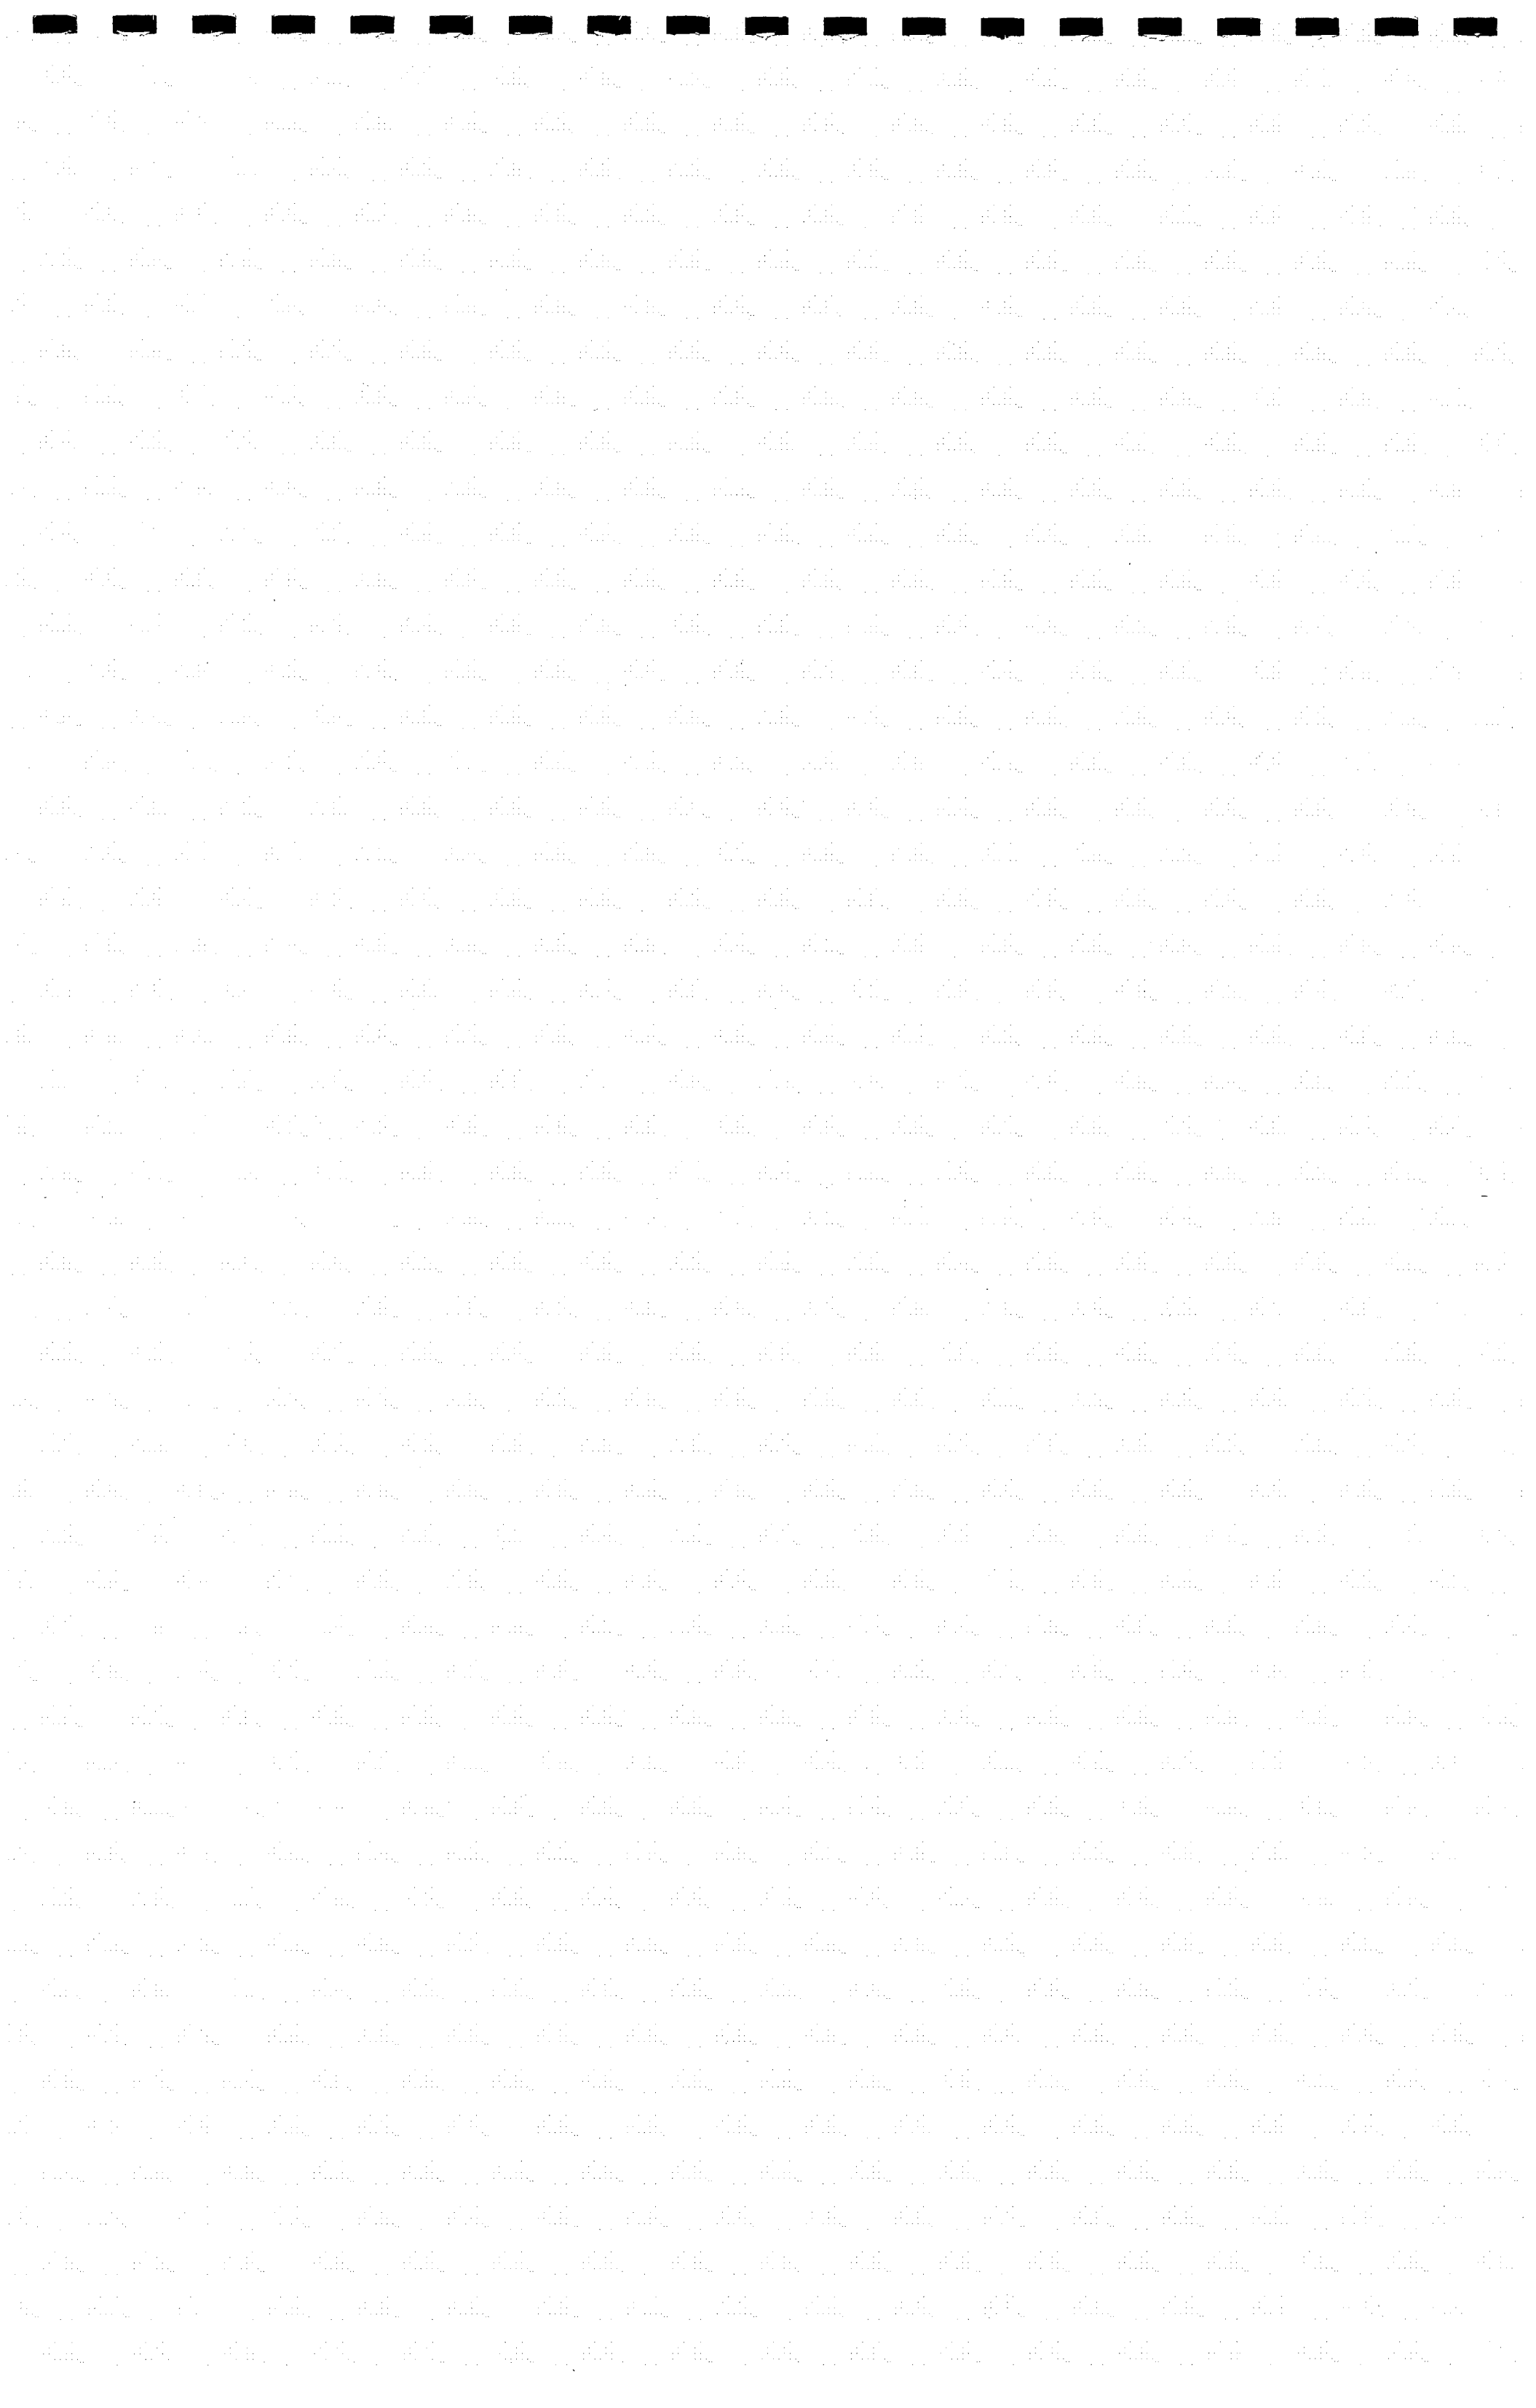






Appendix K

Data Tables





Appendix K, Data Tables

Preface

As required by regional water planning rules and guidelines, the data used in developing the regional water plans must be reported by water user, source, county and basin. These data are incorporated into the state water planning database, hence forward called "DB17".


Data tables are developed by water user group (WUG), wholesale water provider (WWP), and water source. Unfortunately, not all of the data easily fits into the structure of DB17. Specifically, groundwater sources are not constrained by political boundaries (county and regional lines), nor by river basin divides. However, this water source is represented as such.

Water supplies must be identified by source. This includes source type (surface water, groundwater, reuse, aquifer storage and recovery or precipitation enhancement), location (reservoir, county, basin), and river basin. Water users that utilize multiple sources of water must account for the quantity and end user of each source. This structure is very difficult to represent systems that blend multiple sources of water prior to distribution. It also poses challenges to accurately represent conjunctive use strategies that use different volumes of water from each source, pending annual availability. Generally, for conjunctive use operations, the decadal averages are represented in DB17.

The following data tables represent, to the best of the consultant's ability, the essence of the regional water plan. For some water user groups, the entity sells water to other users. These sales are included in the projected water needs for the water users in the regional plan. This relationship between seller and customer are represented in DB17, but may not be reflected in the following data reports. As a result, there may be differences in projected water needs between the regional water plan chapter tables and the data reports.

Also, the report tables were developed for each user group as a whole, regardless of county or basin splits. The splitting of these data by counties and basin can result in rounding differences between the report tables and following data tables. Differences of less than 10 on a county basis are considered consistent with the regional water plan report.

While the DB17 data adequately represents the regional water plan within the constraints of the data structure, it is highly recommended that the user of this data refer to the written plan for clarification and description of the water needs and water management strategies.

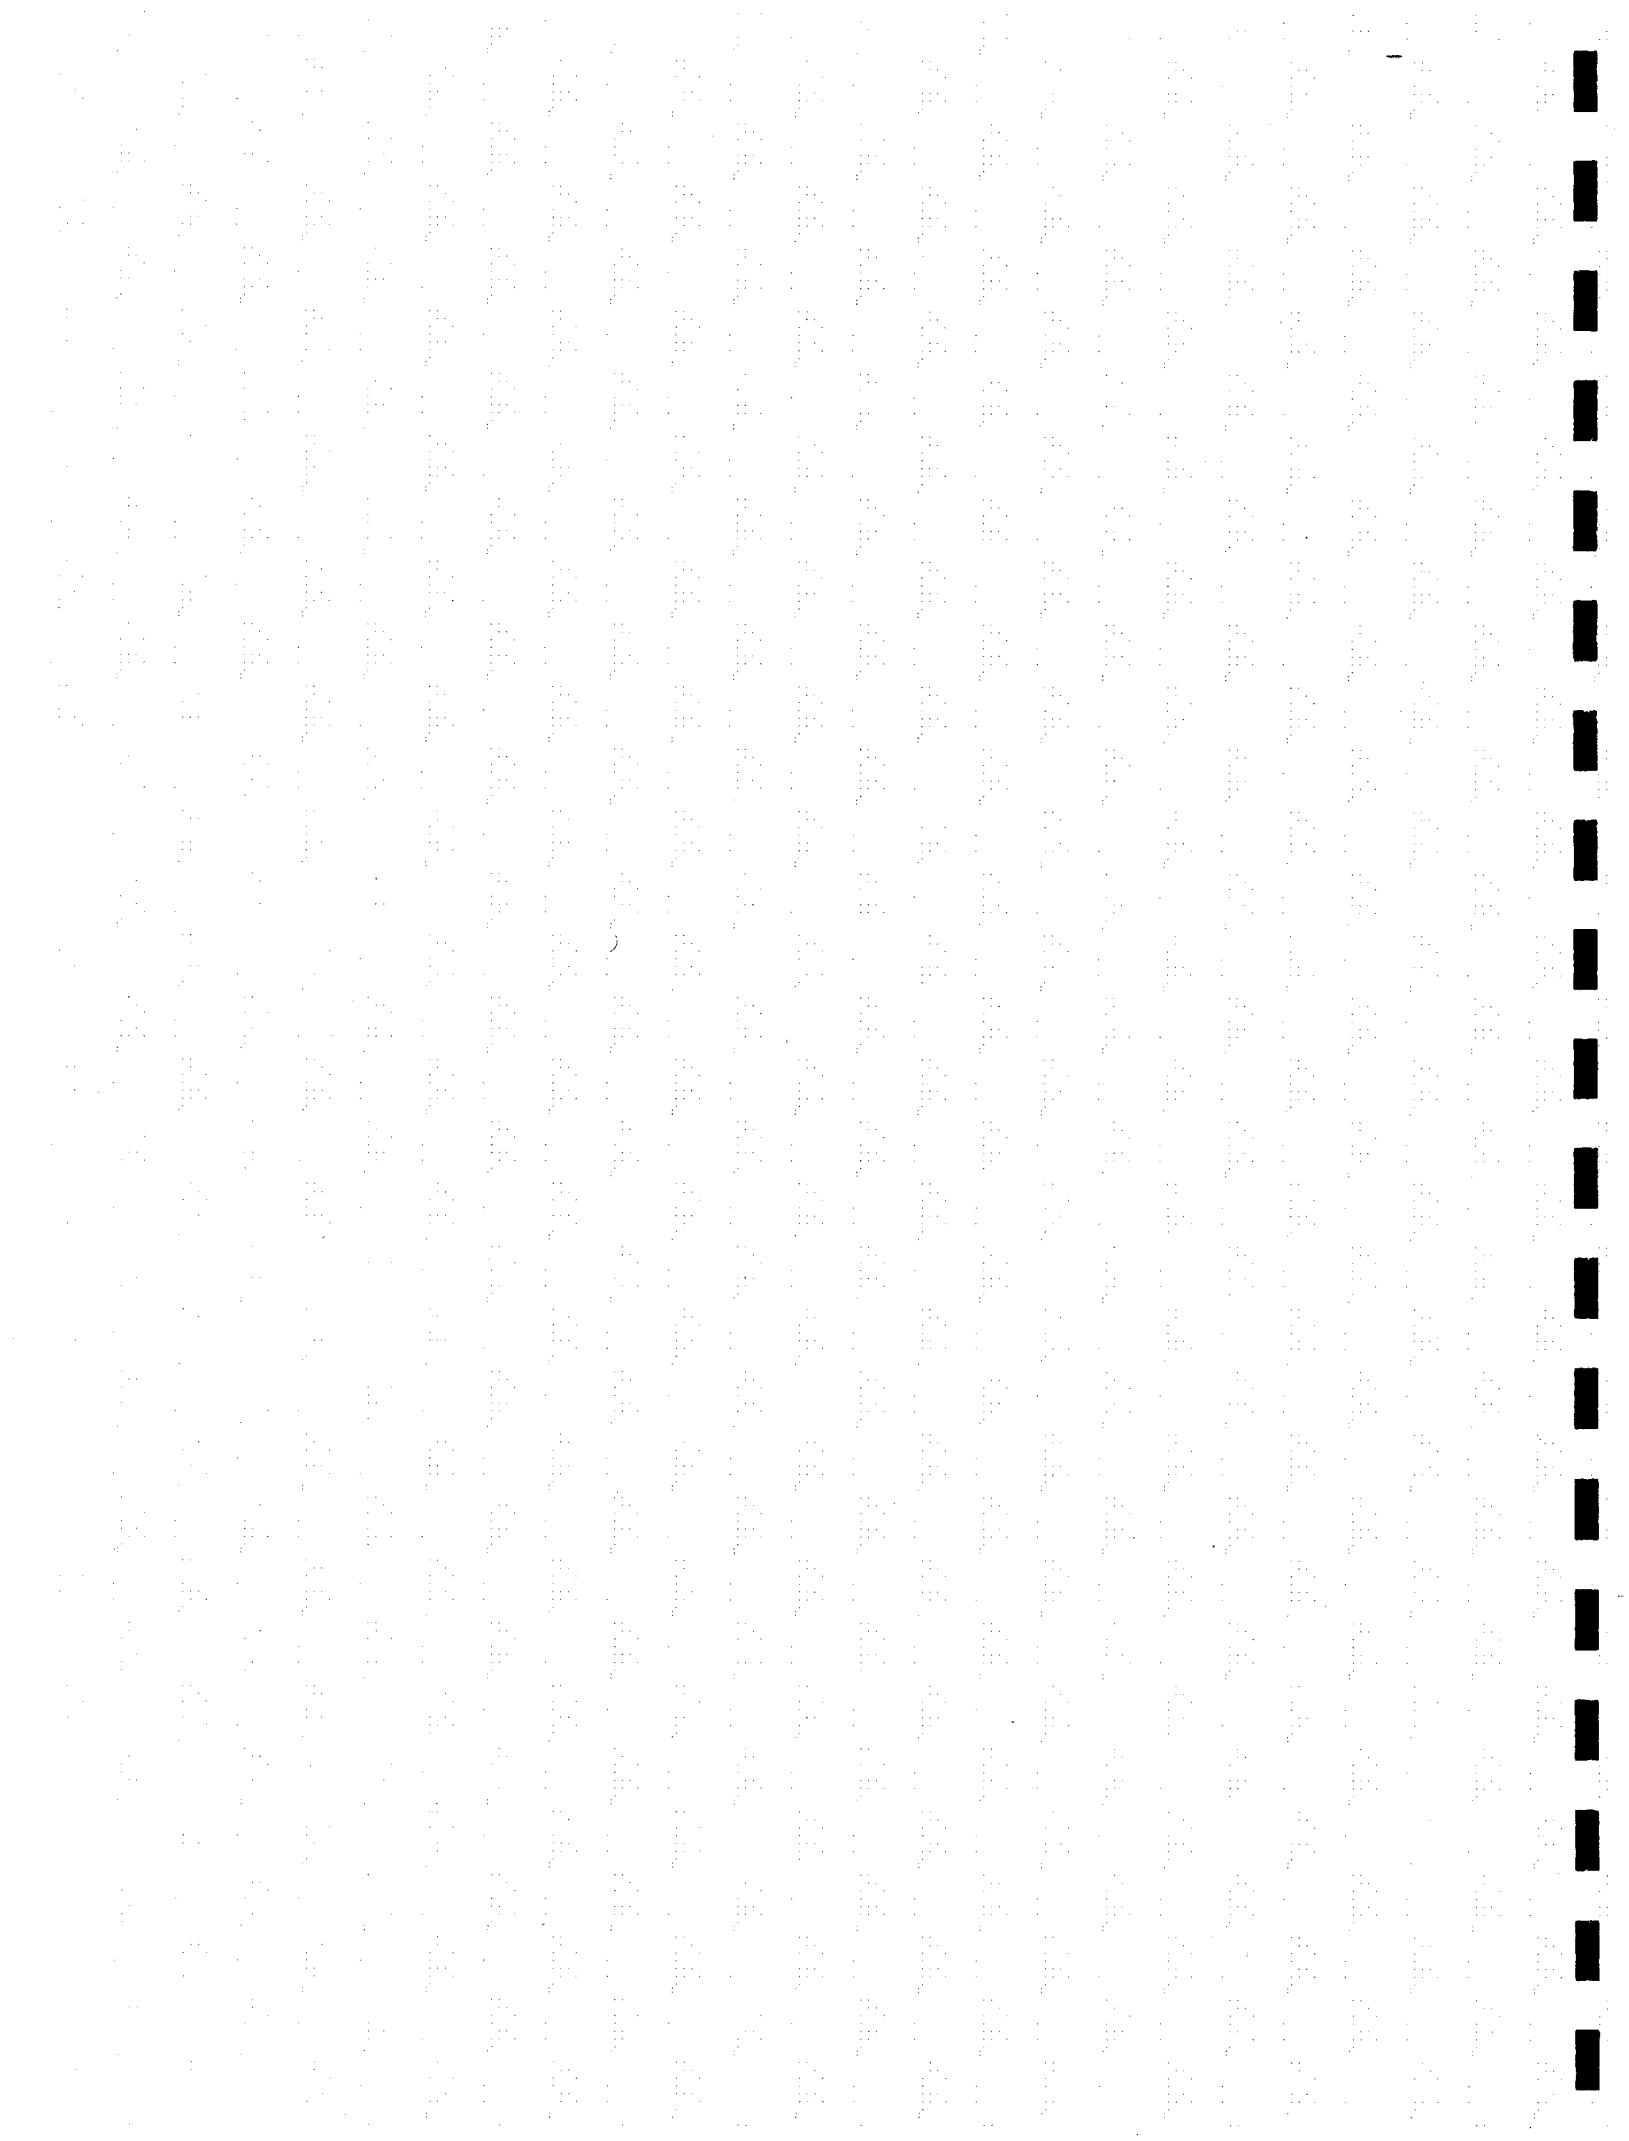

Source Availability

| REGION A | | | | | | | | | |
|------------------------------|---------------|----------|----------|--|---------|---------|---------|---------|---------|
| GROUNDWATER | COUNTY | BASIN | SALINITY | SOURCE AVAILABILITY (ACRE-FEET PER YEAR) | | | | | |
| | | | | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| BLAINE AQUIFER | CHILDRESS | RED | FRESH | 15,206 | 15,206 | 15,206 | 15,206 | 15,206 | 15,206 |
| BLAINE AQUIFER | COLLINGSWORTH | RED | FRESH | 185,376 | 185,376 | 185,376 | 185,376 | 185,376 | 185,376 |
| BLAINE AQUIFER | HALL | RED | FRESH | 11,509 | 11,509 | 11,509 | 11,509 | 11,509 | 11,509 |
| BLAINE AQUIFER | WHEELER | RED | FRESH | 98,997 | 98,997 | 98,997 | 98,997 | 97,695 | 96,410 |
| DOCKUM AQUIFER | ARMSTRONG | RED | FRESH | 582 | 582 | 582 | 582 | 582 | 582 |
| DOCKUM AQUIFER | CARSON | CANADIAN | FRESH | 20 | 20 | 20 | 20 | 20 | 20 |
| DOCKUM AQUIFER | CARSON | RED | FRESH | 263 | 263 | 263 | 263 | 263 | 263 |
| DOCKUM AQUIFER | DALLAM | CANADIAN | FRESH | 4,034 | 4,034 | 4,034 | 4,034 | 4,034 | 4,034 |
| DOCKUM AQUIFER | HARTLEY | CANADIAN | FRESH | 3,567 | 3,567 | 3,567 | 3,567 | 3,567 | 3,567 |
| DOCKUM AQUIFER | MOORE | CANADIAN | FRESH | 5,395 | 5,395 | 5,395 | 5,395 | 5,395 | 5,395 |
| DOCKUM AQUIFER | OLDHAM | CANADIAN | FRESH | 2,868 | 2,868 | 2,868 | 2,868 | 2,868 | 2,868 |
| DOCKUM AQUIFER | OLDHAM | RED | FRESH | 104 | 104 | 104 | 104 | 104 | 104 |
| DOCKUM AQUIFER | POTTER | CANADIAN | FRESH | 1,525 | 1,525 | 1,525 | 1,525 | 1,525 | 1,525 |
| DOCKUM AQUIFER | POTTER | RED | FRESH | 155 | 155 | 155 | 155 | 155 | 155 |
| DOCKUM AQUIFER | RANDALL | RED | FRESH | 2,119 | 2,119 | 2,119 | 2,119 | 2,119 | 2,119 |
| DOCKUM AQUIFER | SHERMAN | CANADIAN | FRESH | 591 | 591 | 591 | 591 | 591 | 591 |
| OGALLALA AQUIFER | ARMSTRONG | RED | FRESH | 45,367 | 41,079 | 37,416 | 34,161 | 31,328 | 28,730 |
| OGALLALA AQUIFER | CARSON | CANADIAN | FRESH | 81,718 | 73,958 | 66,324 | 59,324 | 53,120 | 47,565 |
| OGALLALA AQUIFER | CARSON | RED | FRESH | 89,424 | 80,108 | 71,529 | 63,665 | 56,289 | 49,768 |
| OGALLALA AQUIFER | DONLEY | RED | FRESH | 74,540 | 70,208 | 64,373 | 58,707 | 53,537 | 48,822 |
| OGALLALA AQUIFER | GRAY | CANADIAN | FRESH | 39,813 | 36,848 | 33,749 | 30,659 | 27,766 | 25,146 |
| OGALLALA AQUIFER | GRAY | RED | FRESH | 120,860 | 109,180 | 98,784 | 89,135 | 80,128 | 72,031 |
| OGALLALA AQUIFER | HANSFORD | CANADIAN | FRESH | 262,271 | 240,502 | 218,405 | 197,454 | 177,536 | 159,627 |
| OGALLALA AQUIFER | HEMPHILL | CANADIAN | FRESH | 22,931 | 22,969 | 23,262 | 23,412 | 23,642 | 23,874 |
| OGALLALA AQUIFER | HEMPHILL | RED | FRESH | 18,828 | 19,429 | 19,515 | 19,577 | 19,517 | 19,457 |
| OGALLALA AQUIFER | HUTCHINSON | CANADIAN | FRESH | 136,433 | 124,573 | 112,149 | 100,575 | 90,438 | 81,323 |
| OGALLALA AQUIFER | LIPSCOMB | CANADIAN | FRESH | 283,794 | 273,836 | 256,406 | 237,765 | 219,100 | 201,900 |
| OGALLALA AQUIFER | MOORE | CANADIAN | FRESH | 199,354 | 173,987 | 147,617 | 123,573 | 103,113 | 86,041 |
| OGALLALA AQUIFER | OCHILTREE | CANADIAN | FRESH | 246,475 | 224,578 | 203,704 | 183,227 | 164,265 | 147,265 |
| OGALLALA AQUIFER | OLDHAM | CANADIAN | FRESH | 19,360 | 18,722 | 17,694 | 16,406 | 15,198 | 14,079 |
| OGALLALA AQUIFER | OLDHAM | RED | FRESH | 3,122 | 2,885 | 2,772 | 2,306 | 2,269 | 2,233 |
| OGALLALA AQUIFER | POTTER | CANADIAN | FRESH | 22,044 | 20,621 | 18,960 | 17,318 | 15,450 | 13,783 |
| OGALLALA AQUIFER | POTTER | RED | FRESH | 4,828 | 2,917 | 1,815 | 1,596 | 1,406 | 1,239 |
| OGALLALA AQUIFER | RANDALL | RED | FRESH | 85,614 | 82,398 | 75,698 | 68,881 | 58,384 | 49,487 |
| OGALLALA AQUIFER | ROBERTS | CANADIAN | FRESH | 372,950 | 350,415 | 321,680 | 290,903 | 261,482 | 235,037 |
| OGALLALA AQUIFER | ROBERTS | RED | FRESH | 17,951 | 18,202 | 17,565 | 16,609 | 15,557 | 14,572 |
| OGALLALA AQUIFER | SHERMAN | CANADIAN | FRESH | 300,908 | 263,747 | 229,122 | 197,480 | 169,172 | 144,922 |
| OGALLALA AQUIFER | WHEELER | RED | FRESH | 119,556 | 114,817 | 107,697 | 100,289 | 93,117 | 86,458 |
| OGALLALA-RITA BLANCA AQUIFER | DALLAM | CANADIAN | FRESH | 352,474 | 309,076 | 270,317 | 234,813 | 203,491 | 176,347 |
| OGALLALA-RITA BLANCA AQUIFER | HARTLEY | CANADIAN | FRESH | 389,548 | 337,001 | 291,094 | 250,966 | 216,098 | 186,074 |

Source Availability

| REGION A | | | | | | | | | |
|---|---------------|--------------|-----------------|---|------------------|------------------|------------------|------------------|------------------|
| GROUNDWATER | COUNTY | BASIN | SALINITY | SOURCE AVAILABILITY (ACRE-FEET PER YEAR) | | | | | |
| | | | | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| OTHER AQUIFER WHITEHORSE AND QUARTERMASTER FORMATIONS | ARMSTRONG | RED | FRESH/BRAC KISH | 370 | 370 | 370 | 370 | 370 | 370 |
| OTHER AQUIFER WHITEHORSE AND QUARTERMASTER FORMATIONS | CHILDRESS | RED | FRESH/BRAC KISH | 233 | 233 | 233 | 233 | 233 | 233 |
| OTHER AQUIFER WHITEHORSE AND QUARTERMASTER FORMATIONS | COLLINGSWORTH | RED | FRESH/BRAC KISH | 309 | 309 | 309 | 309 | 309 | 309 |
| OTHER AQUIFER WHITEHORSE AND QUARTERMASTER FORMATIONS | DONLEY | RED | FRESH/BRAC KISH | 479 | 479 | 479 | 479 | 479 | 479 |
| OTHER AQUIFER WHITEHORSE AND QUARTERMASTER FORMATIONS | HALL | RED | FRESH/BRAC KISH | 1,086 | 1,086 | 1,086 | 1,086 | 1,086 | 1,086 |
| OTHER AQUIFER WHITEHORSE AND QUARTERMASTER FORMATIONS | WHEELER | RED | FRESH/BRAC KISH | 276 | 276 | 276 | 276 | 276 | 276 |
| SEYMOUR AQUIFER | CHILDRESS | RED | FRESH | 732 | 717 | 712 | 712 | 712 | 712 |
| SEYMOUR AQUIFER | COLLINGSWORTH | RED | FRESH | 16,010 | 14,250 | 13,348 | 11,329 | 10,241 | 9,257 |
| SEYMOUR AQUIFER | HALL | RED | FRESH | 12,020 | 11,462 | 10,866 | 11,085 | 11,172 | 11,260 |
| GROUNDWATER TOTAL SOURCE AVAILABILITY | | | | 3,673,989 | 3,373,549 | 3,067,637 | 2,776,991 | 2,507,290 | 2,269,486 |

| REGION A | | | | | | | | | |
|--|---------------|--------------|-----------------|---|---------------|---------------|---------------|---------------|---------------|
| REUSE | COUNTY | BASIN | SALINITY | SOURCE AVAILABILITY (ACRE-FEET PER YEAR) | | | | | |
| | | | | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| DIRECT REUSE | CARSON | RED | FRESH | 57 | 58 | 58 | 58 | 58 | 58 |
| DIRECT REUSE | CHILDRESS | RED | FRESH | 162 | 166 | 169 | 172 | 177 | 181 |
| DIRECT REUSE | COLLINGSWORTH | RED | FRESH | 53 | 54 | 55 | 57 | 58 | 60 |
| DIRECT REUSE | GRAY | CANADIAN | FRESH | 220 | 220 | 220 | 220 | 220 | 220 |
| DIRECT REUSE | HUTCHINSON | CANADIAN | FRESH | 1,045 | 1,045 | 1,045 | 1,045 | 1,045 | 1,045 |
| DIRECT REUSE | POTTER | CANADIAN | FRESH | 26,087 | 27,504 | 29,108 | 30,711 | 34,815 | 38,369 |
| DIRECT REUSE | POTTER | RED | FRESH | 1,500 | 1,500 | 1,500 | 1,500 | 1,500 | 1,500 |
| DIRECT REUSE | RANDALL | RED | FRESH | 545 | 597 | 651 | 710 | 777 | 846 |
| DIRECT REUSE | WHEELER | RED | FRESH | 51 | 52 | 53 | 55 | 57 | 59 |
| DIRECT REUSE FROM MEMPHIS | HALL | RED | FRESH | 100 | 100 | 100 | 100 | 100 | 100 |
| REUSE TOTAL SOURCE AVAILABILITY | | | | 29,820 | 31,296 | 32,959 | 34,628 | 38,807 | 42,438 |

| REGION A | | | | | | | | | |
|---------------------------------|---------------|--------------|-----------------|---|-------------|-------------|-------------|-------------|-------------|
| SURFACE WATER | COUNTY | BASIN | SALINITY | SOURCE AVAILABILITY (ACRE-FEET PER YEAR) | | | | | |
| | | | | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| CANADIAN LIVESTOCK LOCAL SUPPLY | CARSON | CANADIAN | FRESH | 59 | 59 | 59 | 59 | 59 | 59 |
| CANADIAN LIVESTOCK LOCAL SUPPLY | DALLAM | CANADIAN | FRESH | 2,488 | 2,488 | 2,488 | 2,488 | 2,488 | 2,488 |
| CANADIAN LIVESTOCK LOCAL SUPPLY | GRAY | CANADIAN | FRESH | 199 | 199 | 199 | 199 | 199 | 199 |

Source Availability

| REGION A | | | | | | | | | |
|---------------------------------|---------------|--------------|-----------------|---|-------------|-------------|-------------|-------------|-------------|
| SURFACE WATER | COUNTY | BASIN | SALINITY | SOURCE AVAILABILITY (ACRE-FEET PER YEAR) | | | | | |
| | | | | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| CANADIAN LIVESTOCK LOCAL SUPPLY | HANSFORD | CANADIAN | FRESH | 2,617 | 2,617 | 2,617 | 2,617 | 2,617 | 2,617 |
| CANADIAN LIVESTOCK LOCAL SUPPLY | HARTLEY | CANADIAN | FRESH | 3,193 | 3,193 | 3,193 | 3,193 | 3,193 | 3,193 |
| CANADIAN LIVESTOCK LOCAL SUPPLY | HEMPHILL | CANADIAN | FRESH | 248 | 248 | 248 | 248 | 248 | 248 |
| CANADIAN LIVESTOCK LOCAL SUPPLY | HUTCHINSON | CANADIAN | FRESH | 281 | 281 | 281 | 281 | 281 | 281 |
| CANADIAN LIVESTOCK LOCAL SUPPLY | LIPSCOMB | CANADIAN | FRESH | 110 | 110 | 110 | 110 | 110 | 110 |
| CANADIAN LIVESTOCK LOCAL SUPPLY | MOORE | CANADIAN | FRESH | 1,000 | 1,000 | 1,000 | 1,000 | 1,000 | 1,000 |
| CANADIAN LIVESTOCK LOCAL SUPPLY | OCHILTREE | CANADIAN | FRESH | 421 | 421 | 421 | 421 | 421 | 421 |
| CANADIAN LIVESTOCK LOCAL SUPPLY | OLDHAM | CANADIAN | FRESH | 626 | 626 | 626 | 626 | 626 | 626 |
| CANADIAN LIVESTOCK LOCAL SUPPLY | POTTER | CANADIAN | FRESH | 500 | 500 | 500 | 500 | 500 | 500 |
| CANADIAN LIVESTOCK LOCAL SUPPLY | ROBERTS | CANADIAN | FRESH | 124 | 124 | 124 | 124 | 124 | 124 |
| CANADIAN LIVESTOCK LOCAL SUPPLY | SHERMAN | CANADIAN | FRESH | 1,052 | 1,052 | 1,052 | 1,052 | 1,052 | 1,052 |
| CANADIAN RUN-OF-RIVER | GRAY | CANADIAN | FRESH | 1 | 1 | 1 | 1 | 1 | 1 |
| CANADIAN RUN-OF-RIVER | HANSFORD | CANADIAN | FRESH | 22 | 22 | 22 | 22 | 22 | 22 |
| CANADIAN RUN-OF-RIVER | HUTCHINSON | CANADIAN | FRESH | 98 | 98 | 98 | 98 | 98 | 98 |
| CANADIAN RUN-OF-RIVER | LIPSCOMB | CANADIAN | FRESH | 66 | 66 | 66 | 66 | 66 | 66 |
| CANADIAN RUN-OF-RIVER | MOORE | CANADIAN | FRESH | 7 | 7 | 7 | 7 | 7 | 7 |
| CANADIAN RUN-OF-RIVER | ROBERTS | CANADIAN | FRESH | 72 | 72 | 72 | 72 | 72 | 72 |
| CANADIAN RUN-OF-RIVER | SHERMAN | CANADIAN | FRESH | 32 | 32 | 32 | 32 | 32 | 32 |
| GREENBELT LAKE/RESERVOIR | RESERVOIR | RED | FRESH | 3,850 | 3,782 | 3,714 | 3,646 | 3,578 | 3,440 |
| MEREDITH LAKE/RESERVOIR | RESERVOIR | CANADIAN | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| PALO DURO LAKE/RESERVOIR | RESERVOIR | CANADIAN | FRESH | 3,917 | 3,875 | 3,833 | 3,792 | 3,750 | 3,708 |
| RED LIVESTOCK LOCAL SUPPLY | ARMSTRONG | RED | FRESH | 122 | 122 | 122 | 122 | 122 | 122 |
| RED LIVESTOCK LOCAL SUPPLY | CARSON | RED | FRESH | 75 | 75 | 75 | 75 | 75 | 75 |
| RED LIVESTOCK LOCAL SUPPLY | CHILDRESS | RED | FRESH | 49 | 49 | 49 | 49 | 49 | 49 |
| RED LIVESTOCK LOCAL SUPPLY | COLLINGSWORTH | RED | FRESH | 29 | 29 | 29 | 29 | 29 | 29 |
| RED LIVESTOCK LOCAL SUPPLY | DONLEY | RED | FRESH | 283 | 283 | 283 | 283 | 283 | 283 |
| RED LIVESTOCK LOCAL SUPPLY | GRAY | RED | FRESH | 600 | 600 | 600 | 600 | 600 | 600 |
| RED LIVESTOCK LOCAL SUPPLY | HALL | RED | FRESH | 91 | 91 | 91 | 91 | 91 | 91 |
| RED LIVESTOCK LOCAL SUPPLY | HEMPHILL | RED | FRESH | 173 | 173 | 173 | 173 | 173 | 173 |

Source Availability

| REGION A | | | | | | | | | |
|--|---------------|--------------|-----------------|---|------------------|------------------|------------------|------------------|------------------|
| SURFACE WATER | COUNTY | BASIN | SALINITY | SOURCE AVAILABILITY (ACRE-FEET PER YEAR) | | | | | |
| | | | | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| RED LIVESTOCK LOCAL SUPPLY | OLDHAM | RED | FRESH | 209 | 209 | 209 | 209 | 209 | 209 |
| RED LIVESTOCK LOCAL SUPPLY | POTTER | RED | FRESH | 62 | 62 | 62 | 62 | 62 | 62 |
| RED LIVESTOCK LOCAL SUPPLY | RANDALL | RED | FRESH | 1,312 | 1,312 | 1,312 | 1,312 | 1,312 | 1,312 |
| RED LIVESTOCK LOCAL SUPPLY | ROBERTS | RED | FRESH | 15 | 15 | 15 | 15 | 15 | 15 |
| RED LIVESTOCK LOCAL SUPPLY | WHEELER | RED | FRESH | 845 | 845 | 845 | 845 | 845 | 845 |
| RED RUN-OF-RIVER | CARSON | RED | FRESH | 277 | 277 | 277 | 277 | 277 | 277 |
| RED RUN-OF-RIVER | CHILDRESS | RED | FRESH | 19 | 19 | 19 | 19 | 19 | 19 |
| RED RUN-OF-RIVER | COLLINGSWORTH | RED | FRESH | 851 | 851 | 851 | 851 | 851 | 851 |
| RED RUN-OF-RIVER | DONLEY | RED | FRESH | 166 | 166 | 166 | 166 | 166 | 166 |
| RED RUN-OF-RIVER | GRAY | RED | FRESH | 55 | 55 | 55 | 55 | 55 | 55 |
| RED RUN-OF-RIVER | HALL | RED | FRESH | 52 | 52 | 52 | 52 | 52 | 52 |
| RED RUN-OF-RIVER | RANDALL | RED | FRESH | 217 | 217 | 217 | 217 | 217 | 217 |
| RED RUN-OF-RIVER | WHEELER | RED | FRESH | 603 | 603 | 603 | 603 | 603 | 603 |
| SURFACE WATER TOTAL SOURCE AVAILABILITY | | | | 27,088 | 26,978 | 26,868 | 26,759 | 26,649 | 26,469 |
| REGION A TOTAL SOURCE AVAILABILITY | | | | 3,730,897 | 3,431,823 | 3,127,464 | 2,838,378 | 2,572,746 | 2,338,393 |

Source Water Balance (Availability- WUG Supply)

| REGION A | | | | | | | | | |
|------------------------------|---------------|--------------|-----------------|--|-------------|-------------|-------------|-------------|-------------|
| GROUNDWATER | COUNTY | BASIN | SALINITY | SOURCE WATER BALANCE (ACRE-FEET PER YEAR) | | | | | |
| | | | | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| BLAINE AQUIFER | CHILDRRESS | RED | FRESH | 7,995 | 8,277 | 8,702 | 9,435 | 10,169 | 10,902 |
| BLAINE AQUIFER | COLLINGSWORTH | RED | FRESH | 176,121 | 176,455 | 176,965 | 177,860 | 178,763 | 179,666 |
| BLAINE AQUIFER | HALL | RED | FRESH | 11,509 | 11,509 | 11,509 | 11,509 | 11,509 | 11,509 |
| BLAINE AQUIFER | WHEELER | RED | FRESH | 98,948 | 98,948 | 98,948 | 98,948 | 97,646 | 96,361 |
| DOCKUM AQUIFER | ARMSTRONG | RED | FRESH | 566 | 566 | 566 | 566 | 566 | 566 |
| DOCKUM AQUIFER | CARSON | CANADIAN | FRESH | 20 | 20 | 20 | 20 | 20 | 20 |
| DOCKUM AQUIFER | CARSON | RED | FRESH | 263 | 263 | 263 | 263 | 263 | 263 |
| DOCKUM AQUIFER | DALLAM | CANADIAN | FRESH | 1,008 | 1,008 | 1,008 | 1,008 | 1,008 | 1,008 |
| DOCKUM AQUIFER | HARTLEY | CANADIAN | FRESH | 2,406 | 2,406 | 2,406 | 2,406 | 2,406 | 2,406 |
| DOCKUM AQUIFER | MOORE | CANADIAN | FRESH | 5,395 | 5,395 | 5,395 | 5,395 | 5,395 | 5,395 |
| DOCKUM AQUIFER | OLDHAM | CANADIAN | FRESH | 1,396 | 1,396 | 1,396 | 1,396 | 1,396 | 1,396 |
| DOCKUM AQUIFER | OLDHAM | RED | FRESH | 104 | 104 | 104 | 104 | 104 | 104 |
| DOCKUM AQUIFER | POTTER | CANADIAN | FRESH | 612 | 612 | 612 | 612 | 612 | 612 |
| DOCKUM AQUIFER | POTTER | RED | FRESH | 155 | 155 | 155 | 155 | 155 | 155 |
| DOCKUM AQUIFER | RANDALL | RED | FRESH | 932 | 943 | 953 | 963 | 972 | 981 |
| DOCKUM AQUIFER | SHERMAN | CANADIAN | FRESH | 591 | 591 | 591 | 591 | 591 | 591 |
| OGALLALA AQUIFER | ARMSTRONG | RED | FRESH | 40,133 | 36,103 | 32,770 | 29,966 | 27,580 | 25,428 |
| OGALLALA AQUIFER | CARSON | CANADIAN | FRESH | 60,201 | 54,119 | 48,497 | 43,645 | 39,336 | 35,684 |
| OGALLALA AQUIFER | CARSON | RED | FRESH | 40,967 | 34,929 | 30,037 | 26,724 | 23,864 | 21,866 |
| OGALLALA AQUIFER | DONLEY | RED | FRESH | 48,072 | 44,743 | 40,375 | 37,286 | 34,649 | 32,466 |
| OGALLALA AQUIFER | GRAY | CANADIAN | FRESH | 26,360 | 23,270 | 20,490 | 17,401 | 15,209 | 13,188 |
| OGALLALA AQUIFER | GRAY | RED | FRESH | 103,430 | 92,613 | 83,352 | 75,257 | 67,771 | 61,192 |
| OGALLALA AQUIFER | HANSFORD | CANADIAN | FRESH | 124,644 | 110,848 | 99,704 | 92,078 | 85,355 | 80,338 |
| OGALLALA AQUIFER | HEMPHILL | CANADIAN | FRESH | 19,262 | 19,503 | 20,021 | 20,427 | 20,917 | 21,270 |
| OGALLALA AQUIFER | HEMPHILL | RED | FRESH | 16,408 | 17,366 | 17,802 | 18,227 | 18,527 | 18,615 |
| OGALLALA AQUIFER | HUTCHINSON | CANADIAN | FRESH | 70,452 | 60,846 | 51,148 | 43,203 | 35,899 | 29,427 |
| OGALLALA AQUIFER | LIPSCOMB | CANADIAN | FRESH | 260,727 | 252,020 | 236,304 | 220,082 | 203,545 | 188,366 |
| OGALLALA AQUIFER | MOORE | CANADIAN | FRESH | 43,809 | 27,684 | 12,543 | 3,528 | 1,538 | 1,136 |
| OGALLALA AQUIFER | OCHILTREE | CANADIAN | FRESH | 181,999 | 164,385 | 148,448 | 133,902 | 120,651 | 109,195 |
| OGALLALA AQUIFER | OLDHAM | CANADIAN | FRESH | 15,828 | 15,242 | 14,330 | 13,316 | 12,350 | 11,468 |
| OGALLALA AQUIFER | OLDHAM | RED | FRESH | 2,045 | 1,837 | 1,776 | 1,395 | 1,442 | 1,489 |
| OGALLALA AQUIFER | POTTER | CANADIAN | FRESH | 8,325 | 9,293 | 8,146 | 7,134 | 5,928 | 4,893 |
| OGALLALA AQUIFER | POTTER | RED | FRESH | 3,674 | 1,703 | 547 | 298 | 58 | 33 |
| OGALLALA AQUIFER | RANDALL | RED | FRESH | 60,226 | 58,478 | 53,408 | 48,717 | 40,274 | 33,427 |
| OGALLALA AQUIFER | ROBERTS | CANADIAN | FRESH | 295,966 | 282,746 | 259,821 | 235,099 | 211,345 | 190,421 |
| OGALLALA AQUIFER | ROBERTS | RED | FRESH | 17,593 | 17,876 | 17,274 | 16,359 | 15,341 | 14,385 |
| OGALLALA AQUIFER | SHERMAN | CANADIAN | FRESH | 76,075 | 51,759 | 34,063 | 23,590 | 16,483 | 13,387 |
| OGALLALA AQUIFER | WHEELER | RED | FRESH | 105,654 | 102,171 | 96,603 | 91,024 | 85,124 | 79,384 |
| OGALLALA-RITA BLANCA AQUIFER | DALLAM | CANADIAN | FRESH | 60,789 | 51,909 | 44,334 | 37,406 | 31,792 | 30,342 |
| OGALLALA-RITA BLANCA AQUIFER | HARTLEY | CANADIAN | FRESH | 116,506 | 98,991 | 83,533 | 70,412 | 59,190 | 52,757 |

Source Water Balance (Availability- WUG Supply)

| REGION A | | | | | | | | | |
|---|---------------|--------------|-----------------|--|------------------|------------------|------------------|------------------|------------------|
| GROUNDWATER | COUNTY | BASIN | SALINITY | SOURCE WATER BALANCE (ACRE-FEET PER YEAR) | | | | | |
| | | | | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| OTHER AQUIFER WHITEHORSE AND QUARtermaster FORMATIONS | ARMSTRONG | RED | FRESH/BRAC KISH | 340 | 340 | 340 | 340 | 340 | 340 |
| OTHER AQUIFER WHITEHORSE AND QUARtermaster FORMATIONS | CHILDRESS | RED | FRESH/BRAC KISH | 0 | 0 | 0 | 0 | 0 | 0 |
| OTHER AQUIFER WHITEHORSE AND QUARtermaster FORMATIONS | COLLINGSWORTH | RED | FRESH/BRAC KISH | 0 | 0 | 0 | 0 | 0 | 0 |
| OTHER AQUIFER WHITEHORSE AND QUARtermaster FORMATIONS | DONLEY | RED | FRESH/BRAC KISH | 96 | 96 | 96 | 96 | 96 | 96 |
| OTHER AQUIFER WHITEHORSE AND QUARtermaster FORMATIONS | HALL | RED | FRESH/BRAC KISH | 0 | 0 | 0 | 0 | 65 | 168 |
| OTHER AQUIFER WHITEHORSE AND QUARtermaster FORMATIONS | WHEELER | RED | FRESH/BRAC KISH | 0 | 0 | 0 | 0 | 0 | 0 |
| SEYMOUR AQUIFER | CHILDRESS | RED | FRESH | 372 | 357 | 352 | 352 | 352 | 352 |
| SEYMOUR AQUIFER | COLLINGSWORTH | RED | FRESH | 6,808 | 5,382 | 4,990 | 3,874 | 3,689 | 3,608 |
| SEYMOUR AQUIFER | HALL | RED | FRESH | 2,667 | 2,437 | 2,373 | 3,623 | 4,675 | 5,691 |
| GROUNDWATER TOTAL SOURCE WATER BALANCE | | | | 2,117,449 | 1,947,694 | 1,773,070 | 1,625,992 | 1,494,960 | 1,392,347 |

| REGION A | | | | | | | | | |
|---|---------------|--------------|-----------------|--|-------------|-------------|-------------|-------------|-------------|
| REUSE | COUNTY | BASIN | SALINITY | SOURCE WATER BALANCE (ACRE-FEET PER YEAR) | | | | | |
| | | | | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| DIRECT REUSE | CARSON | RED | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| DIRECT REUSE | CHILDRESS | RED | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| DIRECT REUSE | COLLINGSWORTH | RED | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| DIRECT REUSE | GRAY | CANADIAN | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| DIRECT REUSE | HUTCHINSON | CANADIAN | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| DIRECT REUSE | POTTER | CANADIAN | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| DIRECT REUSE | POTTER | RED | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| DIRECT REUSE | RANDALL | RED | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| DIRECT REUSE | WHEELER | RED | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| DIRECT REUSE FROM MEMPHIS | HALL | RED | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| REUSE TOTAL SOURCE WATER BALANCE | | | | 0 | 0 | 0 | 0 | 0 | 0 |

| REGION A | | | | | | | | | |
|---------------------------------|---------------|--------------|-----------------|--|-------------|-------------|-------------|-------------|-------------|
| SURFACE WATER | COUNTY | BASIN | SALINITY | SOURCE WATER BALANCE (ACRE-FEET PER YEAR) | | | | | |
| | | | | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| CANADIAN LIVESTOCK LOCAL SUPPLY | CARSON | CANADIAN | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| CANADIAN LIVESTOCK LOCAL SUPPLY | DALLAM | CANADIAN | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| CANADIAN LIVESTOCK LOCAL SUPPLY | GRAY | CANADIAN | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |

Source Water Balance (Availability- WUG Supply)

| REGION A | | | | | | | | | |
|---------------------------------|---------------|----------|----------|---|-------|-------|-------|-------|-------|
| SURFACE WATER | COUNTY | BASIN | SALINITY | SOURCE WATER BALANCE (ACRE-FEET PER YEAR) | | | | | |
| | | | | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| CANADIAN LIVESTOCK LOCAL SUPPLY | HANSFORD | CANADIAN | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| CANADIAN LIVESTOCK LOCAL SUPPLY | HARTLEY | CANADIAN | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| CANADIAN LIVESTOCK LOCAL SUPPLY | HEMPHILL | CANADIAN | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| CANADIAN LIVESTOCK LOCAL SUPPLY | HUTCHINSON | CANADIAN | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| CANADIAN LIVESTOCK LOCAL SUPPLY | LIPSCOMB | CANADIAN | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| CANADIAN LIVESTOCK LOCAL SUPPLY | MOORE | CANADIAN | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| CANADIAN LIVESTOCK LOCAL SUPPLY | OCHILTREE | CANADIAN | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| CANADIAN LIVESTOCK LOCAL SUPPLY | OLDHAM | CANADIAN | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| CANADIAN LIVESTOCK LOCAL SUPPLY | POTTER | CANADIAN | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| CANADIAN LIVESTOCK LOCAL SUPPLY | ROBERTS | CANADIAN | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| CANADIAN LIVESTOCK LOCAL SUPPLY | SHERMAN | CANADIAN | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| CANADIAN RUN-OF-RIVER | GRAY | CANADIAN | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| CANADIAN RUN-OF-RIVER | HANSFORD | CANADIAN | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| CANADIAN RUN-OF-RIVER | HUTCHINSON | CANADIAN | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| CANADIAN RUN-OF-RIVER | LIPSCOMB | CANADIAN | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| CANADIAN RUN-OF-RIVER | MOORE | CANADIAN | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| CANADIAN RUN-OF-RIVER | ROBERTS | CANADIAN | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| CANADIAN RUN-OF-RIVER | SHERMAN | CANADIAN | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| GREENBELT LAKE/RESERVOIR | RESERVOIR | RED | FRESH | 1,538 | 1,339 | 1,145 | 935 | 736 | 472 |
| MEREDITH LAKE/RESERVOIR | RESERVOIR | CANADIAN | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| PALO DURO LAKE/RESERVOIR | RESERVOIR | CANADIAN | FRESH | 3,917 | 3,875 | 3,833 | 3,792 | 3,750 | 3,708 |
| RED LIVESTOCK LOCAL SUPPLY | ARMSTRONG | RED | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| RED LIVESTOCK LOCAL SUPPLY | CARSON | RED | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| RED LIVESTOCK LOCAL SUPPLY | CHILDRESS | RED | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| RED LIVESTOCK LOCAL SUPPLY | COLLINGSWORTH | RED | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| RED LIVESTOCK LOCAL SUPPLY | DONLEY | RED | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| RED LIVESTOCK LOCAL SUPPLY | GRAY | RED | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| RED LIVESTOCK LOCAL SUPPLY | HALL | RED | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| RED LIVESTOCK LOCAL SUPPLY | HEMPHILL | RED | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |

Source Water Balance (Availability- WUG Supply)

| REGION A | | | | | | | | | |
|---|---------------|--------------|-----------------|--|------------------|------------------|------------------|------------------|------------------|
| SURFACE WATER | COUNTY | BASIN | SALINITY | SOURCE WATER BALANCE (ACRE-FEET PER YEAR) | | | | | |
| | | | | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| RED LIVESTOCK LOCAL SUPPLY | OLDHAM | RED | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| RED LIVESTOCK LOCAL SUPPLY | POTTER | RED | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| RED LIVESTOCK LOCAL SUPPLY | RANDALL | RED | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| RED LIVESTOCK LOCAL SUPPLY | ROBERTS | RED | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| RED LIVESTOCK LOCAL SUPPLY | WHEELER | RED | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| RED RUN-OF-RIVER | CARSON | RED | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| RED RUN-OF-RIVER | CHILDRESS | RED | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| RED RUN-OF-RIVER | COLLINGSWORTH | RED | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| RED RUN-OF-RIVER | DONLEY | RED | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| RED RUN-OF-RIVER | GRAY | RED | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| RED RUN-OF-RIVER | HALL | RED | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| RED RUN-OF-RIVER | RANDALL | RED | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| RED RUN-OF-RIVER | WHEELER | RED | FRESH | 0 | 0 | 0 | 0 | 0 | 0 |
| SURFACE WATER TOTAL SOURCE WATER BALANCE | | | | 5,455 | 5,214 | 4,978 | 4,727 | 4,486 | 4,180 |
| REGION A TOTAL SOURCE WATER BALANCE | | | | 2,122,904 | 1,952,908 | 1,778,048 | 1,630,719 | 1,499,446 | 1,396,527 |

Water User Group (WUG) Population

| REGION A | WUG POPULATION | | | | | |
|---|----------------|---------------|---------------|---------------|---------------|---------------|
| | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| DONLEY COUNTY | | | | | | |
| RED BASIN TOTAL POPULATION | 3,788 | 3,788 | 3,788 | 3,788 | 3,788 | 3,788 |
| DONLEY COUNTY TOTAL POPULATION | 3,788 | 3,788 | 3,788 | 3,788 | 3,788 | 3,788 |
| GRAY COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| PAMPA | 19,515 | 21,596 | 24,089 | 27,298 | 29,854 | 32,523 |
| COUNTY-OTHER | 2,650 | 2,933 | 3,271 | 3,706 | 4,054 | 4,416 |
| CANADIAN BASIN TOTAL POPULATION | 22,165 | 24,529 | 27,360 | 31,004 | 33,908 | 36,939 |
| RED BASIN | | | | | | |
| MCLEAN | 844 | 934 | 1,042 | 1,181 | 1,291 | 1,407 |
| COUNTY-OTHER | 1,430 | 1,583 | 1,766 | 2,001 | 2,189 | 2,384 |
| RED BASIN TOTAL POPULATION | 2,274 | 2,517 | 2,808 | 3,182 | 3,480 | 3,791 |
| GRAY COUNTY TOTAL POPULATION | 24,439 | 27,046 | 30,168 | 34,186 | 37,388 | 40,730 |
| HALL COUNTY | | | | | | |
| RED BASIN | | | | | | |
| MEMPHIS | 2,318 | 2,382 | 2,382 | 2,382 | 2,382 | 2,382 |
| COUNTY-OTHER | 1,075 | 1,105 | 1,105 | 1,105 | 1,105 | 1,105 |
| RED BASIN TOTAL POPULATION | 3,393 | 3,487 | 3,487 | 3,487 | 3,487 | 3,487 |
| HALL COUNTY TOTAL POPULATION | 3,393 | 3,487 | 3,487 | 3,487 | 3,487 | 3,487 |
| HANSFORD COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| GRUVER | 1,306 | 1,447 | 1,570 | 1,673 | 1,777 | 1,873 |
| SPEARMAN | 3,505 | 3,648 | 3,759 | 3,873 | 3,991 | 4,113 |
| COUNTY-OTHER | 1,148 | 1,273 | 1,381 | 1,471 | 1,562 | 1,648 |
| CANADIAN BASIN TOTAL POPULATION | 5,959 | 6,368 | 6,710 | 7,017 | 7,330 | 7,634 |
| HANSFORD COUNTY TOTAL POPULATION | 5,959 | 6,368 | 6,710 | 7,017 | 7,330 | 7,634 |
| HARTLEY COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| DALHART | 2,816 | 2,923 | 2,980 | 3,021 | 3,058 | 3,087 |
| COUNTY-OTHER | 3,465 | 3,708 | 3,837 | 3,929 | 4,011 | 4,077 |
| CANADIAN BASIN TOTAL POPULATION | 6,281 | 6,631 | 6,817 | 6,950 | 7,069 | 7,164 |
| HARTLEY COUNTY TOTAL POPULATION | 6,281 | 6,631 | 6,817 | 6,950 | 7,069 | 7,164 |
| HEMPHILL COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| CANADIAN | 3,016 | 3,381 | 3,691 | 4,010 | 4,295 | 4,556 |
| COUNTY-OTHER | 873 | 878 | 881 | 885 | 888 | 892 |
| CANADIAN BASIN TOTAL POPULATION | 3,889 | 4,259 | 4,572 | 4,895 | 5,183 | 5,448 |
| RED BASIN | | | | | | |
| COUNTY-OTHER | 320 | 350 | 376 | 402 | 426 | 447 |
| RED BASIN TOTAL POPULATION | 320 | 350 | 376 | 402 | 426 | 447 |
| HEMPHILL COUNTY TOTAL POPULATION | 4,209 | 4,609 | 4,948 | 5,297 | 5,609 | 5,895 |

Water User Group (WUG) Population

| REGION A | WUG POPULATION | | | | | |
|---|----------------|---------------|---------------|---------------|---------------|---------------|
| | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| HUTCHINSON COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| BORGER | 13,734 | 14,226 | 14,352 | 14,352 | 14,352 | 14,352 |
| FRITCH | 2,186 | 2,265 | 2,285 | 2,285 | 2,285 | 2,285 |
| STINNETT | 1,950 | 2,020 | 2,038 | 2,038 | 2,038 | 2,038 |
| TCW SUPPLY INC | 2,167 | 2,244 | 2,264 | 2,264 | 2,264 | 2,264 |
| COUNTY-OTHER | 2,920 | 3,024 | 3,051 | 3,051 | 3,051 | 3,051 |
| CANADIAN BASIN TOTAL POPULATION | 22,957 | 23,779 | 23,990 | 23,990 | 23,990 | 23,990 |
| HUTCHINSON COUNTY TOTAL POPULATION | 22,957 | 23,779 | 23,990 | 23,990 | 23,990 | 23,990 |
| LIPSCOMB COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| BOOKER | 1,740 | 1,948 | 2,071 | 2,232 | 2,344 | 2,436 |
| COUNTY-OTHER | 1,859 | 1,910 | 1,940 | 1,979 | 2,006 | 2,029 |
| CANADIAN BASIN TOTAL POPULATION | 3,599 | 3,858 | 4,011 | 4,211 | 4,350 | 4,465 |
| LIPSCOMB COUNTY TOTAL POPULATION | 3,599 | 3,858 | 4,011 | 4,211 | 4,350 | 4,465 |
| MOORE COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| CACTUS | 4,232 | 4,824 | 5,455 | 6,095 | 6,763 | 7,444 |
| DUMAS | 16,897 | 19,260 | 21,777 | 24,331 | 26,995 | 29,725 |
| FRITCH | 10 | 11 | 12 | 14 | 15 | 17 |
| SUNRAY | 2,216 | 2,525 | 2,855 | 3,190 | 3,540 | 3,897 |
| COUNTY-OTHER | 2,413 | 2,752 | 3,111 | 3,476 | 3,857 | 4,247 |
| CANADIAN BASIN TOTAL POPULATION | 25,768 | 29,372 | 33,210 | 37,106 | 41,170 | 45,330 |
| MOORE COUNTY TOTAL POPULATION | 25,768 | 29,372 | 33,210 | 37,106 | 41,170 | 45,330 |
| OCHILTREE COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| BOOKER | 22 | 33 | 45 | 58 | 74 | 92 |
| PERRYTON | 9,728 | 10,454 | 11,234 | 12,073 | 12,974 | 13,943 |
| COUNTY-OTHER | 1,555 | 1,671 | 1,796 | 1,930 | 2,074 | 2,229 |
| CANADIAN BASIN TOTAL POPULATION | 11,305 | 12,158 | 13,075 | 14,061 | 15,122 | 16,264 |
| OCHILTREE COUNTY TOTAL POPULATION | 11,305 | 12,158 | 13,075 | 14,061 | 15,122 | 16,264 |
| OLDHAM COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| VEGA | 961 | 1,024 | 1,024 | 1,024 | 1,024 | 1,024 |
| COUNTY-OTHER | 1,022 | 1,089 | 1,089 | 1,089 | 1,089 | 1,089 |
| CANADIAN BASIN TOTAL POPULATION | 1,983 | 2,113 | 2,113 | 2,113 | 2,113 | 2,113 |
| RED BASIN | | | | | | |
| COUNTY-OTHER | 247 | 263 | 263 | 263 | 263 | 263 |
| RED BASIN TOTAL POPULATION | 247 | 263 | 263 | 263 | 263 | 263 |
| OLDHAM COUNTY TOTAL POPULATION | 2,230 | 2,376 | 2,376 | 2,376 | 2,376 | 2,376 |

Water User Group (WUG) Population

| REGION A | WUG POPULATION | | | | | |
|--|----------------|----------------|----------------|----------------|----------------|----------------|
| | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| POTTER COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| AMARILLO | 70,415 | 78,259 | 86,558 | 94,822 | 103,832 | 113,322 |
| COUNTY-OTHER | 11,034 | 12,262 | 13,563 | 14,857 | 16,270 | 17,757 |
| CANADIAN BASIN TOTAL POPULATION | 81,449 | 90,521 | 100,121 | 109,679 | 120,102 | 131,079 |
| RED BASIN | | | | | | |
| AMARILLO | 46,360 | 51,523 | 56,988 | 62,428 | 68,361 | 74,609 |
| COUNTY-OTHER | 6,222 | 6,916 | 7,648 | 8,379 | 9,175 | 10,013 |
| RED BASIN TOTAL POPULATION | 52,582 | 58,439 | 64,636 | 70,807 | 77,536 | 84,622 |
| POTTER COUNTY TOTAL POPULATION | 134,031 | 148,960 | 164,757 | 180,486 | 197,638 | 215,701 |
| RANDALL COUNTY | | | | | | |
| RED BASIN | | | | | | |
| AMARILLO | 94,816 | 106,024 | 117,243 | 128,735 | 140,962 | 153,663 |
| CANYON | 14,803 | 16,553 | 18,305 | 20,099 | 22,008 | 23,991 |
| HAPPY | 68 | 76 | 84 | 93 | 101 | 111 |
| LAKE TANGLEWOOD | 820 | 820 | 820 | 820 | 820 | 820 |
| COUNTY-OTHER | 23,762 | 26,571 | 29,383 | 32,263 | 35,328 | 38,510 |
| RED BASIN TOTAL POPULATION | 134,269 | 150,044 | 165,835 | 182,010 | 199,219 | 217,095 |
| RANDALL COUNTY TOTAL POPULATION | 134,269 | 150,044 | 165,835 | 182,010 | 199,219 | 217,095 |
| ROBERTS COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| MIAMI | 613 | 623 | 624 | 624 | 624 | 624 |
| COUNTY-OTHER | 387 | 420 | 419 | 419 | 419 | 419 |
| CANADIAN BASIN TOTAL POPULATION | 1,000 | 1,043 | 1,043 | 1,043 | 1,043 | 1,043 |
| RED BASIN | | | | | | |
| COUNTY-OTHER | 3 | 4 | 4 | 4 | 4 | 4 |
| RED BASIN TOTAL POPULATION | 3 | 4 | 4 | 4 | 4 | 4 |
| ROBERTS COUNTY TOTAL POPULATION | 1,003 | 1,047 | 1,047 | 1,047 | 1,047 | 1,047 |
| SHERMAN COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| STRATFORD | 2,190 | 2,374 | 2,474 | 2,562 | 2,626 | 2,673 |
| COUNTY-OTHER | 1,104 | 1,197 | 1,246 | 1,291 | 1,323 | 1,347 |
| CANADIAN BASIN TOTAL POPULATION | 3,294 | 3,571 | 3,720 | 3,853 | 3,949 | 4,020 |
| SHERMAN COUNTY TOTAL POPULATION | 3,294 | 3,571 | 3,720 | 3,853 | 3,949 | 4,020 |
| WHEELER COUNTY | | | | | | |
| RED BASIN | | | | | | |
| SHAMROCK | 1,973 | 2,051 | 2,126 | 2,203 | 2,288 | 2,378 |
| WHEELER | 1,645 | 1,710 | 1,772 | 1,836 | 1,907 | 1,982 |
| COUNTY-OTHER | 1,969 | 2,048 | 2,121 | 2,200 | 2,283 | 2,373 |
| RED BASIN TOTAL POPULATION | 5,587 | 5,809 | 6,019 | 6,239 | 6,478 | 6,733 |
| WHEELER COUNTY TOTAL POPULATION | 5,587 | 5,809 | 6,019 | 6,239 | 6,478 | 6,733 |

Water User Group (WUG) Population

| | | | | | | |
|---------------------------|---------|---------|---------|---------|---------|---------|
| REGION A TOTAL POPULATION | 418,626 | 461,008 | 503,546 | 547,060 | 592,266 | 639,220 |
|---------------------------|---------|---------|---------|---------|---------|---------|



Water User Group (WUG) Demand

| REGION A | WUG DEMAND (ACRE-FEET PER YEAR) | | | | | |
|--|---------------------------------|---------------|---------------|---------------|---------------|---------------|
| | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| ARMSTRONG COUNTY | | | | | | |
| RED BASIN | | | | | | |
| CLAUDE | 358 | 353 | 348 | 346 | 345 | 345 |
| COUNTY-OTHER | 89 | 85 | 84 | 83 | 83 | 83 |
| LIVESTOCK | 645 | 649 | 652 | 656 | 659 | 663 |
| IRRIGATION | 4,194 | 3,990 | 3,708 | 3,296 | 2,884 | 2,472 |
| RED BASIN TOTAL DEMAND | 5,286 | 5,077 | 4,792 | 4,381 | 3,971 | 3,563 |
| ARMSTRONG COUNTY TOTAL DEMAND | 5,286 | 5,077 | 4,792 | 4,381 | 3,971 | 3,563 |
| CARSON COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| WHITE DEER | 106 | 107 | 107 | 107 | 107 | 107 |
| COUNTY-OTHER | 161 | 161 | 160 | 158 | 157 | 157 |
| MANUFACTURING | 25 | 28 | 30 | 32 | 35 | 37 |
| MINING | 14 | 14 | 14 | 14 | 14 | 14 |
| LIVESTOCK | 519 | 522 | 525 | 528 | 532 | 535 |
| IRRIGATION | 14,483 | 13,738 | 12,682 | 11,273 | 9,864 | 8,454 |
| CANADIAN BASIN TOTAL DEMAND | 15,308 | 14,570 | 13,518 | 12,112 | 10,709 | 9,304 |
| RED BASIN | | | | | | |
| GROOM | 179 | 176 | 174 | 173 | 173 | 173 |
| PANHANDLE | 572 | 581 | 582 | 577 | 576 | 576 |
| WHITE DEER | 138 | 141 | 141 | 140 | 140 | 140 |
| COUNTY-OTHER | 123 | 120 | 120 | 119 | 119 | 119 |
| MANUFACTURING | 394 | 432 | 469 | 500 | 541 | 587 |
| LIVESTOCK | 173 | 174 | 175 | 176 | 177 | 178 |
| IRRIGATION | 41,219 | 39,100 | 36,094 | 32,083 | 28,073 | 24,063 |
| RED BASIN TOTAL DEMAND | 42,798 | 40,724 | 37,755 | 33,768 | 29,799 | 25,836 |
| CARSON COUNTY TOTAL DEMAND | 58,106 | 55,294 | 51,273 | 45,880 | 40,508 | 35,140 |
| CHILDRESS COUNTY | | | | | | |
| RED BASIN | | | | | | |
| CHILDRESS | 1,624 | 1,658 | 1,686 | 1,722 | 1,768 | 1,814 |
| COUNTY-OTHER | 198 | 204 | 210 | 216 | 222 | 227 |
| LIVESTOCK | 490 | 493 | 495 | 497 | 500 | 503 |
| IRRIGATION | 7,308 | 7,026 | 6,601 | 5,868 | 5,134 | 4,401 |
| RED BASIN TOTAL DEMAND | 9,620 | 9,381 | 8,992 | 8,303 | 7,624 | 6,945 |
| CHILDRESS COUNTY TOTAL DEMAND | 9,620 | 9,381 | 8,992 | 8,303 | 7,624 | 6,945 |
| COLLINGSWORTH COUNTY | | | | | | |
| RED BASIN | | | | | | |
| WELLINGTON | 525 | 540 | 549 | 567 | 582 | 595 |
| COUNTY-OTHER | 191 | 197 | 200 | 207 | 212 | 217 |
| LIVESTOCK | 600 | 603 | 605 | 608 | 611 | 614 |
| IRRIGATION | 17,943 | 17,276 | 16,255 | 14,449 | 12,643 | 10,837 |
| RED BASIN TOTAL DEMAND | 19,259 | 18,616 | 17,609 | 15,831 | 14,048 | 12,263 |
| COLLINGSWORTH COUNTY TOTAL DEMAND | 19,259 | 18,616 | 17,609 | 15,831 | 14,048 | 12,263 |
| DALLAM COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| DALHART | 1,815 | 2,014 | 2,228 | 2,447 | 2,666 | 2,878 |
| TEXLINE | 227 | 253 | 280 | 308 | 335 | 362 |
| COUNTY-OTHER | 141 | 151 | 166 | 183 | 199 | 214 |

Water User Group (WUG) Demand

| REGION A | WUG DEMAND (ACRE-FEET PER YEAR) | | | | | |
|------------------------------------|---------------------------------|----------------|----------------|----------------|----------------|----------------|
| | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| DALLAM COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| MANUFACTURING | 9 | 9 | 10 | 10 | 11 | 11 |
| LIVESTOCK | 4,437 | 4,669 | 4,920 | 5,191 | 5,485 | 5,803 |
| IRRIGATION | 369,864 | 347,524 | 318,795 | 283,373 | 247,952 | 212,530 |
| CANADIAN BASIN TOTAL DEMAND | 376,493 | 354,620 | 326,399 | 291,512 | 256,648 | 221,798 |
| DALLAM COUNTY TOTAL DEMAND | 376,493 | 354,620 | 326,399 | 291,512 | 256,648 | 221,798 |
| DONLEY COUNTY | | | | | | |
| RED BASIN | | | | | | |
| CLARENDON | 378 | 369 | 361 | 356 | 356 | 356 |
| COUNTY-OTHER | 245 | 237 | 230 | 228 | 227 | 227 |
| LIVESTOCK | 1,330 | 1,332 | 1,333 | 1,335 | 1,337 | 1,339 |
| IRRIGATION | 24,080 | 23,203 | 21,847 | 19,419 | 16,992 | 14,564 |
| RED BASIN TOTAL DEMAND | 26,033 | 25,141 | 23,771 | 21,338 | 18,912 | 16,486 |
| DONLEY COUNTY TOTAL DEMAND | 26,033 | 25,141 | 23,771 | 21,338 | 18,912 | 16,486 |
| GRAY COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| PAMPA | 3,711 | 3,991 | 4,360 | 4,926 | 5,377 | 5,855 |
| COUNTY-OTHER | 450 | 488 | 537 | 604 | 659 | 717 |
| MANUFACTURING | 4,133 | 4,197 | 4,240 | 4,257 | 4,086 | 3,923 |
| MINING | 7 | 7 | 7 | 6 | 5 | 5 |
| STEAM ELECTRIC POWER | 1,409 | 2,112 | 2,299 | 2,952 | 3,087 | 3,320 |
| LIVESTOCK | 135 | 138 | 141 | 144 | 147 | 151 |
| IRRIGATION | 5,536 | 5,227 | 4,820 | 4,285 | 3,749 | 3,213 |
| CANADIAN BASIN TOTAL DEMAND | 15,381 | 16,160 | 16,404 | 17,174 | 17,110 | 17,184 |
| RED BASIN | | | | | | |
| MCLEAN | 205 | 222 | 243 | 274 | 299 | 326 |
| COUNTY-OTHER | 243 | 264 | 290 | 326 | 356 | 388 |
| MANUFACTURING | 217 | 221 | 223 | 224 | 215 | 206 |
| MINING | 68 | 67 | 60 | 54 | 48 | 42 |
| LIVESTOCK | 1,217 | 1,240 | 1,266 | 1,294 | 1,326 | 1,360 |
| IRRIGATION | 15,755 | 14,877 | 13,719 | 12,194 | 10,670 | 9,146 |
| RED BASIN TOTAL DEMAND | 17,705 | 16,891 | 15,801 | 14,366 | 12,914 | 11,468 |
| GRAY COUNTY TOTAL DEMAND | 33,086 | 33,051 | 32,205 | 31,540 | 30,024 | 28,652 |
| HALL COUNTY | | | | | | |
| RED BASIN | | | | | | |
| MEMPHIS | 383 | 382 | 372 | 370 | 369 | 369 |
| COUNTY-OTHER | 319 | 322 | 320 | 319 | 319 | 319 |
| LIVESTOCK | 336 | 337 | 339 | 340 | 341 | 343 |
| IRRIGATION | 10,134 | 9,806 | 9,274 | 8,243 | 7,213 | 6,182 |
| RED BASIN TOTAL DEMAND | 11,172 | 10,847 | 10,305 | 9,272 | 8,242 | 7,213 |
| HALL COUNTY TOTAL DEMAND | 11,172 | 10,847 | 10,305 | 9,272 | 8,242 | 7,213 |
| HANSFORD COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| GRUVER | 310 | 336 | 360 | 380 | 404 | 425 |
| SPEARMAN | 672 | 683 | 691 | 704 | 724 | 746 |
| COUNTY-OTHER | 138 | 145 | 157 | 167 | 176 | 186 |
| MANUFACTURING | 58 | 61 | 63 | 65 | 70 | 74 |

Water User Group (WUG) Demand

| REGION A | WUG DEMAND (ACRE-FEET PER YEAR) | | | | | |
|---------------------------------------|---------------------------------|----------------|----------------|----------------|----------------|----------------|
| | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| HANSFORD COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| MINING | 577 | 904 | 602 | 309 | 16 | 1 |
| LIVESTOCK | 3,432 | 3,574 | 3,724 | 3,881 | 4,046 | 4,219 |
| IRRIGATION | 134,902 | 126,481 | 115,759 | 102,897 | 90,035 | 77,173 |
| CANADIAN BASIN TOTAL DEMAND | 140,089 | 132,184 | 121,356 | 108,403 | 95,471 | 82,824 |
| HANSFORD COUNTY TOTAL DEMAND | 140,089 | 132,184 | 121,356 | 108,403 | 95,471 | 82,824 |
| HARTLEY COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| DALHART | 854 | 874 | 882 | 889 | 899 | 907 |
| COUNTY-OTHER | 655 | 687 | 700 | 711 | 725 | 737 |
| MANUFACTURING | 5 | 5 | 5 | 5 | 5 | 5 |
| MINING | 7 | 7 | 6 | 5 | 4 | 3 |
| LIVESTOCK | 6,498 | 6,977 | 7,498 | 8,066 | 8,684 | 9,359 |
| IRRIGATION | 345,365 | 325,882 | 300,290 | 266,924 | 233,559 | 200,193 |
| CANADIAN BASIN TOTAL DEMAND | 353,384 | 334,432 | 309,381 | 276,600 | 243,876 | 211,204 |
| HARTLEY COUNTY TOTAL DEMAND | 353,384 | 334,432 | 309,381 | 276,600 | 243,876 | 211,204 |
| HEMPHILL COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| CANADIAN | 786 | 866 | 934 | 1,009 | 1,079 | 1,145 |
| COUNTY-OTHER | 115 | 112 | 109 | 109 | 109 | 109 |
| MANUFACTURING | 6 | 6 | 6 | 6 | 6 | 6 |
| MINING | 926 | 705 | 498 | 293 | 89 | 27 |
| LIVESTOCK | 757 | 760 | 763 | 766 | 769 | 773 |
| IRRIGATION | 1,316 | 1,251 | 1,162 | 1,033 | 904 | 775 |
| CANADIAN BASIN TOTAL DEMAND | 3,906 | 3,700 | 3,472 | 3,216 | 2,956 | 2,835 |
| RED BASIN | | | | | | |
| COUNTY-OTHER | 43 | 45 | 46 | 49 | 52 | 55 |
| MINING | 1,388 | 1,058 | 746 | 439 | 134 | 41 |
| LIVESTOCK | 518 | 519 | 521 | 523 | 526 | 529 |
| IRRIGATION | 591 | 563 | 523 | 465 | 407 | 349 |
| RED BASIN TOTAL DEMAND | 2,540 | 2,185 | 1,836 | 1,476 | 1,119 | 974 |
| HEMPHILL COUNTY TOTAL DEMAND | 6,446 | 5,885 | 5,308 | 4,692 | 4,075 | 3,809 |
| HUTCHINSON COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| BORGER | 3,215 | 3,254 | 3,234 | 3,229 | 3,225 | 3,224 |
| FRITCH | 437 | 441 | 436 | 434 | 433 | 433 |
| STINNETT | 446 | 452 | 448 | 447 | 446 | 446 |
| TCW SUPPLY INC | 738 | 755 | 754 | 750 | 749 | 749 |
| COUNTY-OTHER | 312 | 319 | 321 | 320 | 320 | 319 |
| MANUFACTURING | 25,347 | 26,827 | 28,249 | 29,483 | 31,540 | 33,741 |
| MINING | 184 | 231 | 170 | 113 | 56 | 34 |
| LIVESTOCK | 847 | 873 | 903 | 935 | 971 | 1,010 |
| IRRIGATION | 40,008 | 37,671 | 34,635 | 30,786 | 26,938 | 23,090 |
| CANADIAN BASIN TOTAL DEMAND | 71,534 | 70,823 | 69,150 | 66,497 | 64,678 | 63,046 |
| HUTCHINSON COUNTY TOTAL DEMAND | 71,534 | 70,823 | 69,150 | 66,497 | 64,678 | 63,046 |

Water User Group (WUG) Demand

| REGION A | WUG DEMAND (ACRE-FEET PER YEAR) | | | | | |
|--------------------------------------|---------------------------------|----------------|----------------|----------------|----------------|----------------|
| | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| LIPSCOMB COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| BOOKER | 496 | 547 | 576 | 618 | 648 | 674 |
| COUNTY-OTHER | 445 | 448 | 447 | 453 | 459 | 464 |
| MANUFACTURING | 147 | 155 | 161 | 167 | 180 | 193 |
| MINING | 1,098 | 758 | 446 | 142 | 21 | 3 |
| LIVESTOCK | 947 | 969 | 993 | 1,020 | 1,050 | 1,083 |
| IRRIGATION | 20,009 | 19,014 | 17,650 | 15,689 | 13,728 | 11,767 |
| CANADIAN BASIN TOTAL DEMAND | 23,142 | 21,891 | 20,273 | 18,089 | 16,086 | 14,184 |
| LIPSCOMB COUNTY TOTAL DEMAND | 23,142 | 21,891 | 20,273 | 18,089 | 16,086 | 14,184 |
| MOORE COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| CACTUS | 985 | 1,108 | 1,242 | 1,382 | 1,532 | 1,686 |
| DUMAS | 3,538 | 3,941 | 4,388 | 4,866 | 5,391 | 5,933 |
| FRITCH | 2 | 3 | 3 | 3 | 3 | 4 |
| SUNRAY | 504 | 562 | 626 | 695 | 770 | 847 |
| COUNTY-OTHER | 327 | 360 | 397 | 439 | 486 | 534 |
| MANUFACTURING | 9,052 | 9,549 | 10,038 | 10,469 | 11,179 | 11,937 |
| MINING | 16 | 16 | 16 | 15 | 15 | 15 |
| STEAM ELECTRIC POWER | 200 | 0 | 0 | 0 | 0 | 0 |
| LIVESTOCK | 3,676 | 3,906 | 4,155 | 4,424 | 4,716 | 5,032 |
| IRRIGATION | 143,028 | 134,395 | 123,290 | 109,591 | 95,892 | 82,193 |
| CANADIAN BASIN TOTAL DEMAND | 161,328 | 153,840 | 144,155 | 131,884 | 119,984 | 108,181 |
| MOORE COUNTY TOTAL DEMAND | 161,328 | 153,840 | 144,155 | 131,884 | 119,984 | 108,181 |
| OCHILTREE COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| BOOKER | 7 | 10 | 13 | 17 | 21 | 26 |
| PERRYTON | 2,829 | 2,994 | 3,183 | 3,401 | 3,650 | 3,922 |
| COUNTY-OTHER | 239 | 248 | 260 | 278 | 298 | 320 |
| MINING | 824 | 853 | 503 | 161 | 23 | 3 |
| LIVESTOCK | 4,216 | 3,632 | 3,729 | 3,832 | 3,942 | 4,058 |
| IRRIGATION | 57,243 | 53,825 | 49,414 | 43,923 | 38,433 | 32,942 |
| CANADIAN BASIN TOTAL DEMAND | 65,358 | 61,562 | 57,102 | 51,612 | 46,367 | 41,271 |
| OCHILTREE COUNTY TOTAL DEMAND | 65,358 | 61,562 | 57,102 | 51,612 | 46,367 | 41,271 |
| OLDHAM COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| VEGA | 272 | 285 | 281 | 279 | 279 | 279 |
| COUNTY-OTHER | 302 | 315 | 312 | 312 | 311 | 311 |
| MINING | 456 | 540 | 613 | 644 | 708 | 776 |
| LIVESTOCK | 909 | 911 | 913 | 915 | 917 | 920 |
| IRRIGATION | 3,071 | 2,939 | 2,749 | 2,444 | 2,138 | 1,833 |
| CANADIAN BASIN TOTAL DEMAND | 5,010 | 4,990 | 4,868 | 4,594 | 4,353 | 4,119 |
| RED BASIN | | | | | | |
| COUNTY-OTHER | 73 | 77 | 76 | 76 | 76 | 76 |
| MINING | 19 | 23 | 26 | 27 | 29 | 32 |
| LIVESTOCK | 320 | 320 | 321 | 322 | 323 | 323 |
| IRRIGATION | 866 | 829 | 775 | 689 | 603 | 517 |

Water User Group (WUG) Demand

| REGION A | WUG DEMAND (ACRE-FEET PER YEAR) | | | | | |
|------------------------------------|---------------------------------|---------------|---------------|---------------|---------------|----------------|
| | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| OLDHAM COUNTY | | | | | | |
| RED BASIN TOTAL DEMAND | 1,278 | 1,249 | 1,198 | 1,114 | 1,031 | 948 |
| OLDHAM COUNTY TOTAL DEMAND | 6,288 | 6,239 | 6,066 | 5,708 | 5,384 | 5,067 |
| POTTER COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| AMARILLO | 15,884 | 17,294 | 18,856 | 20,510 | 22,424 | 24,462 |
| COUNTY-OTHER | 1,971 | 2,146 | 2,342 | 2,547 | 2,784 | 3,036 |
| MANUFACTURING | 1,457 | 1,569 | 1,679 | 1,773 | 1,904 | 2,043 |
| MINING | 640 | 781 | 912 | 988 | 1,109 | 1,245 |
| STEAM ELECTRIC POWER | 25,387 | 26,804 | 28,408 | 30,011 | 34,115 | 37,669 |
| LIVESTOCK | 399 | 400 | 402 | 403 | 405 | 408 |
| IRRIGATION | 1,679 | 1,613 | 1,514 | 1,346 | 1,178 | 1,010 |
| CANADIAN BASIN TOTAL DEMAND | 47,417 | 50,607 | 54,113 | 57,578 | 63,919 | 69,873 |
| RED BASIN | | | | | | |
| AMARILLO | 10,458 | 11,386 | 12,414 | 13,504 | 14,764 | 16,106 |
| COUNTY-OTHER | 1,112 | 1,210 | 1,320 | 1,436 | 1,569 | 1,712 |
| MANUFACTURING | 8,256 | 8,892 | 9,512 | 10,050 | 10,787 | 11,579 |
| MINING | 301 | 368 | 429 | 465 | 522 | 586 |
| LIVESTOCK | 82 | 82 | 82 | 83 | 83 | 83 |
| IRRIGATION | 1,748 | 1,679 | 1,577 | 1,402 | 1,226 | 1,051 |
| RED BASIN TOTAL DEMAND | 21,957 | 23,617 | 25,334 | 26,940 | 28,951 | 31,117 |
| POTTER COUNTY TOTAL DEMAND | 69,374 | 74,224 | 79,447 | 84,518 | 92,870 | 100,990 |
| RANDALL COUNTY | | | | | | |
| RED BASIN | | | | | | |
| AMARILLO | 21,389 | 23,430 | 25,540 | 27,846 | 30,443 | 33,171 |
| CANYON | 3,633 | 3,982 | 4,343 | 4,736 | 5,179 | 5,643 |
| HAPPY | 11 | 12 | 13 | 14 | 15 | 16 |
| LAKE TANGLEWOOD | 319 | 315 | 312 | 311 | 310 | 310 |
| COUNTY-OTHER | 3,665 | 4,002 | 4,359 | 4,748 | 5,187 | 5,651 |
| MANUFACTURING | 589 | 638 | 684 | 722 | 784 | 852 |
| LIVESTOCK | 2,654 | 2,665 | 2,677 | 2,690 | 2,704 | 2,719 |
| IRRIGATION | 18,000 | 17,156 | 15,976 | 14,201 | 12,426 | 10,650 |
| RED BASIN TOTAL DEMAND | 50,260 | 52,200 | 53,904 | 55,268 | 57,048 | 59,012 |
| RANDALL COUNTY TOTAL DEMAND | 50,260 | 52,200 | 53,904 | 55,268 | 57,048 | 59,012 |
| ROBERTS COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| MIAMI | 224 | 225 | 223 | 222 | 222 | 222 |
| COUNTY-OTHER | 48 | 50 | 48 | 48 | 48 | 48 |
| MINING | 1,457 | 1,010 | 593 | 183 | 19 | 2 |
| LIVESTOCK | 359 | 359 | 360 | 361 | 362 | 363 |
| IRRIGATION | 5,660 | 5,329 | 4,897 | 4,353 | 3,809 | 3,265 |
| CANADIAN BASIN TOTAL DEMAND | 7,748 | 6,973 | 6,121 | 5,167 | 4,460 | 3,900 |
| RED BASIN | | | | | | |
| COUNTY-OTHER | 1 | 1 | 1 | 1 | 1 | 1 |
| MINING | 45 | 31 | 18 | 6 | 1 | 0 |
| LIVESTOCK | 10 | 10 | 10 | 10 | 10 | 10 |
| IRRIGATION | 298 | 280 | 258 | 229 | 200 | 172 |

Water User Group (WUG) Demand

| REGION A | WUG DEMAND (ACRE-FEET PER YEAR) | | | | | |
|------------------------------------|---------------------------------|------------------|------------------|------------------|------------------|------------------|
| | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| ROBERTS COUNTY | | | | | | |
| RED BASIN TOTAL DEMAND | 354 | 322 | 287 | 246 | 212 | 183 |
| ROBERTS COUNTY TOTAL DEMAND | 8,102 | 7,295 | 6,408 | 5,413 | 4,672 | 4,083 |
| SHERMAN COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| STRATFORD | 470 | 498 | 510 | 524 | 536 | 546 |
| COUNTY-OTHER | 184 | 194 | 197 | 204 | 208 | 212 |
| MINING | 35 | 207 | 151 | 98 | 44 | 20 |
| LIVESTOCK | 3,449 | 3,631 | 3,825 | 4,034 | 4,257 | 4,497 |
| IRRIGATION | 220,966 | 207,757 | 190,687 | 169,499 | 148,312 | 127,125 |
| CANADIAN BASIN TOTAL DEMAND | 225,104 | 212,287 | 195,370 | 174,359 | 153,357 | 132,400 |
| SHERMAN COUNTY TOTAL DEMAND | 225,104 | 212,287 | 195,370 | 174,359 | 153,357 | 132,400 |
| WHEELER COUNTY | | | | | | |
| RED BASIN | | | | | | |
| SHAMROCK | 350 | 353 | 357 | 369 | 383 | 398 |
| WHEELER | 507 | 520 | 533 | 549 | 569 | 592 |
| COUNTY-OTHER | 290 | 291 | 293 | 302 | 313 | 325 |
| MINING | 3,268 | 2,329 | 1,413 | 503 | 139 | 119 |
| LIVESTOCK | 1,577 | 1,680 | 1,682 | 1,684 | 1,687 | 1,689 |
| IRRIGATION | 8,203 | 7,983 | 7,433 | 6,607 | 5,781 | 4,955 |
| RED BASIN TOTAL DEMAND | 14,195 | 13,156 | 11,711 | 10,014 | 8,872 | 8,078 |
| WHEELER COUNTY TOTAL DEMAND | 14,195 | 13,156 | 11,711 | 10,014 | 8,872 | 8,078 |
| REGION A TOTAL DEMAND | | | | | | |
| | 1,733,659 | 1,658,045 | 1,554,977 | 1,421,114 | 1,292,717 | 1,166,209 |

Water User Group (WUG) Existing Water Supply

| REGION A | SOURCE REGION SOURCE NAME | EXISTING SUPPLY (ACRE-FEET PER YEAR) | | | | | |
|---|---|--------------------------------------|---------------|---------------|---------------|---------------|---------------|
| | | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| ARMSTRONG COUNTY | | | | | | | |
| RED BASIN | | | | | | | |
| CLAUDE | A OGALLALA AQUIFER ARMSTRONG COUNTY | 463 | 405 | 354 | 311 | 273 | 235 |
| COUNTY-OTHER | A DOCKUM AQUIFER ARMSTRONG COUNTY | 16 | 16 | 16 | 16 | 16 | 16 |
| COUNTY-OTHER | A OGALLALA AQUIFER ARMSTRONG COUNTY | 84 | 84 | 84 | 84 | 84 | 84 |
| LIVESTOCK | A OGALLALA AQUIFER ARMSTRONG COUNTY | 493 | 497 | 500 | 504 | 507 | 511 |
| LIVESTOCK | A OTHER AQUIFER FRESH/BRACKISH ARMSTRONG COUNTY | 30 | 30 | 30 | 30 | 30 | 30 |
| LIVESTOCK | A RED LIVESTOCK LOCAL SUPPLY | 122 | 122 | 122 | 122 | 122 | 122 |
| IRRIGATION | A OGALLALA AQUIFER ARMSTRONG COUNTY | 4,194 | 3,990 | 3,708 | 3,296 | 2,884 | 2,472 |
| RED BASIN TOTAL EXISTING SUPPLY | | 5,402 | 5,144 | 4,814 | 4,363 | 3,916 | 3,470 |
| ARMSTRONG COUNTY TOTAL EXISTING SUPPLY | | 5,402 | 5,144 | 4,814 | 4,363 | 3,916 | 3,470 |
| CARSON COUNTY | | | | | | | |
| CANADIAN BASIN | | | | | | | |
| WHITE DEER | A OGALLALA AQUIFER CARSON COUNTY | 106 | 107 | 107 | 107 | 107 | 107 |
| COUNTY-OTHER | A OGALLALA AQUIFER CARSON COUNTY | 249 | 237 | 228 | 225 | 208 | 185 |
| MANUFACTURING | A OGALLALA AQUIFER CARSON COUNTY | 25 | 28 | 30 | 32 | 35 | 37 |
| MINING | A OGALLALA AQUIFER CARSON COUNTY | 14 | 14 | 14 | 14 | 14 | 14 |
| LIVESTOCK | A CANADIAN LIVESTOCK LOCAL SUPPLY | 59 | 59 | 59 | 59 | 59 | 59 |
| LIVESTOCK | A OGALLALA AQUIFER CARSON COUNTY | 460 | 463 | 466 | 469 | 473 | 476 |
| IRRIGATION | A OGALLALA AQUIFER CARSON COUNTY | 14,483 | 13,738 | 12,682 | 11,273 | 9,864 | 8,454 |
| CANADIAN BASIN TOTAL EXISTING SUPPLY | | 15,396 | 14,646 | 13,586 | 12,179 | 10,760 | 9,332 |
| RED BASIN | | | | | | | |
| GROOM | A OGALLALA AQUIFER CARSON COUNTY | 326 | 342 | 344 | 338 | 326 | 314 |
| PANHANDLE | A OGALLALA AQUIFER CARSON COUNTY | 483 | 60 | 0 | 0 | 0 | 0 |
| WHITE DEER | A OGALLALA AQUIFER CARSON COUNTY | 138 | 141 | 141 | 140 | 140 | 140 |
| COUNTY-OTHER | A OGALLALA AQUIFER CARSON COUNTY | 215 | 205 | 197 | 194 | 180 | 160 |
| MANUFACTURING | A OGALLALA AQUIFER CARSON COUNTY | 1,102 | 995 | 927 | 871 | 824 | 777 |
| LIVESTOCK | A OGALLALA AQUIFER CARSON COUNTY | 98 | 99 | 100 | 101 | 102 | 103 |
| LIVESTOCK | A RED LIVESTOCK LOCAL SUPPLY | 75 | 75 | 75 | 75 | 75 | 75 |
| IRRIGATION | A DIRECT REUSE | 57 | 58 | 58 | 58 | 58 | 58 |
| IRRIGATION | A OGALLALA AQUIFER CARSON COUNTY | 40,885 | 38,765 | 35,759 | 31,748 | 27,738 | 23,728 |
| IRRIGATION | A RED RUN-OF-RIVER | 277 | 277 | 277 | 277 | 277 | 277 |
| RED BASIN TOTAL EXISTING SUPPLY | | 43,656 | 41,017 | 37,878 | 33,802 | 29,720 | 25,632 |
| CARSON COUNTY TOTAL EXISTING SUPPLY | | 59,052 | 55,663 | 51,464 | 45,981 | 40,480 | 34,964 |
| CHILDRESS COUNTY | | | | | | | |
| RED BASIN | | | | | | | |
| CHILDRESS | A GREENBELT LAKE/RESERVOIR | 1,087 | 1,161 | 1,228 | 1,301 | 1,379 | 1,457 |
| CHILDRESS | A OGALLALA AQUIFER DONLEY COUNTY | 537 | 497 | 458 | 421 | 389 | 357 |
| COUNTY-OTHER | A GREENBELT LAKE/RESERVOIR | 119 | 129 | 138 | 147 | 156 | 164 |
| COUNTY-OTHER | A OGALLALA AQUIFER DONLEY COUNTY | 59 | 55 | 51 | 47 | 44 | 40 |
| COUNTY-OTHER | A OTHER AQUIFER FRESH/BRACKISH CHILDRESS COUNTY | 20 | 20 | 20 | 20 | 20 | 20 |
| COUNTY-OTHER | A SEYMOUR AQUIFER CHILDRESS COUNTY | 20 | 20 | 20 | 20 | 20 | 20 |
| LIVESTOCK | A BLAINE AQUIFER CHILDRESS COUNTY | 216 | 216 | 216 | 216 | 216 | 216 |

Water User Group (WUG) Existing Water Supply

| REGION A | SOURCE REGION SOURCE NAME | EXISTING SUPPLY (ACRE-FEET PER YEAR) | | | | | |
|---|---|--------------------------------------|----------------|----------------|----------------|----------------|----------------|
| | | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| CHILDRESS COUNTY | | | | | | | |
| RED BASIN | | | | | | | |
| LIVESTOCK | A RED LIVESTOCK LOCAL SUPPLY | 49 | 49 | 49 | 49 | 49 | 49 |
| LIVESTOCK | A SEYMOUR AQUIFER CHILDRESS COUNTY | 240 | 240 | 240 | 240 | 240 | 240 |
| IRRIGATION | A BLAINE AQUIFER CHILDRESS COUNTY | 6,995 | 6,713 | 6,288 | 5,555 | 4,821 | 4,088 |
| IRRIGATION | A DIRECT REUSE | 162 | 166 | 169 | 172 | 177 | 181 |
| IRRIGATION | A OTHER AQUIFER FRESH/BRACKISH CHILDRESS COUNTY | 213 | 213 | 213 | 213 | 213 | 213 |
| IRRIGATION | A RED RUN-OF-RIVER | 19 | 19 | 19 | 19 | 19 | 19 |
| IRRIGATION | A SEYMOUR AQUIFER CHILDRESS COUNTY | 100 | 100 | 100 | 100 | 100 | 100 |
| RED BASIN TOTAL EXISTING SUPPLY | | 9,836 | 9,598 | 9,209 | 8,520 | 7,843 | 7,164 |
| CHILDRESS COUNTY TOTAL EXISTING SUPPLY | | 9,836 | 9,598 | 9,209 | 8,520 | 7,843 | 7,164 |
| COLLINGSWORTH COUNTY | | | | | | | |
| RED BASIN | | | | | | | |
| WELLINGTON | A SEYMOUR AQUIFER COLLINGSWORTH COUNTY | 0 | 0 | 0 | 0 | 0 | 0 |
| COUNTY-OTHER | A BLAINE AQUIFER COLLINGSWORTH COUNTY | 8 | 8 | 8 | 8 | 8 | 8 |
| COUNTY-OTHER | A OTHER AQUIFER FRESH/BRACKISH COLLINGSWORTH COUNTY | 25 | 25 | 25 | 25 | 25 | 25 |
| COUNTY-OTHER | A SEYMOUR AQUIFER COLLINGSWORTH COUNTY | 204 | 204 | 204 | 204 | 204 | 204 |
| LIVESTOCK | A BLAINE AQUIFER COLLINGSWORTH COUNTY | 275 | 275 | 275 | 283 | 283 | 283 |
| LIVESTOCK | A OTHER AQUIFER FRESH/BRACKISH COLLINGSWORTH COUNTY | 276 | 276 | 276 | 276 | 276 | 276 |
| LIVESTOCK | A RED LIVESTOCK LOCAL SUPPLY | 29 | 29 | 29 | 29 | 29 | 29 |
| LIVESTOCK | A SEYMOUR AQUIFER COLLINGSWORTH COUNTY | 26 | 26 | 26 | 26 | 26 | 26 |
| IRRIGATION | A BLAINE AQUIFER COLLINGSWORTH COUNTY | 8,972 | 8,638 | 8,128 | 7,225 | 6,322 | 5,419 |
| IRRIGATION | A DIRECT REUSE | 53 | 54 | 55 | 57 | 58 | 60 |
| IRRIGATION | A OTHER AQUIFER FRESH/BRACKISH COLLINGSWORTH COUNTY | 8 | 8 | 8 | 8 | 8 | 8 |
| IRRIGATION | A RED RUN-OF-RIVER | 851 | 851 | 851 | 851 | 851 | 851 |
| IRRIGATION | A SEYMOUR AQUIFER COLLINGSWORTH COUNTY | 8,972 | 8,638 | 8,128 | 7,225 | 6,322 | 5,419 |
| RED BASIN TOTAL EXISTING SUPPLY | | 19,699 | 19,032 | 18,013 | 16,217 | 14,412 | 12,608 |
| COLLINGSWORTH COUNTY TOTAL EXISTING SUPPLY | | 19,699 | 19,032 | 18,013 | 16,217 | 14,412 | 12,608 |
| DALLAM COUNTY | | | | | | | |
| CANADIAN BASIN | | | | | | | |
| DALHART | A OGALLALA-RITA BLANCA AQUIFER DALLAM COUNTY | 1,306 | 1,220 | 1,112 | 993 | 872 | 744 |
| TEXLINE | A OGALLALA-RITA BLANCA AQUIFER DALLAM COUNTY | 227 | 253 | 280 | 262 | 236 | 201 |
| COUNTY-OTHER | A OGALLALA-RITA BLANCA AQUIFER DALLAM COUNTY | 141 | 151 | 166 | 183 | 199 | 214 |
| MANUFACTURING | A OGALLALA-RITA BLANCA AQUIFER DALLAM COUNTY | 9 | 9 | 10 | 10 | 11 | 11 |
| LIVESTOCK | A CANADIAN LIVESTOCK LOCAL SUPPLY | 2,488 | 2,488 | 2,488 | 2,488 | 2,488 | 2,488 |
| LIVESTOCK | A OGALLALA-RITA BLANCA AQUIFER DALLAM COUNTY | 1,949 | 2,181 | 2,432 | 2,703 | 2,997 | 3,315 |
| IRRIGATION | A DOCKUM AQUIFER DALLAM COUNTY | 3,026 | 3,026 | 3,026 | 3,026 | 3,026 | 3,026 |
| IRRIGATION | A OGALLALA-RITA BLANCA AQUIFER DALLAM COUNTY | 287,439 | 252,823 | 221,543 | 192,895 | 167,090 | 141,286 |
| CANADIAN BASIN TOTAL EXISTING SUPPLY | | 296,585 | 262,151 | 231,057 | 202,560 | 176,919 | 151,285 |

Water User Group (WUG) Existing Water Supply

| REGION A | SOURCE REGION SOURCE NAME | EXISTING SUPPLY (ACRE-FEET PER YEAR) | | | | | |
|---|--|--------------------------------------|----------------|----------------|----------------|----------------|----------------|
| | | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| DALLAM COUNTY TOTAL EXISTING SUPPLY | | 296,585 | 262,151 | 231,057 | 202,560 | 176,919 | 151,285 |
| DONLEY COUNTY | | | | | | | |
| RED BASIN | | | | | | | |
| CLARENDON | A GREENBELT LAKE/RESERVOIR | 253 | 258 | 263 | 269 | 278 | 286 |
| CLARENDON | A OGALLALA AQUIFER DONLEY COUNTY | 125 | 111 | 98 | 87 | 78 | 70 |
| COUNTY-OTHER | A GREENBELT LAKE/RESERVOIR | 64 | 66 | 69 | 72 | 74 | 76 |
| COUNTY-OTHER | A OGALLALA AQUIFER DONLEY COUNTY | 201 | 199 | 196 | 193 | 191 | 189 |
| LIVESTOCK | A OGALLALA AQUIFER DONLEY COUNTY | 664 | 666 | 667 | 669 | 671 | 673 |
| LIVESTOCK | A OTHER AQUIFER FRESH/BRACKISH DONLEY COUNTY | 383 | 383 | 383 | 383 | 383 | 383 |
| LIVESTOCK | A RED LIVESTOCK LOCAL SUPPLY | 283 | 283 | 283 | 283 | 283 | 283 |
| IRRIGATION | A OGALLALA AQUIFER DONLEY COUNTY | 24,080 | 23,203 | 21,847 | 19,419 | 16,992 | 14,564 |
| IRRIGATION | A RED RUN-OF-RIVER | 166 | 166 | 166 | 166 | 166 | 166 |
| RED BASIN TOTAL EXISTING SUPPLY | | 26,219 | 25,335 | 23,972 | 21,541 | 19,116 | 16,690 |
| DONLEY COUNTY TOTAL EXISTING SUPPLY | | 26,219 | 25,335 | 23,972 | 21,541 | 19,116 | 16,690 |
| GRAY COUNTY | | | | | | | |
| CANADIAN BASIN | | | | | | | |
| PAMPA | A OGALLALA AQUIFER GRAY COUNTY | 1,531 | 1,224 | 976 | 791 | 637 | 483 |
| PAMPA | A OGALLALA AQUIFER ROBERTS COUNTY | 2,484 | 1,015 | 893 | 1,945 | 1,755 | 1,566 |
| COUNTY-OTHER | A OGALLALA AQUIFER GRAY COUNTY | 450 | 488 | 537 | 604 | 659 | 717 |
| MANUFACTURING | A OGALLALA AQUIFER GRAY COUNTY | 4,371 | 4,370 | 4,465 | 4,465 | 4,275 | 4,085 |
| MINING | A OGALLALA AQUIFER GRAY COUNTY | 7 | 7 | 7 | 6 | 5 | 5 |
| STEAM ELECTRIC POWER | A OGALLALA AQUIFER GRAY COUNTY | 1,409 | 2,112 | 2,299 | 2,952 | 3,087 | 3,320 |
| LIVESTOCK | A CANADIAN LIVESTOCK LOCAL SUPPLY | 199 | 199 | 199 | 199 | 199 | 199 |
| LIVESTOCK | A OGALLALA AQUIFER GRAY COUNTY | 141 | 141 | 141 | 141 | 141 | 141 |
| IRRIGATION | A CANADIAN RUN-OF-RIVER | 1 | 1 | 1 | 1 | 1 | 1 |
| IRRIGATION | A DIRECT REUSE | 220 | 220 | 220 | 220 | 220 | 220 |
| IRRIGATION | A OGALLALA AQUIFER GRAY COUNTY | 5,315 | 5,006 | 4,599 | 4,064 | 3,528 | 2,992 |
| CANADIAN BASIN TOTAL EXISTING SUPPLY | | 16,128 | 14,783 | 14,337 | 15,388 | 14,507 | 13,729 |
| RED BASIN | | | | | | | |
| MCLEAN | A OGALLALA AQUIFER GRAY COUNTY | 245 | 240 | 244 | 185 | 164 | 144 |
| COUNTY-OTHER | A OGALLALA AQUIFER GRAY COUNTY | 243 | 264 | 290 | 326 | 356 | 388 |
| MANUFACTURING | A OGALLALA AQUIFER GRAY COUNTY | 229 | 230 | 235 | 235 | 225 | 215 |
| MINING | A OGALLALA AQUIFER GRAY COUNTY | 68 | 67 | 60 | 54 | 48 | 42 |
| LIVESTOCK | A OGALLALA AQUIFER GRAY COUNTY | 1,174 | 1,174 | 1,174 | 1,174 | 1,174 | 1,174 |
| LIVESTOCK | A RED LIVESTOCK LOCAL SUPPLY | 600 | 600 | 600 | 600 | 600 | 600 |
| IRRIGATION | A OGALLALA AQUIFER GRAY COUNTY | 15,700 | 14,822 | 13,664 | 12,139 | 10,615 | 9,091 |
| IRRIGATION | A RED RUN-OF-RIVER | 55 | 55 | 55 | 55 | 55 | 55 |
| RED BASIN TOTAL EXISTING SUPPLY | | 18,314 | 17,452 | 16,322 | 14,768 | 13,237 | 11,709 |
| GRAY COUNTY TOTAL EXISTING SUPPLY | | 34,442 | 32,235 | 30,659 | 30,156 | 27,744 | 25,438 |
| HALL COUNTY | | | | | | | |
| RED BASIN | | | | | | | |
| MEMPHIS | A GREENBELT LAKE/RESERVOIR | 67 | 70 | 73 | 76 | 78 | 80 |
| MEMPHIS | A OGALLALA AQUIFER DONLEY COUNTY | 361 | 324 | 299 | 226 | 191 | 156 |

Water User Group (WUG) Existing Water Supply

| REGION A | SOURCE REGION SOURCE NAME | EXISTING SUPPLY (ACRE-FEET PER YEAR) | | | | | |
|--|---|--------------------------------------|----------------|----------------|----------------|----------------|----------------|
| | | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| HALL COUNTY | | | | | | | |
| RED BASIN | | | | | | | |
| COUNTY-OTHER | A GREENBELT LAKE/RESERVOIR | 62 | 64 | 67 | 69 | 72 | 74 |
| COUNTY-OTHER | A OGALLALA AQUIFER DONLEY COUNTY | 115 | 113 | 110 | 108 | 105 | 103 |
| COUNTY-OTHER | A SEYMOUR AQUIFER HALL COUNTY | 142 | 142 | 142 | 142 | 142 | 142 |
| LIVESTOCK | A OTHER AQUIFER FRESH/BRACKISH HALL COUNTY | 300 | 300 | 300 | 300 | 300 | 300 |
| LIVESTOCK | A RED LIVESTOCK LOCAL SUPPLY | 91 | 91 | 91 | 91 | 91 | 91 |
| LIVESTOCK | A SEYMOUR AQUIFER HALL COUNTY | 15 | 15 | 15 | 15 | 15 | 15 |
| IRRIGATION | A DIRECT REUSE | 100 | 100 | 100 | 100 | 100 | 100 |
| IRRIGATION | A OTHER AQUIFER FRESH/BRACKISH HALL COUNTY | 786 | 786 | 786 | 786 | 721 | 618 |
| IRRIGATION | A RED RUN-OF-RIVER | 52 | 52 | 52 | 52 | 52 | 52 |
| IRRIGATION | A SEYMOUR AQUIFER HALL COUNTY | 9,196 | 8,868 | 8,336 | 7,305 | 6,340 | 5,412 |
| RED BASIN TOTAL EXISTING SUPPLY | | 11,287 | 10,925 | 10,371 | 9,270 | 8,207 | 7,143 |
| HALL COUNTY TOTAL EXISTING SUPPLY | | 11,287 | 10,925 | 10,371 | 9,270 | 8,207 | 7,143 |
| HANSFORD COUNTY | | | | | | | |
| CANADIAN BASIN | | | | | | | |
| GRUVER | A OGALLALA AQUIFER HANSFORD COUNTY | 371 | 338 | 249 | 184 | 132 | 81 |
| SPEARMAN | A OGALLALA AQUIFER HANSFORD COUNTY | 672 | 683 | 691 | 421 | 258 | 112 |
| COUNTY-OTHER | A OGALLALA AQUIFER HANSFORD COUNTY | 200 | 200 | 200 | 200 | 200 | 200 |
| MANUFACTURING | A OGALLALA AQUIFER HANSFORD COUNTY | 90 | 91 | 93 | 101 | 111 | 120 |
| MINING | A OGALLALA AQUIFER HANSFORD COUNTY | 577 | 904 | 602 | 309 | 16 | 1 |
| LIVESTOCK | A CANADIAN LIVESTOCK LOCAL SUPPLY | 2,617 | 2,617 | 2,617 | 2,617 | 2,617 | 2,617 |
| LIVESTOCK | A OGALLALA AQUIFER HANSFORD COUNTY | 815 | 957 | 1,107 | 1,264 | 1,429 | 1,602 |
| IRRIGATION | A CANADIAN RUN-OF-RIVER | 22 | 22 | 22 | 22 | 22 | 22 |
| IRRIGATION | A OGALLALA AQUIFER HANSFORD COUNTY | 134,902 | 126,481 | 115,759 | 102,897 | 90,035 | 77,173 |
| CANADIAN BASIN TOTAL EXISTING SUPPLY | | 140,266 | 132,293 | 121,340 | 108,015 | 94,820 | 81,928 |
| HANSFORD COUNTY TOTAL EXISTING SUPPLY | | 140,266 | 132,293 | 121,340 | 108,015 | 94,820 | 81,928 |
| HARTLEY COUNTY | | | | | | | |
| CANADIAN BASIN | | | | | | | |
| DALHART | A OGALLALA-RITA BLANCA AQUIFER DALLAM COUNTY | 614 | 530 | 440 | 361 | 294 | 234 |
| COUNTY-OTHER | A OGALLALA-RITA BLANCA AQUIFER HARTLEY COUNTY | 655 | 687 | 700 | 711 | 725 | 737 |
| MANUFACTURING | A OGALLALA-RITA BLANCA AQUIFER HARTLEY COUNTY | 5 | 5 | 5 | 5 | 5 | 5 |
| MINING | A OGALLALA-RITA BLANCA AQUIFER HARTLEY COUNTY | 7 | 7 | 6 | 5 | 4 | 3 |
| LIVESTOCK | A CANADIAN LIVESTOCK LOCAL SUPPLY | 3,193 | 3,193 | 3,193 | 3,193 | 3,193 | 3,193 |
| LIVESTOCK | A DOCKUM AQUIFER HARTLEY COUNTY | 1,161 | 1,161 | 1,161 | 1,161 | 1,161 | 1,161 |
| LIVESTOCK | A OGALLALA-RITA BLANCA AQUIFER HARTLEY COUNTY | 2,144 | 2,623 | 3,144 | 3,712 | 4,330 | 5,005 |
| IRRIGATION | A OGALLALA-RITA BLANCA AQUIFER HARTLEY COUNTY | 268,060 | 232,514 | 201,640 | 174,225 | 150,144 | 126,063 |
| CANADIAN BASIN TOTAL EXISTING SUPPLY | | 275,839 | 240,720 | 210,289 | 183,373 | 159,856 | 136,401 |
| HARTLEY COUNTY TOTAL EXISTING SUPPLY | | 275,839 | 240,720 | 210,289 | 183,373 | 159,856 | 136,401 |

Water User Group (WUG) Existing Water Supply

| REGION A | SOURCE REGION SOURCE NAME | EXISTING SUPPLY (ACRE-FEET PER YEAR) | | | | | |
|--|--|--------------------------------------|---------------|---------------|---------------|---------------|---------------|
| | | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| HEMPHILL COUNTY | | | | | | | |
| CANADIAN BASIN | | | | | | | |
| CANADIAN | A OGALLALA AQUIFER HEMPHILL COUNTY | 786 | 866 | 934 | 1,009 | 1,079 | 1,145 |
| COUNTY-OTHER | A OGALLALA AQUIFER HEMPHILL COUNTY | 132 | 132 | 132 | 132 | 132 | 132 |
| MANUFACTURING | A OGALLALA AQUIFER HEMPHILL COUNTY | 6 | 6 | 6 | 6 | 6 | 6 |
| MINING | A OGALLALA AQUIFER HEMPHILL COUNTY | 926 | 705 | 498 | 293 | 89 | 27 |
| LIVESTOCK | A CANADIAN LIVESTOCK LOCAL SUPPLY | 248 | 248 | 248 | 248 | 248 | 248 |
| LIVESTOCK | A OGALLALA AQUIFER HEMPHILL COUNTY | 509 | 512 | 515 | 518 | 521 | 525 |
| IRRIGATION | A OGALLALA AQUIFER HEMPHILL COUNTY | 1,316 | 1,251 | 1,162 | 1,033 | 904 | 775 |
| CANADIAN BASIN TOTAL EXISTING SUPPLY | | 3,923 | 3,720 | 3,495 | 3,239 | 2,979 | 2,858 |
| RED BASIN | | | | | | | |
| COUNTY-OTHER | A OGALLALA AQUIFER HEMPHILL COUNTY | 90 | 90 | 90 | 90 | 90 | 90 |
| MINING | A OGALLALA AQUIFER HEMPHILL COUNTY | 1,388 | 1,058 | 746 | 439 | 134 | 41 |
| LIVESTOCK | A OGALLALA AQUIFER HEMPHILL COUNTY | 345 | 346 | 348 | 350 | 353 | 356 |
| LIVESTOCK | A RED LIVESTOCK LOCAL SUPPLY | 173 | 173 | 173 | 173 | 173 | 173 |
| IRRIGATION | A OGALLALA AQUIFER HEMPHILL COUNTY | 591 | 563 | 523 | 465 | 407 | 349 |
| RED BASIN TOTAL EXISTING SUPPLY | | 2,587 | 2,230 | 1,880 | 1,517 | 1,157 | 1,009 |
| HEMPHILL COUNTY TOTAL EXISTING SUPPLY | | 6,510 | 5,950 | 5,375 | 4,756 | 4,136 | 3,867 |
| HUTCHINSON COUNTY | | | | | | | |
| CANADIAN BASIN | | | | | | | |
| BORGER | A OGALLALA AQUIFER HUTCHINSON COUNTY | 794 | 594 | 643 | 648 | 528 | 434 |
| BORGER | A OGALLALA AQUIFER ROBERTS COUNTY | 2,329 | 2,129 | 1,639 | 1,238 | 1,050 | 863 |
| FRITCH | A OGALLALA AQUIFER CARSON COUNTY | 437 | 441 | 436 | 434 | 433 | 433 |
| STINNETT | A OGALLALA AQUIFER HUTCHINSON COUNTY | 501 | 467 | 448 | 332 | 281 | 230 |
| TCW SUPPLY INC | A OGALLALA AQUIFER HUTCHINSON COUNTY | 663 | 504 | 379 | 284 | 214 | 180 |
| COUNTY-OTHER | A OGALLALA AQUIFER HUTCHINSON COUNTY | 455 | 448 | 441 | 433 | 426 | 421 |
| MANUFACTURING | A CANADIAN RUN-OF-RIVER | 2 | 2 | 2 | 2 | 2 | 2 |
| MANUFACTURING | A DIRECT REUSE | 1,045 | 1,045 | 1,045 | 1,045 | 1,045 | 1,045 |
| MANUFACTURING | A OGALLALA AQUIFER HUTCHINSON COUNTY | 22,810 | 23,220 | 23,663 | 24,122 | 25,406 | 26,778 |
| MANUFACTURING | A OGALLALA AQUIFER ROBERTS COUNTY | 1,500 | 1,700 | 1,800 | 1,700 | 1,600 | 1,500 |
| MINING | A OGALLALA AQUIFER HUTCHINSON COUNTY | 184 | 231 | 170 | 113 | 56 | 34 |
| LIVESTOCK | A CANADIAN LIVESTOCK LOCAL SUPPLY | 281 | 281 | 281 | 281 | 281 | 281 |
| LIVESTOCK | A OGALLALA AQUIFER HUTCHINSON COUNTY | 566 | 592 | 622 | 654 | 690 | 729 |
| IRRIGATION | A CANADIAN RUN-OF-RIVER | 96 | 96 | 96 | 96 | 96 | 96 |
| IRRIGATION | A OGALLALA AQUIFER HUTCHINSON COUNTY | 40,008 | 37,671 | 34,635 | 30,786 | 26,938 | 23,090 |
| CANADIAN BASIN TOTAL EXISTING SUPPLY | | 71,671 | 69,421 | 66,300 | 62,168 | 59,046 | 56,116 |
| HUTCHINSON COUNTY TOTAL EXISTING SUPPLY | | 71,671 | 69,421 | 66,300 | 62,168 | 59,046 | 56,116 |
| LIPSCOMB COUNTY | | | | | | | |
| CANADIAN BASIN | | | | | | | |
| BOOKER | A OGALLALA AQUIFER LIPSCOMB COUNTY | 496 | 547 | 499 | 361 | 300 | 240 |
| COUNTY-OTHER | A OGALLALA AQUIFER LIPSCOMB COUNTY | 473 | 473 | 473 | 473 | 473 | 473 |
| MANUFACTURING | A OGALLALA AQUIFER LIPSCOMB COUNTY | 147 | 155 | 140 | 98 | 83 | 69 |
| MINING | A OGALLALA AQUIFER LIPSCOMB COUNTY | 1,098 | 758 | 446 | 142 | 21 | 3 |
| LIVESTOCK | A CANADIAN LIVESTOCK LOCAL SUPPLY | 110 | 110 | 110 | 110 | 110 | 110 |

Water User Group (WUG) Existing Water Supply

| REGION A | SOURCE REGION SOURCE NAME | EXISTING SUPPLY (ACRE-FEET PER YEAR) | | | | | |
|---|---|--------------------------------------|----------------|----------------|----------------|----------------|---------------|
| | | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| LIPSCOMB COUNTY | | | | | | | |
| CANADIAN BASIN | | | | | | | |
| LIVESTOCK | A OGALLALA AQUIFER LIPSCOMB COUNTY | 837 | 859 | 883 | 910 | 940 | 973 |
| IRRIGATION | A CANADIAN RUN-OF-RIVER | 66 | 66 | 66 | 66 | 66 | 66 |
| IRRIGATION | A OGALLALA AQUIFER LIPSCOMB COUNTY | 20,009 | 19,014 | 17,650 | 15,689 | 13,728 | 11,767 |
| CANADIAN BASIN TOTAL EXISTING SUPPLY | | 23,236 | 21,982 | 20,267 | 17,849 | 15,721 | 13,701 |
| LIPSCOMB COUNTY TOTAL EXISTING SUPPLY | | 23,236 | 21,982 | 20,267 | 17,849 | 15,721 | 13,701 |
| MOORE COUNTY | | | | | | | |
| CANADIAN BASIN | | | | | | | |
| CACTUS | A OGALLALA AQUIFER MOORE COUNTY | 402 | 331 | 268 | 212 | 185 | 156 |
| DUMAS | A OGALLALA AQUIFER MOORE COUNTY | 1,132 | 790 | 573 | 318 | 162 | 7 |
| DUMAS | A OGALLALA-RITA BLANCA AQUIFER HARTLEY COUNTY | 2,116 | 2,130 | 2,030 | 1,869 | 1,679 | 1,489 |
| FRITCH | A OGALLALA AQUIFER CARSON COUNTY | 5 | 5 | 5 | 5 | 5 | 5 |
| SUNRAY | A OGALLALA AQUIFER MOORE COUNTY | 609 | 330 | 125 | 62 | 18 | 0 |
| COUNTY-OTHER | A OGALLALA AQUIFER MOORE COUNTY | 307 | 332 | 363 | 399 | 444 | 489 |
| COUNTY-OTHER | A OGALLALA-RITA BLANCA AQUIFER HARTLEY COUNTY | 55 | 44 | 36 | 27 | 21 | 15 |
| MANUFACTURING | A OGALLALA AQUIFER MOORE COUNTY | 7,175 | 7,203 | 7,284 | 6,024 | 5,032 | 4,191 |
| MINING | A OGALLALA AQUIFER MOORE COUNTY | 16 | 16 | 16 | 15 | 15 | 15 |
| STEAM ELECTRIC POWER | A OGALLALA AQUIFER MOORE COUNTY | 200 | 0 | 0 | 0 | 0 | 0 |
| LIVESTOCK | A CANADIAN LIVESTOCK LOCAL SUPPLY | 1,000 | 1,000 | 1,000 | 1,000 | 1,000 | 1,000 |
| LIVESTOCK | A OGALLALA AQUIFER MOORE COUNTY | 2,676 | 2,906 | 3,155 | 3,424 | 3,716 | 4,032 |
| IRRIGATION | A CANADIAN RUN-OF-RIVER | 7 | 7 | 7 | 7 | 7 | 7 |
| IRRIGATION | A OGALLALA AQUIFER MOORE COUNTY | 143,028 | 134,395 | 123,290 | 109,591 | 92,003 | 76,015 |
| CANADIAN BASIN TOTAL EXISTING SUPPLY | | 158,728 | 149,489 | 138,152 | 122,953 | 104,287 | 87,421 |
| MOORE COUNTY TOTAL EXISTING SUPPLY | | 158,728 | 149,489 | 138,152 | 122,953 | 104,287 | 87,421 |
| OCHILTREE COUNTY | | | | | | | |
| CANADIAN BASIN | | | | | | | |
| BOOKER | A OGALLALA AQUIFER LIPSCOMB COUNTY | 7 | 10 | 11 | 10 | 10 | 9 |
| PERRYTON | A OGALLALA AQUIFER OCHILTREE COUNTY | 2,351 | 2,031 | 1,745 | 1,524 | 1,309 | 1,136 |
| COUNTY-OTHER | A OGALLALA AQUIFER OCHILTREE COUNTY | 263 | 273 | 286 | 306 | 328 | 352 |
| MINING | A OGALLALA AQUIFER OCHILTREE COUNTY | 824 | 853 | 503 | 161 | 23 | 3 |
| LIVESTOCK | A CANADIAN LIVESTOCK LOCAL SUPPLY | 421 | 421 | 421 | 421 | 421 | 421 |
| LIVESTOCK | A OGALLALA AQUIFER OCHILTREE COUNTY | 3,795 | 3,211 | 3,308 | 3,411 | 3,521 | 3,637 |
| IRRIGATION | A OGALLALA AQUIFER OCHILTREE COUNTY | 57,243 | 53,825 | 49,414 | 43,923 | 38,433 | 32,942 |
| CANADIAN BASIN TOTAL EXISTING SUPPLY | | 64,904 | 60,624 | 55,688 | 49,756 | 44,045 | 38,500 |
| OCHILTREE COUNTY TOTAL EXISTING SUPPLY | | 64,904 | 60,624 | 55,688 | 49,756 | 44,045 | 38,500 |
| OLDHAM COUNTY | | | | | | | |
| CANADIAN BASIN | | | | | | | |
| VEGA | A OGALLALA AQUIFER OLDHAM COUNTY | 90 | 90 | 90 | 90 | 90 | 90 |
| VEGA | O OGALLALA AQUIFER DEAF SMITH COUNTY | 200 | 200 | 200 | 200 | 200 | 200 |
| COUNTY-OTHER | A DOCKUM AQUIFER OLDHAM COUNTY | 387 | 387 | 387 | 387 | 387 | 387 |
| COUNTY-OTHER | A OGALLALA AQUIFER OLDHAM COUNTY | 214 | 210 | 211 | 211 | 211 | 211 |
| MINING | A DOCKUM AQUIFER OLDHAM COUNTY | 283 | 283 | 283 | 283 | 283 | 283 |

Water User Group (WUG) Existing Water Supply

| REGION A | SOURCE REGION SOURCE NAME | EXISTING SUPPLY (ACRE-FEET PER YEAR) | | | | | |
|---|--|--------------------------------------|---------------|---------------|---------------|---------------|---------------|
| | | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| OLDHAM COUNTY | | | | | | | |
| CANADIAN BASIN | | | | | | | |
| MINING | A OGALLALA AQUIFER OLDHAM COUNTY | 173 | 257 | 330 | 361 | 425 | 493 |
| LIVESTOCK | A CANADIAN LIVESTOCK LOCAL SUPPLY | 626 | 626 | 626 | 626 | 626 | 626 |
| LIVESTOCK | A DOCKUM AQUIFER OLDHAM COUNTY | 430 | 430 | 430 | 430 | 430 | 430 |
| LIVESTOCK | A OGALLALA AQUIFER OLDHAM COUNTY | 356 | 356 | 356 | 356 | 356 | 356 |
| IRRIGATION | A DOCKUM AQUIFER OLDHAM COUNTY | 372 | 372 | 372 | 372 | 372 | 372 |
| IRRIGATION | A OGALLALA AQUIFER OLDHAM COUNTY | 2,699 | 2,567 | 2,377 | 2,072 | 1,766 | 1,461 |
| CANADIAN BASIN TOTAL EXISTING SUPPLY | | 5,830 | 5,778 | 5,662 | 5,388 | 5,146 | 4,909 |
| RED BASIN | | | | | | | |
| COUNTY-OTHER | A OGALLALA AQUIFER OLDHAM COUNTY | 73 | 77 | 76 | 76 | 76 | 76 |
| MINING | A OGALLALA AQUIFER OLDHAM COUNTY | 19 | 23 | 26 | 27 | 29 | 32 |
| LIVESTOCK | A OGALLALA AQUIFER OLDHAM COUNTY | 119 | 119 | 119 | 119 | 119 | 119 |
| LIVESTOCK | A RED LIVESTOCK LOCAL SUPPLY | 209 | 209 | 209 | 209 | 209 | 209 |
| IRRIGATION | A OGALLALA AQUIFER OLDHAM COUNTY | 866 | 829 | 775 | 689 | 603 | 517 |
| RED BASIN TOTAL EXISTING SUPPLY | | 1,286 | 1,257 | 1,205 | 1,120 | 1,036 | 953 |
| OLDHAM COUNTY TOTAL EXISTING SUPPLY | | 7,116 | 7,035 | 6,867 | 6,508 | 6,182 | 5,862 |
| POTTER COUNTY | | | | | | | |
| CANADIAN BASIN | | | | | | | |
| AMARILLO | A OGALLALA AQUIFER CARSON COUNTY | 3,643 | 3,112 | 2,617 | 2,211 | 1,911 | 1,610 |
| AMARILLO | A OGALLALA AQUIFER POTTER COUNTY | 3,151 | 2,452 | 2,364 | 2,233 | 2,056 | 1,879 |
| AMARILLO | A OGALLALA AQUIFER RANDALL COUNTY | 753 | 576 | 455 | 365 | 295 | 225 |
| AMARILLO | A OGALLALA AQUIFER ROBERTS COUNTY | 6,803 | 6,992 | 6,146 | 5,279 | 4,931 | 4,433 |
| AMARILLO | O OGALLALA AQUIFER DEAF SMITH COUNTY | 33 | 33 | 33 | 33 | 16 | 0 |
| COUNTY-OTHER | A DOCKUM AQUIFER POTTER COUNTY | 900 | 900 | 900 | 900 | 900 | 900 |
| COUNTY-OTHER | A OGALLALA AQUIFER POTTER COUNTY | 800 | 800 | 800 | 800 | 800 | 800 |
| MANUFACTURING | A OGALLALA AQUIFER POTTER COUNTY | 219 | 191 | 169 | 154 | 137 | 122 |
| MANUFACTURING | A OGALLALA AQUIFER ROBERTS COUNTY | 924 | 836 | 724 | 612 | 547 | 476 |
| MINING | A OGALLALA AQUIFER POTTER COUNTY | 640 | 781 | 912 | 988 | 1,109 | 1,245 |
| STEAM ELECTRIC POWER | A DIRECT REUSE | 25,387 | 26,804 | 28,408 | 30,011 | 34,115 | 37,669 |
| LIVESTOCK | A CANADIAN LIVESTOCK LOCAL SUPPLY | 500 | 500 | 500 | 500 | 500 | 500 |
| LIVESTOCK | A DOCKUM AQUIFER POTTER COUNTY | 13 | 13 | 13 | 13 | 13 | 13 |
| LIVESTOCK | A OGALLALA AQUIFER POTTER COUNTY | 50 | 50 | 50 | 50 | 50 | 50 |
| IRRIGATION | A DIRECT REUSE | 555 | 617 | 711 | 760 | 727 | 700 |
| IRRIGATION | A OGALLALA AQUIFER POTTER COUNTY | 1,305 | 1,033 | 803 | 586 | 451 | 317 |
| CANADIAN BASIN TOTAL EXISTING SUPPLY | | 45,676 | 45,690 | 45,605 | 45,495 | 48,558 | 50,939 |
| RED BASIN | | | | | | | |
| AMARILLO | A OGALLALA AQUIFER CARSON COUNTY | 2,399 | 2,049 | 1,722 | 1,456 | 1,257 | 1,059 |
| AMARILLO | A OGALLALA AQUIFER POTTER COUNTY | 2,074 | 1,614 | 1,557 | 1,470 | 1,353 | 1,237 |
| AMARILLO | A OGALLALA AQUIFER RANDALL COUNTY | 496 | 379 | 300 | 240 | 194 | 149 |
| AMARILLO | A OGALLALA AQUIFER ROBERTS COUNTY | 4,480 | 4,603 | 4,046 | 3,476 | 3,246 | 2,919 |
| AMARILLO | O OGALLALA AQUIFER DEAF SMITH COUNTY | 22 | 22 | 22 | 22 | 11 | 0 |
| COUNTY-OTHER | A OGALLALA AQUIFER POTTER COUNTY | 700 | 700 | 700 | 700 | 700 | 500 |

Water User Group (WUG) Existing Water Supply

| REGION A | SOURCE REGION SOURCE NAME | EXISTING SUPPLY (ACRE-FEET PER YEAR) | | | | | |
|---|--|--------------------------------------|---------------|---------------|---------------|---------------|---------------|
| | | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| POTTER COUNTY | | | | | | | |
| RED BASIN | | | | | | | |
| MANUFACTURING | A OGALLALA AQUIFER POTTER COUNTY | 1,238 | 1,085 | 957 | 871 | 776 | 692 |
| MANUFACTURING | A OGALLALA AQUIFER ROBERTS COUNTY | 5,233 | 4,738 | 4,102 | 3,472 | 3,101 | 2,699 |
| MINING | A OGALLALA AQUIFER POTTER COUNTY | 301 | 368 | 429 | 465 | 522 | 586 |
| LIVESTOCK | A OGALLALA AQUIFER POTTER COUNTY | 50 | 50 | 50 | 50 | 50 | 50 |
| LIVESTOCK | A RED LIVESTOCK LOCAL SUPPLY | 62 | 62 | 62 | 62 | 62 | 62 |
| IRRIGATION | A DIRECT REUSE | 1,645 | 1,583 | 1,489 | 1,440 | 1,473 | 1,500 |
| IRRIGATION | A OGALLALA AQUIFER POTTER COUNTY | 103 | 96 | 89 | 83 | 76 | 70 |
| RED BASIN TOTAL EXISTING SUPPLY | | 18,803 | 17,349 | 15,525 | 13,807 | 12,821 | 11,523 |
| POTTER COUNTY TOTAL EXISTING SUPPLY | | 64,479 | 63,039 | 61,130 | 59,302 | 61,379 | 62,462 |
| RANDALL COUNTY | | | | | | | |
| RED BASIN | | | | | | | |
| AMARILLO | A OGALLALA AQUIFER CARSON COUNTY | 4,906 | 4,217 | 3,544 | 3,002 | 2,592 | 2,181 |
| AMARILLO | A OGALLALA AQUIFER POTTER COUNTY | 4,242 | 3,322 | 3,202 | 3,032 | 2,790 | 2,548 |
| AMARILLO | A OGALLALA AQUIFER RANDALL COUNTY | 1,014 | 780 | 617 | 495 | 401 | 306 |
| AMARILLO | A OGALLALA AQUIFER ROBERTS COUNTY | 9,162 | 9,473 | 8,325 | 7,167 | 6,693 | 6,011 |
| AMARILLO | O OGALLALA AQUIFER DEAF SMITH COUNTY | 45 | 45 | 45 | 45 | 23 | 0 |
| CANYON | A DOCKUM AQUIFER RANDALL COUNTY | 218 | 207 | 197 | 187 | 178 | 169 |
| CANYON | A OGALLALA AQUIFER RANDALL COUNTY | 1,500 | 1,425 | 1,354 | 1,286 | 1,222 | 1,161 |
| CANYON | A OGALLALA AQUIFER ROBERTS COUNTY | 906 | 761 | 616 | 493 | 0 | 0 |
| HAPPY | A DOCKUM AQUIFER RANDALL COUNTY | 5 | 5 | 6 | 6 | 6 | 7 |
| HAPPY | O OGALLALA AQUIFER SWISHER COUNTY | 10 | 12 | 12 | 13 | 12 | 10 |
| LAKE TANGLEWOOD | A OGALLALA AQUIFER RANDALL COUNTY | 147 | 115 | 87 | 63 | 44 | 26 |
| COUNTY-OTHER | A DOCKUM AQUIFER RANDALL COUNTY | 689 | 689 | 689 | 689 | 689 | 689 |
| COUNTY-OTHER | A OGALLALA AQUIFER RANDALL COUNTY | 2,316 | 2,316 | 2,316 | 2,316 | 2,316 | 2,316 |
| COUNTY-OTHER | A OGALLALA AQUIFER ROBERTS COUNTY | 23 | 19 | 15 | 12 | 10 | 8 |
| MANUFACTURING | A OGALLALA AQUIFER RANDALL COUNTY | 50 | 50 | 50 | 50 | 50 | 50 |
| MANUFACTURING | A OGALLALA AQUIFER ROBERTS COUNTY | 498 | 419 | 339 | 271 | 226 | 183 |
| LIVESTOCK | A DOCKUM AQUIFER RANDALL COUNTY | 230 | 230 | 230 | 230 | 230 | 230 |
| LIVESTOCK | A OGALLALA AQUIFER RANDALL COUNTY | 1,112 | 1,123 | 1,135 | 1,148 | 1,162 | 1,177 |
| LIVESTOCK | A RED LIVESTOCK LOCAL SUPPLY | 1,312 | 1,312 | 1,312 | 1,312 | 1,312 | 1,312 |
| IRRIGATION | A DIRECT REUSE | 545 | 597 | 651 | 710 | 777 | 846 |
| IRRIGATION | A OGALLALA AQUIFER RANDALL COUNTY | 18,000 | 17,156 | 15,976 | 14,201 | 12,426 | 10,650 |
| IRRIGATION | A RED RUN-OF-RIVER | 217 | 217 | 217 | 217 | 217 | 217 |
| RED BASIN TOTAL EXISTING SUPPLY | | 47,147 | 44,490 | 40,935 | 36,945 | 33,376 | 30,097 |
| RANDALL COUNTY TOTAL EXISTING SUPPLY | | 47,147 | 44,490 | 40,935 | 36,945 | 33,376 | 30,097 |
| ROBERTS COUNTY | | | | | | | |
| CANADIAN BASIN | | | | | | | |
| MIAMI | A OGALLALA AQUIFER ROBERTS COUNTY | 541 | 541 | 541 | 459 | 393 | 326 |
| COUNTY-OTHER | A OGALLALA AQUIFER ROBERTS COUNTY | 60 | 60 | 60 | 60 | 60 | 60 |
| MINING | A OGALLALA AQUIFER ROBERTS COUNTY | 1,457 | 1,010 | 593 | 183 | 19 | 2 |
| LIVESTOCK | A CANADIAN LIVESTOCK LOCAL SUPPLY | 124 | 124 | 124 | 124 | 124 | 124 |

Water User Group (WUG) Existing Water Supply

| REGION A | SOURCE REGION SOURCE NAME | EXISTING SUPPLY (ACRE-FEET PER YEAR) | | | | | |
|---|---|--------------------------------------|----------------|----------------|----------------|----------------|----------------|
| | | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| ROBERTS COUNTY | | | | | | | |
| CANADIAN BASIN | | | | | | | |
| LIVESTOCK | A OGALLALA AQUIFER ROBERTS COUNTY | 338 | 338 | 338 | 338 | 338 | 338 |
| IRRIGATION | A CANADIAN RUN-OF-RIVER | 72 | 72 | 72 | 72 | 72 | 72 |
| IRRIGATION | A OGALLALA AQUIFER ROBERTS COUNTY | 5,588 | 5,257 | 4,825 | 4,281 | 3,737 | 3,193 |
| CANADIAN BASIN TOTAL EXISTING SUPPLY | | 8,180 | 7,402 | 6,553 | 5,517 | 4,743 | 4,115 |
| RED BASIN | | | | | | | |
| COUNTY-OTHER | A OGALLALA AQUIFER ROBERTS COUNTY | 5 | 5 | 5 | 5 | 5 | 5 |
| MINING | A OGALLALA AQUIFER ROBERTS COUNTY | 45 | 31 | 18 | 6 | 1 | 0 |
| LIVESTOCK | A OGALLALA AQUIFER ROBERTS COUNTY | 10 | 10 | 10 | 10 | 10 | 10 |
| LIVESTOCK | A RED LIVESTOCK LOCAL SUPPLY | 15 | 15 | 15 | 15 | 15 | 15 |
| IRRIGATION | A OGALLALA AQUIFER ROBERTS COUNTY | 298 | 280 | 258 | 229 | 200 | 172 |
| RED BASIN TOTAL EXISTING SUPPLY | | 373 | 341 | 306 | 265 | 231 | 202 |
| ROBERTS COUNTY TOTAL EXISTING SUPPLY | | 8,553 | 7,743 | 6,859 | 5,782 | 4,974 | 4,317 |
| SHERMAN COUNTY | | | | | | | |
| CANADIAN BASIN | | | | | | | |
| STRATFORD | A OGALLALA AQUIFER SHERMAN COUNTY | 1,251 | 1,251 | 1,251 | 1,107 | 920 | 733 |
| COUNTY-OTHER | A OGALLALA AQUIFER SHERMAN COUNTY | 184 | 194 | 197 | 204 | 208 | 212 |
| MINING | A OGALLALA AQUIFER SHERMAN COUNTY | 35 | 207 | 151 | 98 | 44 | 20 |
| LIVESTOCK | A CANADIAN LIVESTOCK LOCAL SUPPLY | 1,052 | 1,052 | 1,052 | 1,052 | 1,052 | 1,052 |
| LIVESTOCK | A OGALLALA AQUIFER SHERMAN COUNTY | 2,397 | 2,579 | 2,773 | 2,982 | 3,205 | 3,445 |
| IRRIGATION | A CANADIAN RUN-OF-RIVER | 32 | 32 | 32 | 32 | 32 | 32 |
| IRRIGATION | A OGALLALA AQUIFER SHERMAN COUNTY | 220,966 | 207,757 | 190,687 | 169,499 | 148,312 | 127,125 |
| CANADIAN BASIN TOTAL EXISTING SUPPLY | | 225,917 | 213,072 | 196,143 | 174,974 | 153,773 | 132,619 |
| SHERMAN COUNTY TOTAL EXISTING SUPPLY | | 225,917 | 213,072 | 196,143 | 174,974 | 153,773 | 132,619 |
| WHEELER COUNTY | | | | | | | |
| RED BASIN | | | | | | | |
| SHAMROCK | A OGALLALA AQUIFER WHEELER COUNTY | 957 | 912 | 872 | 820 | 765 | 710 |
| WHEELER | A OGALLALA AQUIFER WHEELER COUNTY | 323 | 271 | 225 | 184 | 157 | 139 |
| COUNTY-OTHER | A BLAINE AQUIFER WHEELER COUNTY | 15 | 15 | 15 | 15 | 15 | 15 |
| COUNTY-OTHER | A OGALLALA AQUIFER WHEELER COUNTY | 348 | 348 | 348 | 348 | 348 | 348 |
| COUNTY-OTHER | A OTHER AQUIFER FRESH/BRACKISH WHEELER COUNTY | 22 | 22 | 22 | 22 | 22 | 22 |
| MINING | A OGALLALA AQUIFER WHEELER COUNTY | 3,268 | 2,329 | 1,413 | 503 | 139 | 119 |
| LIVESTOCK | A BLAINE AQUIFER WHEELER COUNTY | 19 | 19 | 19 | 19 | 19 | 19 |
| LIVESTOCK | A OGALLALA AQUIFER WHEELER COUNTY | 803 | 803 | 803 | 803 | 803 | 803 |
| LIVESTOCK | A OTHER AQUIFER FRESH/BRACKISH WHEELER COUNTY | 28 | 28 | 28 | 28 | 28 | 28 |
| LIVESTOCK | A RED LIVESTOCK LOCAL SUPPLY | 845 | 845 | 845 | 845 | 845 | 845 |
| IRRIGATION | A BLAINE AQUIFER WHEELER COUNTY | 15 | 15 | 15 | 15 | 15 | 15 |
| IRRIGATION | A DIRECT REUSE | 51 | 52 | 53 | 55 | 57 | 59 |
| IRRIGATION | A OGALLALA AQUIFER WHEELER COUNTY | 8,203 | 7,983 | 7,433 | 6,607 | 5,781 | 4,955 |
| IRRIGATION | A OTHER AQUIFER FRESH/BRACKISH WHEELER COUNTY | 226 | 226 | 226 | 226 | 226 | 226 |
| IRRIGATION | A RED RUN-OF-RIVER | 603 | 603 | 603 | 603 | 603 | 603 |
| RED BASIN TOTAL EXISTING SUPPLY | | 15,726 | 14,471 | 12,920 | 11,093 | 9,823 | 8,906 |

Water User Group (WUG) Existing Water Supply


| REGION A | SOURCE REGION SOURCE NAME | EXISTING SUPPLY (ACRE-FEET PER YEAR) | | | | | |
|---|-----------------------------|--------------------------------------|-----------|-----------|-----------|-----------|---------|
| | | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| WHEELER COUNTY TOTAL EXISTING SUPPLY | | 15,726 | 14,471 | 12,920 | 11,093 | 9,823 | 8,906 |
| REGION A TOTAL EXISTING SUPPLY | | 1,572,614 | 1,450,412 | 1,321,824 | 1,182,082 | 1,050,055 | 920,959 |

Water User Group (WUG) Needs/Surplus

| REGION A | WUG (NEEDS)/SURPLUS (ACRE-FEET PER YEAR) | | | | | |
|------------------------|--|----------|----------|----------|----------|----------|
| | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| GRAY COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| PAMPA | 304 | (1,752) | (2,491) | (2,190) | (2,985) | (3,806) |
| COUNTY-OTHER | 0 | 0 | 0 | 0 | 0 | 0 |
| MANUFACTURING | 238 | 173 | 225 | 208 | 189 | 162 |
| MINING | 0 | 0 | 0 | 0 | 0 | 0 |
| STEAM ELECTRIC POWER | 0 | 0 | 0 | 0 | 0 | 0 |
| LIVESTOCK | 205 | 202 | 199 | 196 | 193 | 189 |
| IRRIGATION | 0 | 0 | 0 | 0 | 0 | 0 |
| RED BASIN | | | | | | |
| MCLEAN | 40 | 18 | 1 | (89) | (135) | (182) |
| COUNTY-OTHER | 0 | 0 | 0 | 0 | 0 | 0 |
| MANUFACTURING | 12 | 9 | 12 | 11 | 10 | 9 |
| MINING | 0 | 0 | 0 | 0 | 0 | 0 |
| LIVESTOCK | 557 | 534 | 508 | 480 | 448 | 414 |
| IRRIGATION | 0 | 0 | 0 | 0 | 0 | 0 |
| HALL COUNTY | | | | | | |
| RED BASIN | | | | | | |
| MEMPHIS | 45 | 12 | 0 | (68) | (100) | (133) |
| COUNTY-OTHER | 0 | (3) | (1) | 0 | 0 | 0 |
| LIVESTOCK | 70 | 69 | 67 | 66 | 65 | 63 |
| IRRIGATION | 0 | 0 | 0 | 0 | 0 | 0 |
| HANSFORD COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| GRUVER | 61 | 2 | (111) | (196) | (272) | (344) |
| SPEARMAN | 0 | 0 | 0 | (283) | (466) | (634) |
| COUNTY-OTHER | 62 | 55 | 43 | 33 | 24 | 14 |
| MANUFACTURING | 32 | 30 | 30 | 36 | 41 | 46 |
| MINING | 0 | 0 | 0 | 0 | 0 | 0 |
| LIVESTOCK | 0 | 0 | 0 | 0 | 0 | 0 |
| IRRIGATION | 22 | 22 | 22 | 22 | 22 | 22 |
| HARTLEY COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| DALHART | (240) | (344) | (442) | (528) | (605) | (673) |
| COUNTY-OTHER | 0 | 0 | 0 | 0 | 0 | 0 |
| MANUFACTURING | 0 | 0 | 0 | 0 | 0 | 0 |
| MINING | 0 | 0 | 0 | 0 | 0 | 0 |
| LIVESTOCK | 0 | 0 | 0 | 0 | 0 | 0 |
| IRRIGATION | (77,305) | (93,368) | (98,650) | (92,699) | (83,415) | (74,130) |
| HEMPHILL COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| CANADIAN | 0 | 0 | 0 | 0 | 0 | 0 |
| COUNTY-OTHER | 17 | 20 | 23 | 23 | 23 | 23 |
| MANUFACTURING | 0 | 0 | 0 | 0 | 0 | 0 |
| MINING | 0 | 0 | 0 | 0 | 0 | 0 |
| LIVESTOCK | 0 | 0 | 0 | 0 | 0 | 0 |
| IRRIGATION | 0 | 0 | 0 | 0 | 0 | 0 |
| RED BASIN | | | | | | |
| COUNTY-OTHER | 47 | 45 | 44 | 41 | 38 | 35 |

Water User Group (WUG) Needs/Surplus

| REGION A | WUG (NEEDS)/SURPLUS (ACRE-FEET PER YEAR) | | | | | |
|-----------------------|--|-------|-------|-------|-------|-------|
| | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| SHERMAN COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| STRATFORD | 781 | 753 | 741 | 583 | 384 | 187 |
| COUNTY-OTHER | 0 | 0 | 0 | 0 | 0 | 0 |
| MINING | 0 | 0 | 0 | 0 | 0 | 0 |
| LIVESTOCK | 0 | 0 | 0 | 0 | 0 | 0 |
| IRRIGATION | 32 | 32 | 32 | 32 | 32 | 32 |
| WHEELER COUNTY | | | | | | |
| RED BASIN | | | | | | |
| SHAMROCK | 607 | 559 | 515 | 451 | 382 | 312 |
| WHEELER | (184) | (249) | (308) | (365) | (412) | (453) |
| COUNTY-OTHER | 95 | 94 | 92 | 83 | 72 | 60 |
| MINING | 0 | 0 | 0 | 0 | 0 | 0 |
| LIVESTOCK | 118 | 15 | 13 | 11 | 8 | 6 |
| IRRIGATION | 895 | 896 | 897 | 899 | 901 | 903 |

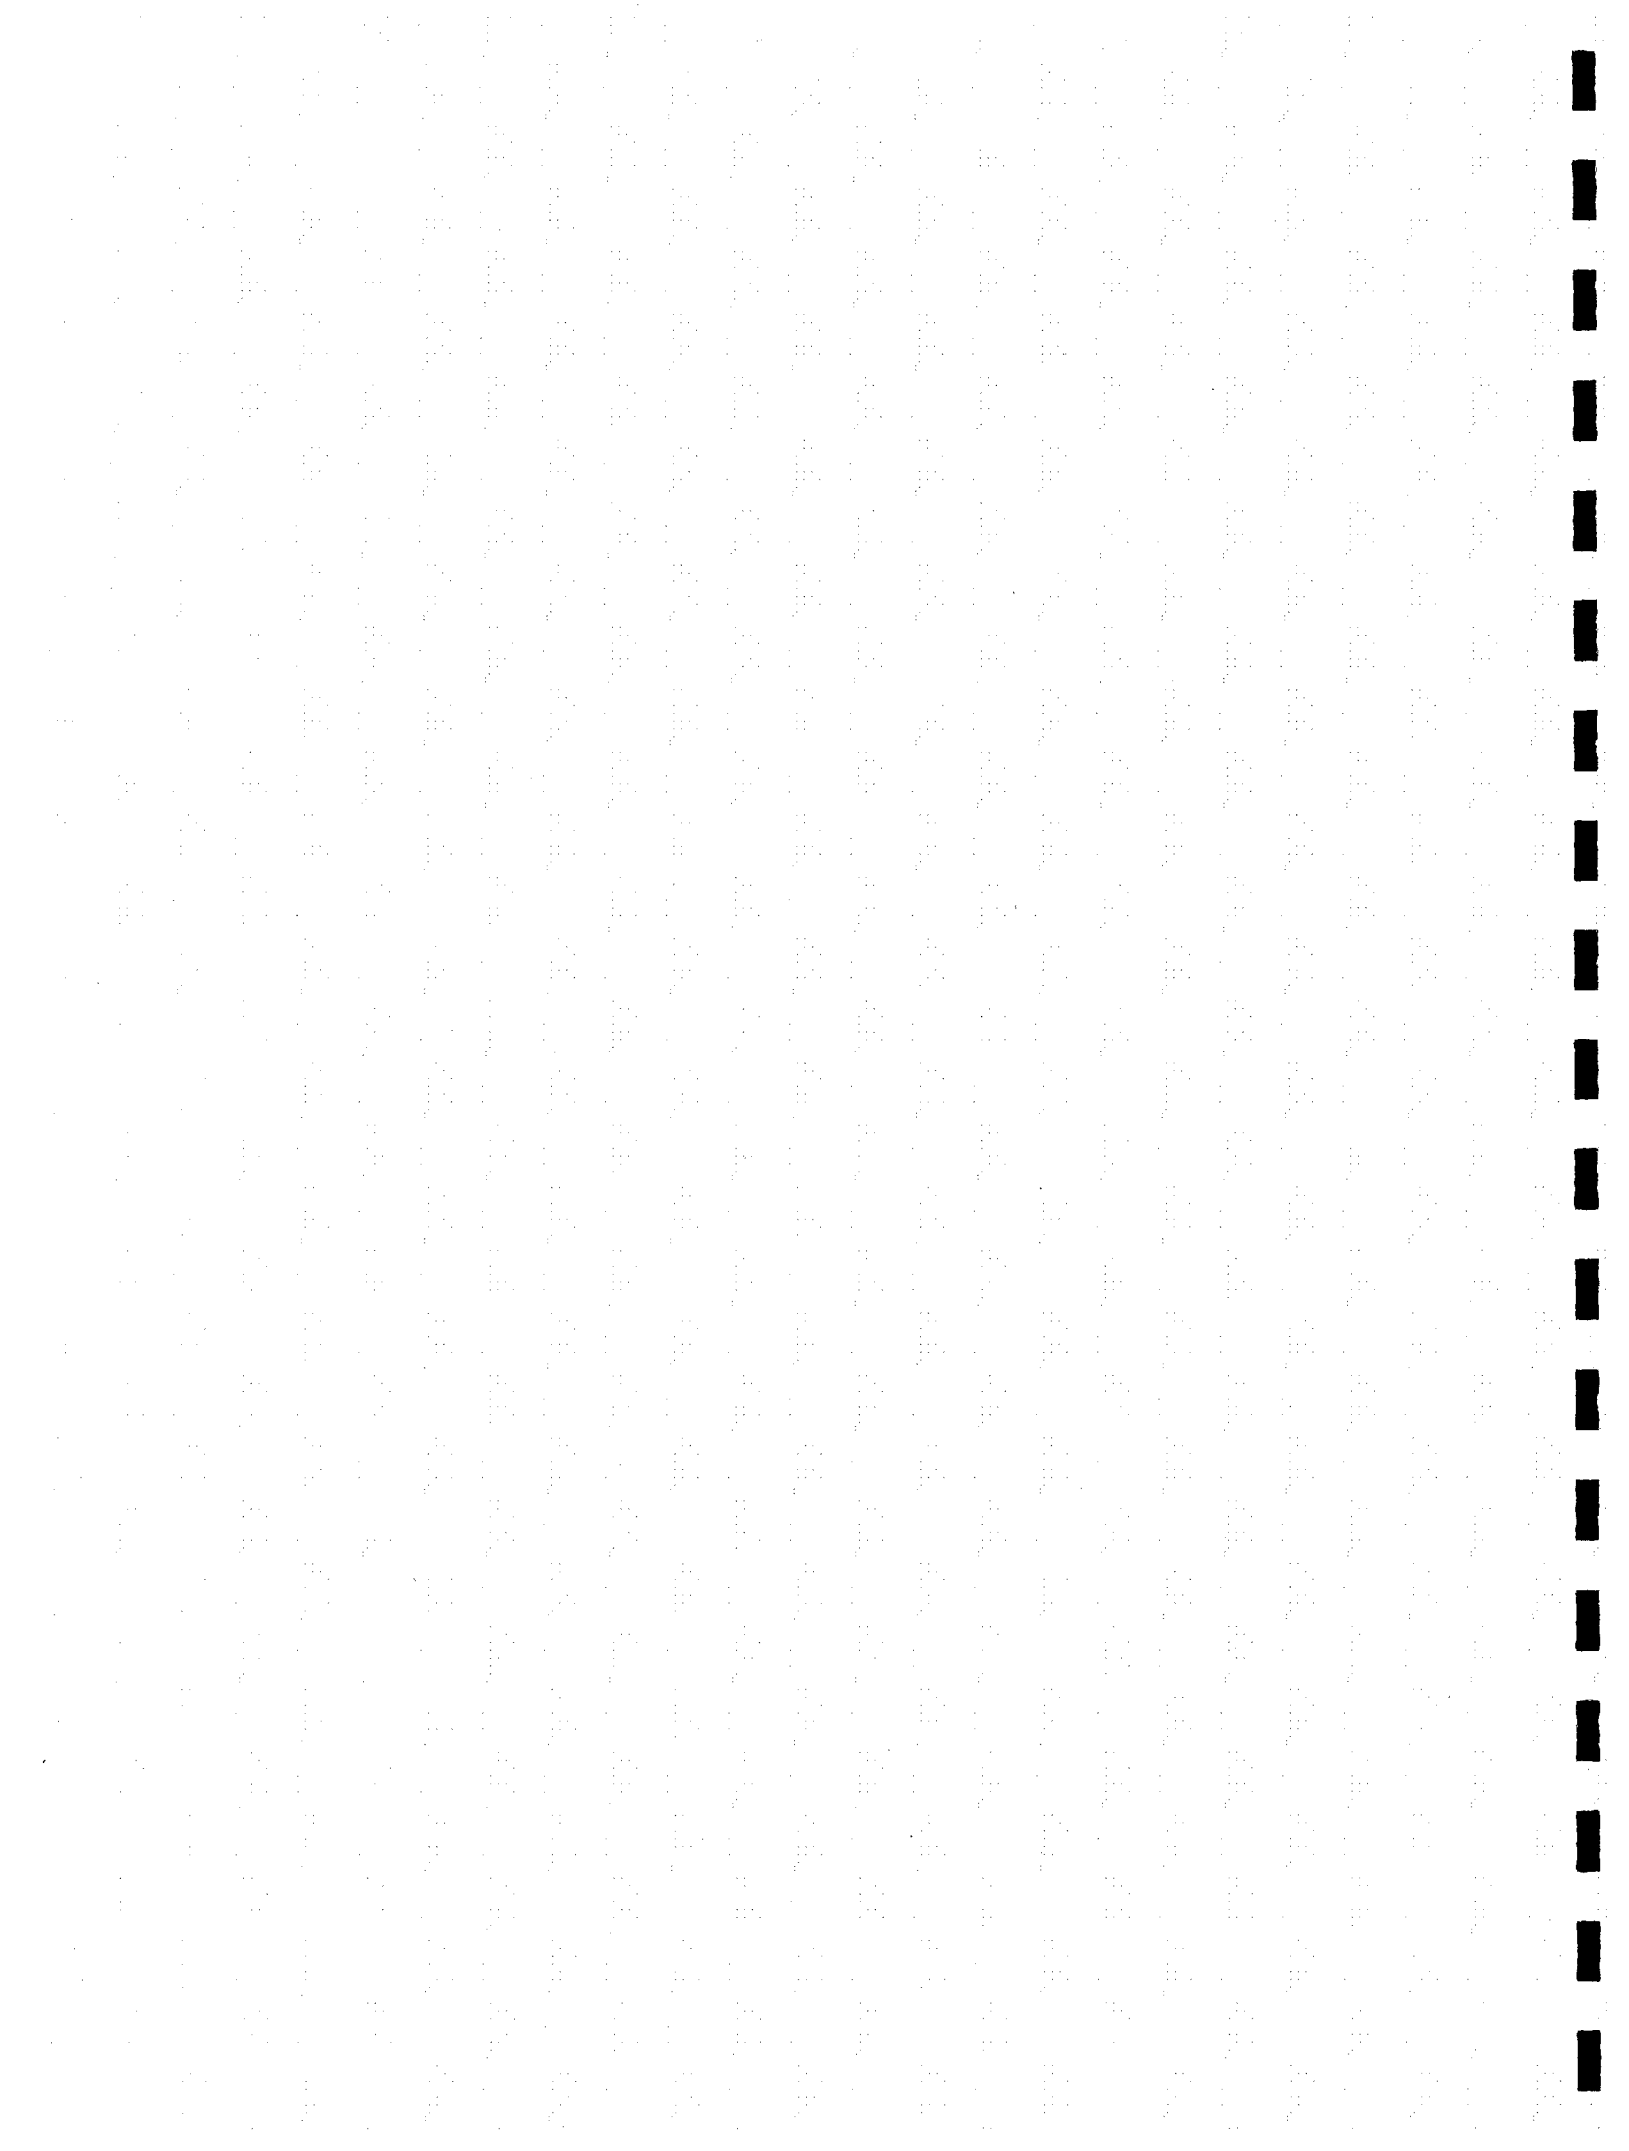

Water User Group (WUG) Category Summary

| REGION A | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
|--|-------------|-------------|-------------|-------------|-------------|-------------|
| MUNICIPAL | | | | | | |
| POPULATION | 345,540 | 381,158 | 417,140 | 453,985 | 492,307 | 532,142 |
| DEMANDS (acre-feet per year) | 79,557 | 85,913 | 92,583 | 100,001 | 108,191 | 116,808 |
| EXISTING SUPPLIES (acre-feet per year) | 73,395 | 65,613 | 58,431 | 52,158 | 46,596 | 41,222 |
| NEEDS (acre-feet per year)* | (8,754) | (22,205) | (35,919) | (49,297) | (62,701) | (76,343) |
| COUNTY-OTHER | | | | | | |
| POPULATION | 73,086 | 79,850 | 86,406 | 93,075 | 99,959 | 107,078 |
| DEMANDS (acre-feet per year) | 12,080 | 12,879 | 13,702 | 14,643 | 15,675 | 16,764 |
| EXISTING SUPPLIES (acre-feet per year) | 11,803 | 11,911 | 12,030 | 12,203 | 12,349 | 12,287 |
| NEEDS (acre-feet per year)* | (1,320) | (1,937) | (2,602) | (3,327) | (4,146) | (5,216) |
| MANUFACTURING | | | | | | |
| DEMANDS (acre-feet per year) | 49,695 | 52,589 | 55,369 | 57,763 | 61,343 | 65,194 |
| EXISTING SUPPLIES (acre-feet per year) | 46,678 | 46,378 | 46,046 | 44,146 | 43,497 | 43,063 |
| NEEDS (acre-feet per year)* | (4,017) | (6,986) | (10,048) | (14,243) | (18,369) | (22,538) |
| MINING | | | | | | |
| DEMANDS (acre-feet per year) | 11,330 | 9,909 | 7,223 | 4,465 | 2,996 | 2,968 |
| EXISTING SUPPLIES (acre-feet per year) | 11,330 | 9,909 | 7,223 | 4,465 | 2,996 | 2,968 |
| NEEDS (acre-feet per year)* | 0 | 0 | 0 | 0 | 0 | 0 |
| STEAM ELECTRIC POWER | | | | | | |
| DEMANDS (acre-feet per year) | 26,996 | 28,916 | 30,707 | 32,963 | 37,202 | 40,989 |
| EXISTING SUPPLIES (acre-feet per year) | 26,996 | 28,916 | 30,707 | 32,963 | 37,202 | 40,989 |
| NEEDS (acre-feet per year)* | 0 | 0 | 0 | 0 | 0 | 0 |
| LIVESTOCK | | | | | | |
| DEMANDS (acre-feet per year) | 40,532 | 41,425 | 43,009 | 44,718 | 46,567 | 48,564 |
| EXISTING SUPPLIES (acre-feet per year) | 42,326 | 43,080 | 44,621 | 46,293 | 48,091 | 50,033 |
| NEEDS (acre-feet per year)* | 0 | 0 | 0 | 0 | 0 | 0 |
| IRRIGATION | | | | | | |
| DEMANDS (acre-feet per year) | 1,513,469 | 1,426,414 | 1,312,384 | 1,166,561 | 1,020,743 | 874,922 |
| EXISTING SUPPLIES (acre-feet per year) | 1,360,086 | 1,244,605 | 1,122,766 | 989,854 | 859,324 | 730,397 |
| NEEDS (acre-feet per year)* | (156,704) | (185,043) | (192,876) | (180,151) | (165,133) | (148,519) |
| REGION TOTALS | | | | | | |
| POPULATION | 418,626 | 461,008 | 503,546 | 547,060 | 592,266 | 639,220 |
| DEMANDS (acre-feet per year) | 1,733,659 | 1,658,045 | 1,554,977 | 1,421,114 | 1,292,717 | 1,166,209 |
| EXISTING SUPPLIES (acre-feet per year) | 1,572,614 | 1,450,412 | 1,321,824 | 1,182,082 | 1,050,055 | 920,959 |
| NEEDS (acre-feet per year)* | (170,795) | (216,171) | (241,445) | (247,018) | (250,349) | (252,616) |

*WUG supplies and projected demands are entered for each of a WUG's region-county-basin divisions. The needs shown in the WUG Category Summary report are calculated by first deducting the WUG split's projected demand from its total existing water supply volume. If the WUG split has a greater existing supply volume than projected demand in any given decade, this amount is considered a surplus volume. Before aggregating the difference between supplies and demands to the WUG category level, calculated surpluses are updated to zero so that only the WUGs with needs in the decade are included with the Needs totals.



Water User Group (WUG) Second-Tier Identified Water Need

| REGION A | WUG SECOND-TIER NEEDS (ACRE-FEET PER YEAR) | | | | | |
|-----------------------------|--|--------|-------|-------|-------|-------|
| | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| ARMSTRONG COUNTY | | | | | | |
| RED BASIN | | | | | | |
| CLAUDE | 0 | 0 | 0 | 7 | 44 | 82 |
| COUNTY-OTHER | 0 | 0 | 0 | 0 | 0 | 0 |
| LIVESTOCK | 0 | 0 | 0 | 0 | 0 | 0 |
| IRRIGATION | 0 | 0 | 0 | 0 | 0 | 0 |
| CARSON COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| WHITE DEER | 0 | 0 | 0 | 0 | 0 | 0 |
| COUNTY-OTHER | 0 | 0 | 0 | 0 | 0 | 0 |
| MANUFACTURING | 0 | 0 | 0 | 0 | 0 | 0 |
| MINING | 0 | 0 | 0 | 0 | 0 | 0 |
| LIVESTOCK | 0 | 0 | 0 | 0 | 0 | 0 |
| IRRIGATION | 0 | 0 | 0 | 0 | 0 | 0 |
| RED BASIN | | | | | | |
| GROOM | 0 | 0 | 0 | 0 | 0 | 0 |
| PANHANDLE | 42 | 473 | 534 | 529 | 528 | 528 |
| WHITE DEER | 0 | 0 | 0 | 0 | 0 | 0 |
| COUNTY-OTHER | 0 | 0 | 0 | 0 | 0 | 0 |
| MANUFACTURING | 0 | 0 | 0 | 0 | 0 | 0 |
| LIVESTOCK | 0 | 0 | 0 | 0 | 0 | 0 |
| IRRIGATION | 0 | 0 | 0 | 0 | 0 | 0 |
| CHILDRESS COUNTY | | | | | | |
| RED BASIN | | | | | | |
| CHILDRESS | 0 | 0 | 0 | 0 | 0 | 0 |
| COUNTY-OTHER | 0 | 0 | 0 | 0 | 0 | 0 |
| LIVESTOCK | 0 | 0 | 0 | 0 | 0 | 0 |
| IRRIGATION | 0 | 0 | 0 | 0 | 0 | 0 |
| COLLINGSWORTH COUNTY | | | | | | |
| RED BASIN | | | | | | |
| WELLINGTON | 481 | 495 | 503 | 520 | 533 | 545 |
| COUNTY-OTHER | 0 | 0 | 0 | 0 | 0 | 0 |
| LIVESTOCK | 0 | 0 | 0 | 0 | 0 | 0 |
| IRRIGATION | 0 | 0 | 0 | 0 | 0 | 0 |
| DALLAM COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| DALHART | 455 | 734 | 1,049 | 1,381 | 1,714 | 2,048 |
| TEXLINE | 0 | 0 | 0 | 22 | 73 | 133 |
| COUNTY-OTHER | 0 | 0 | 0 | 0 | 0 | 0 |
| MANUFACTURING | 0 | 0 | 0 | 0 | 0 | 0 |
| LIVESTOCK | 0 | 0 | 0 | 0 | 0 | 0 |
| IRRIGATION | 45,181 | 30,501 | 0 | 0 | 0 | 0 |
| DONLEY COUNTY | | | | | | |
| RED BASIN | | | | | | |
| CLARENDON | 0 | 0 | 0 | 0 | 0 | 0 |
| COUNTY-OTHER | 0 | 0 | 0 | 0 | 0 | 0 |
| LIVESTOCK | 0 | 0 | 0 | 0 | 0 | 0 |
| IRRIGATION | 0 | 0 | 0 | 0 | 0 | 0 |

Water User Group (WUG) Second-Tier Identified Water Need

| REGION A | WUG SECOND-TIER NEEDS (ACRE-FEET PER YEAR) | | | | | |
|------------------------|--|--------|-------|-------|-------|-------|
| | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| GRAY COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| PAMPA | 0 | 1,591 | 2,313 | 1,988 | 2,765 | 3,566 |
| COUNTY-OTHER | 0 | 0 | 0 | 0 | 0 | 0 |
| MANUFACTURING | 0 | 0 | 0 | 0 | 0 | 0 |
| MINING | 0 | 0 | 0 | 0 | 0 | 0 |
| STEAM ELECTRIC POWER | 0 | 0 | 0 | 0 | 0 | 0 |
| LIVESTOCK | 0 | 0 | 0 | 0 | 0 | 0 |
| IRRIGATION | 0 | 0 | 0 | 0 | 0 | 0 |
| RED BASIN | | | | | | |
| MCLEAN | 0 | 0 | 0 | 66 | 110 | 155 |
| COUNTY-OTHER | 0 | 0 | 0 | 0 | 0 | 0 |
| MANUFACTURING | 0 | 0 | 0 | 0 | 0 | 0 |
| MINING | 0 | 0 | 0 | 0 | 0 | 0 |
| LIVESTOCK | 0 | 0 | 0 | 0 | 0 | 0 |
| IRRIGATION | 0 | 0 | 0 | 0 | 0 | 0 |
| HALL COUNTY | | | | | | |
| RED BASIN | | | | | | |
| MEMPHIS | 0 | 0 | 0 | 54 | 86 | 119 |
| COUNTY-OTHER | 0 | 0 | 0 | 0 | 0 | 0 |
| LIVESTOCK | 0 | 0 | 0 | 0 | 0 | 0 |
| IRRIGATION | 0 | 0 | 0 | 0 | 0 | 0 |
| HANSFORD COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| GRUVER | 0 | 0 | 85 | 168 | 242 | 313 |
| SPEARMAN | 0 | 0 | 0 | 258 | 440 | 607 |
| COUNTY-OTHER | 0 | 0 | 0 | 0 | 0 | 0 |
| MANUFACTURING | 0 | 0 | 0 | 0 | 0 | 0 |
| MINING | 0 | 0 | 0 | 0 | 0 | 0 |
| LIVESTOCK | 0 | 0 | 0 | 0 | 0 | 0 |
| IRRIGATION | 0 | 0 | 0 | 0 | 0 | 0 |
| HARTLEY COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| DALHART | 215 | 318 | 416 | 501 | 578 | 646 |
| COUNTY-OTHER | 0 | 0 | 0 | 0 | 0 | 0 |
| MANUFACTURING | 0 | 0 | 0 | 0 | 0 | 0 |
| MINING | 0 | 0 | 0 | 0 | 0 | 0 |
| LIVESTOCK | 0 | 0 | 0 | 0 | 0 | 0 |
| IRRIGATION | 48,108 | 41,207 | 8,174 | 0 | 0 | 0 |
| HEMPHILL COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| CANADIAN | 0 | 0 | 0 | 0 | 0 | 0 |
| COUNTY-OTHER | 0 | 0 | 0 | 0 | 0 | 0 |
| MANUFACTURING | 0 | 0 | 0 | 0 | 0 | 0 |
| MINING | 0 | 0 | 0 | 0 | 0 | 0 |
| LIVESTOCK | 0 | 0 | 0 | 0 | 0 | 0 |
| IRRIGATION | 0 | 0 | 0 | 0 | 0 | 0 |
| RED BASIN | | | | | | |
| COUNTY-OTHER | 0 | 0 | 0 | 0 | 0 | 0 |
| MINING | 0 | 0 | 0 | 0 | 0 | 0 |

Water User Group (WUG) Second-Tier Identified Water Need

| REGION A | WUG SECOND-TIER NEEDS (ACRE-FEET PER YEAR) | | | | | |
|--------------------------|--|-------|-------|-------|-------|-------|
| | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| HEMPHILL COUNTY | | | | | | |
| RED BASIN | | | | | | |
| LIVESTOCK | 0 | 0 | 0 | 0 | 0 | 0 |
| IRRIGATION | 0 | 0 | 0 | 0 | 0 | 0 |
| HUTCHINSON COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| BORGER | 0 | 424 | 846 | 1,237 | 1,541 | 1,821 |
| FRITCH | 0 | 0 | 0 | 0 | 0 | 0 |
| STINNETT | 0 | 0 | 0 | 78 | 128 | 179 |
| TCW SUPPLY INC | 17 | 192 | 316 | 407 | 476 | 510 |
| COUNTY-OTHER | 0 | 0 | 0 | 0 | 0 | 0 |
| MANUFACTURING | 0 | 860 | 1,739 | 2,614 | 3,487 | 4,416 |
| MINING | 0 | 0 | 0 | 0 | 0 | 0 |
| LIVESTOCK | 0 | 0 | 0 | 0 | 0 | 0 |
| IRRIGATION | 0 | 0 | 0 | 0 | 0 | 0 |
| LIPSCOMB COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| BOOKER | 0 | 0 | 59 | 239 | 329 | 414 |
| COUNTY-OTHER | 0 | 0 | 0 | 0 | 0 | 0 |
| MANUFACTURING | 0 | 0 | 21 | 69 | 97 | 124 |
| MINING | 0 | 0 | 0 | 0 | 0 | 0 |
| LIVESTOCK | 0 | 0 | 0 | 0 | 0 | 0 |
| IRRIGATION | 0 | 0 | 0 | 0 | 0 | 0 |
| MOORE COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| CACTUS | 551 | 741 | 933 | 1,125 | 1,297 | 1,475 |
| DUMAS | 157 | 869 | 1,614 | 2,489 | 3,340 | 4,206 |
| FRITCH | 0 | 0 | 0 | 0 | 0 | 0 |
| SUNRAY | 0 | 190 | 455 | 581 | 695 | 784 |
| COUNTY-OTHER | 0 | 0 | 0 | 0 | 0 | 7 |
| MANUFACTURING | 1,877 | 2,346 | 2,754 | 4,445 | 6,147 | 7,746 |
| MINING | 0 | 0 | 0 | 0 | 0 | 0 |
| STEAM ELECTRIC POWER | 0 | 0 | 0 | 0 | 0 | 0 |
| LIVESTOCK | 0 | 0 | 0 | 0 | 0 | 0 |
| IRRIGATION | 0 | 0 | 0 | 0 | 0 | 0 |
| OCHILTREE COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| BOOKER | 0 | 0 | 2 | 6 | 10 | 16 |
| PERRYTON | 393 | 873 | 1,342 | 1,774 | 2,230 | 2,667 |
| COUNTY-OTHER | 0 | 0 | 0 | 0 | 0 | 0 |
| MINING | 0 | 0 | 0 | 0 | 0 | 0 |
| LIVESTOCK | 0 | 0 | 0 | 0 | 0 | 0 |
| IRRIGATION | 0 | 0 | 0 | 0 | 0 | 0 |
| OLDHAM COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| VEGA | 0 | 0 | 0 | 0 | 0 | 0 |
| COUNTY-OTHER | 0 | 0 | 0 | 0 | 0 | 0 |
| MINING | 0 | 0 | 0 | 0 | 0 | 0 |
| LIVESTOCK | 0 | 0 | 0 | 0 | 0 | 0 |
| IRRIGATION | 0 | 0 | 0 | 0 | 0 | 0 |

Water User Group (WUG) Second-Tier Identified Water Need

| REGION A | WUG SECOND-TIER NEEDS (ACRE-FEET PER YEAR) | | | | | |
|-----------------------|--|-------|-------|--------|--------|--------|
| | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| OLDHAM COUNTY | | | | | | |
| RED BASIN | | | | | | |
| COUNTY-OTHER | 0 | 0 | 0 | 0 | 0 | 0 |
| MINING | 0 | 0 | 0 | 0 | 0 | 0 |
| LIVESTOCK | 0 | 0 | 0 | 0 | 0 | 0 |
| IRRIGATION | 0 | 0 | 0 | 0 | 0 | 0 |
| POTTER COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| AMARILLO | 924 | 3,487 | 6,537 | 9,621 | 12,375 | 15,399 |
| COUNTY-OTHER | 101 | 260 | 439 | 625 | 842 | 1,071 |
| MANUFACTURING | 314 | 542 | 786 | 1,007 | 1,220 | 1,445 |
| MINING | 0 | 0 | 0 | 0 | 0 | 0 |
| STEAM ELECTRIC POWER | 0 | 0 | 0 | 0 | 0 | 0 |
| LIVESTOCK | 0 | 0 | 0 | 0 | 0 | 0 |
| IRRIGATION | 0 | 0 | 0 | 0 | 0 | 0 |
| RED BASIN | | | | | | |
| AMARILLO | 607 | 2,296 | 4,303 | 6,334 | 8,150 | 10,139 |
| COUNTY-OTHER | 316 | 405 | 505 | 611 | 732 | 1,064 |
| MANUFACTURING | 1,785 | 3,069 | 4,453 | 5,707 | 6,910 | 8,188 |
| MINING | 0 | 0 | 0 | 0 | 0 | 0 |
| LIVESTOCK | 0 | 0 | 0 | 0 | 0 | 0 |
| IRRIGATION | 0 | 0 | 0 | 0 | 0 | 0 |
| RANDALL COUNTY | | | | | | |
| RED BASIN | | | | | | |
| AMARILLO | 1,243 | 4,723 | 8,853 | 13,063 | 16,803 | 20,882 |
| CANYON | 882 | 1,447 | 2,020 | 2,599 | 3,592 | 4,110 |
| HAPPY | 0 | 0 | 0 | 0 | 0 | 0 |
| LAKE TANGLEWOOD | 147 | 176 | 201 | 224 | 242 | 260 |
| COUNTY-OTHER | 494 | 820 | 1,166 | 1,542 | 1,965 | 2,413 |
| MANUFACTURING | 41 | 169 | 295 | 401 | 508 | 619 |
| LIVESTOCK | 0 | 0 | 0 | 0 | 0 | 0 |
| IRRIGATION | 0 | 0 | 0 | 0 | 0 | 0 |
| ROBERTS COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| MIAMI | 0 | 0 | 0 | 0 | 0 | 0 |
| COUNTY-OTHER | 0 | 0 | 0 | 0 | 0 | 0 |
| MINING | 0 | 0 | 0 | 0 | 0 | 0 |
| LIVESTOCK | 0 | 0 | 0 | 0 | 0 | 0 |
| IRRIGATION | 0 | 0 | 0 | 0 | 0 | 0 |
| RED BASIN | | | | | | |
| COUNTY-OTHER | 0 | 0 | 0 | 0 | 0 | 0 |
| MINING | 0 | 0 | 0 | 0 | 0 | 0 |
| LIVESTOCK | 0 | 0 | 0 | 0 | 0 | 0 |
| IRRIGATION | 0 | 0 | 0 | 0 | 0 | 0 |
| SHERMAN COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| STRATFORD | 0 | 0 | 0 | 0 | 0 | 0 |
| COUNTY-OTHER | 0 | 0 | 0 | 0 | 0 | 0 |
| MINING | 0 | 0 | 0 | 0 | 0 | 0 |
| LIVESTOCK | 0 | 0 | 0 | 0 | 0 | 0 |

Water User Group (WUG) Second-Tier Identified Water Need

| REGION A | WUG SECOND-TIER NEEDS (ACRE-FEET PER YEAR) | | | | | |
|-----------------------|--|------|------|------|------|------|
| | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| SHERMAN COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| IRRIGATION | 0 | 0 | 0 | 0 | 0 | 0 |
| WHEELER COUNTY | | | | | | |
| RED BASIN | | | | | | |
| SHAMROCK | 0 | 0 | 0 | 0 | 0 | 0 |
| WHEELER | 169 | 234 | 292 | 349 | 395 | 435 |
| COUNTY-OTHER | 0 | 0 | 0 | 0 | 0 | 0 |
| MINING | 0 | 0 | 0 | 0 | 0 | 0 |
| LIVESTOCK | 0 | 0 | 0 | 0 | 0 | 0 |
| IRRIGATION | 0 | 0 | 0 | 0 | 0 | 0 |

*Second-tier needs are WUG split needs adjusted to include the implementation of recommended demand reduction and direct reuse water management strategies.



Water User Group (WUG) Second-Tier Identified Water Need Summary

REGION A

| | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
|-----------------------------|--------|--------|--------|--------|--------|--------|
| MUNICIPAL | 6,283 | 19,263 | 32,673 | 45,620 | 58,716 | 72,039 |
| COUNTY-OTHER | 911 | 1,485 | 2,110 | 2,778 | 3,539 | 4,555 |
| MANUFACTURING | 4,017 | 6,986 | 10,048 | 14,243 | 18,369 | 22,538 |
| MINING | 0 | 0 | 0 | 0 | 0 | 0 |
| STEAM ELECTRIC POWER | 0 | 0 | 0 | 0 | 0 | 0 |
| LIVESTOCK | 0 | 0 | 0 | 0 | 0 | 0 |
| IRRIGATION | 93,289 | 71,708 | 8,174 | 0 | 0 | 0 |

*Second-tier needs are WUG split needs adjusted to include the implementation of recommended demand reduction and direct reuse water management strategies.



Recommended Water User Group (WUG) Water Management Strategies (WMS)

WUG Entity Primary Region: A

Water Management Strategy Supplies

| WUG Entity Name | WMS Sponsor Region | WMS Name | Source Name | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 | Unit Cost 2020 | Unit Cost 2070 |
|---|--------------------|---|--|-------|--------|--------|--------|--------|--------|----------------|----------------|
| AMARILLO | A | CONJUNCTIVE USE - CRMWA | A MEREDITH LAKE/RESERVOIR | 4,579 | 4,595 | 4,381 | 4,117 | 4,114 | 4,111 | \$451 | \$106 |
| AMARILLO | A | DEVELOP CARSON COUNTY WELL FIELD (OGALLALA AQUIFER) - AMARILLO | A OGALLALA AQUIFER CARSON COUNTY | 0 | 0 | 11,200 | 5,509 | 6,025 | 4,924 | N/A | \$161 |
| AMARILLO | A | DEVELOP POTTER COUNTY WELL FIELD (OGALLALA AQUIFER) - AMARILLO | A OGALLALA AQUIFER POTTER COUNTY | 3,210 | 1,475 | 1,087 | 2,500 | 1,000 | 0 | \$941 | N/A |
| AMARILLO | A | DEVELOP ROBERTS COUNTY WELL FIELD (OGALLALA AQUIFER) - AMARILLO | A OGALLALA AQUIFER ROBERTS COUNTY | 0 | 0 | 0 | 0 | 0 | 11,200 | N/A | \$1538 |
| AMARILLO | A | EXPAND CAPACITY CRMWA II | A OGALLALA AQUIFER ROBERTS COUNTY | 0 | 22,056 | 21,027 | 19,760 | 19,745 | 19,731 | N/A | \$240 |
| AMARILLO | A | MUNICIPAL CONSERVATION - AMARILLO | DEMAND REDUCTION | 1,734 | 1,935 | 2,122 | 2,316 | 2,534 | 2,762 | \$250 | \$251 |
| AMARILLO | A | REPLACE WELL CAPACITY FOR CRMWA I | A OGALLALA AQUIFER ROBERTS COUNTY | 0 | 4,135 | 3,695 | 7,822 | 9,461 | 11,510 | N/A | \$179 |
| BOOKER | A | DEVELOP OGALLALA AQUIFER SUPPLIES - BOOKER | A OGALLALA AQUIFER LIPSCOMB COUNTY | 0 | 0 | 529 | 481 | 453 | 576 | N/A | \$83 |
| BOOKER | A | MUNICIPAL CONSERVATION - BOOKER | DEMAND REDUCTION | 15 | 17 | 18 | 19 | 20 | 21 | \$648 | \$559 |
| BORGER | A | CONJUNCTIVE USE - CRMWA | A MEREDITH LAKE/RESERVOIR | 702 | 652 | 620 | 582 | 581 | 581 | \$451 | \$106 |
| BORGER | A | DEVELOP NEW WELL FIELD (OGALLALA AQUIFER) - BORGER | A OGALLALA AQUIFER HUTCHINSON COUNTY | 6,000 | 5,140 | 4,261 | 3,386 | 2,513 | 1,584 | \$521 | \$158 |
| BORGER | A | EXPAND CAPACITY CRMWA II | A OGALLALA AQUIFER ROBERTS COUNTY | 0 | 3,128 | 2,974 | 2,793 | 2,790 | 2,787 | N/A | \$240 |
| BORGER | A | MUNICIPAL CONSERVATION - BORGER | DEMAND REDUCTION | 104 | 107 | 106 | 106 | 106 | 106 | \$410 | \$418 |
| BORGER | A | REPLACE WELL CAPACITY FOR CRMWA I | A OGALLALA AQUIFER ROBERTS COUNTY | 0 | 586 | 805 | 1,106 | 1,337 | 1,626 | N/A | \$179 |
| CACTUS | A | DEVELOP NEW WELL FIELD (OGALLALA AQUIFER) - CACTUS | A OGALLALA AQUIFER MOORE COUNTY | 3,565 | 3,078 | 2,653 | 2,286 | 1,933 | 1,565 | \$422 | \$145 |
| CACTUS | A | MUNICIPAL CONSERVATION - CACTUS | DEMAND REDUCTION | 32 | 36 | 41 | 45 | 50 | 55 | \$519 | \$460 |
| CANADIAN | A | MUNICIPAL CONSERVATION - CANADIAN | DEMAND REDUCTION | 25 | 27 | 29 | 32 | 34 | 36 | \$536 | \$481 |
| CANADIAN | A | WATER AUDITS AND LEAK REPAIR - CANADIAN | DEMAND REDUCTION | 39 | 43 | 47 | 50 | 54 | 57 | \$767 | \$796 |
| CANADIAN RIVER MUNICIPAL WATER AUTHORITY - UNASSIGNED WATER VOLUMES | A | CONJUNCTIVE USE - CRMWA | A OGALLALA AQUIFER ASR | 2,000 | 2,000 | 2,000 | 2,000 | 2,000 | 2,000 | \$1124 | \$240 |
| CANADIAN RIVER MUNICIPAL WATER AUTHORITY - UNASSIGNED WATER VOLUMES | A | CONJUNCTIVE USE - CRMWA | A OGALLALA AQUIFER ASR HUTCHINSON COUNTY | 2,000 | 2,000 | 2,000 | 2,000 | 2,000 | 2,000 | \$1124 | \$240 |
| CANADIAN RIVER MUNICIPAL WATER AUTHORITY - UNASSIGNED WATER VOLUMES | A | CONJUNCTIVE USE - CRMWA | O OGALLALA AQUIFER ASR LUBBOCK COUNTY | 2,400 | 2,400 | 2,400 | 2,400 | 2,400 | 2,400 | \$1124 | \$240 |
| CANYON | A | DEVELOP DOCKUM/OGALLALA AQUIFER SUPPLIES - CANYON | A DOCKUM AQUIFER RANDALL COUNTY | 932 | 943 | 953 | 963 | 972 | 981 | \$425 | \$189 |
| CANYON | A | DEVELOP DOCKUM/OGALLALA AQUIFER SUPPLIES - CANYON | A OGALLALA AQUIFER RANDALL COUNTY | 468 | 1,157 | 1,847 | 1,837 | 2,828 | 3,319 | \$425 | \$189 |

Recommended Water User Group (WUG) Water Management Strategies (WMS)

Water Management Strategy Supplies

| WUG Entity Name | WMS Sponsor Region | WMS Name | Source Name | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 | Unit Cost 2020 | Unit Cost 2070 |
|-----------------------|--------------------|---|---|-------|-------|-------|-------|-------|-------|----------------|----------------|
| CANYON | A | DEVELOP POTTER COUNTY WELL FIELD (OGALLALA AQUIFER) - AMARILLO | A OGALLALA AQUIFER POTTER COUNTY | 94 | 239 | 384 | 507 | 0 | 0 | \$941 | N/A |
| CANYON | A | MUNICIPAL CONSERVATION - CANYON | DEMAND REDUCTION | 127 | 142 | 156 | 171 | 187 | 203 | \$604 | \$583 |
| CHILDRESS | A | MUNICIPAL CONSERVATION - CHILDRESS | DEMAND REDUCTION | 51 | 52 | 54 | 55 | 57 | 57 | \$437 | \$438 |
| CHILDRESS | A | WATER AUDITS AND LEAK REPAIR - CHILDRESS | DEMAND REDUCTION | 81 | 83 | 84 | 86 | 88 | 91 | \$776 | \$807 |
| CLARENDON | A | MUNICIPAL CONSERVATION - CLARENDON | DEMAND REDUCTION | 14 | 13 | 13 | 13 | 13 | 13 | \$787 | \$813 |
| CLAUDE | A | DEVELOP OGALLALA AQUIFER SUPPLIES - CLAUDE | A OGALLALA AQUIFER ARMSTRONG COUNTY | 0 | 0 | 400 | 400 | 400 | 400 | N/A | \$185 |
| CLAUDE | A | MUNICIPAL CONSERVATION - CLAUDE | DEMAND REDUCTION | 11 | 11 | 10 | 10 | 10 | 10 | \$746 | \$814 |
| CLAUDE | A | WATER AUDITS AND LEAK REPAIR - CLAUDE | DEMAND REDUCTION | 18 | 18 | 18 | 18 | 18 | 18 | \$651 | \$676 |
| COUNTY-OTHER, HALL | A | ADVANCED TREATMENT - HALL COUNTY OTHER (LAKEVIEW) | A SEYMOUR AQUIFER HALL COUNTY | 75 | 75 | 75 | 75 | 75 | 75 | \$3345 | \$1558 |
| COUNTY-OTHER, HALL | A | DEVELOP OGALLALA AQUIFER SUPPLIES - HALL COUNTY OTHER (TURKEY) | O OGALLALA AQUIFER BRISCOE COUNTY | 100 | 100 | 100 | 100 | 100 | 100 | \$1380 | \$250 |
| COUNTY-OTHER, HALL | A | DEVELOP SEYMOUR AQUIFER SUPPLIES - HALL COUNTY OTHER (BRICE-LESLEY) | A SEYMOUR AQUIFER HALL COUNTY | 50 | 50 | 50 | 50 | 50 | 50 | \$688 | \$188 |
| COUNTY-OTHER, HALL | A | DEVELOP SEYMOUR AQUIFER SUPPLIES - HALL COUNTY OTHER (ESTELLINE) | A SEYMOUR AQUIFER HALL COUNTY | 50 | 50 | 50 | 50 | 50 | 50 | \$360 | \$120 |
| COUNTY-OTHER, HALL | A | MUNICIPAL CONSERVATION - HALL COUNTY OTHER | DEMAND REDUCTION | 9 | 10 | 10 | 10 | 10 | 10 | \$841 | \$842 |
| COUNTY-OTHER, HALL | A | WATER AUDITS AND LEAK REPAIR - HALL COUNTY OTHER | DEMAND REDUCTION | 16 | 16 | 16 | 16 | 16 | 16 | \$674 | \$693 |
| COUNTY-OTHER, MOORE | A | DEVELOP NEW WELL FIELD (OGALLALA AQUIFER) - CACTUS | A OGALLALA AQUIFER MOORE COUNTY | 58 | 76 | 93 | 112 | 128 | 145 | \$422 | \$125 |
| COUNTY-OTHER, MOORE | A | MUNICIPAL CONSERVATION - MOORE COUNTY OTHER | DEMAND REDUCTION | 14 | 15 | 17 | 19 | 21 | 23 | \$857 | \$723 |
| COUNTY-OTHER, POTTER | A | DEVELOP DOCKUM AQUIFER SUPPLIES - POTTER COUNTY OTHER | A DOCKUM AQUIFER POTTER COUNTY | 700 | 700 | 700 | 700 | 700 | 700 | \$527 | \$127 |
| COUNTY-OTHER, POTTER | A | DEVELOP OGALLALA AQUIFER SUPPLIES - POTTER COUNTY OTHER | A OGALLALA AQUIFER POTTER COUNTY | 900 | 900 | 900 | 900 | 900 | 856 | \$488 | \$118 |
| COUNTY-OTHER, POTTER | A | DEVELOP OGALLALA AQUIFER SUPPLIES (IRRIGATION CONSERVATION) - POTTER COUNTY OTHER | A OGALLALA AQUIFER POTTER COUNTY | 0 | 0 | 0 | 0 | 0 | 44 | N/A | \$118 |
| COUNTY-OTHER, POTTER | A | MUNICIPAL CONSERVATION - POTTER COUNTY OTHER | DEMAND REDUCTION | 112 | 123 | 135 | 148 | 161 | 176 | \$468 | \$461 |
| COUNTY-OTHER, POTTER | A | WATER AUDITS AND LEAK REPAIR - POTTER COUNTY OTHER | DEMAND REDUCTION | 154 | 168 | 183 | 199 | 218 | 237 | \$1119 | \$1170 |
| COUNTY-OTHER, RANDALL | A | DEVELOP OGALLALA AQUIFER SUPPLIES - RANDALL COUNTY OTHER | A OGALLALA AQUIFER RANDALL COUNTY | 500 | 1,000 | 1,200 | 2,600 | 2,600 | 2,800 | \$248 | \$90 |
| COUNTY-OTHER, RANDALL | A | DEVELOP POTTER COUNTY WELL FIELD (OGALLALA AQUIFER) - AMARILLO | A OGALLALA AQUIFER POTTER COUNTY | 2 | 6 | 10 | 13 | 15 | 17 | \$941 | \$196 |
| COUNTY-OTHER, RANDALL | A | MUNICIPAL CONSERVATION - RANDALL COUNTY OTHER | DEMAND REDUCTION | 143 | 158 | 173 | 189 | 207 | 225 | \$493 | \$492 |
| DALHART | A | DEVELOP OGALLALA AQUIFER SUPPLIES - DALHART | A OGALLALA-RITA BLANCA AQUIFER HARTLEY COUNTY | 2,700 | 2,700 | 2,700 | 2,700 | 2,700 | 2,700 | \$213 | \$83 |
| DALHART | A | MUNICIPAL CONSERVATION - DALHART | DEMAND REDUCTION | 79 | 86 | 93 | 100 | 107 | 113 | \$369 | \$357 |
| DUMAS | A | DEVELOP OGALLALA AQUIFER SUPPLIES - DUMAS | A OGALLALA-RITA BLANCA AQUIFER HARTLEY COUNTY | 2,000 | 2,000 | 2,000 | 4,500 | 4,500 | 4,500 | \$332 | \$98 |

Recommended Water User Group (WUG) Water Management Strategies (WMS)

Water Management Strategy Supplies

| WUG Entity Name | WMS Sponsor Region | WMS Name | Source Name | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 | Unit Cost 2020 | Unit Cost 2070 |
|---|--------------------|--|--|--------|--------|---------|---------|---------|---------|----------------|----------------|
| DUMAS | A | MUNICIPAL CONSERVATION - DUMAS | DEMAND REDUCTION | 133 | 152 | 171 | 190 | 210 | 231 | \$606 | \$558 |
| FRITCH | A | MUNICIPAL CONSERVATION - FRITCH | DEMAND REDUCTION | 15 | 16 | 15 | 15 | 15 | 15 | \$729 | \$740 |
| FRITCH | A | WATER AUDITS AND LEAK REPAIR - FRITCH | DEMAND REDUCTION | 22 | 22 | 22 | 22 | 22 | 22 | \$1000 | \$1054 |
| GREENBELT MUNICIPAL & INDUSTRIAL WATER AUTHORITY - UNASSIGNED WATER VOLUMES | A | DEVELOP OGALLALA AQUIFER IN DONLEY COUNTY - GREENBELT MIWA | A OGALLALA AQUIFER DONLEY COUNTY | 1,817 | 1,818 | 1,828 | 1,848 | 1,875 | 1,888 | \$629 | \$101 |
| GROOM | A | MUNICIPAL CONSERVATION - GROOM | DEMAND REDUCTION | 5 | 5 | 5 | 5 | 5 | 5 | \$1252 | \$1281 |
| GRUVER | A | DEVELOP OGALLALA AQUIFER SUPPLIES - GRUVER | A OGALLALA AQUIFER HANSFORD COUNTY | 0 | 0 | 350 | 350 | 350 | 350 | N/A | \$118 |
| GRUVER | A | MUNICIPAL CONSERVATION - GRUVER | DEMAND REDUCTION | 10 | 11 | 11 | 13 | 14 | 14 | \$894 | \$713 |
| GRUVER | A | WATER AUDITS AND LEAK REPAIR - GRUVER | DEMAND REDUCTION | 13 | 14 | 15 | 15 | 16 | 17 | \$1036 | \$1084 |
| IRRIGATION, ARMSTRONG | A | IRRIGATION CONSERVATION - ARMSTRONG COUNTY | DEMAND REDUCTION | 206 | 425 | 721 | 800 | 869 | 900 | \$17 | \$17 |
| IRRIGATION, ARMSTRONG | A | WEATHER MODIFICATION (PRECIPITATION ENHANCEMENT) | | 402 | 402 | 402 | 402 | 402 | 402 | \$8 | \$8 |
| IRRIGATION, CARSON | A | IRRIGATION CONSERVATION - CARSON COUNTY | DEMAND REDUCTION | 3,980 | 6,910 | 12,747 | 14,010 | 14,774 | 15,146 | \$17 | \$17 |
| IRRIGATION, CARSON | A | WEATHER MODIFICATION (PRECIPITATION ENHANCEMENT) | | 4,850 | 4,850 | 4,850 | 4,850 | 4,850 | 4,850 | \$8 | \$8 |
| IRRIGATION, CHILDRESS | A | IRRIGATION CONSERVATION - CHILDRESS COUNTY | DEMAND REDUCTION | 351 | 632 | 1,100 | 1,220 | 1,324 | 1,378 | \$17 | \$17 |
| IRRIGATION, COLLINGSWORTH | A | IRRIGATION CONSERVATION - COLLINGSWORTH COUNTY | DEMAND REDUCTION | 548 | 1,037 | 1,647 | 1,843 | 2,104 | 2,250 | \$17 | \$17 |
| IRRIGATION, DALLAM | A | IRRIGATION CONSERVATION - DALLAM COUNTY | DEMAND REDUCTION | 34,218 | 61,174 | 106,343 | 121,011 | 132,167 | 140,612 | \$17 | \$17 |
| IRRIGATION, DONLEY | A | IRRIGATION CONSERVATION - DONLEY COUNTY | DEMAND REDUCTION | 836 | 1,484 | 2,436 | 2,729 | 3,065 | 3,259 | \$17 | \$17 |
| IRRIGATION, DONLEY | A | WEATHER MODIFICATION (PRECIPITATION ENHANCEMENT) | | 1,866 | 1,866 | 1,866 | 1,866 | 1,866 | 1,866 | \$8 | \$8 |
| IRRIGATION, GRAY | A | IRRIGATION CONSERVATION - GRAY COUNTY | DEMAND REDUCTION | 1,361 | 2,301 | 4,216 | 4,648 | 4,929 | 5,078 | \$17 | \$17 |
| IRRIGATION, GRAY | A | WEATHER MODIFICATION (PRECIPITATION ENHANCEMENT) | | 1,858 | 1,858 | 1,858 | 1,858 | 1,858 | 1,858 | \$8 | \$8 |
| IRRIGATION, HALL | A | IRRIGATION CONSERVATION - HALL COUNTY | DEMAND REDUCTION | 392 | 679 | 1,145 | 1,280 | 1,419 | 1,499 | \$17 | \$17 |
| IRRIGATION, HANSFORD | A | IRRIGATION CONSERVATION - HANSFORD COUNTY | DEMAND REDUCTION | 9,447 | 17,175 | 31,242 | 34,401 | 36,373 | 37,260 | \$17 | \$17 |
| IRRIGATION, HARTLEY | A | IRRIGATION CONSERVATION - HARTLEY COUNTY | DEMAND REDUCTION | 29,197 | 52,161 | 90,476 | 103,095 | 113,047 | 120,509 | \$17 | \$17 |
| IRRIGATION, HEMPHILL | A | IRRIGATION CONSERVATION - HEMPHILL COUNTY | DEMAND REDUCTION | 57 | 111 | 174 | 196 | 224 | 239 | \$17 | \$17 |
| IRRIGATION, HUTCHINSON | A | IRRIGATION CONSERVATION - HUTCHINSON COUNTY | DEMAND REDUCTION | 2,692 | 4,694 | 8,578 | 9,459 | 10,010 | 10,281 | \$17 | \$17 |
| IRRIGATION, HUTCHINSON | A | WEATHER MODIFICATION (PRECIPITATION ENHANCEMENT) | | 2,960 | 2,960 | 2,960 | 2,960 | 2,960 | 2,960 | \$8 | \$8 |
| IRRIGATION, LIPSCOMB | A | IRRIGATION CONSERVATION - LIPSCOMB COUNTY | DEMAND REDUCTION | 936 | 1,702 | 2,945 | 3,268 | 3,555 | 3,706 | \$17 | \$17 |
| IRRIGATION, MOORE | A | IRRIGATION CONSERVATION - MOORE COUNTY | DEMAND REDUCTION | 13,308 | 24,120 | 41,895 | 47,571 | 52,037 | 55,406 | \$17 | \$17 |
| IRRIGATION, OCHILTREE | A | IRRIGATION CONSERVATION - OCHILTREE COUNTY | DEMAND REDUCTION | 4,030 | 7,195 | 13,177 | 14,476 | 15,292 | 15,670 | \$17 | \$17 |
| IRRIGATION, OCHILTREE | A | IRRIGATION CONSERVATION - OLDHAM COUNTY | DEMAND REDUCTION | 127 | 360 | 567 | 617 | 694 | 723 | \$17 | \$17 |

Recommended Water User Group (WUG) Water Management Strategies (WMS)

Water Management Strategy Supplies

| WUG Entity Name | WMS Sponsor Region | WMS Name | Source Name | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 | Unit Cost 2020 | Unit Cost 2070 |
|---------------------------|--------------------|--|--|--------|--------|--------|--------|--------|--------|----------------|----------------|
| IRRIGATION, POTTER | A | IRRIGATION CONSERVATION - POTTER COUNTY | DEMAND REDUCTION | 95 | 209 | 319 | 359 | 413 | 441 | \$17 | \$17 |
| IRRIGATION, POTTER | A | WEATHER MODIFICATION (PRECIPITATION ENHANCEMENT) | | 216 | 216 | 216 | 216 | 216 | 216 | \$8 | \$8 |
| IRRIGATION, RANDALL | A | IRRIGATION CONSERVATION - RANDALL COUNTY | DEMAND REDUCTION | 647 | 1,641 | 2,637 | 2,890 | 3,221 | 3,356 | \$17 | \$17 |
| IRRIGATION, ROBERTS | A | IRRIGATION CONSERVATION - ROBERTS COUNTY | DEMAND REDUCTION | 435 | 717 | 1,339 | 1,475 | 1,550 | 1,590 | \$17 | \$17 |
| IRRIGATION, ROBERTS | A | WEATHER MODIFICATION (PRECIPITATION ENHANCEMENT) | | 469 | 469 | 469 | 469 | 469 | 469 | \$8 | \$8 |
| IRRIGATION, SHERMAN | A | IRRIGATION CONSERVATION - SHERMAN COUNTY | DEMAND REDUCTION | 20,156 | 36,498 | 63,651 | 72,285 | 78,846 | 83,721 | \$17 | \$17 |
| IRRIGATION, WHEELER | A | IRRIGATION CONSERVATION - WHEELER COUNTY | DEMAND REDUCTION | 395 | 706 | 1,230 | 1,364 | 1,480 | 1,542 | \$17 | \$17 |
| IRRIGATION, WHEELER | A | WEATHER MODIFICATION (PRECIPITATION ENHANCEMENT) | | 944 | 944 | 944 | 944 | 944 | 944 | \$8 | \$8 |
| LAKE TANGLEWOOD | A | DEVELOP OGALLALA AQUIFER SUPPLIES - LAKE TANGLEWOOD | A OGALLALA AQUIFER RANDALL COUNTY | 300 | 300 | 300 | 300 | 300 | 300 | \$1035 | \$205 |
| LAKE TANGLEWOOD | A | MUNICIPAL CONSERVATION - LAKE TANGLEWOOD | DEMAND REDUCTION | 9 | 8 | 8 | 8 | 8 | 8 | \$832 | \$897 |
| LAKE TANGLEWOOD | A | WATER AUDITS AND LEAK REPAIR - LAKE TANGLEWOOD | DEMAND REDUCTION | 16 | 16 | 16 | 16 | 16 | 16 | \$514 | \$529 |
| MANUFACTURING, HUTCHINSON | A | DEVELOP NEW WELL FIELD (OGALLALA AQUIFER) - BORGER | A OGALLALA AQUIFER HUTCHINSON COUNTY | 0 | 860 | 1,739 | 2,614 | 3,487 | 4,416 | N/A | \$158 |
| MANUFACTURING, LIPSCOMB | A | DEVELOP OGALLALA AQUIFER SUPPLIES - BOOKER | A OGALLALA AQUIFER LIPSCOMB COUNTY | 0 | 0 | 21 | 69 | 97 | 124 | N/A | \$83 |
| MANUFACTURING, MOORE | A | DEVELOP NEW WELL FIELD (OGALLALA AQUIFER) - CACTUS | A OGALLALA AQUIFER MOORE COUNTY | 1,877 | 2,346 | 2,754 | 3,102 | 3,439 | 3,790 | \$422 | \$125 |
| MANUFACTURING, MOORE | A | DEVELOP NEW WELL FIELD (OGALLALA AQUIFER) - MANUFACTURING MOORE COUNTY | A OGALLALA AQUIFER MOORE COUNTY | 0 | 0 | 0 | 4,000 | 4,000 | 4,000 | N/A | \$97 |
| MANUFACTURING, POTTER | A | DEVELOP CARSON COUNTY WELL FIELD (OGALLALA AQUIFER) - AMARILLO | A OGALLALA AQUIFER CARSON COUNTY | 0 | 0 | 0 | 5,691 | 5,175 | 6,277 | N/A | \$161 |
| MANUFACTURING, POTTER | A | DEVELOP POTTER COUNTY WELL FIELD (OGALLALA AQUIFER) - AMARILLO | A OGALLALA AQUIFER POTTER COUNTY | 2,642 | 3,749 | 3,508 | 1,501 | 3,061 | 3,583 | \$941 | \$196 |
| MANUFACTURING, POTTER | A | REPLACE WELL CAPACITY FOR CRMWA I | A OGALLALA AQUIFER ROBERTS COUNTY | 0 | 0 | 2,000 | 0 | 0 | 0 | N/A | N/A |
| MANUFACTURING, RANDALL | A | DEVELOP OGALLALA AQUIFER SUPPLIES - RANDALL COUNTY MANUFACTURING | A OGALLALA AQUIFER RANDALL COUNTY | 0 | 300 | 300 | 300 | 300 | 300 | N/A | \$94 |
| MANUFACTURING, RANDALL | A | DEVELOP POTTER COUNTY WELL FIELD (OGALLALA AQUIFER) - AMARILLO | A OGALLALA AQUIFER POTTER COUNTY | 52 | 131 | 211 | 279 | 324 | 367 | \$941 | \$196 |
| MCLEAN | A | DEVELOP OGALLALA AQUIFER SUPPLIES - MCLEAN | A OGALLALA AQUIFER GRAY COUNTY | 200 | 200 | 200 | 200 | 200 | 200 | \$446 | \$116 |
| MCLEAN | A | MUNICIPAL CONSERVATION - MCLEAN | DEMAND REDUCTION | 7 | 7 | 8 | 9 | 10 | 11 | \$1075 | \$812 |
| MCLEAN | A | WATER AUDITS AND LEAK REPAIR - MCLEAN | DEMAND REDUCTION | 10 | 11 | 12 | 14 | 15 | 16 | \$823 | \$863 |
| MEMPHIS | A | DEVELOP OGALLALA AQUIFER SUPPLIES - MEMPHIS | A OGALLALA AQUIFER DONLEY COUNTY | 0 | 0 | 0 | 150 | 150 | 150 | N/A | \$188 |
| MEMPHIS | A | MUNICIPAL CONSERVATION - MEMPHIS | DEMAND REDUCTION | 15 | 15 | 14 | 14 | 14 | 14 | \$781 | \$806 |
| MEMPHIS | A | WATER AUDITS AND LEAK REPAIR - MEMPHIS | DEMAND REDUCTION | 19 | 8 | 0 | 0 | 0 | 0 | \$1210 | N/A |
| MIAMI | A | MUNICIPAL CONSERVATION - MIAMI | DEMAND REDUCTION | 6 | 7 | 6 | 6 | 6 | 6 | \$1034 | \$1056 |

Recommended Water User Group (WUG) Water Management Strategies (WMS)

Water Management Strategy Supplies

| WUG Entity Name | WMS Sponsor Region | WMS Name | Source Name | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 | Unit Cost 2020 | Unit Cost 2070 |
|-----------------|--------------------|--|--|-------|-------|-------|-------|-------|-------|----------------|----------------|
| MIAMI | A | WATER AUDITS AND LEAK REPAIR - MIAMI | DEMAND REDUCTION | 11 | 11 | 11 | 11 | 11 | 11 | \$547 | \$562 |
| PAMPA | A | CONJUNCTIVE USE - CRMWA | A MEREDITH LAKE/RESERVOIR | 181 | 168 | 161 | 385 | 385 | 385 | \$451 | \$106 |
| PAMPA | A | DEVELOP OGALLALA AQUIFER SUPPLIES - PAMPA | A OGALLALA AQUIFER GRAY COUNTY | 2,000 | 2,000 | 2,000 | 2,000 | 2,000 | 2,000 | \$490 | \$130 |
| PAMPA | A | EXPAND CAPACITY CRMWA II | A OGALLALA AQUIFER ROBERTS COUNTY | 0 | 806 | 772 | 1,850 | 1,848 | 1,847 | N/A | \$240 |
| PAMPA | A | MUNICIPAL CONSERVATION - PAMPA | DEMAND REDUCTION | 146 | 161 | 178 | 202 | 220 | 240 | \$584 | \$559 |
| PAMPA | A | REPLACE WELL CAPACITY FOR CRMWA I | A OGALLALA AQUIFER ROBERTS COUNTY | 0 | 151 | 209 | 732 | 886 | 1,077 | N/A | \$179 |
| PANHANDLE | A | DEVELOP OGALLALA AQUIFER SUPPLIES - PANHANDLE | A OGALLALA AQUIFER CARSON COUNTY | 600 | 600 | 600 | 600 | 600 | 600 | \$621 | \$173 |
| PANHANDLE | A | MUNICIPAL CONSERVATION - PANHANDLE | DEMAND REDUCTION | 18 | 19 | 19 | 19 | 19 | 19 | \$647 | \$644 |
| PANHANDLE | A | WATER AUDITS AND LEAK REPAIR - PANHANDLE | DEMAND REDUCTION | 29 | 29 | 29 | 29 | 29 | 29 | \$871 | \$914 |
| PERRYTON | A | DEVELOP OGALLALA AQUIFER SUPPLIES - PERRYTON | A OGALLALA AQUIFER OCHILTREE COUNTY | 1,400 | 1,400 | 1,400 | 2,800 | 2,800 | 2,800 | \$425 | \$109 |
| PERRYTON | A | MUNICIPAL CONSERVATION - PERRYTON | DEMAND REDUCTION | 85 | 90 | 96 | 103 | 111 | 119 | \$374 | \$364 |
| SHAMROCK | A | MUNICIPAL CONSERVATION - SHAMROCK | DEMAND REDUCTION | 12 | 13 | 13 | 14 | 14 | 15 | \$851 | \$780 |
| SHAMROCK | A | WATER AUDITS AND LEAK REPAIR - SHAMROCK | DEMAND REDUCTION | 18 | 18 | 18 | 18 | 19 | 20 | \$1127 | \$1195 |
| SPEARMAN | A | DEVELOP OGALLALA AQUIFER SUPPLIES - SPEARMAN | A OGALLALA AQUIFER HANSFORD COUNTY | 0 | 0 | 0 | 650 | 650 | 650 | N/A | \$164 |
| SPEARMAN | A | MUNICIPAL CONSERVATION - SPEARMAN | DEMAND REDUCTION | 24 | 24 | 25 | 25 | 26 | 27 | \$619 | \$606 |
| STINNETT | A | DEVELOP OGALLALA AQUIFER SUPPLIES - STINNETT | A OGALLALA AQUIFER HUTCHINSON COUNTY | 0 | 0 | 0 | 225 | 225 | 225 | N/A | \$139 |
| STINNETT | A | MUNICIPAL CONSERVATION - STINNETT | DEMAND REDUCTION | 15 | 15 | 15 | 15 | 15 | 15 | \$695 | \$699 |
| STINNETT | A | WATER AUDITS AND LEAK REPAIR - STINNETT | DEMAND REDUCTION | 22 | 23 | 22 | 22 | 22 | 22 | \$874 | \$914 |
| STRATFORD | A | MUNICIPAL CONSERVATION - STRATFORD | DEMAND REDUCTION | 15 | 17 | 17 | 18 | 18 | 19 | \$721 | \$650 |
| STRATFORD | A | WATER AUDITS AND LEAK REPAIR - STRATFORD | DEMAND REDUCTION | 24 | 25 | 26 | 26 | 27 | 27 | \$932 | \$979 |
| SUNRAY | A | DEVELOP OGALLALA AQUIFER SUPPLIES - SUNRAY | A OGALLALA AQUIFER MOORE COUNTY | 0 | 850 | 850 | 850 | 850 | 850 | N/A | \$126 |
| SUNRAY | A | MUNICIPAL CONSERVATION - SUNRAY | DEMAND REDUCTION | 16 | 19 | 20 | 24 | 26 | 28 | \$689 | \$564 |
| SUNRAY | A | WATER AUDITS AND LEAK REPAIR - SUNRAY | DEMAND REDUCTION | 21 | 23 | 26 | 28 | 31 | 35 | \$1078 | \$1128 |
| TCW SUPPLY INC | A | DEVELOP OGALLALA AQUIFER SUPPLIES - TCW SUPPLY | A OGALLALA AQUIFER HUTCHINSON COUNTY | 575 | 575 | 575 | 575 | 575 | 575 | \$736 | \$169 |
| TCW SUPPLY INC | A | MUNICIPAL CONSERVATION - TCW SUPPLY | DEMAND REDUCTION | 21 | 21 | 21 | 21 | 22 | 22 | \$522 | \$510 |
| TCW SUPPLY INC | A | WATER AUDITS AND LEAK REPAIR - TCW SUPPLY | DEMAND REDUCTION | 37 | 38 | 38 | 38 | 37 | 37 | \$587 | \$605 |
| TEXLINE | A | DEVELOP OGALLALA AQUIFER SUPPLIES - TEXLINE | A OGALLALA-RITA BLANCA AQUIFER DALLAM COUNTY | 0 | 0 | 0 | 150 | 150 | 150 | N/A | \$192 |
| TEXLINE | A | MUNICIPAL CONSERVATION - TEXLINE | DEMAND REDUCTION | 7 | 7 | 8 | 9 | 9 | 10 | \$1002 | \$753 |
| TEXLINE | A | WATER AUDITS AND LEAK REPAIR - TEXLINE | DEMAND REDUCTION | 11 | 13 | 14 | 15 | 17 | 18 | \$516 | \$530 |

Recommended Water User Group (WUG) Water Management Strategies (WMS)

Water Management Strategy Supplies

| WUG Entity Name | WMS Sponsor Region | WMS Name | Source Name | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 | Unit Cost 2020 | Unit Cost 2070 |
|--|--------------------|---|--|---------|---------|---------|---------|---------|---------|----------------|----------------|
| VEGA | A | MUNICIPAL CONSERVATION - VEGA | DEMAND REDUCTION | 8 | 9 | 9 | 9 | 9 | 9 | \$975 | \$918 |
| VEGA | A | WATER AUDITS AND LEAK REPAIR - VEGA | DEMAND REDUCTION | 14 | 14 | 14 | 14 | 14 | 14 | \$707 | \$734 |
| WELLINGTON | A | ADVANCED TREATMENT - WELLINGTON | A SEYMOUR AQUIFER COLLINGSWORTH COUNTY | 500 | 500 | 500 | 500 | 500 | 500 | \$1029 | \$413 |
| WELLINGTON | A | DEVELOP SEYMOUR AQUIFER SUPPLIES - WELLINGTON | A SEYMOUR AQUIFER COLLINGSWORTH COUNTY | 180 | 180 | 180 | 180 | 180 | 180 | \$1485 | \$279 |
| WELLINGTON | A | MUNICIPAL CONSERVATION - WELLINGTON | DEMAND REDUCTION | 18 | 18 | 19 | 19 | 20 | 20 | \$650 | \$639 |
| WELLINGTON | A | WATER AUDITS AND LEAK REPAIR - WELLINGTON | DEMAND REDUCTION | 26 | 27 | 27 | 28 | 29 | 30 | \$883 | \$925 |
| WHEELER | A | DEVELOP OGALLALA AQUIFER SUPPLIES - WHEELER | A OGALLALA AQUIFER WHEELER COUNTY | 500 | 500 | 500 | 500 | 500 | 500 | \$625 | \$157 |
| WHEELER | A | MUNICIPAL CONSERVATION - WHEELER | DEMAND REDUCTION | 15 | 15 | 16 | 16 | 17 | 18 | \$638 | \$593 |
| WHITE DEER | A | MUNICIPAL CONSERVATION - WHITE DEER | DEMAND REDUCTION | 8 | 9 | 9 | 9 | 9 | 9 | \$968 | \$944 |
| WHITE DEER | A | WATER AUDITS AND LEAK REPAIR - WHITE DEER | DEMAND REDUCTION | 12 | 12 | 12 | 12 | 12 | 12 | \$922 | \$962 |
| Region A Total Recommended WMS Supplies | | | | 186,579 | 318,193 | 498,532 | 561,885 | 603,280 | 644,976 | | |

Recommended Projects Associated with Water Management Strategies

Project Sponsor Region: A

| Sponsor Name | Is Sponsor a WWP? | Project Name | Project Description | Capital Cost | Online Decade |
|--|-------------------|--|--|---------------|---------------|
| AMARILLO | Y | DEVELOP CARSON COUNTY WELL FIELD (OGALLALA AQUIFER) - AMARILLO | CONVEYANCE/TRANSMISSION PIPELINE; MULTIPLE WELLS/WELL FIELD | \$37,528,000 | 2040 |
| AMARILLO | Y | DEVELOP POTTER COUNTY WELL FIELD (OGALLALA AQUIFER) - AMARILLO | CONVEYANCE/TRANSMISSION PIPELINE; MULTIPLE WELLS/WELL FIELD | \$53,397,000 | 2020 |
| AMARILLO | Y | DEVELOP ROBERTS COUNTY WELL FIELD (OGALLALA AQUIFER) - AMARILLO | CONVEYANCE/TRANSMISSION PIPELINE; MULTIPLE WELLS/WELL FIELD | \$170,217,000 | 2070 |
| BOOKER | N | DEVELOP OGALLALA AQUIFER SUPPLIES - BOOKER | MULTIPLE WELLS/WELL FIELD | \$1,489,400 | 2040 |
| BORGER | Y | DEVELOP NEW WELL FIELD (OGALLALA AQUIFER) - BORGER | CONVEYANCE/TRANSMISSION PIPELINE; MULTIPLE WELLS/WELL FIELD | \$26,070,400 | 2020 |
| CACTUS | Y | DEVELOP NEW WELL FIELD (OGALLALA AQUIFER) - CACTUS | CONVEYANCE/TRANSMISSION PIPELINE; MULTIPLE WELLS/WELL FIELD | \$18,191,900 | 2020 |
| CANADIAN | N | MUNICIPAL CONSERVATION - CANADIAN | WATER LOSS CONTROL | \$2,294,900 | 2020 |
| CANADIAN RIVER MUNICIPAL WATER AUTHORITY | Y | ASR - CRMWA | CONVEYANCE/TRANSMISSION PIPELINE; INJECTION WELL; PUMP STATION | \$67,649,300 | 2030 |
| CANADIAN RIVER MUNICIPAL WATER AUTHORITY | Y | EXPANSION OF ROBERTS COUNTY WELL FIELD (OGALLALA AQUIFER) IN 2024 - CRMWA2 | CONVEYANCE/TRANSMISSION PIPELINE; MULTIPLE WELLS/WELL FIELD | \$250,299,000 | 2024 |
| CANADIAN RIVER MUNICIPAL WATER AUTHORITY | Y | REPLACE CAPACITY OF ROBERTS COUNTY WELL FIELD (OGALLALA AQUIFER) IN 2030 - CRMWA | MULTIPLE WELLS/WELL FIELD | \$8,267,250 | 2030 |
| CANADIAN RIVER MUNICIPAL WATER AUTHORITY | Y | REPLACE CAPACITY OF ROBERTS COUNTY WELL FIELD (OGALLALA AQUIFER) IN 2040 - CRMWA | MULTIPLE WELLS/WELL FIELD | \$16,533,500 | 2040 |
| CANYON | N | DEVELOP DOCKUM/OGALLALA AQUIFER SUPPLIES - CANYON | CONVEYANCE/TRANSMISSION PIPELINE; MULTIPLE WELLS/WELL FIELD | \$11,614,100 | 2020 |
| CHILDRESS | N | MUNICIPAL CONSERVATION - CHILDRESS | WATER LOSS CONTROL | \$4,098,000 | 2020 |
| CLAUDE | N | DEVELOP OGALLALA AQUIFER SUPPLIES - CLAUDE | CONVEYANCE/TRANSMISSION PIPELINE; MULTIPLE WELLS/WELL FIELD | \$2,891,100 | 2040 |
| CLAUDE | N | MUNICIPAL CONSERVATION - CLAUDE | WATER LOSS CONTROL | \$721,800 | 2020 |
| COUNTY-OTHER, HALL | N | ADVANCED TREATMENT - HALL COUNTY OTHER (LAKEVIEW) | NEW WATER TREATMENT PLANT | \$1,600,800 | 2020 |
| COUNTY-OTHER, HALL | N | MUNICIPAL CONSERVATION - HALL COUNTY OTHER | WATER LOSS CONTROL | \$660,000 | 2020 |
| COUNTY-OTHER, HALL | N | NEW GROUNDWATER SOURCE - HALL COUNTY OTHER (BRICE-LESLEY) | SINGLE WELL | \$299,300 | 2020 |
| COUNTY-OTHER, HALL | N | NEW GROUNDWATER SOURCE - HALL COUNTY OTHER (ESTELLINE) | SINGLE WELL | \$141,100 | 2020 |
| COUNTY-OTHER, HALL | N | NEW GROUNDWATER SOURCE - HALL COUNTY OTHER (TURKEY) | CONVEYANCE/TRANSMISSION PIPELINE; MULTIPLE WELLS/WELL FIELD | \$1,345,300 | 2020 |
| COUNTY-OTHER, POTTER | N | DEVELOP DOCKUM AQUIFER SUPPLIES - POTTER COUNTY OTHER | MULTIPLE WELLS/WELL FIELD | \$3,345,600 | 2020 |
| COUNTY-OTHER, POTTER | N | DEVELOP OGALLALA AQUIFER SUPPLIES - POTTER COUNTY OTHER | MULTIPLE WELLS/WELL FIELD | \$3,979,400 | 2030 |
| COUNTY-OTHER, POTTER | N | MUNICIPAL CONSERVATION - POTTER COUNTY OTHER | WATER LOSS CONTROL | \$13,409,600 | 2020 |
| COUNTY-OTHER, RANDALL | N | DEVELOP OGALLALA AQUIFER SUPPLIES - RANDALL COUNTY OTHER | MULTIPLE WELLS/WELL FIELD | \$5,299,300 | 2030 |
| DALHART | N | DEVELOP OGALLALA AQUIFER SUPPLIES - DALHART | MULTIPLE WELLS/WELL FIELD; SINGLE WELL | \$4,197,900 | 2020 |
| DUMAS | N | DEVELOP OGALLALA AQUIFER SUPPLIES - DUMAS | CONVEYANCE/TRANSMISSION PIPELINE; MULTIPLE WELLS/WELL FIELD | \$12,544,700 | 2020 |
| FRITCH | N | MUNICIPAL CONSERVATION - FRITCH | WATER LOSS CONTROL | \$1,367,000 | 2020 |
| GREENBELT MUNICIPAL & INDUSTRIAL WATER AUTHORITY | Y | DEVELOP OGALLALA AQUIFER IN DONLEY COUNTY - GREENBELT MIWA | CONVEYANCE/TRANSMISSION PIPELINE; MULTIPLE WELLS/WELL FIELD | \$12,617,000 | 2020 |
| GRUVER | N | DEVELOP OGALLALA AQUIFER SUPPLIES - GRUVER | MULTIPLE WELLS/WELL FIELD | \$1,385,600 | 2040 |
| GRUVER | N | MUNICIPAL CONSERVATION - GRUVER | WATER LOSS CONTROL | \$964,600 | 2020 |
| IRRIGATION, ARMSTRONG | N | IRRIGATION CONSERVATION - ARMSTRONG COUNTY | ON FARM IRRIGATION CONSERVATION | \$154,200 | 2020 |


Recommended Projects Associated with Water Management Strategies

| Sponsor Name | Is Sponsor a WWP? | Project Name | Project Description | Capital Cost | Online Decade |
|---------------------------|-------------------|--|---|--------------|---------------|
| IRRIGATION, CARSON | N | IRRIGATION CONSERVATION - CARSON COUNTY | ON FARM IRRIGATION CONSERVATION | \$2,047,700 | 2020 |
| IRRIGATION, CHILDRESS | N | IRRIGATION CONSERVATION - CHILDRESS COUNTY | ON FARM IRRIGATION CONSERVATION | \$268,700 | 2020 |
| IRRIGATION, COLLINGSWORTH | N | IRRIGATION CONSERVATION - COLLINGSWORTH COUNTY | ON FARM IRRIGATION CONSERVATION | \$659,600 | 2020 |
| IRRIGATION, DALLAM | N | IRRIGATION CONSERVATION - DALLAM COUNTY | ON FARM IRRIGATION CONSERVATION | \$13,596,900 | 2020 |
| IRRIGATION, DONLEY | N | IRRIGATION CONSERVATION - DONLEY COUNTY | ON FARM IRRIGATION CONSERVATION | \$885,200 | 2020 |
| IRRIGATION, GRAY | N | IRRIGATION CONSERVATION - GRAY COUNTY | ON FARM IRRIGATION CONSERVATION | \$782,700 | 2020 |
| IRRIGATION, HALL | N | IRRIGATION CONSERVATION - HALL COUNTY | ON FARM IRRIGATION CONSERVATION | \$372,500 | 2020 |
| IRRIGATION, HANSFORD | N | IRRIGATION CONSERVATION - HANSFORD COUNTY | ON FARM IRRIGATION CONSERVATION | \$4,959,300 | 2020 |
| IRRIGATION, HARTLEY | N | IRRIGATION CONSERVATION - HARTLEY COUNTY | ON FARM IRRIGATION CONSERVATION | \$12,696,300 | 2020 |
| IRRIGATION, HEMPHILL | N | IRRIGATION CONSERVATION - HEMPHILL COUNTY | ON FARM IRRIGATION CONSERVATION | \$70,100 | 2020 |
| IRRIGATION, HUTCHINSON | N | IRRIGATION CONSERVATION - HUTCHINSON COUNTY | ON FARM IRRIGATION CONSERVATION | \$1,470,800 | 2020 |
| IRRIGATION, LIPSCOMB | N | IRRIGATION CONSERVATION - LIPSCOMB COUNTY | ON FARM IRRIGATION CONSERVATION | \$735,600 | 2020 |
| IRRIGATION, MOORE | N | IRRIGATION CONSERVATION - MOORE COUNTY | ON FARM IRRIGATION CONSERVATION | \$5,258,000 | 2020 |
| IRRIGATION, OCHILTREE | N | IRRIGATION CONSERVATION - OCHILTREE COUNTY | ON FARM IRRIGATION CONSERVATION | \$2,104,300 | 2020 |
| IRRIGATION, OLDHAM | N | IRRIGATION CONSERVATION - OLDHAM COUNTY | ON FARM IRRIGATION CONSERVATION | \$144,700 | 2020 |
| IRRIGATION, POTTER | N | IRRIGATION CONSERVATION - POTTER COUNTY | ON FARM IRRIGATION CONSERVATION | \$126,000 | 2020 |
| IRRIGATION, RANDALL | N | IRRIGATION CONSERVATION - RANDALL COUNTY | ON FARM IRRIGATION CONSERVATION | \$661,700 | 2020 |
| IRRIGATION, ROBERTS | N | IRRIGATION CONSERVATION - ROBERTS COUNTY | ON FARM IRRIGATION CONSERVATION | \$219,000 | 2020 |
| IRRIGATION, SHERMAN | N | IRRIGATION CONSERVATION - SHERMAN COUNTY | ON FARM IRRIGATION CONSERVATION | \$8,123,100 | 2020 |
| IRRIGATION, WHEELER | N | IRRIGATION CONSERVATION - WHEELER COUNTY | ON FARM IRRIGATION CONSERVATION | \$301,500 | 2020 |
| LAKE TANGLEWOOD | N | DEVELOP OGALLALA AQUIFER SUPPLIES - LAKE TANGLEWOOD | CONVEYANCE/TRANSMISSION PIPELINE; MULTIPLE WELLS/WELL FIELD | \$2,976,400 | 2020 |
| LAKE TANGLEWOOD | N | MUNICIPAL CONSERVATION - LAKE TANGLEWOOD | WATER LOSS CONTROL | \$492,000 | 2020 |
| MANUFACTURING, MOORE | N | DEVELOP NEW WELL FIELD (OGALLALA AQUIFER) - MANUFACTURING MOORE COUNTY | MULTIPLE WELLS/WELL FIELD | \$11,244,800 | 2050 |
| MANUFACTURING, RANDALL | N | DEVELOP OGALLALA AQUIFER SUPPLIES - RANDALL COUNTY MANUFACTURING | MULTIPLE WELLS/WELL FIELD | \$746,000 | 2020 |
| MCLEAN | N | DEVELOP OGALLALA AQUIFER SUPPLIES - MCLEAN | SINGLE WELL | \$789,400 | 2020 |
| MCLEAN | N | MUNICIPAL CONSERVATION - MCLEAN | WATER LOSS CONTROL | \$669,900 | 2020 |
| MEMPHIS | N | DEVELOP OGALLALA AQUIFER SUPPLIES - MEMPHIS | MULTIPLE WELLS/WELL FIELD | \$1,183,900 | 2050 |
| MEMPHIS | N | MUNICIPAL CONSERVATION - MEMPHIS | WATER LOSS CONTROL | \$470,000 | 2020 |
| MIAMI | N | MUNICIPAL CONSERVATION - MIAMI | WATER LOSS CONTROL | \$373,200 | 2020 |
| PAMPA | N | DEVELOP OGALLALA AQUIFER SUPPLIES - PAMPA | CONVEYANCE/TRANSMISSION PIPELINE; MULTIPLE WELLS/WELL FIELD | \$8,618,100 | 2030 |
| PANHANDLE | N | DEVELOP OGALLALA AQUIFER SUPPLIES - PANHANDLE | CONVEYANCE/TRANSMISSION PIPELINE; MULTIPLE WELLS/WELL FIELD | \$3,217,800 | 2020 |
| PANHANDLE | N | MUNICIPAL CONSERVATION - PANHANDLE | WATER LOSS CONTROL | \$1,559,800 | 2020 |
| PERRYTON | N | DEVELOP OGALLALA AQUIFER SUPPLIES - PERRYTON | CONVEYANCE/TRANSMISSION PIPELINE; MULTIPLE WELLS/WELL FIELD | \$10,584,100 | 2020 |
| SHAMROCK | N | MUNICIPAL CONSERVATION - SHAMROCK | WATER LOSS CONTROL | \$1,301,900 | 2020 |
| SPEARMAN | N | DEVELOP OGALLALA AQUIFER SUPPLIES - SPEARMAN | CONVEYANCE/TRANSMISSION PIPELINE; MULTIPLE WELLS/WELL FIELD | \$3,665,600 | 2050 |
| STINNETT | N | DEVELOP OGALLALA AQUIFER SUPPLIES - STINNETT | SINGLE WELL | \$908,000 | 2050 |

Recommended Projects Associated with Water Management Strategies

| Sponsor Name | Is Sponsor a WWP? | Project Name | Project Description | Capital Cost | Online Decade |
|--|-------------------|---|---|----------------------|---------------|
| STINNETT | N | MUNICIPAL CONSERVATION - STINNETT | WATER LOSS CONTROL | \$1,212,200 | 2020 |
| STRATFORD | N | MUNICIPAL CONSERVATION - STRATFORD | WATER LOSS CONTROL | \$1,489,900 | 2020 |
| SUNRAY | N | DEVELOP OGALLALA AQUIFER SUPPLIES - SUNRAY | MULTIPLE WELLS/WELL FIELD | \$3,526,100 | 2030 |
| SUNRAY | N | MUNICIPAL CONSERVATION - SUNRAY | WATER LOSS CONTROL | \$1,822,300 | 2020 |
| TCW SUPPLY INC | N | DEVELOP OGALLALA AQUIFER SUPPLIES - TCW SUPPLY | CONVEYANCE/TRANSMISSION PIPELINE; MULTIPLE WELLS/WELL FIELD | \$3,890,200 | 2020 |
| TCW SUPPLY INC | N | MUNICIPAL CONSERVATION - TCW SUPPLY | WATER LOSS CONTROL | \$1,346,700 | 2020 |
| TEXLINE | N | DEVELOP OGALLALA AQUIFER SUPPLIES - TEXLINE | SINGLE WELL | \$1,056,000 | 2050 |
| TEXLINE | N | MUNICIPAL CONSERVATION - TEXLINE | WATER LOSS CONTROL | \$464,500 | 2020 |
| VEGA | N | MUNICIPAL CONSERVATION - VEGA | WATER LOSS CONTROL | \$608,100 | 2020 |
| WELLINGTON | N | ADVANCED TREATMENT (NITRATE REMOVAL) - WELLINGTON | NEW WATER TREATMENT PLANT | \$3,679,700 | 2020 |
| WELLINGTON | N | DEVELOP SEYMOUR AQUIFER SUPPLIES - WELLINGTON | CONVEYANCE/TRANSMISSION PIPELINE; MULTIPLE WELLS/WELL FIELD | \$2,589,800 | 2020 |
| WELLINGTON | N | MUNICIPAL CONSERVATION - WELLINGTON | WATER LOSS CONTROL | \$1,533,900 | 2020 |
| WHEELER | N | DEVELOP OGALLALA AQUIFER SUPPLIES - WHEELER | CONVEYANCE/TRANSMISSION PIPELINE; MULTIPLE WELLS/WELL FIELD | \$2,795,600 | 2020 |
| WHITE DEER | N | MUNICIPAL CONSERVATION - WHITE DEER | WATER LOSS CONTROL | \$704,400 | 2020 |
| Region A Total Recommended Capital Cost | | | | \$865,578,050 | |

*Projects with a capital cost of zero are excluded from the report list.

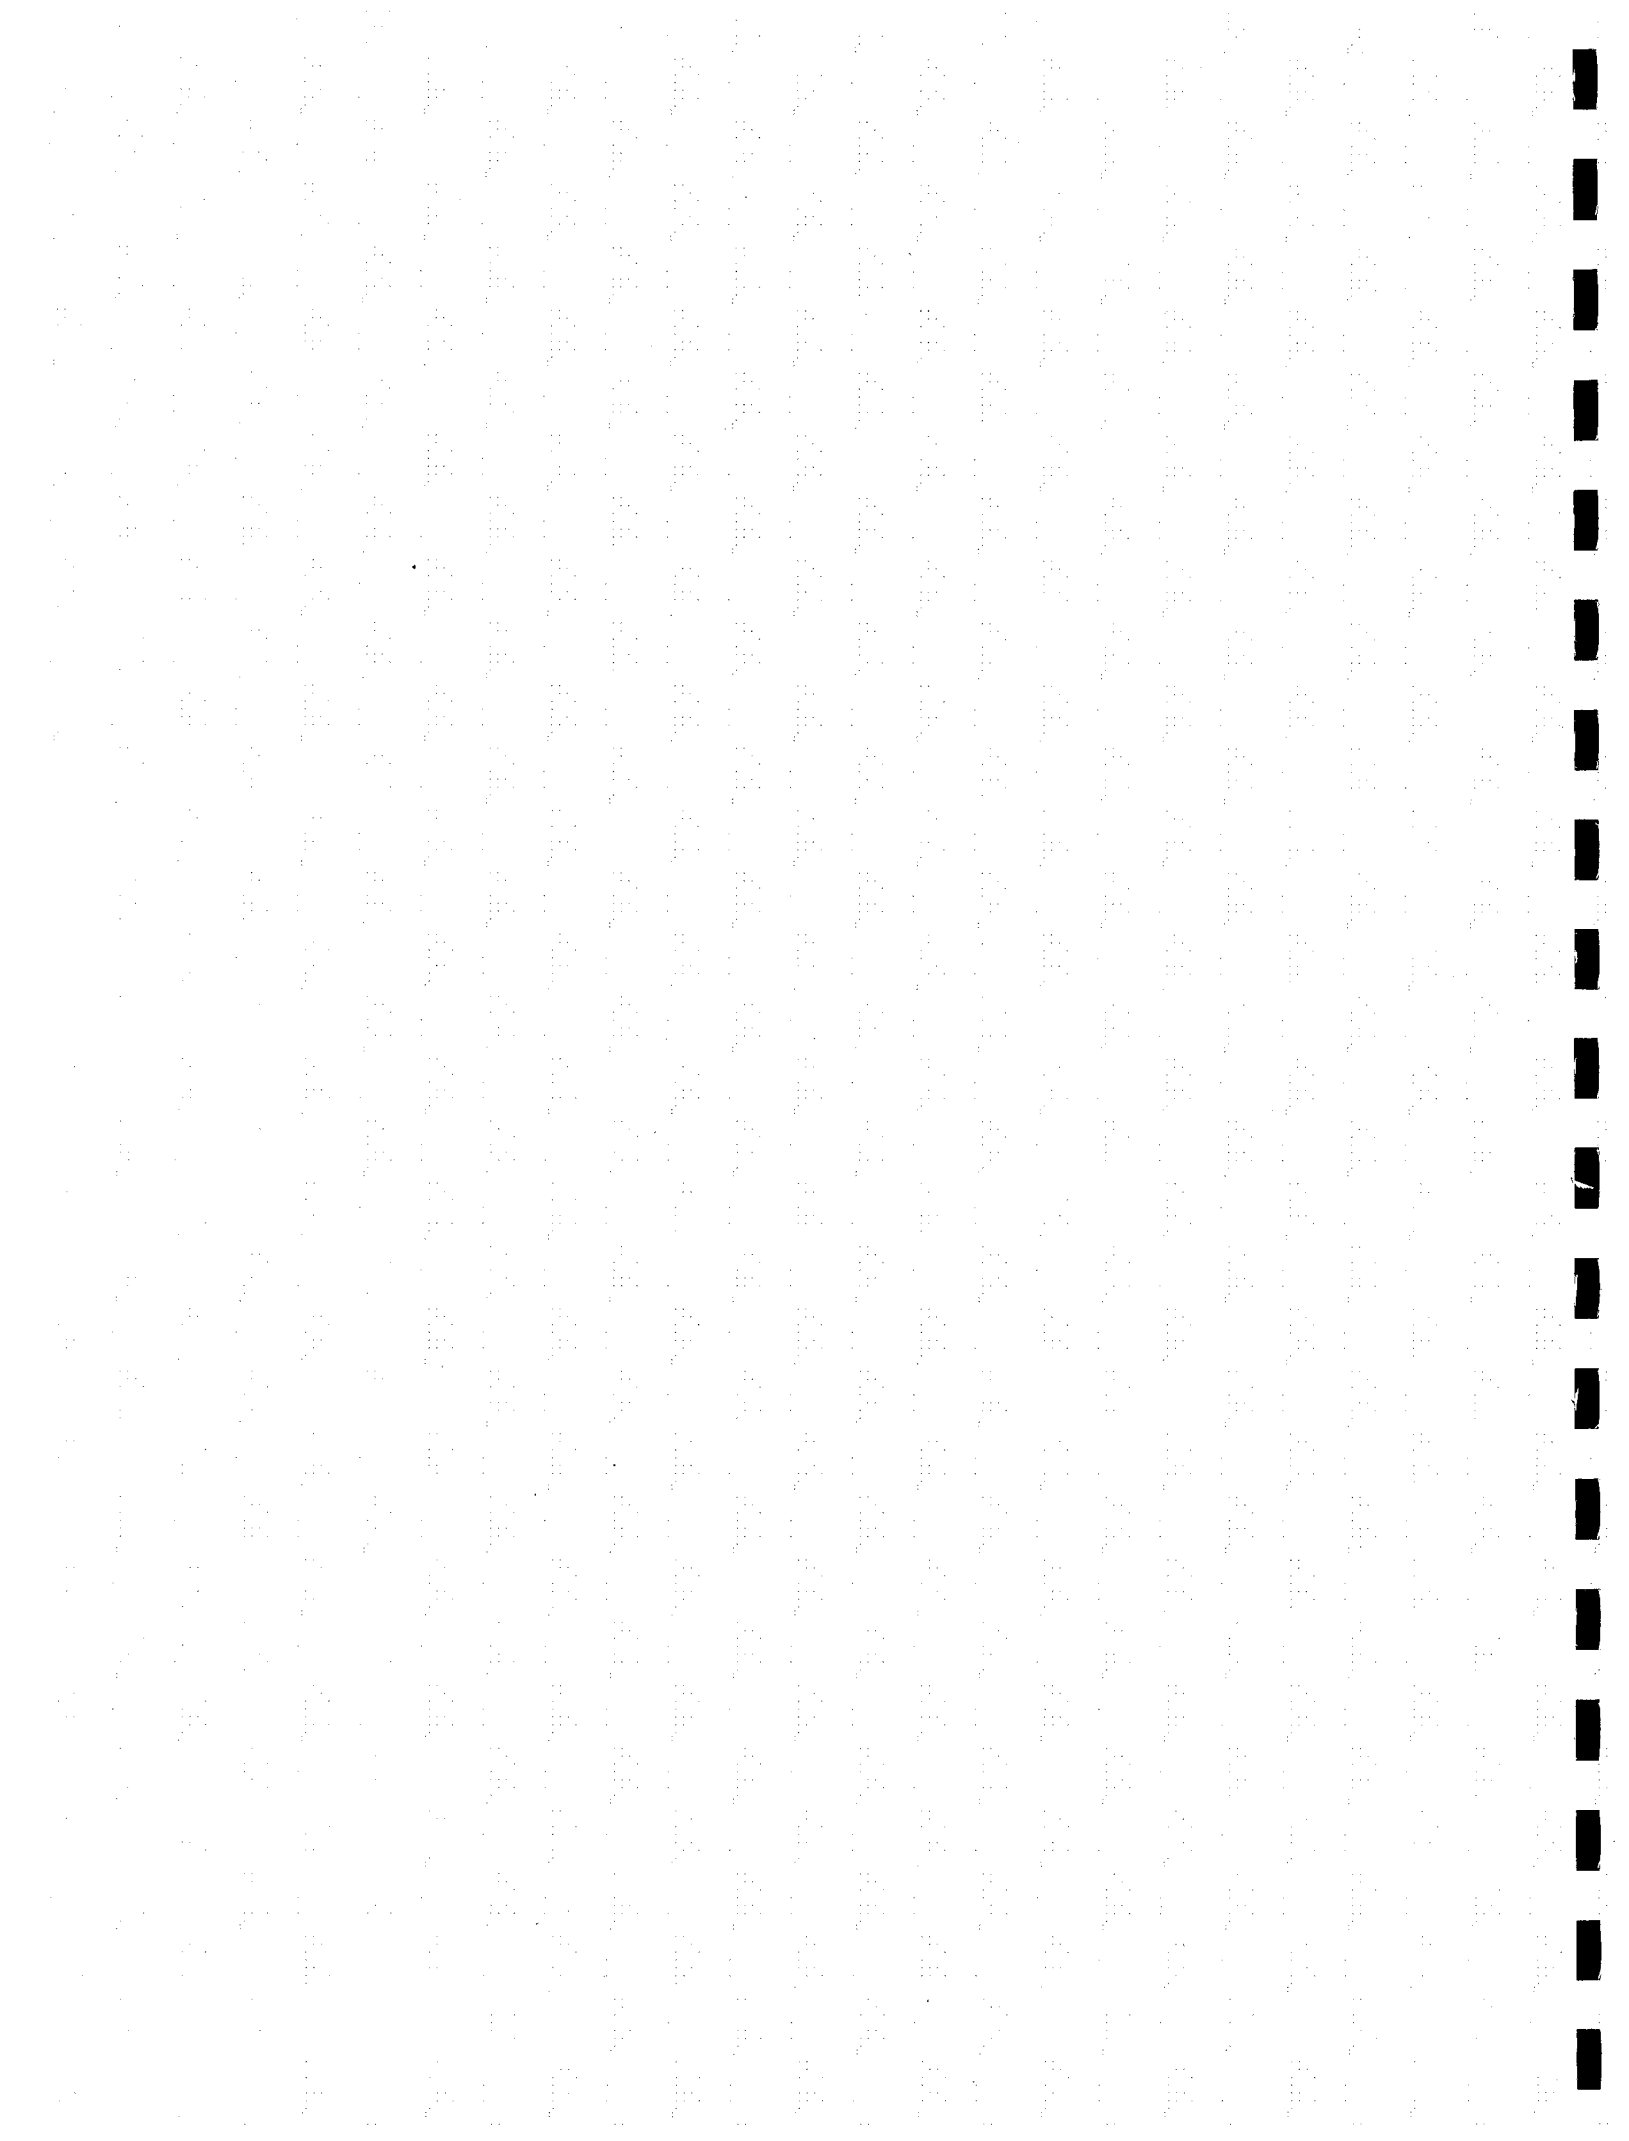

Water User Group (WUG) Management Supply Factor

| REGION A | WUG MANAGEMENT SUPPLY FACTOR | | | | | |
|-----------------------------|------------------------------|------|------|------|------|------|
| | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| AMARILLO | 1.1 | 1.4 | 1.4 | 1.2 | 1.0 | 1.1 |
| BOOKER | 1.0 | 1.0 | 1.8 | 1.4 | 1.2 | 1.2 |
| BORGER | 3.1 | 3.8 | 3.4 | 3.1 | 2.8 | 2.5 |
| CACTUS | 4.1 | 3.1 | 2.4 | 1.8 | 1.4 | 1.1 |
| CANADIAN | 1.1 | 1.1 | 1.1 | 1.1 | 1.1 | 1.1 |
| CANYON | 1.2 | 1.2 | 1.3 | 1.1 | 1.0 | 1.0 |
| CHILDRESS | 1.1 | 1.1 | 1.1 | 1.1 | 1.1 | 1.1 |
| CLARENDON | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 |
| CLAUDE | 1.4 | 1.2 | 2.2 | 2.1 | 2.0 | 1.9 |
| COUNTY-OTHER, ARMSTRONG | 1.1 | 1.2 | 1.2 | 1.2 | 1.2 | 1.2 |
| COUNTY-OTHER, CARSON | 1.6 | 1.6 | 1.5 | 1.5 | 1.4 | 1.3 |
| COUNTY-OTHER, CHILDRESS | 1.1 | 1.1 | 1.1 | 1.1 | 1.1 | 1.1 |
| COUNTY-OTHER, COLLINGSWORTH | 1.2 | 1.2 | 1.2 | 1.1 | 1.1 | 1.1 |
| COUNTY-OTHER, DALLAM | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 |
| COUNTY-OTHER, DONLEY | 1.1 | 1.1 | 1.2 | 1.2 | 1.2 | 1.2 |
| COUNTY-OTHER, GRAY | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 |
| COUNTY-OTHER, HALL | 1.9 | 1.9 | 1.9 | 1.9 | 1.9 | 1.9 |
| COUNTY-OTHER, HANSFORD | 1.4 | 1.4 | 1.3 | 1.2 | 1.1 | 1.1 |
| COUNTY-OTHER, HARTLEY | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 |
| COUNTY-OTHER, HEMPHILL | 1.4 | 1.4 | 1.4 | 1.4 | 1.4 | 1.4 |
| COUNTY-OTHER, HUTCHINSON | 1.5 | 1.4 | 1.4 | 1.4 | 1.3 | 1.3 |
| COUNTY-OTHER, LIPSCOMB | 1.1 | 1.1 | 1.1 | 1.0 | 1.0 | 1.0 |
| COUNTY-OTHER, MOORE | 1.3 | 1.3 | 1.3 | 1.3 | 1.3 | 1.3 |
| COUNTY-OTHER, OCHILTREE | 1.1 | 1.1 | 1.1 | 1.1 | 1.1 | 1.1 |
| COUNTY-OTHER, OLDHAM | 1.8 | 1.7 | 1.7 | 1.7 | 1.7 | 1.7 |
| COUNTY-OTHER, POTTER | 1.4 | 1.3 | 1.2 | 1.1 | 1.0 | 0.9 |
| COUNTY-OTHER, RANDALL | 1.0 | 1.0 | 1.0 | 1.2 | 1.1 | 1.1 |
| COUNTY-OTHER, ROBERTS | 1.3 | 1.3 | 1.3 | 1.3 | 1.3 | 1.3 |
| COUNTY-OTHER, SHERMAN | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 |
| COUNTY-OTHER, WHEELER | 1.3 | 1.3 | 1.3 | 1.3 | 1.2 | 1.2 |
| DALHART | 1.8 | 1.6 | 1.4 | 1.2 | 1.1 | 1.0 |
| DUMAS | 1.5 | 1.3 | 1.1 | 1.4 | 1.2 | 1.0 |
| FRITCH | 1.1 | 1.1 | 1.1 | 1.1 | 1.1 | 1.1 |
| GROOM | 1.8 | 2.0 | 2.0 | 2.0 | 1.9 | 1.8 |
| GRUVER | 1.3 | 1.1 | 1.7 | 1.5 | 1.3 | 1.1 |
| IRRIGATION, ARMSTRONG | 1.1 | 1.2 | 1.3 | 1.4 | 1.4 | 1.5 |
| IRRIGATION, CARSON | 1.2 | 1.2 | 1.4 | 1.4 | 1.5 | 1.6 |
| IRRIGATION, CHILDRESS | 1.1 | 1.1 | 1.2 | 1.2 | 1.3 | 1.4 |
| IRRIGATION, COLLINGSWORTH | 1.1 | 1.1 | 1.2 | 1.2 | 1.2 | 1.3 |
| IRRIGATION, DALLAM | 0.9 | 0.9 | 1.0 | 1.1 | 1.2 | 1.3 |
| IRRIGATION, DONLEY | 1.1 | 1.2 | 1.2 | 1.2 | 1.3 | 1.4 |
| IRRIGATION, GRAY | 1.2 | 1.2 | 1.3 | 1.4 | 1.5 | 1.6 |
| IRRIGATION, HALL | 1.0 | 1.1 | 1.1 | 1.2 | 1.2 | 1.2 |
| IRRIGATION, HANSFORD | 1.1 | 1.1 | 1.3 | 1.3 | 1.4 | 1.5 |
| IRRIGATION, HARTLEY | 0.9 | 0.9 | 1.0 | 1.0 | 1.1 | 1.2 |
| IRRIGATION, HEMPHILL | 1.0 | 1.1 | 1.1 | 1.1 | 1.2 | 1.2 |
| IRRIGATION, HUTCHINSON | 1.1 | 1.2 | 1.3 | 1.4 | 1.5 | 1.6 |
| IRRIGATION, LIPSCOMB | 1.1 | 1.1 | 1.2 | 1.2 | 1.3 | 1.3 |
| IRRIGATION, MOORE | 1.1 | 1.1 | 1.3 | 1.3 | 1.4 | 1.5 |
| IRRIGATION, OCHILTREE | 1.1 | 1.1 | 1.3 | 1.3 | 1.4 | 1.5 |


Water User Group (WUG) Management Supply Factor

| REGION A | WUG MANAGEMENT SUPPLY FACTOR | | | | | |
|---------------------------|------------------------------|------|------|------|------|------|
| | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| IRRIGATION, OLDHAM | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 |
| IRRIGATION, POTTER | 1.1 | 1.1 | 1.1 | 1.1 | 1.2 | 1.4 |
| IRRIGATION, RANDALL | 1.1 | 1.1 | 1.2 | 1.3 | 1.3 | 1.4 |
| IRRIGATION, ROBERTS | 1.2 | 1.2 | 1.4 | 1.4 | 1.5 | 1.6 |
| IRRIGATION, SHERMAN | 1.1 | 1.2 | 1.3 | 1.4 | 1.5 | 1.7 |
| IRRIGATION, WHEELER | 1.3 | 1.3 | 1.4 | 1.5 | 1.6 | 1.7 |
| LAKE TANGLEWOOD | 1.5 | 1.4 | 1.3 | 1.2 | 1.2 | 1.1 |
| LIVESTOCK, ARMSTRONG | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 |
| LIVESTOCK, CARSON | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 |
| LIVESTOCK, CHILDRESS | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 |
| LIVESTOCK, COLLINGSWORTH | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 |
| LIVESTOCK, DALLAM | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 |
| LIVESTOCK, DONLEY | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 |
| LIVESTOCK, GRAY | 1.6 | 1.5 | 1.5 | 1.5 | 1.4 | 1.4 |
| LIVESTOCK, HALL | 1.2 | 1.2 | 1.2 | 1.2 | 1.2 | 1.2 |
| LIVESTOCK, HANSFORD | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 |
| LIVESTOCK, HARTLEY | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 |
| LIVESTOCK, HEMPHILL | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 |
| LIVESTOCK, HUTCHINSON | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 |
| LIVESTOCK, LIPSCOMB | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 |
| LIVESTOCK, MOORE | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 |
| LIVESTOCK, OCHILTREE | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 |
| LIVESTOCK, OLDHAM | 1.4 | 1.4 | 1.4 | 1.4 | 1.4 | 1.4 |
| LIVESTOCK, POTTER | 1.4 | 1.4 | 1.4 | 1.4 | 1.4 | 1.4 |
| LIVESTOCK, RANDALL | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 |
| LIVESTOCK, ROBERTS | 1.3 | 1.3 | 1.3 | 1.3 | 1.3 | 1.3 |
| LIVESTOCK, SHERMAN | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 |
| LIVESTOCK, WHEELER | 1.1 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 |
| MANUFACTURING, CARSON | 2.7 | 2.2 | 1.9 | 1.7 | 1.5 | 1.3 |
| MANUFACTURING, DALLAM | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 |
| MANUFACTURING, GRAY | 1.1 | 1.0 | 1.1 | 1.0 | 1.0 | 1.0 |
| MANUFACTURING, HANSFORD | 1.6 | 1.5 | 1.5 | 1.6 | 1.6 | 1.6 |
| MANUFACTURING, HARTLEY | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 |
| MANUFACTURING, HEMPHILL | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 |
| MANUFACTURING, HUTCHINSON | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 |
| MANUFACTURING, LIPSCOMB | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 |
| MANUFACTURING, MOORE | 1.0 | 1.0 | 1.0 | 1.3 | 1.1 | 1.0 |
| MANUFACTURING, POTTER | 1.1 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 |
| MANUFACTURING, RANDALL | 1.0 | 1.4 | 1.3 | 1.2 | 1.1 | 1.1 |
| MCLEAN | 2.3 | 2.1 | 1.9 | 1.5 | 1.3 | 1.1 |
| MEMPHIS | 1.2 | 1.1 | 1.0 | 1.3 | 1.2 | 1.1 |
| MIAMI | 2.5 | 2.5 | 2.5 | 2.1 | 1.8 | 1.5 |
| MINING, CARSON | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 |
| MINING, GRAY | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 |
| MINING, HANSFORD | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 |
| MINING, HARTLEY | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 |
| MINING, HEMPHILL | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 |
| MINING, HUTCHINSON | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 |
| MINING, LIPSCOMB | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 |
| MINING, MOORE | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 |

Water User Group (WUG) Management Supply Factor

| REGION A | WUG MANAGEMENT SUPPLY FACTOR | | | | | |
|------------------------------|------------------------------|------|------|------|------|------|
| | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| MINING, OCHILTREE | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 |
| MINING, OLDHAM | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 |
| MINING, POTTER | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 |
| MINING, ROBERTS | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 |
| MINING, SHERMAN | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 |
| MINING, WHEELER | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 |
| PAMPA | 1.7 | 1.4 | 1.2 | 1.6 | 1.4 | 1.3 |
| PANHANDLE | 2.0 | 1.2 | 1.1 | 1.1 | 1.1 | 1.1 |
| PERRYTON | 1.4 | 1.2 | 1.0 | 1.3 | 1.2 | 1.0 |
| SHAMROCK | 2.8 | 2.7 | 2.5 | 2.3 | 2.1 | 1.9 |
| SPEARMAN | 1.0 | 1.0 | 1.0 | 1.6 | 1.3 | 1.1 |
| STEAM ELECTRIC POWER, GRAY | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 |
| STEAM ELECTRIC POWER, MOORE | 1.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| STEAM ELECTRIC POWER, POTTER | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 |
| STINNETT | 1.2 | 1.1 | 1.1 | 1.3 | 1.2 | 1.1 |
| STRATFORD | 2.7 | 2.6 | 2.5 | 2.2 | 1.8 | 1.4 |
| SUNRAY | 1.3 | 2.2 | 1.6 | 1.4 | 1.2 | 1.1 |
| TCW SUPPLY INC | 1.8 | 1.5 | 1.3 | 1.2 | 1.1 | 1.1 |
| TEXLINE | 1.1 | 1.1 | 1.1 | 1.4 | 1.2 | 1.0 |
| VEGA | 1.1 | 1.1 | 1.1 | 1.1 | 1.1 | 1.1 |
| WELLINGTON | 1.4 | 1.3 | 1.3 | 1.3 | 1.3 | 1.2 |
| WHEELER | 1.7 | 1.5 | 1.4 | 1.3 | 1.2 | 1.1 |
| WHITE DEER | 1.1 | 1.1 | 1.1 | 1.1 | 1.1 | 1.1 |


*WUG supplies and projected demands are entered for each of a WUG's region-county-basin divisions. To calculate the Management Supply Factor for each WUG as a whole, not split by region-county-basin the combined total of existing and future supply is divided by the total projected demand.

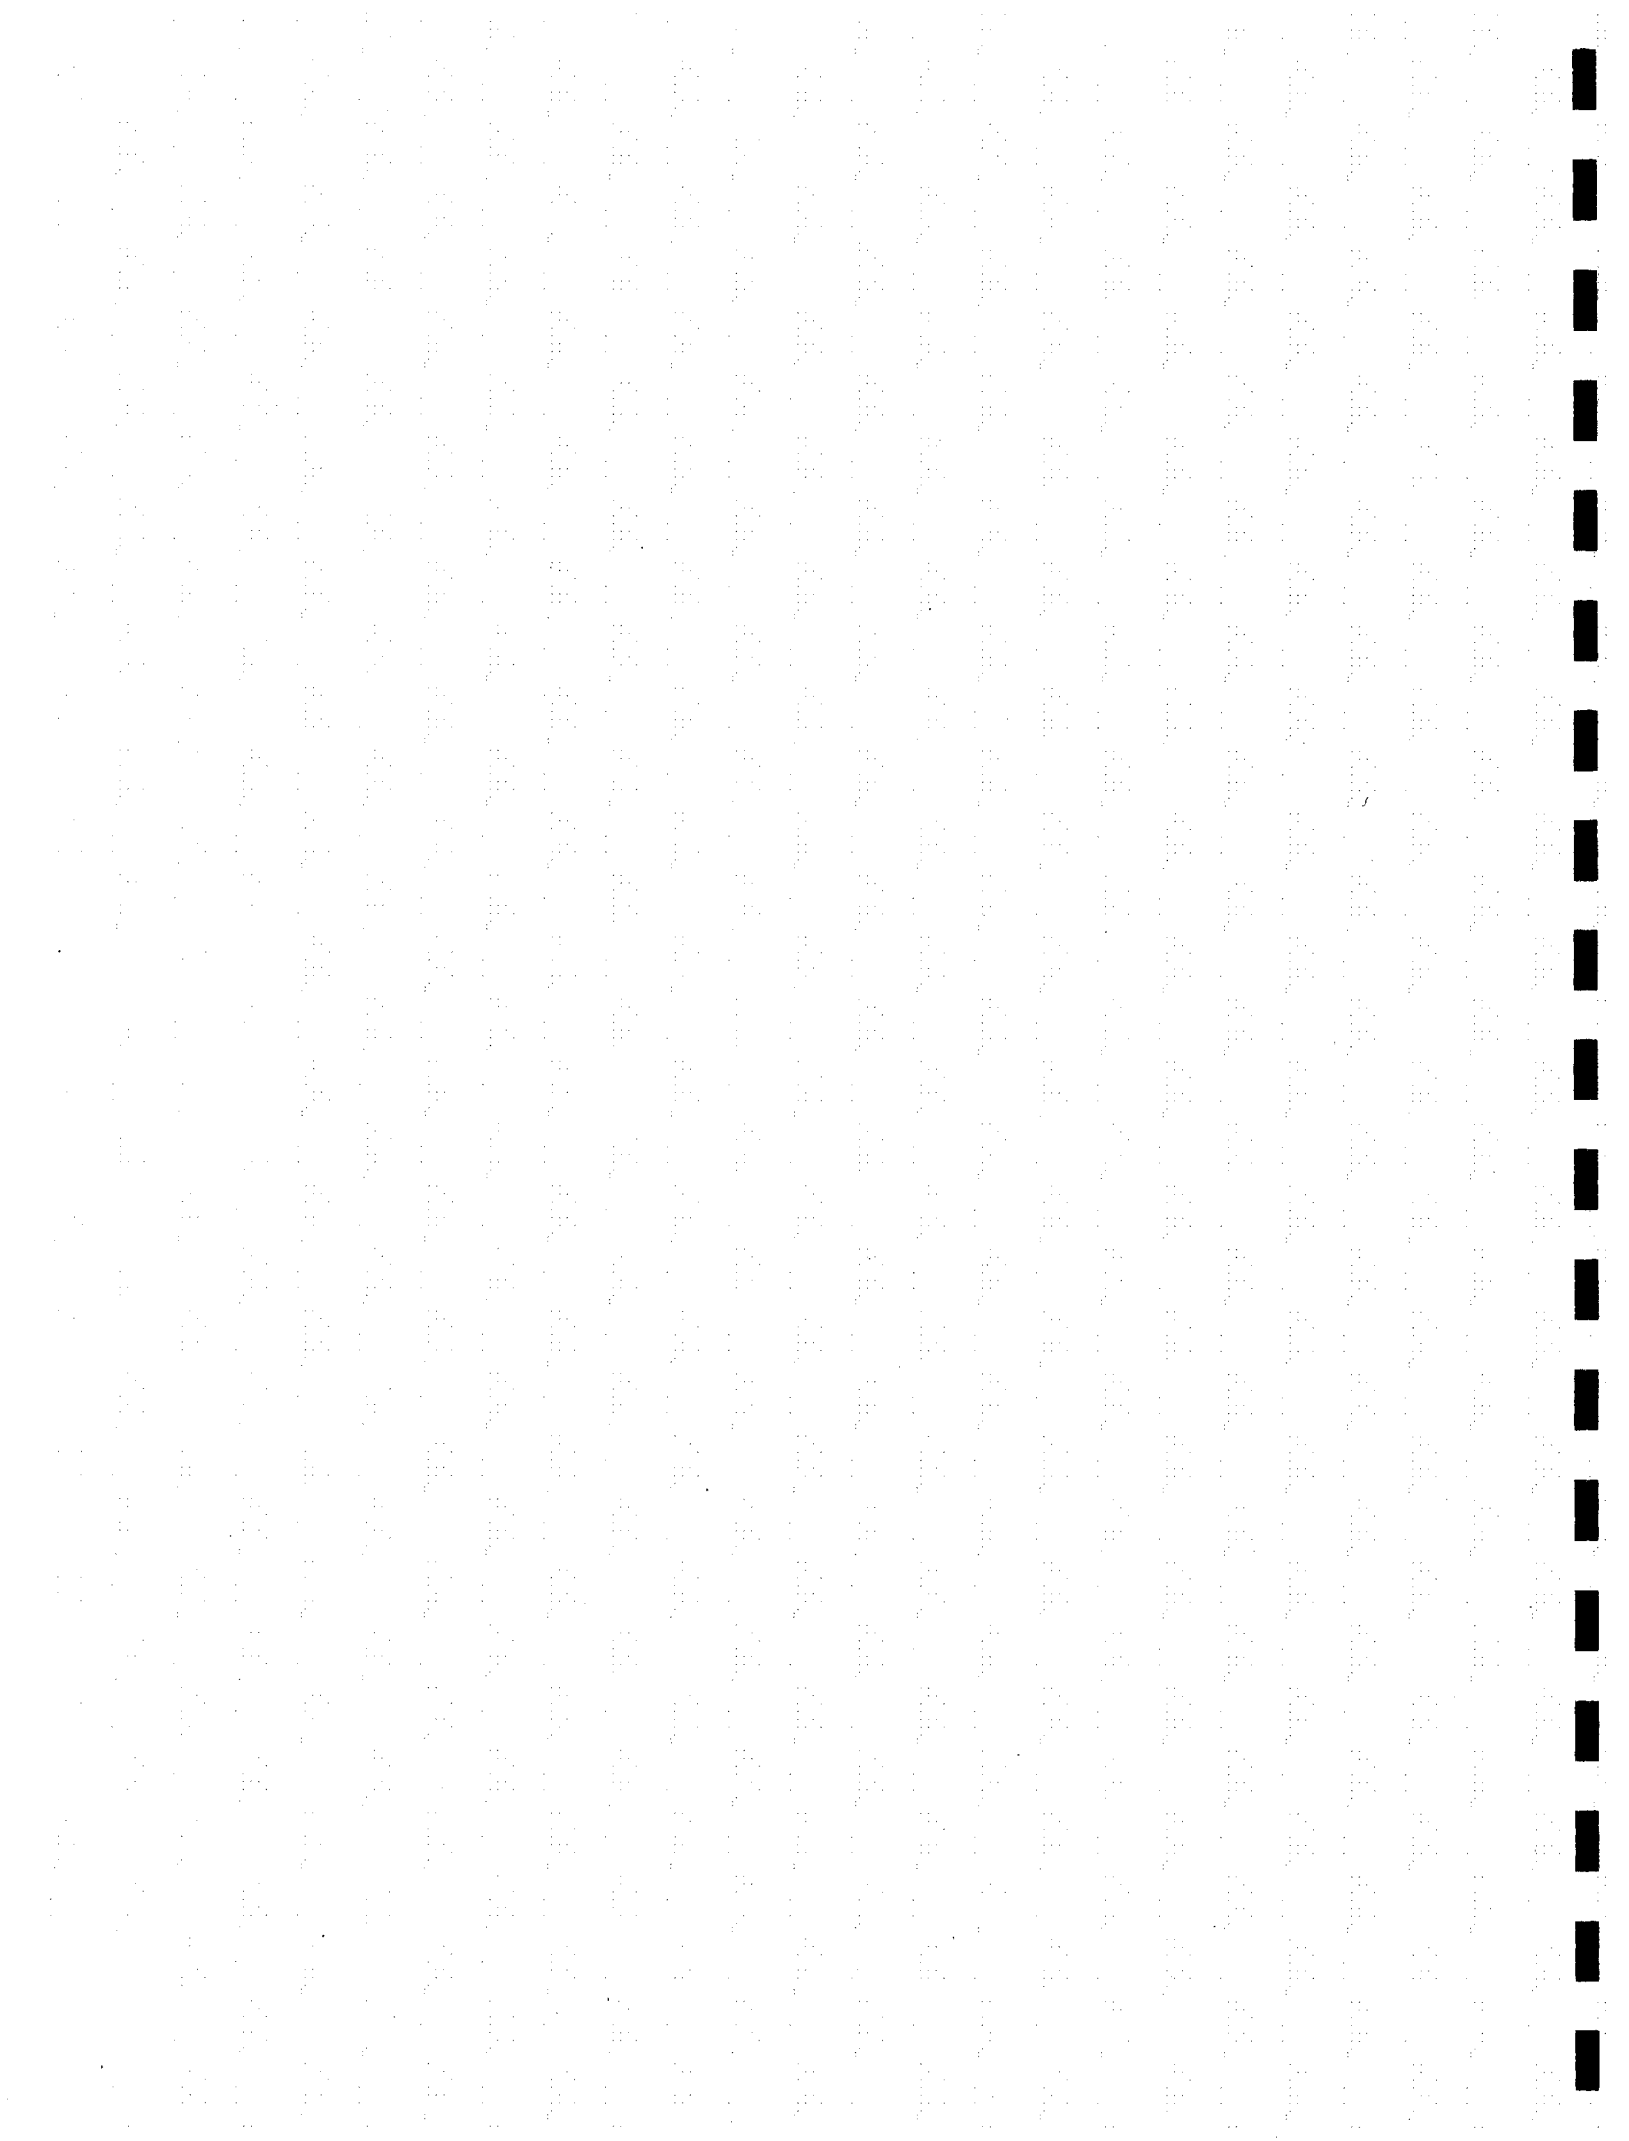

Water User Group (WUG) Unmet Needs

| REGION A | WUG UNMET NEEDS (ACRE-FEET PER YEAR) | | | | | |
|-----------------------|--------------------------------------|--------|-------|------|------|------|
| | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| DALLAM COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| IRRIGATION | 45,181 | 30,501 | 0 | 0 | 0 | 0 |
| HARTLEY COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| IRRIGATION | 48,108 | 41,207 | 8,174 | 0 | 0 | 0 |
| POTTER COUNTY | | | | | | |
| CANADIAN BASIN | | | | | | |
| COUNTY-OTHER | 0 | 0 | 0 | 0 | 0 | 467 |
| RED BASIN | | | | | | |
| COUNTY-OTHER | 0 | 0 | 0 | 0 | 0 | 68 |

*WUG supplies and projected demands are entered for each of a WUG's region-county-basin divisions. The unmet needs shown in the WUG Unmet Needs report are calculated by first deducting the WUG split's projected demand from the sum of its total existing water supply volume and all associated recommended water management strategy water volumes. If the WUG split has a greater future supply volume than projected demand in any given decade, this amount is considered a surplus volume. In order to display only unmet needs associated with the WUG split, these surplus volumes are updated to a zero and the unmet needs water volumes are shown as absolute values.

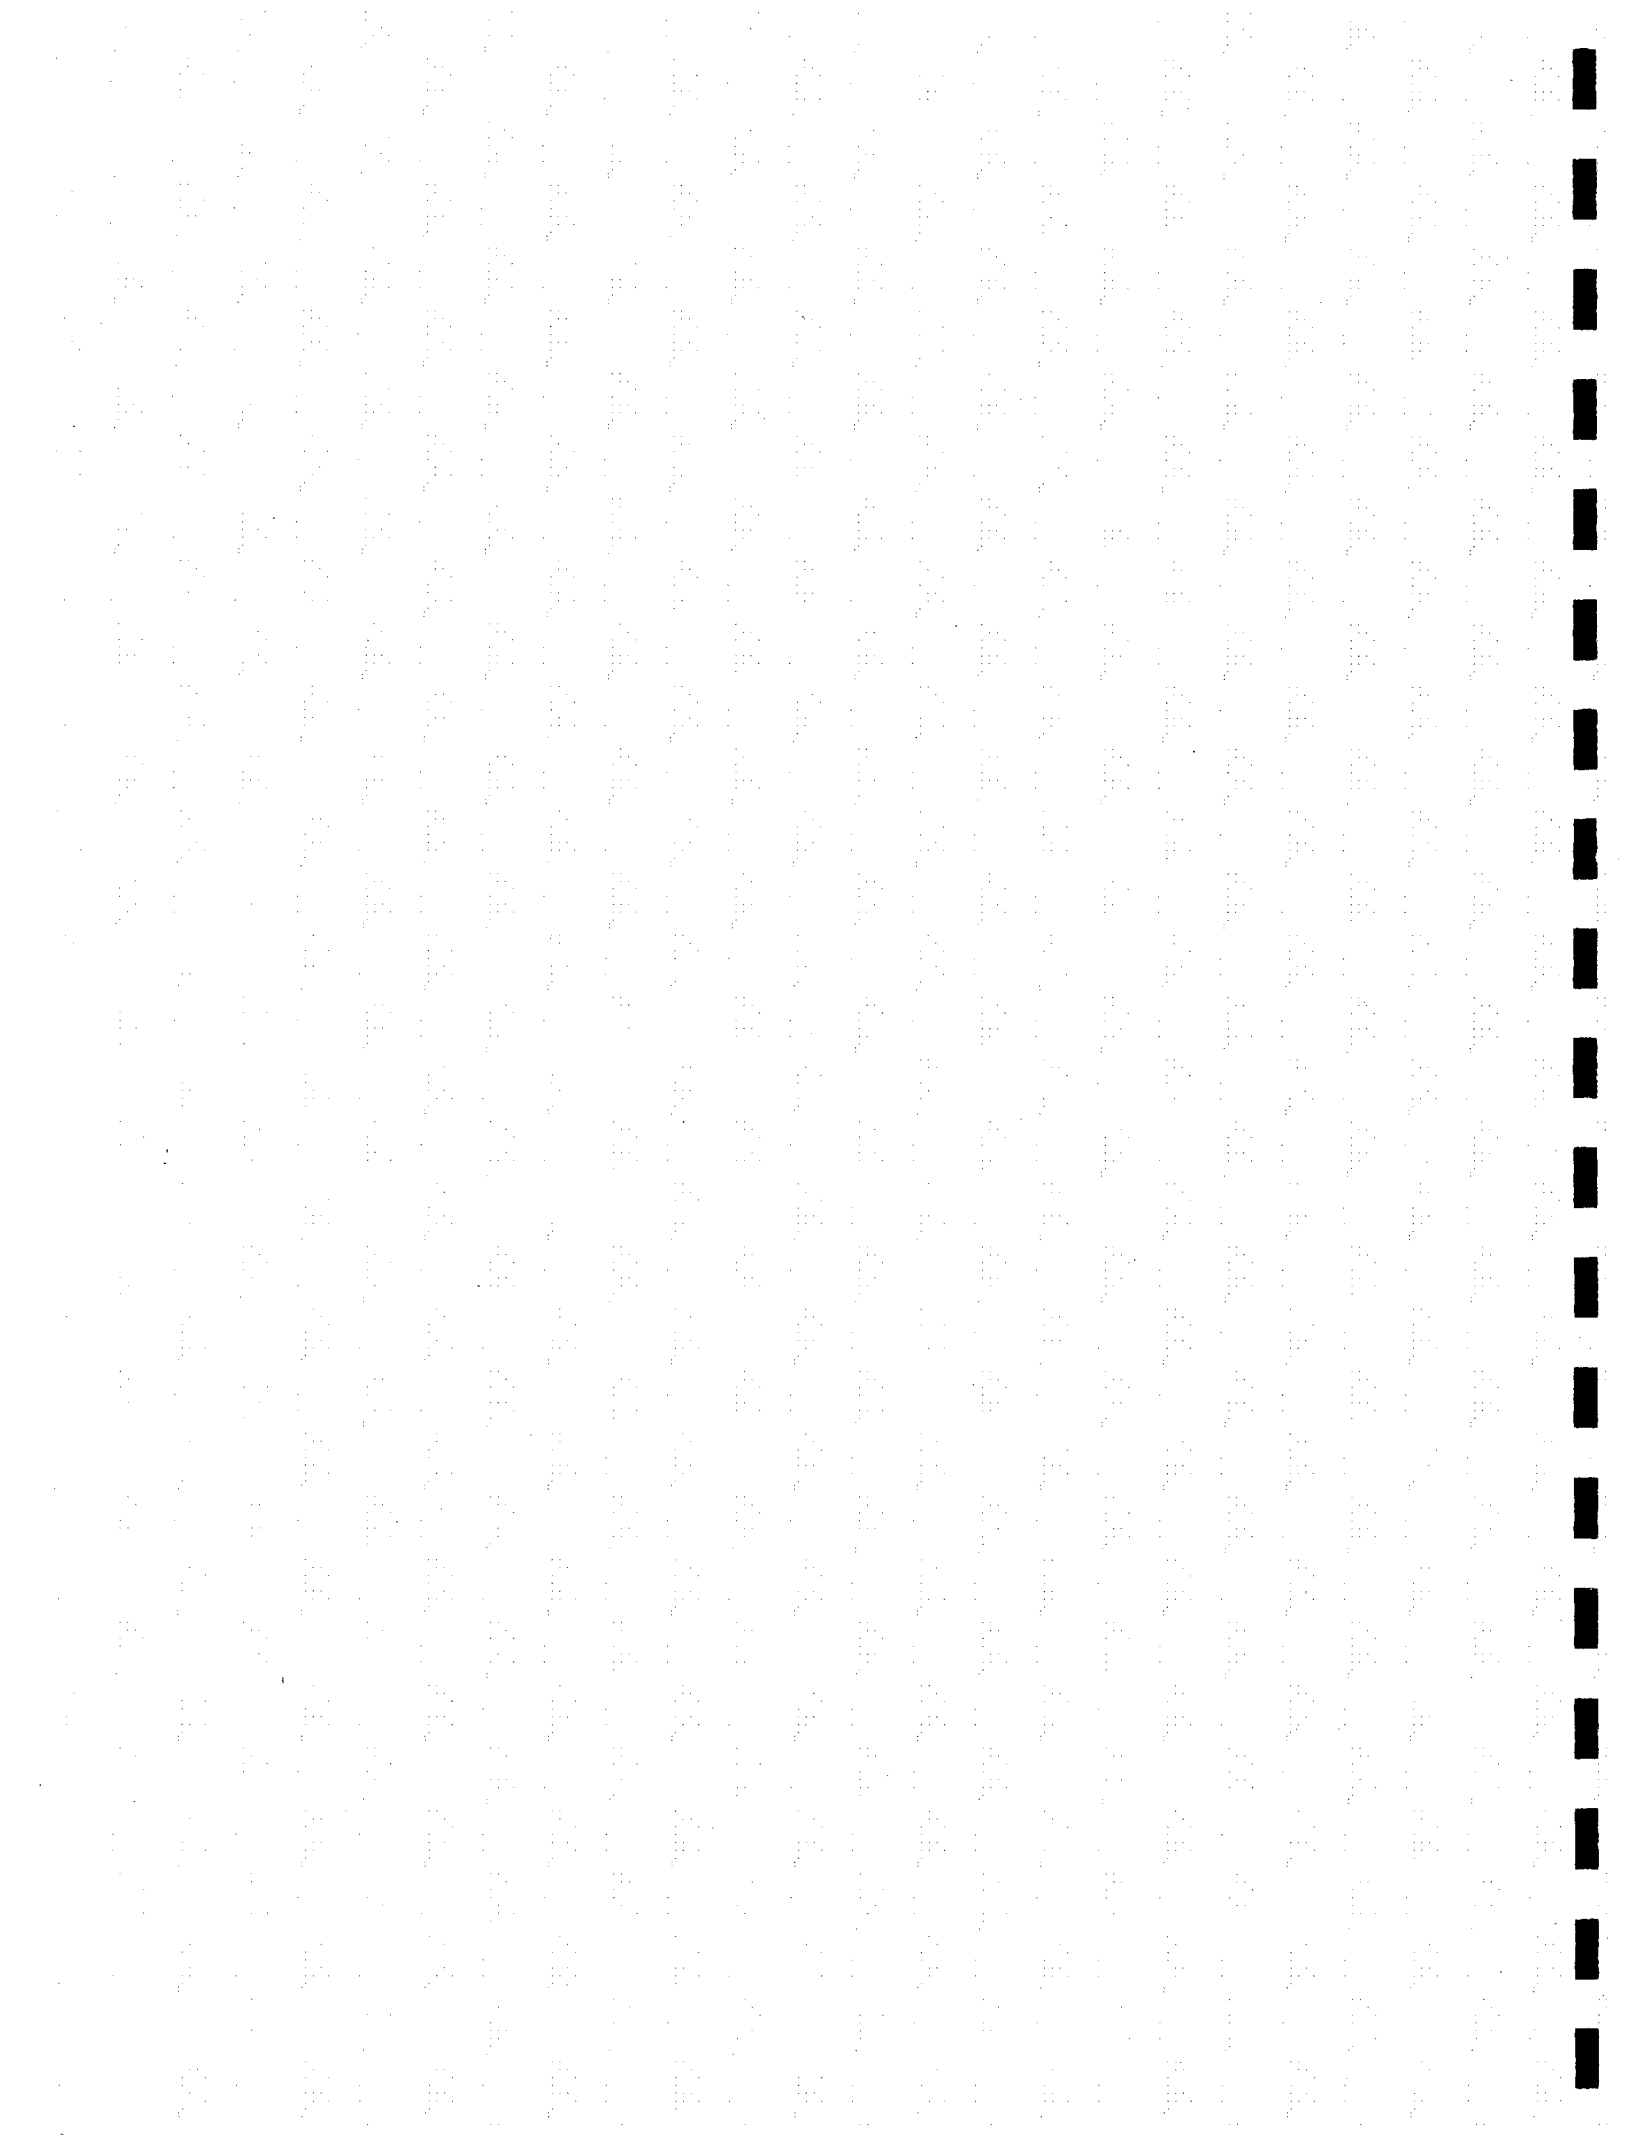

Water User Group (WUG) Unmet Needs Summary

REGION A

| | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
|-----------------------------|--------|--------|-------|------|------|------|
| MUNICIPAL | 0 | 0 | 0 | 0 | 0 | 0 |
| COUNTY-OTHER | 0 | 0 | 0 | 0 | 0 | 535 |
| MANUFACTURING | 0 | 0 | 0 | 0 | 0 | 0 |
| MINING | 0 | 0 | 0 | 0 | 0 | 0 |
| STEAM ELECTRIC POWER | 0 | 0 | 0 | 0 | 0 | 0 |
| LIVESTOCK | 0 | 0 | 0 | 0 | 0 | 0 |
| IRRIGATION | 93,289 | 71,708 | 8,174 | 0 | 0 | 0 |

*WUG supplies and projected demands are entered for each of a WUG's region-county-basin divisions. The unmet needs shown in the WUG Unmet Needs Summary report are calculated by first deducting the WUG split's projected demand from the sum of its total existing water supply volume and all associated recommended water management strategy water volumes. If the WUG split has a greater future supply volume than projected demand in any given decade, this amount is considered a surplus volume. Before aggregating the difference between supplies and demands to the WUG category level, calculated surpluses are updated to zero so that only the WUGs with unmet needs in the decade are included with the Needs totals. Unmet needs water volumes are shown as absolute values.



Alternative Water User Group (WUG) Water Management Strategies (WMS)

WUG Entity Primary Region: A

Water Management Strategy Supplies

| WUG Entity Name | WMS Sponsor Region | WMS Name | Source Name | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 | Unit Cost 2020 | Unit Cost 2070 |
|--|--------------------|--|------------------------------|--------------|--------------|---------------|---------------|---------------|---------------|----------------|----------------|
| AMARILLO | A | DIRECT REUSE - AMARILLO | A DIRECT REUSE | 6,100 | 6,100 | 6,100 | 6,100 | 6,100 | 6,100 | \$1368 | \$496 |
| MANUFACTURING, POTTER | A | DIRECT REUSE - POTTER COUNTY MANUFACTURING | A DIRECT REUSE | 0 | 0 | 5,700 | 5,700 | 5,700 | 5,700 | N/A | \$464 |
| PALO DURO RIVER AUTHORITY - UNASSIGNED WATER VOLUMES | A | CONNECTING TO PALO DURO RESERVOIR | A PALO DURO LAKE/RESERVOIR | 0 | 3,875 | 3,833 | 3,792 | 3,750 | 3,708 | N/A | \$810 |
| Region A Total Alternative WMS Supplies | | | | 6,100 | 9,975 | 15,633 | 15,592 | 15,550 | 15,508 | | |




Alternative Projects Associated with Water Management Strategies

Project Sponsor Region: A

| Sponsor Name | Is Sponsor a WWP? | Project Name | Project Description | Capital Cost | Online Decade |
|--|-------------------|--|--|----------------------|---------------|
| AMARILLO | Y | DIRECT REUSE - AMARILLO | CONVEYANCE/TRANSMISSION PIPELINE; NEW WATER TREATMENT PLANT; WATER TREATMENT PLANT EXPANSION | \$63,566,200 | 2030 |
| MANUFACTURING, POTTER | N | DIRECT REUSE - POTTER COUNTY MANUFACTURING | CONVEYANCE/TRANSMISSION PIPELINE; NEW WATER TREATMENT PLANT | \$57,732,350 | 2040 |
| PALO DURO RIVER AUTHORITY | Y | CONNECTING TO PALO DURO RESERVOIR | CONVEYANCE/TRANSMISSION PIPELINE; NEW WATER TREATMENT PLANT; PUMP STATION | \$139,574,500 | 2030 |
| Region A Total Alternative Capital Cost | | | | \$260,873,050 | |

*Projects with a capital cost of zero are excluded from the report list.

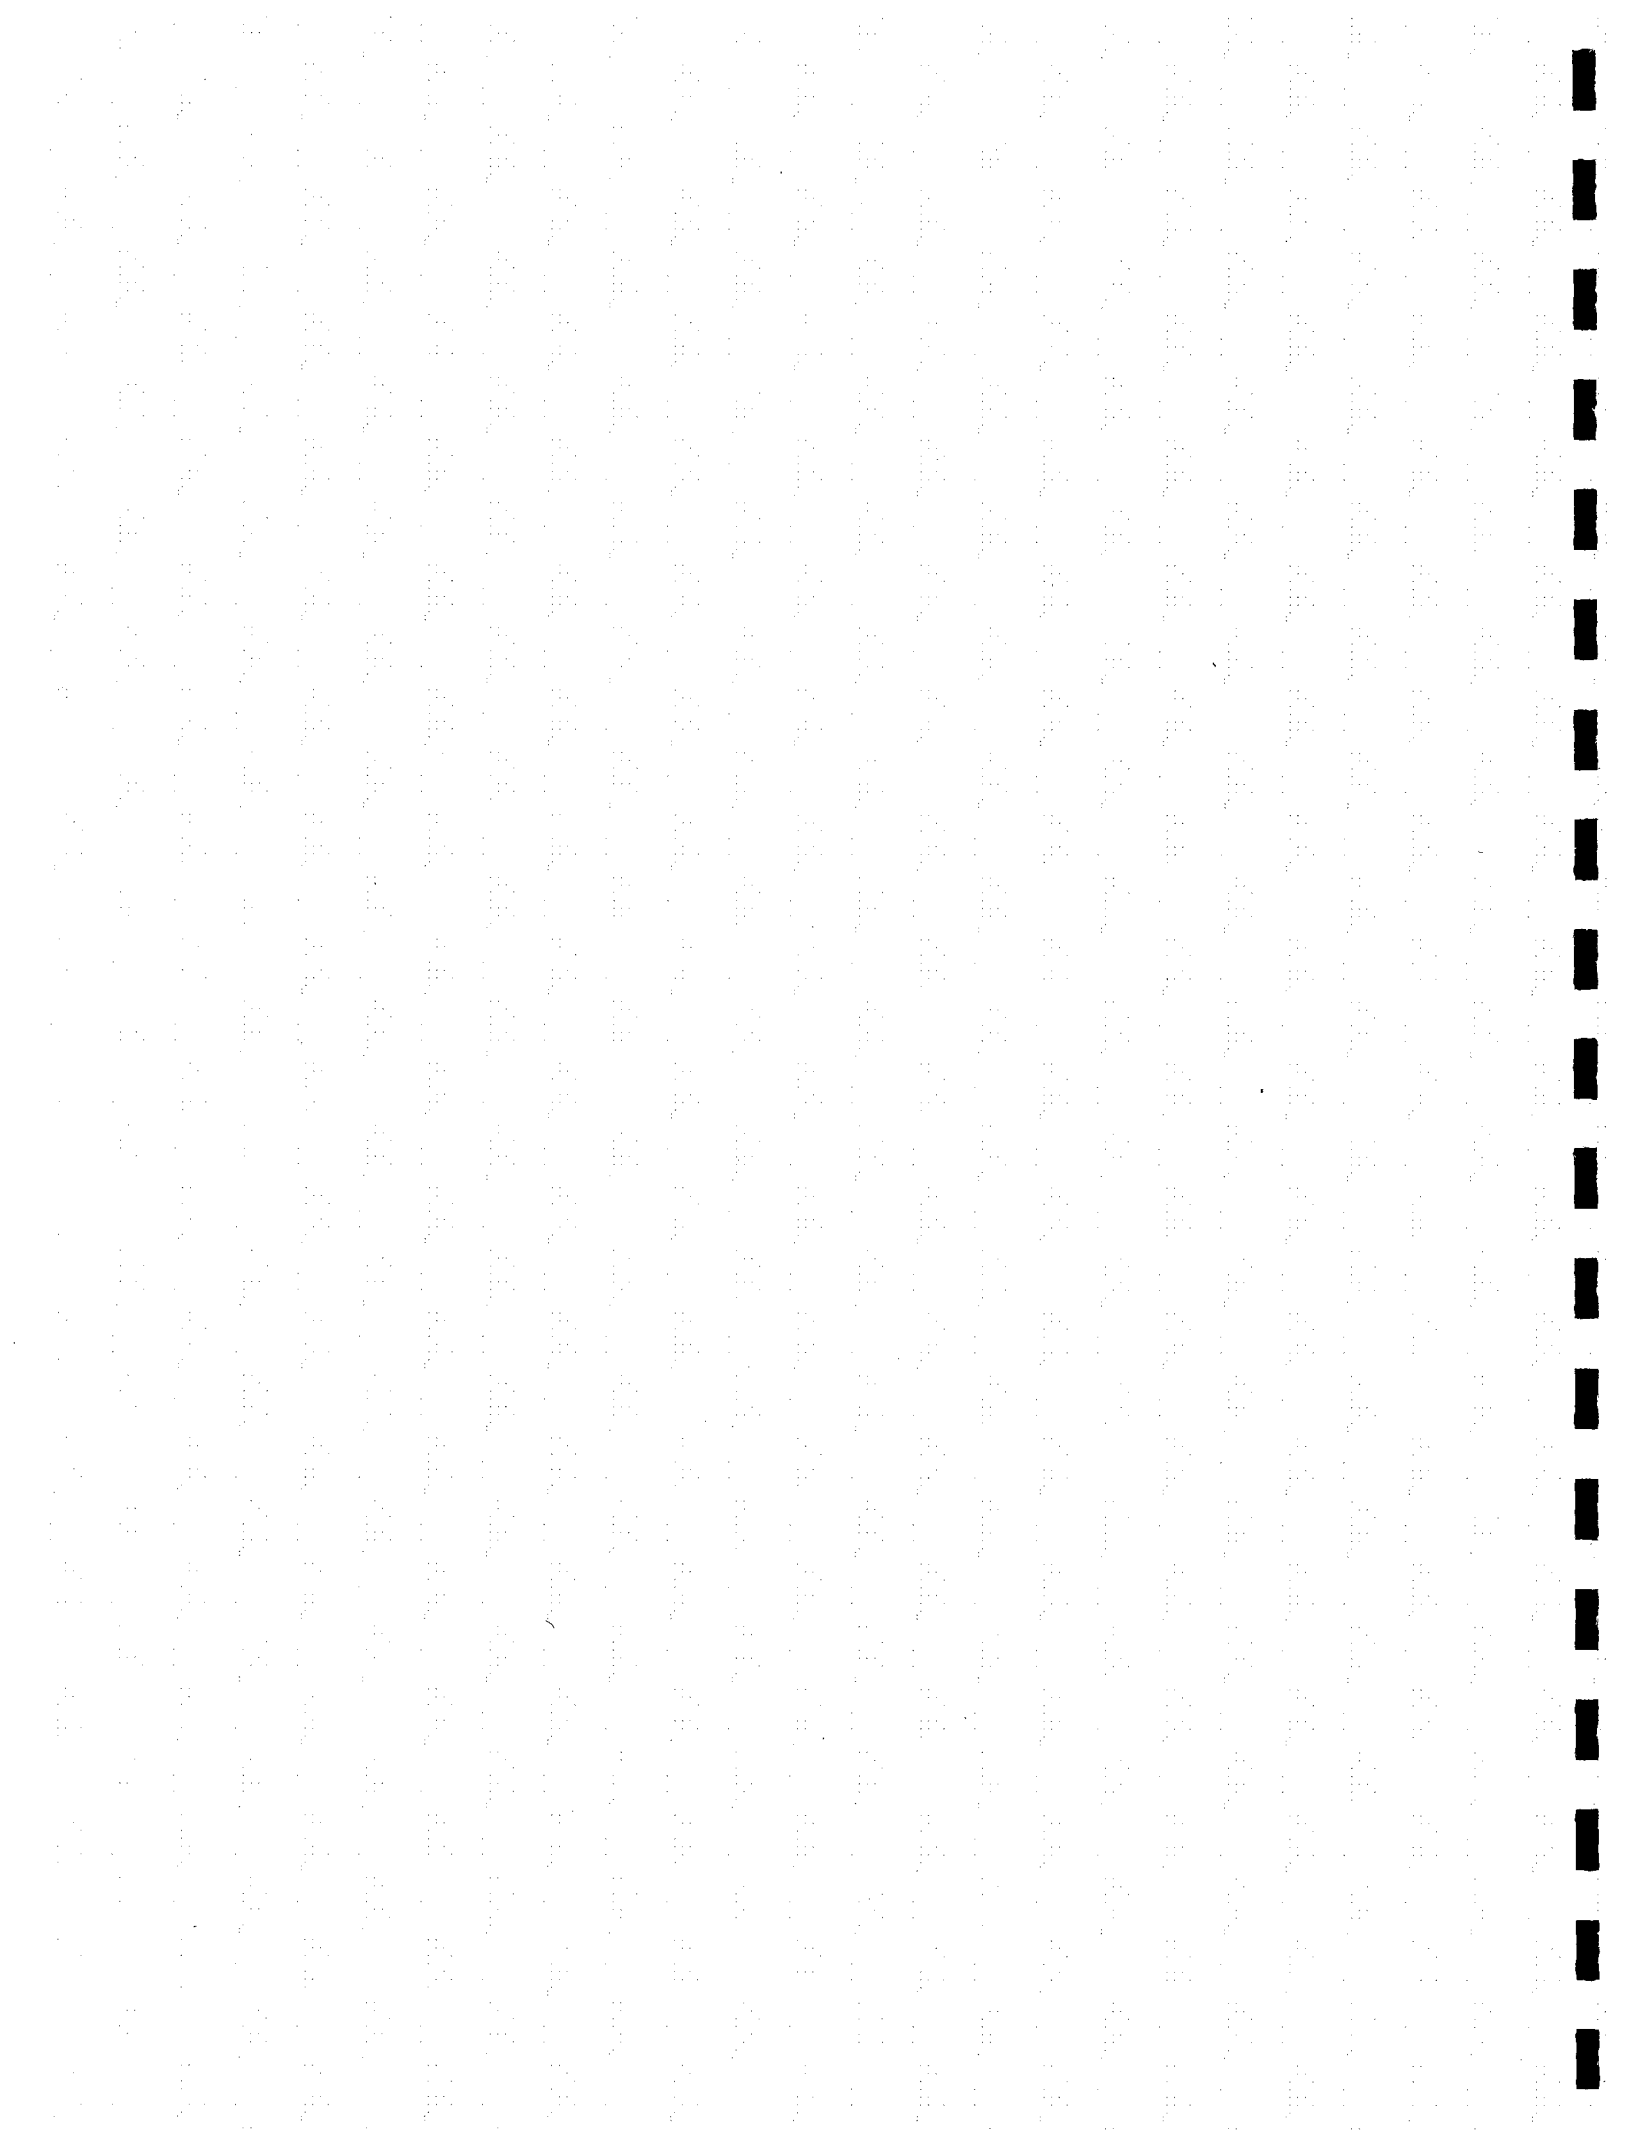

WWP DEMAND

| AMARILLO | | | | | | WWP DEMAND (ACRE-FEET PER YEAR) | | | | | |
|------------------------------|----------------|---------|----------|----------------|---------------|--|---------------|----------------|----------------|----------------|--------|
| CUSTOMER | WUG | County | Basin | USE TYPE | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 | |
| | | | | | AMARILLO | AMARILLO | POTTER | CANADIAN | MUNICIPAL | 15,884 | 17,294 |
| AMARILLO | AMARILLO | POTTER | RED | MUNICIPAL | 10,458 | 11,386 | 12,414 | 13,504 | 14,764 | 16,106 | |
| AMARILLO | AMARILLO | RANDALL | RED | MUNICIPAL | 21,389 | 23,430 | 25,540 | 27,846 | 30,443 | 33,171 | |
| MANUFACTURING | MANUFACTURING | POTTER | CANADIAN | MANUFACTURING | 1,020 | 1,098 | 1,175 | 1,240 | 1,332 | 1,430 | |
| MANUFACTURING | MANUFACTURING | POTTER | RED | MANUFACTURING | 5,779 | 6,225 | 6,659 | 7,036 | 7,552 | 8,105 | |
| CANYON | CANYON | RANDALL | RED | MUNICIPAL | 1,000 | 1,000 | 1,000 | 1,000 | 0 | 0 | |
| MANUFACTURING | MANUFACTURING | RANDALL | RED | MANUFACTURING | 550 | 550 | 550 | 550 | 550 | 550 | |
| PALO DURO STATE PARK | COUNTY-OTHER | RANDALL | RED | MUNICIPAL | 25 | 25 | 25 | 25 | 25 | 25 | |
| STEAM ELECTRIC | STEAM ELECTRIC | POTTER | CANADIAN | STEAM ELECTRIC | 25,387 | 26,804 | 28,408 | 30,011 | 34,115 | 37,669 | |
| AMARILLO TOTAL DEMAND | | | | | 81,492 | 87,812 | 94,627 | 101,722 | 111,205 | 121,518 | |

| BORGER | | | | | | WWP DEMAND (ACRE-FEET PER YEAR) | | | | | |
|----------------------------|---------------|------------|----------|---------------|---------------|--|---------------|---------------|---------------|---------------|-------|
| CUSTOMER | WUG | County | Basin | USE TYPE | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 | |
| | | | | | BORGER | BORGER | HUTCHINSON | CANADIAN | MUNICIPAL | 3,215 | 3,254 |
| COUNTY-OTHER | COUNTY-OTHER | HUTCHINSON | CANADIAN | MUNICIPAL | 56 | 57 | 57 | 55 | 52 | 49 | |
| MANUFACTURING | MANUFACTURING | CARSON | CANADIAN | MANUFACTURING | 20 | 28 | 35 | 43 | 54 | 67 | |
| MANUFACTURING | MANUFACTURING | CARSON | RED | MANUFACTURING | 430 | 422 | 415 | 407 | 396 | 383 | |
| MANUFACTURING | MANUFACTURING | HUTCHINSON | CANADIAN | MANUFACTURING | 6,337 | 6,707 | 7,062 | 7,371 | 7,885 | 8,435 | |
| BORGER TOTAL DEMAND | | | | | 10,058 | 10,468 | 10,803 | 11,105 | 11,612 | 12,158 | |

| CACTUS | | | | | | WWP DEMAND (ACRE-FEET PER YEAR) | | | | | |
|----------------------------|---------------|--------|----------|---------------|--------------|--|--------------|--------------|--------------|--------------|-------|
| CUSTOMER | WUG | County | Basin | USE TYPE | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 | |
| | | | | | CACTUS | CACTUS | MOORE | CANADIAN | MUNICIPAL | 985 | 1,108 |
| COUNTY-OTHER | COUNTY-OTHER | MOORE | CANADIAN | MUNICIPAL | 98 | 108 | 119 | 132 | 146 | 160 | |
| MANUFACTURING | MANUFACTURING | MOORE | CANADIAN | MANUFACTURING | 3,168 | 3,342 | 3,513 | 3,664 | 3,913 | 4,178 | |
| CACTUS TOTAL DEMAND | | | | | 4,251 | 4,558 | 4,874 | 5,178 | 5,591 | 6,024 | |

| CANADIAN RIVER MUNICIPAL WATER AUTHORITY | | | | | | WWP DEMAND (ACRE-FEET PER YEAR) | | | | | |
|--|------------|---------|----------|-----------|----------------|--|----------------|----------------|----------------|----------------|-------|
| CUSTOMER | WUG | COUNTY | BASIN | USE TYPE | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 | |
| | | | | | LAMESA | LAMESA | DAWSON | COLORADO | MUNICIPAL | 1,534 | 1,950 |
| O'DONNELL | O'DONNELL | DAWSON | BRAZOS | MUNICIPAL | 20 | 20 | 23 | 22 | 24 | 24 | |
| O'DONNELL | O'DONNELL | LYNN | BRAZOS | MUNICIPAL | 117 | 119 | 119 | 124 | 126 | 129 | |
| PAMPA | PAMPA | GRAY | CANADIAN | MUNICIPAL | 1,818 | 1,827 | 1,836 | 4,680 | 4,680 | 4,680 | |
| PLAINVIEW | PLAINVIEW | HALE | BRAZOS | MUNICIPAL | 2,761 | 3,000 | 3,250 | 3,500 | 3,500 | 3,500 | |
| LEVELLAND | LEVELLAND | HOCKLEY | BRAZOS | MUNICIPAL | 2,301 | 2,400 | 2,500 | 2,588 | 2,671 | 2,743 | |
| BORGER | WWP | WWP | WWP | WWP | 7,054 | 7,091 | 7,072 | 7,068 | 7,064 | 7,063 | |
| LUBBOCK | LUBBOCK | LUBBOCK | BRAZOS | MUNICIPAL | 35,600 | 39,000 | 43,500 | 47,000 | 47,000 | 47,000 | |
| SLATON | SLATON | LUBBOCK | BRAZOS | MUNICIPAL | 1,405 | 1,430 | 1,455 | 1,479 | 1,477 | 1,477 | |
| TAHOKA | TAHOKA | LYNN | BRAZOS | MUNICIPAL | 460 | 477 | 483 | 496 | 507 | 517 | |
| AMARILLO | WWP | WWP | WWP | WWP | 46,000 | 50,000 | 50,000 | 50,000 | 50,000 | 50,000 | |
| BROWNFIELD | BROWNFIELD | TERRY | COLORADO | MUNICIPAL | 1,380 | 1,500 | 1,600 | 1,750 | 1,750 | 1,750 | |
| CANADIAN RIVER MUNICIPAL WATER AUTHORITY TOTAL DEMAND | | | | | 100,450 | 108,814 | 114,138 | 121,457 | 121,549 | 121,633 | |

WWP DEMAND

| GREENBELT MIWA | | | | | WWP DEMAND (ACRE-FEET PER YEAR) | | | | | |
|-------------------------------|---------------|-----------|-------|---------------|---------------------------------|--------------|--------------|--------------|--------------|--------------|
| CUSTOMER | WUG | County | Basin | USE TYPE | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| CHILDRESS | CHILDRESS | CHILDRESS | RED | MUNICIPAL | 1,624 | 1,658 | 1,686 | 1,722 | 1,768 | 1,814 |
| CHILLICOTHE | CHILLICOTHE | HARDEMAN | RED | MUNICIPAL | 65 | 63 | 60 | 61 | 62 | 62 |
| CLARENDON | CLARENDON | DONLEY | RED | MUNICIPAL | 378 | 369 | 361 | 356 | 356 | 356 |
| CROWELL | CROWELL | FOARD | RED | MUNICIPAL | 138 | 134 | 132 | 131 | 131 | 131 |
| MEMPHIS | MEMPHIS | HALL | RED | MUNICIPAL | 100 | 100 | 100 | 100 | 100 | 100 |
| COUNTY-OTHER | COUNTY-OTHER | CHILDRESS | RED | MUNICIPAL | 178 | 184 | 189 | 194 | 200 | 204 |
| COUNTY-OTHER | COUNTY-OTHER | DONLEY | RED | MUNICIPAL | 95 | 95 | 95 | 95 | 95 | 95 |
| COUNTY-OTHER | COUNTY-OTHER | FOARD | RED | MUNICIPAL | 50 | 50 | 50 | 50 | 50 | 50 |
| COUNTY-OTHER | COUNTY-OTHER | HALL | RED | MUNICIPAL | 92 | 92 | 92 | 92 | 92 | 92 |
| COUNTY-OTHER | COUNTY-OTHER | HARDEMAN | RED | MUNICIPAL | 60 | 60 | 60 | 60 | 60 | 60 |
| MANUFACTURING | MANUFACTURING | HARDEMAN | RED | MANUFACTURING | 276 | 294 | 313 | 332 | 332 | 332 |
| QUANAH | QUANAH | HARDEMAN | RED | MUNICIPAL | 397 | 391 | 388 | 394 | 397 | 400 |
| GREENBELT TOTAL DEMAND | | | | | 3,453 | 3,490 | 3,526 | 3,587 | 3,643 | 3,696 |

WWP (NEEDS)/SURPLUS

| AMARILLO | | | | | | | | | | |
|-------------------------------------|----------------|---------|----------|----------------|--|-----------------|-----------------|-----------------|-----------------|-----------------|
| CUSTOMER | WUG | COUNTY | BASIN | USE TYPE | WWP (NEEDS)/SURPLUS (ACRE-FEET PER YEAR) | | | | | |
| | | | | | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| AMARILLO | AMARILLO | POTTER | CANADIAN | MUNICIPAL | (1,501) | (4,129) | (7,241) | (10,389) | (13,215) | (16,315) |
| AMARILLO | AMARILLO | POTTER | RED | MUNICIPAL | (987) | (2,719) | (4,767) | (6,840) | (8,703) | (10,742) |
| AMARILLO | AMARILLO | RANDALL | RED | MUNICIPAL | (2,020) | (5,593) | (9,807) | (14,105) | (17,944) | (22,125) |
| MANUFACTURING | MANUFACTURING | POTTER | CANADIAN | MANUFACTURING | (96) | (262) | (451) | (628) | (785) | (954) |
| MANUFACTURING | MANUFACTURING | POTTER | RED | MANUFACTURING | (546) | (1,487) | (2,557) | (3,564) | (4,451) | (5,406) |
| CANYON | CANYON | RANDALL | RED | MUNICIPAL | (94) | (239) | (384) | (507) | 0 | 0 |
| MANUFACTURING | MANUFACTURING | RANDALL | RED | MANUFACTURING | (52) | (131) | (211) | (279) | (324) | (367) |
| PALO DURO STATE PARK | COUNTY-OTHER | RANDALL | RED | MUNICIPAL | (2) | (6) | (10) | (13) | (15) | (17) |
| STEAM ELECTRIC | STEAM ELECTRIC | POTTER | CANADIAN | STEAM ELECTRIC | 0 | 0 | 0 | 0 | 0 | 0 |
| AMARILLO TOTAL NEEDS/SURPLUS | | | | | (5,298) | (14,566) | (25,428) | (36,325) | (45,437) | (55,926) |

| BORGER | | | | | | | | | | |
|-----------------------------------|---------------|------------|----------|---------------|--|----------------|----------------|----------------|----------------|----------------|
| CUSTOMER | WUG | County | Basin | USE TYPE | WWP (NEEDS)/SURPLUS (ACRE-FEET PER YEAR) | | | | | |
| | | | | | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| BORGER | BORGER | HUTCHINSON | CANADIAN | MUNICIPAL | (92) | (531) | (952) | (1,343) | (1,647) | (1,927) |
| COUNTY-OTHER | COUNTY-OTHER | HUTCHINSON | CANADIAN | MUNICIPAL | (1) | (9) | (16) | (22) | (26) | (28) |
| MANUFACTURING | MANUFACTURING | CARSON* | CANADIAN | MANUFACTURING | 5 | 0 | (5) | (11) | (19) | (30) |
| MANUFACTURING | MANUFACTURING | CARSON* | RED | MANUFACTURING | 106 | 7 | (54) | (102) | (138) | (172) |
| MANUFACTURING | MANUFACTURING | HUTCHINSON | CANADIAN | MANUFACTURING | 26 | (802) | (1,652) | (2,504) | (3,360) | (4,281) |
| BORGER TOTAL NEEDS/SURPLUS | | | | | 44 | (1,335) | (2,679) | (3,982) | (5,190) | (6,438) |
| BORGER TOTAL NEEDS ONLY | | | | | (93) | (1,342) | (2,679) | (3,982) | (5,190) | (6,438) |

*Carson County Manufacturing has a separate well field which can produce more supply than their demand. However, there is not infrastructure in place for this supply to be used in other portions of the system. This results in a surplus for Manufacturing, while other users have a need.

| CACTUS | | | | | | | | | | |
|-----------------------------------|---------------|--------|----------|---------------|--|----------------|----------------|----------------|----------------|----------------|
| CUSTOMER | WUG | County | Basin | USE TYPE | WWP (NEEDS)/SURPLUS (ACRE-FEET PER YEAR) | | | | | |
| | | | | | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| CACTUS | CACTUS | MOORE | CANADIAN | MUNICIPAL | (583) | (777) | (974) | (1,170) | (1,347) | (1,530) |
| COUNTY-OTHER | COUNTY-OTHER | MOORE | CANADIAN | MUNICIPAL | (58) | (76) | (93) | (112) | (128) | (145) |
| MANUFACTURING | MANUFACTURING | MOORE | CANADIAN | MANUFACTURING | (1,877) | (2,346) | (2,754) | (3,102) | (3,439) | (3,790) |
| CACTUS TOTAL NEEDS/SURPLUS | | | | | (2,518) | (3,199) | (3,821) | (4,384) | (4,914) | (5,465) |

| CANADIAN RIVER MUNICIPAL WATER AUTHORITY | | | | | | | | | | |
|---|------------|---------|----------|-----------|--|-----------------|-----------------|-----------------|-----------------|-----------------|
| CUSTOMER | WUG | COUNTY | BASIN | USE TYPE | WWP (NEEDS)/SURPLUS (ACRE-FEET PER YEAR) | | | | | |
| | | | | | 2020 | 2030 | 2040 | 2050 | 2060 | 2070 |
| LAMESA | LAMESA | DAWSON | COLORADO | MUNICIPAL | (31) | (866) | (1,182) | (1,607) | (1,719) | (1,830) |
| O'DONNELL | O'DONNELL | DAWSON | BRAZOS | MUNICIPAL | 8 | (9) | (12) | (13) | (15) | (16) |
| O'DONNELL | O'DONNELL | LYNN | BRAZOS | MUNICIPAL | 47 | (53) | (61) | (72) | (79) | (86) |
| FAMPA | FAMPA | GRAY | CANADIAN | MUNICIPAL | 666 | (812) | (943) | (2,735) | (2,925) | (3,114) |
| PLAINVIEW | PLAINVIEW | HALE | BRAZOS | MUNICIPAL | (214) | (1,333) | (1,670) | (2,045) | (2,187) | (2,329) |
| LEVELLAND | LEVELLAND | HOCKLEY | BRAZOS | MUNICIPAL | (375) | (1,066) | (1,284) | (1,512) | (1,669) | (1,825) |
| BORGER | WWP | WWP | WWP | MUNICIPAL | (3,225) | (3,262) | (3,633) | (4,130) | (4,414) | (4,700) |
| LUBBOCK | LUBBOCK | LUBBOCK | BRAZOS | MUNICIPAL | (10,031) | (17,277) | (22,347) | (27,465) | (29,371) | (31,274) |
| SLATON | SLATON | LUBBOCK | BRAZOS | MUNICIPAL | (318) | (635) | (747) | (864) | (923) | (983) |
| TAHOKA | TAHOKA | LYNN | BRAZOS | MUNICIPAL | (143) | (212) | (248) | (290) | (317) | (344) |
| AMARILLO | WWP | WWP | WWP | MUNICIPAL | (17,971) | (22,159) | (25,687) | (29,218) | (31,246) | (33,271) |
| BROWNFIELD | BROWNFIELD | TERRY | COLORADO | MUNICIPAL | 137 | (667) | (822) | (1,023) | (1,094) | (1,164) |
| CANADIAN RIVER MUNICIPAL WATER AUTHORITY TOTAL NEEDS/SURPLUS | | | | | (31,450) | (48,351) | (58,636) | (70,974) | (75,959) | (80,936) |
| CANADIAN RIVER MUNICIPAL WATER AUTHORITY TOTAL NEED ONLY | | | | | (32,308) | (48,351) | (58,636) | (70,974) | (75,959) | (80,936) |

*Supplies were allocated based on contract amounts which, in some cases, are greater than their TWDB demand. This results in some users having surpluses while others have needs.



